

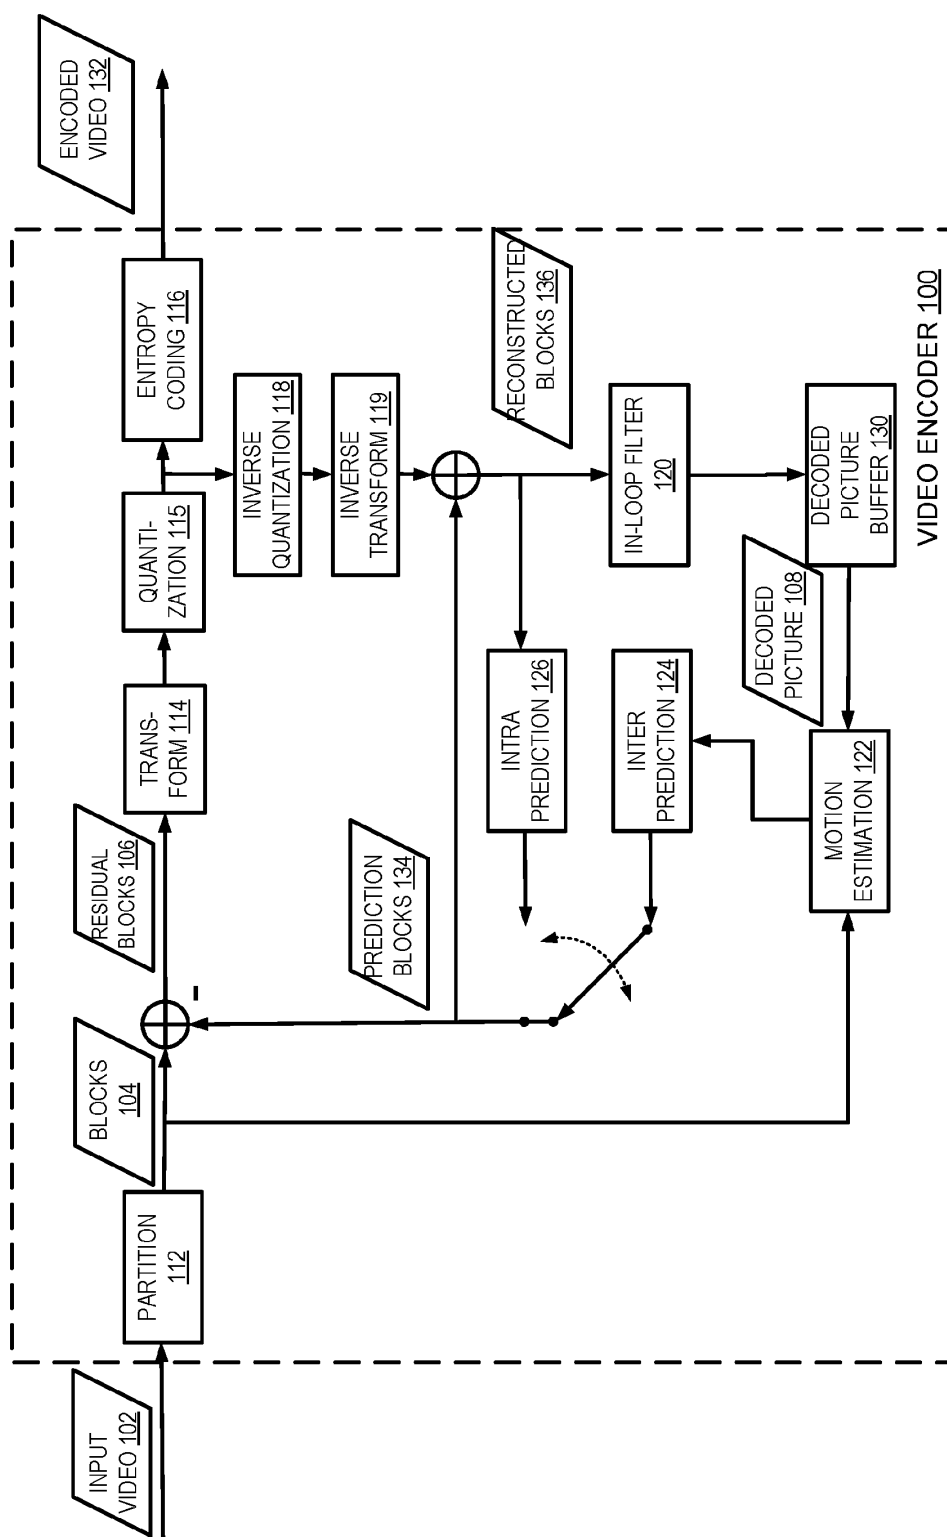


FIG. 1

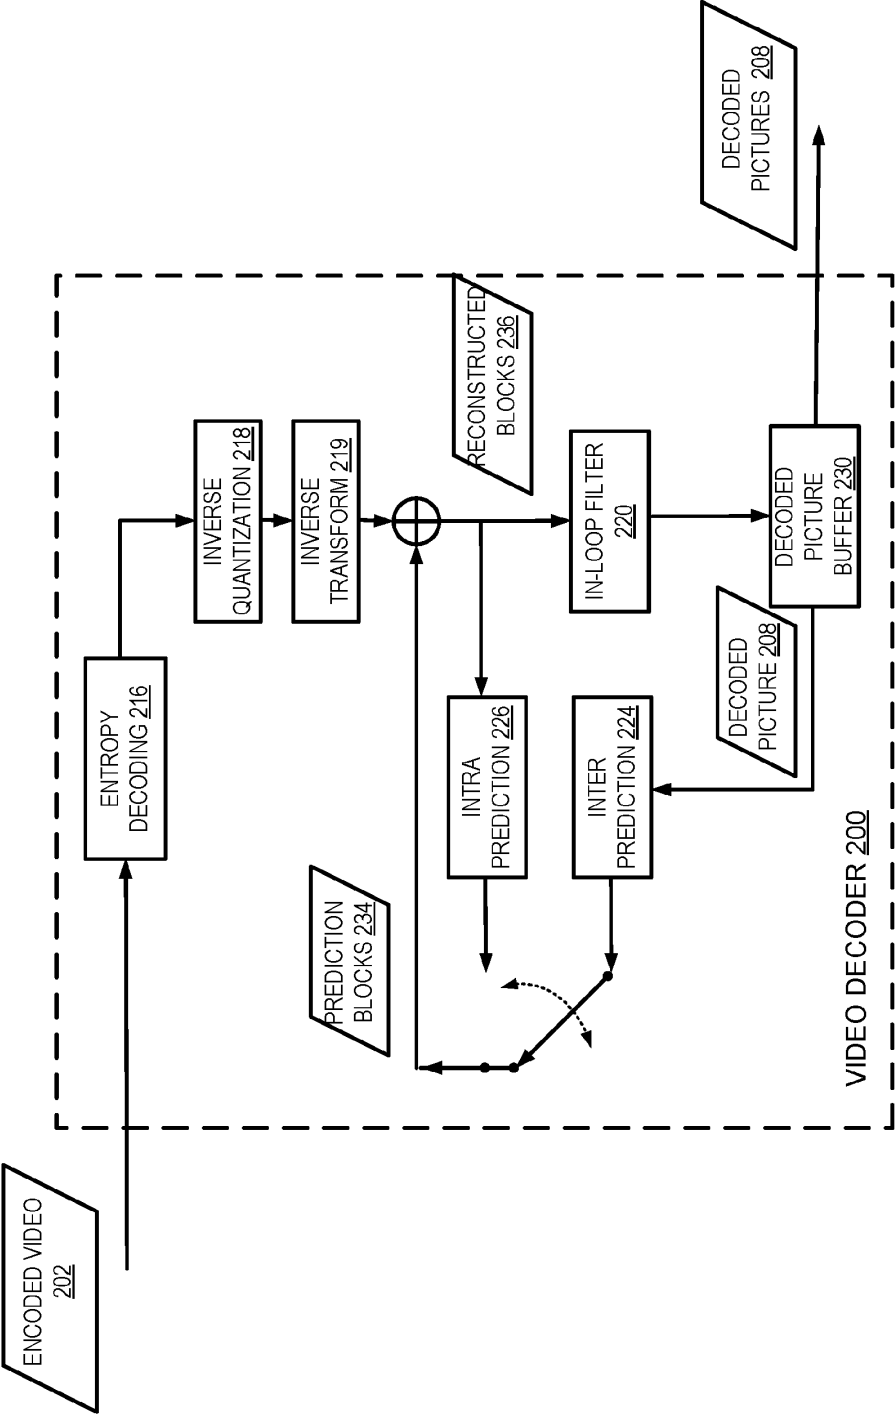


FIG. 2

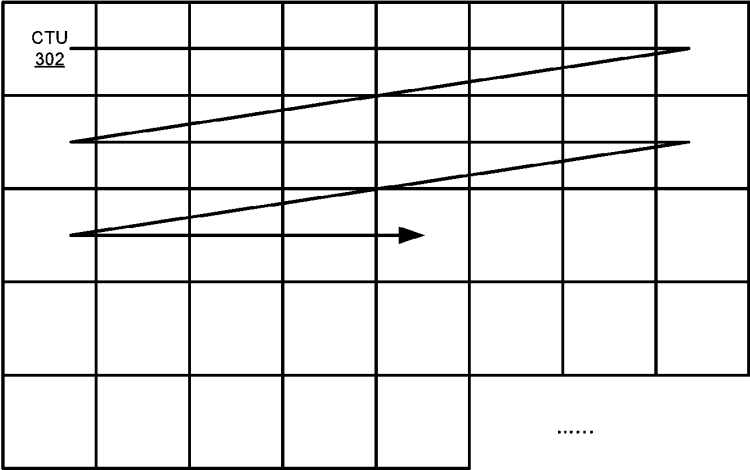
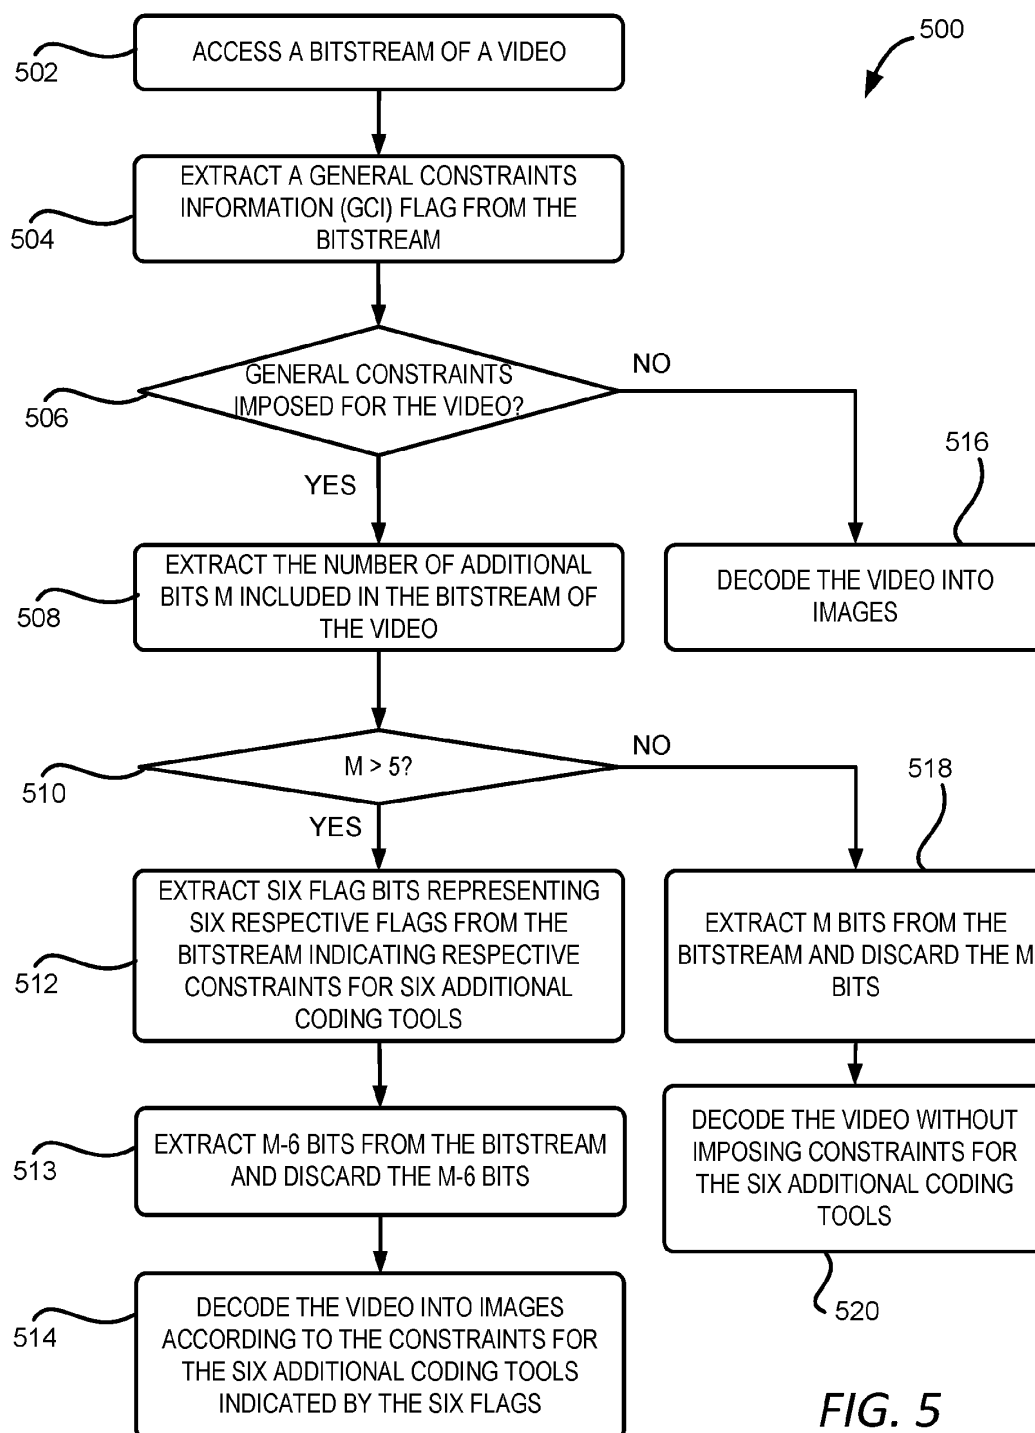


FIG. 3

			CU 402
CU 402	CU 402	CU 402	CU 402
CU 402	CU 402	CU 402	CU 402
CU 402	CU 402	CU 402	CU 402
CU 402	CU 402	CU 402	
CU 402	CU 402	CU 402	

FIG. 4

4/7



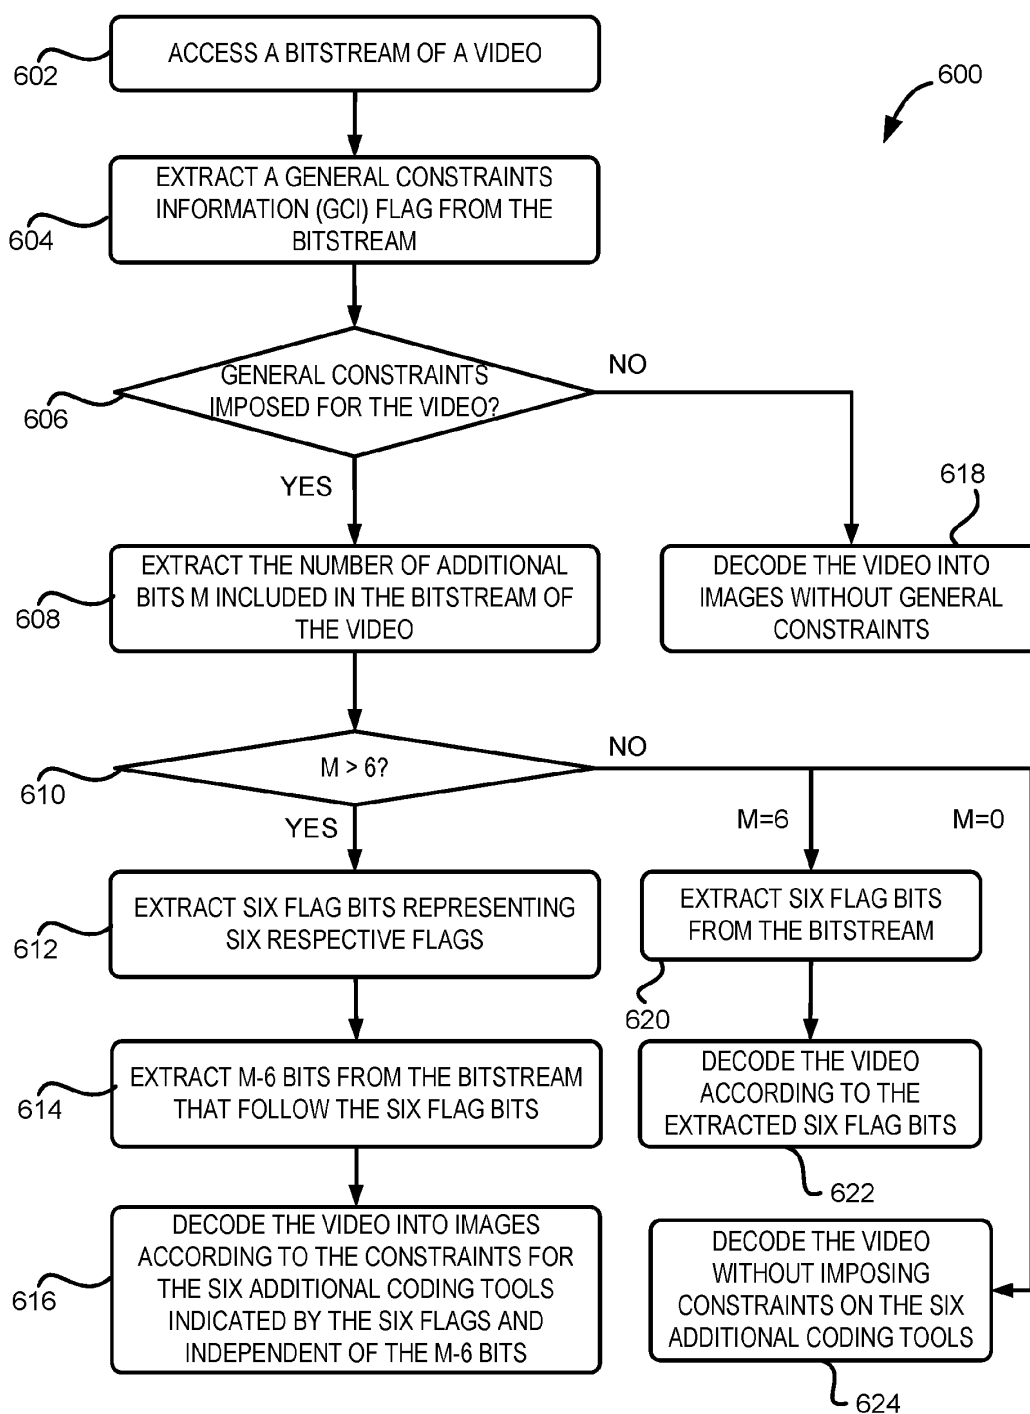


FIG. 6

6/7

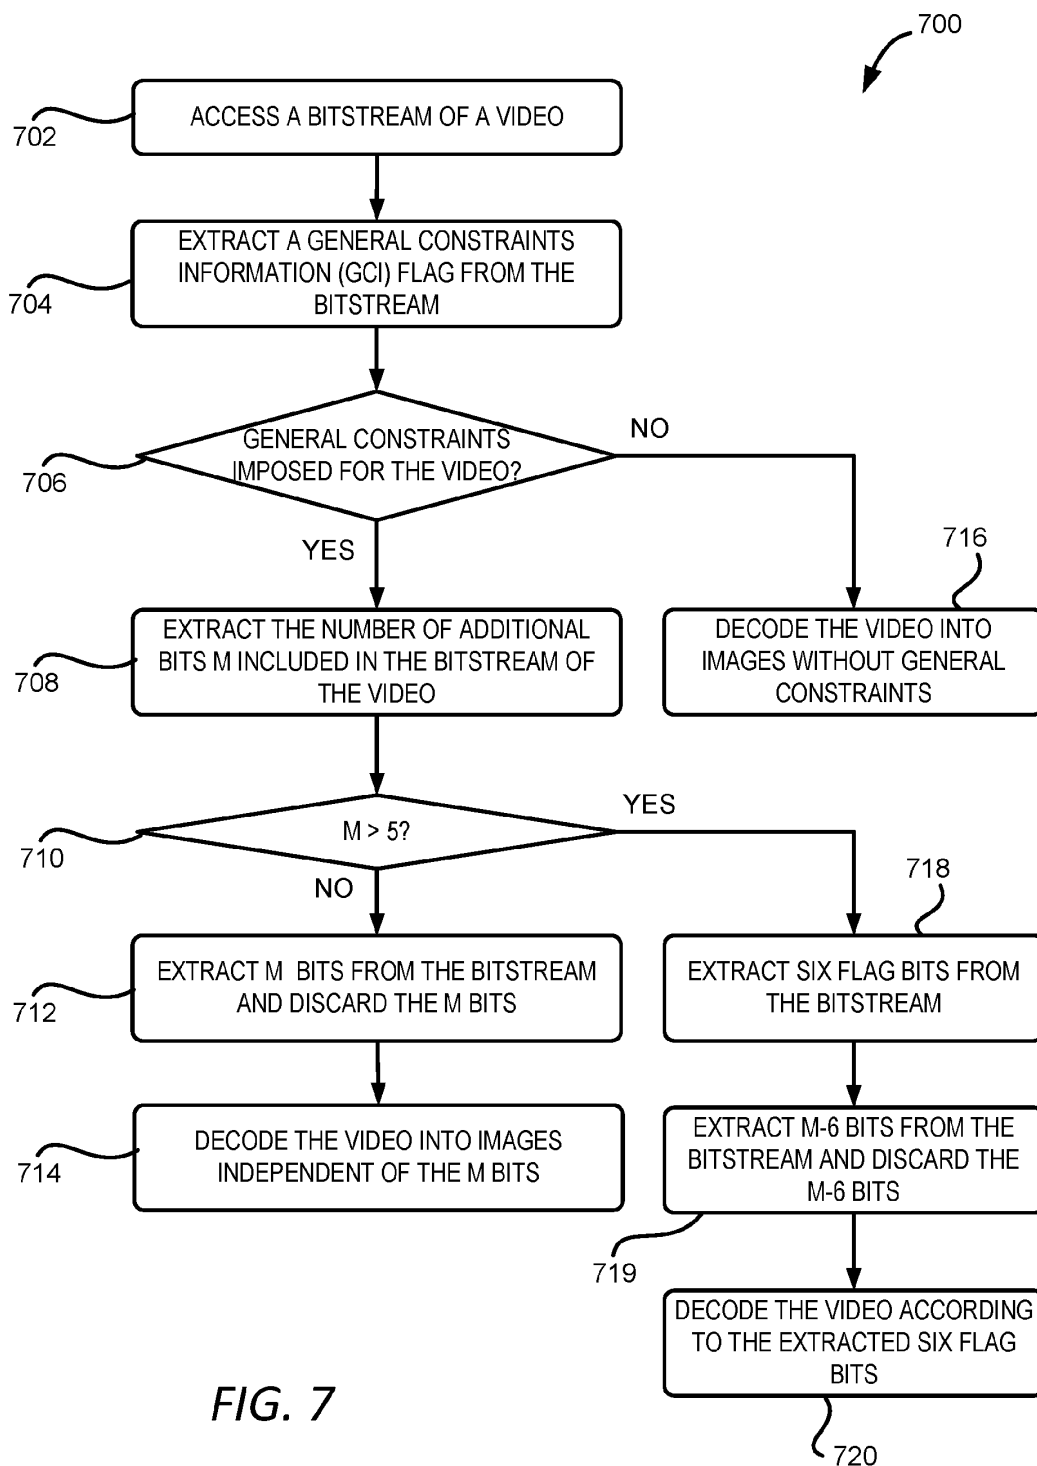


FIG. 7

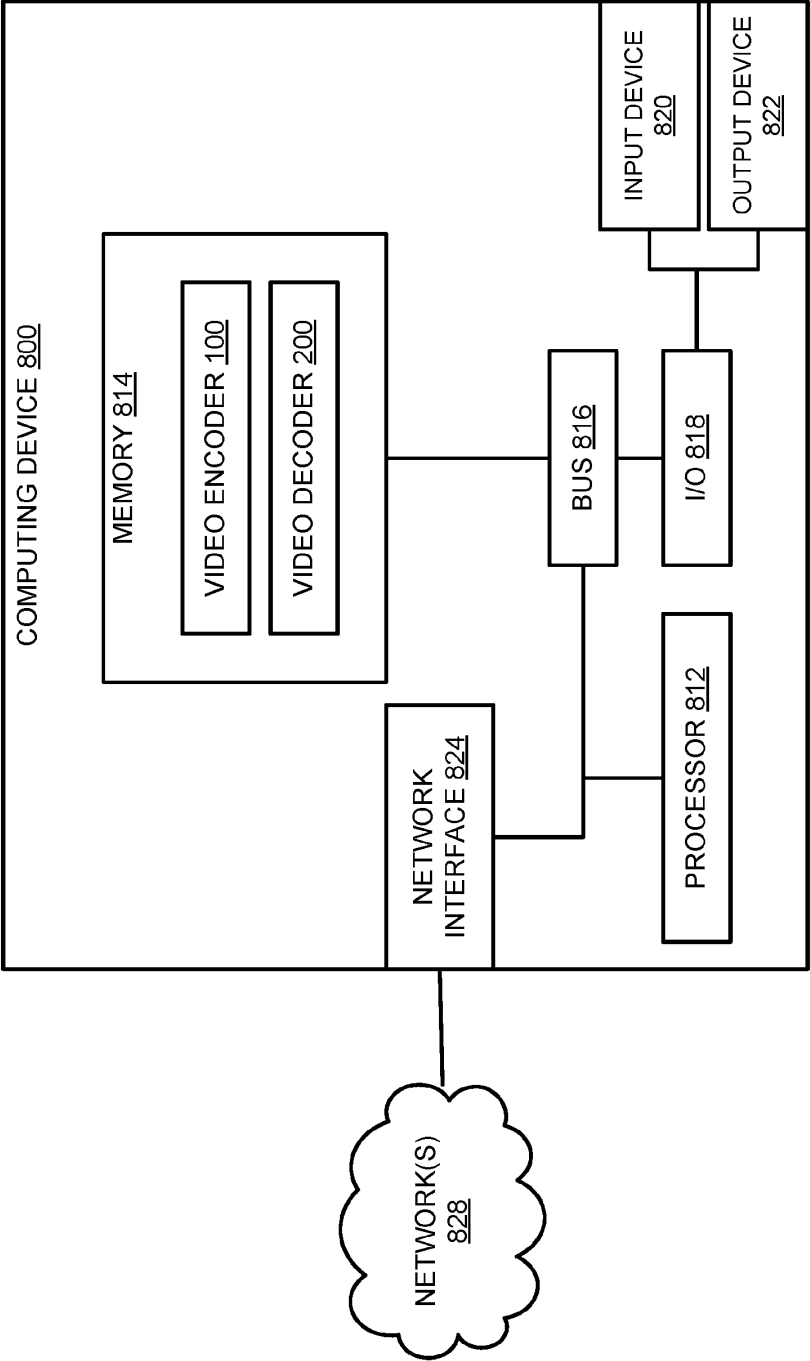


FIG. 8