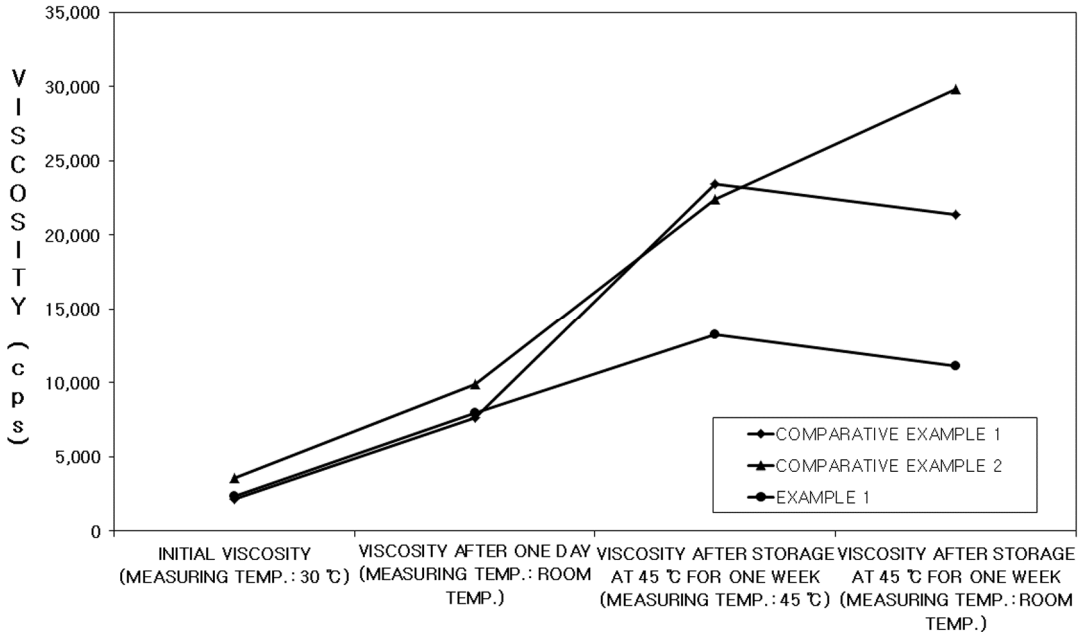

35,000
30,000
25,000
20,000
15,000
10,000
5,000
0
VISCOSITY (cps)
COMPARATIVE EXAMPLE 1
COMPARATIVE EXAMPLE 2
EXAMPLE 1
INITIAL VISCOSITY (MEASURING TEMP.: 30 ℃)
VISCOSITY AFTER ONE DAY (MEASURING TEMP.: ROOM TEMP.)
VISCOSITY AFTER STORAGE AT 45 ℃ FOR ONE WEEK (MEASURING TEMP.: 45 ℃)
VISCOSITY AFTER STORAGE AT 45 ℃ FOR ONE WEEK (MEASURING TEMP.: ROOM TEMP.)

FIG. 1

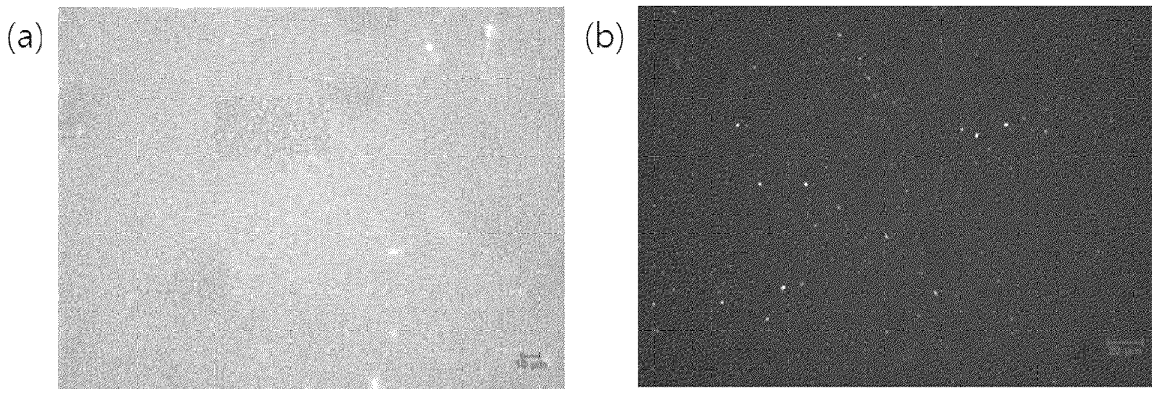

(a)
(b)

FIG. 2

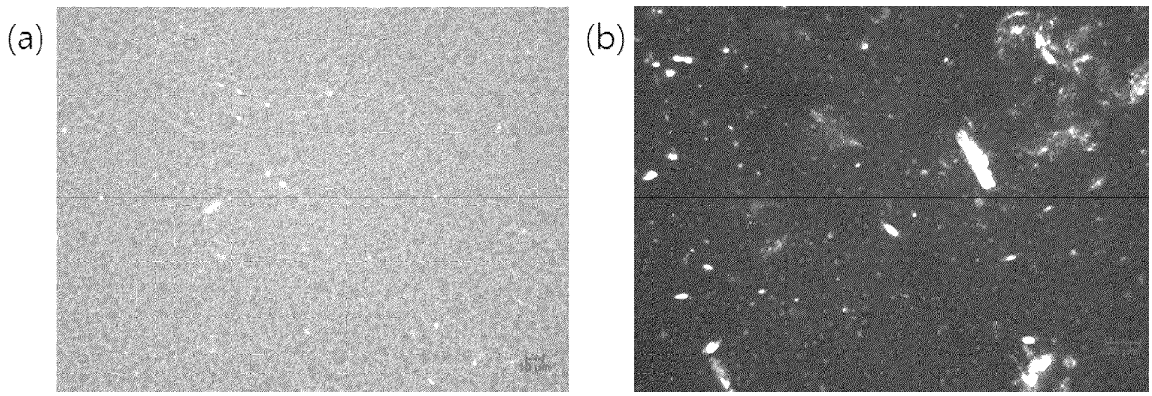


FIG. 3