




[図1]

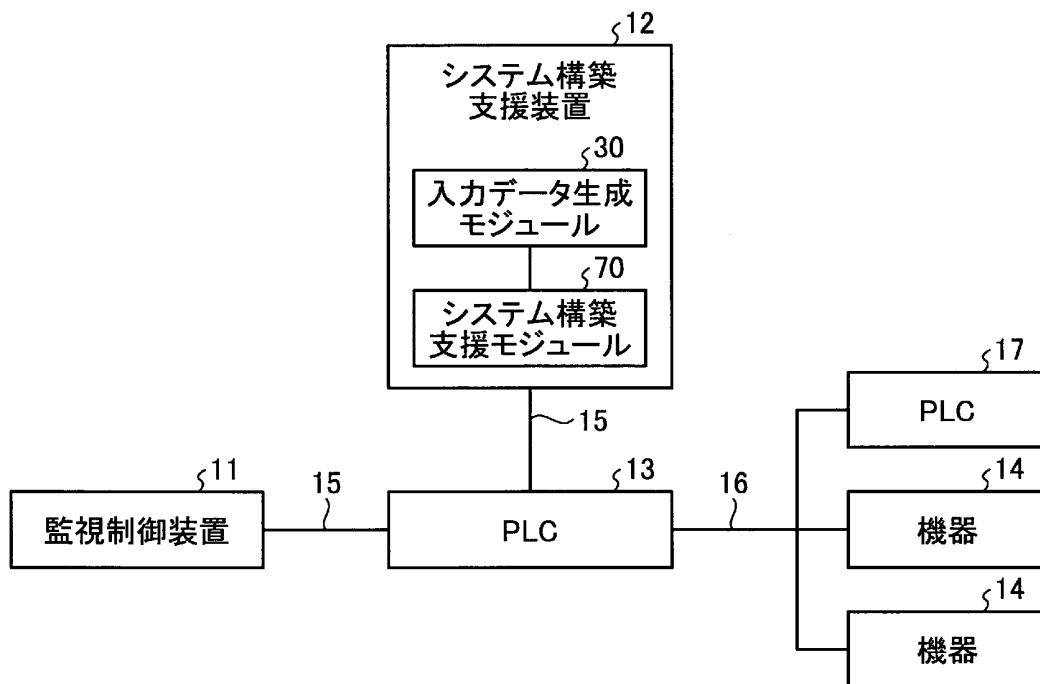


[図2]

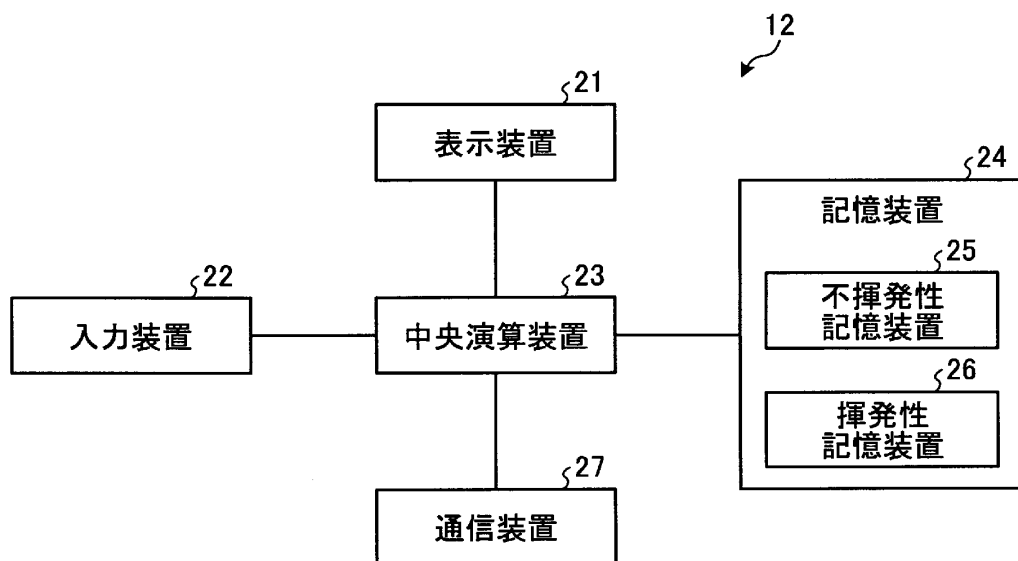

[図3]

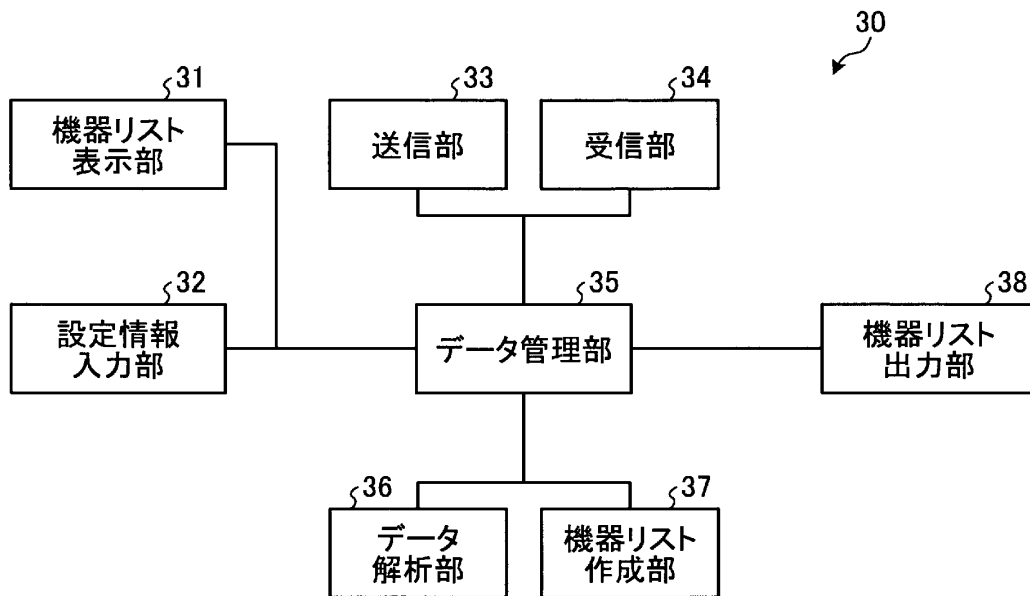

[図4]

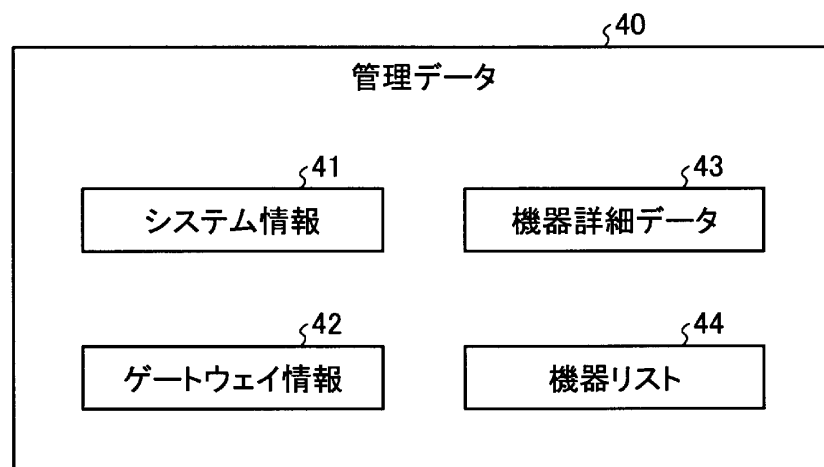


[図5]

機器詳細データ							43
PLCのIPアドレス	PLCのネットワーク 接続形態	PLCの局番	PLCの稼働状態	Plant	Cell	Unit	Equipment
51	52	53	54	55	56	57	58

44 }			
機器リスト			
Plant	Cell	Unit	Equipment
} 55	} 56	} 57	} 58

[図7]

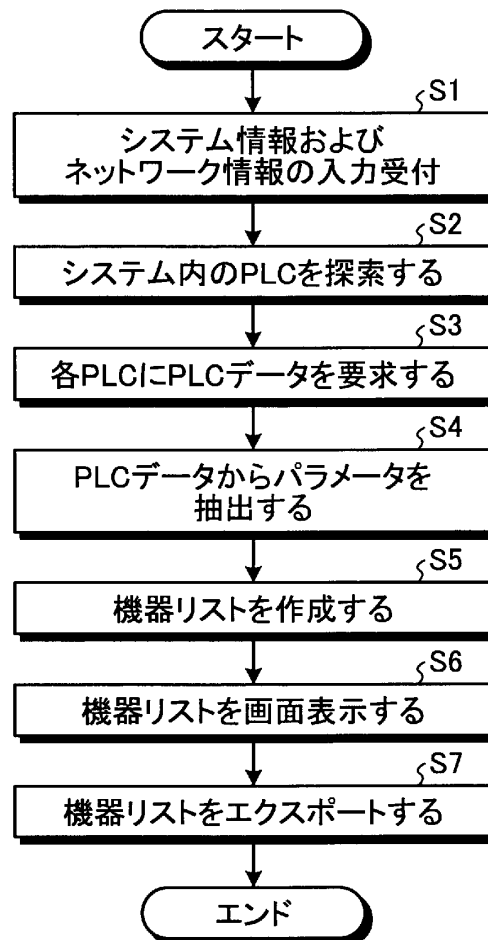

[図8]

Diagram illustrating a selection dialog box (80) containing a table (81) and a list of checkboxes (82).

The table (81) has the following structure:


Plant	Cell	Unit	Equipment
System1	10.**.**.**	PLC1	
System1	10.**.**.**	PLC1-1	Equip1-1
System1	10.**.**.**	PLC2	Equip2-1
System1	10.**.**.**	PLC3	
System1	10.**.**.**	PLC3-1	Equip3-1
System1	10.**.**.**	PLC3-2	Equip3-2

The list of checkboxes (82) is located to the left of the table and includes:


- ☒ System1
- ☒ System1
- ☒ System1
- ☒ System1
- ☒ System1
- ☐ System1

The dialog box (80) also features an OK button and a Cancel button at the bottom right.


[図9]

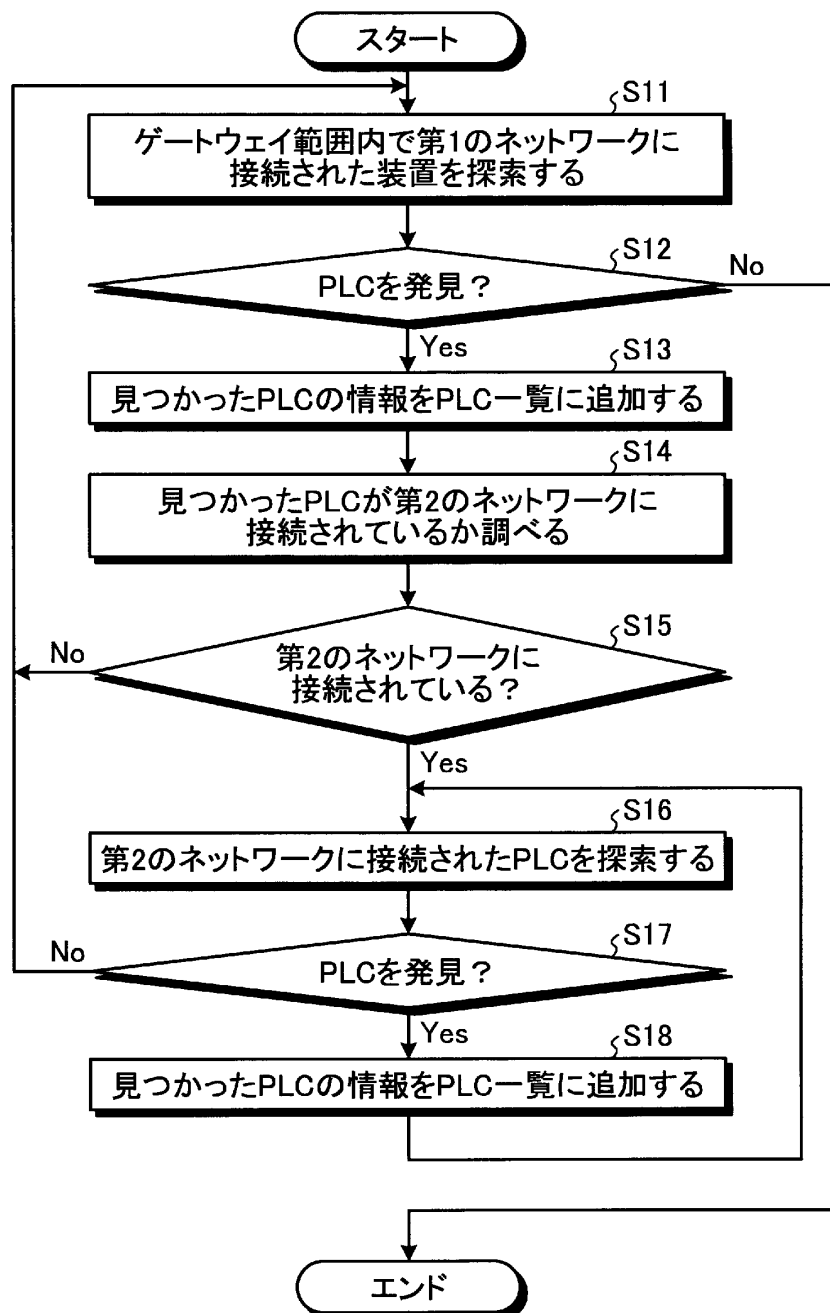


[図10]

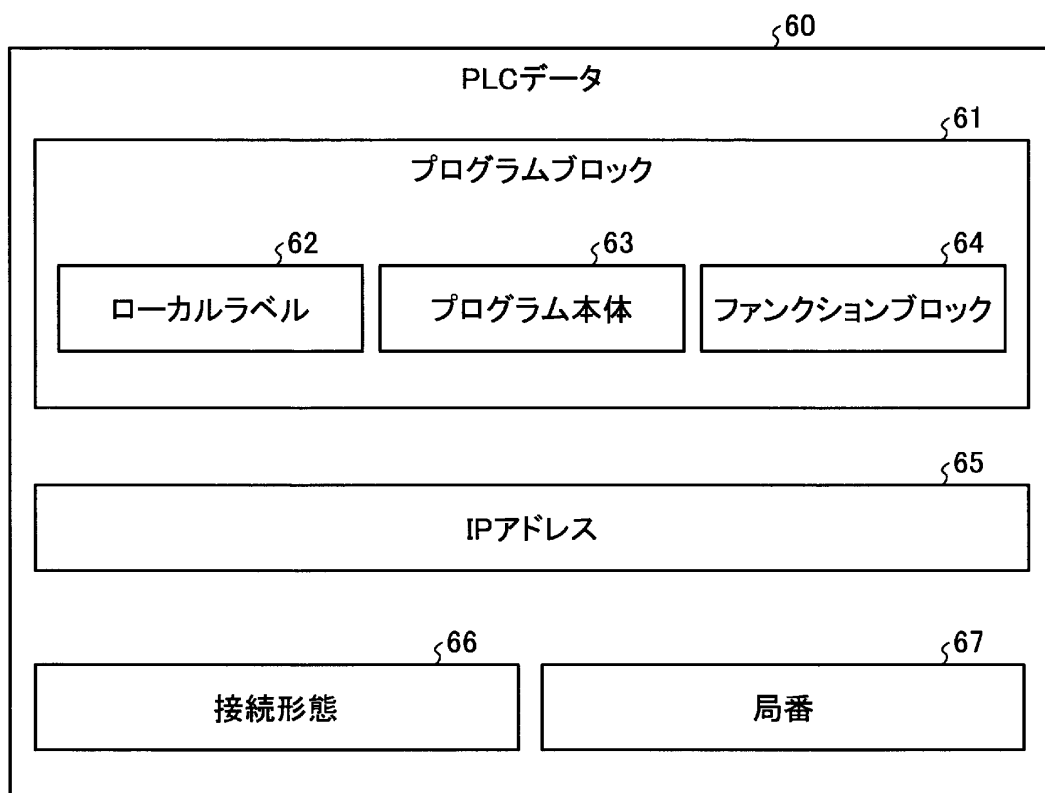


[図11]

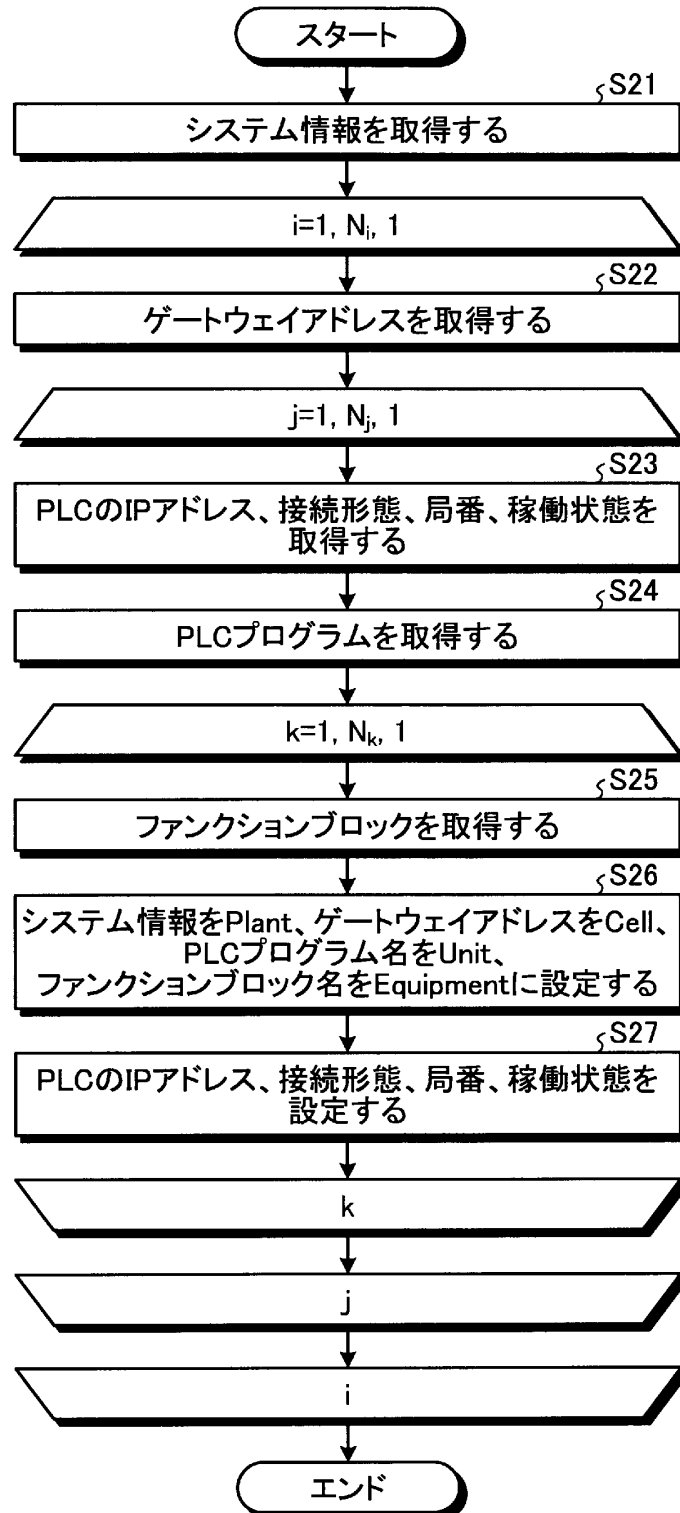

[図12]

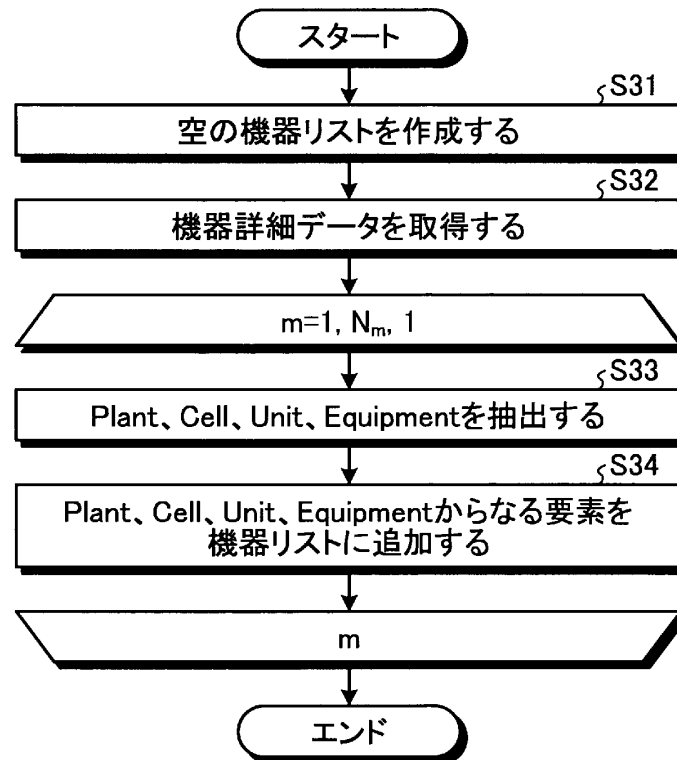

[図13]

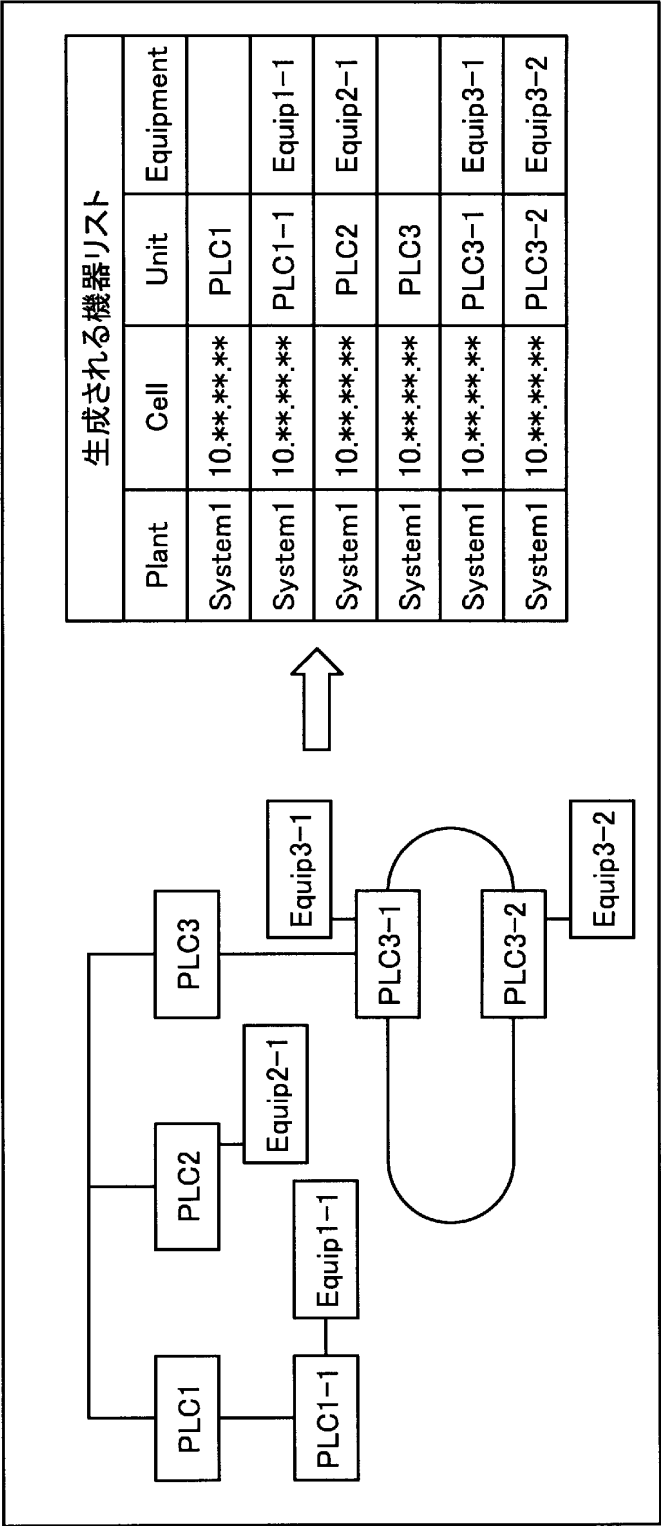

[図14]

