

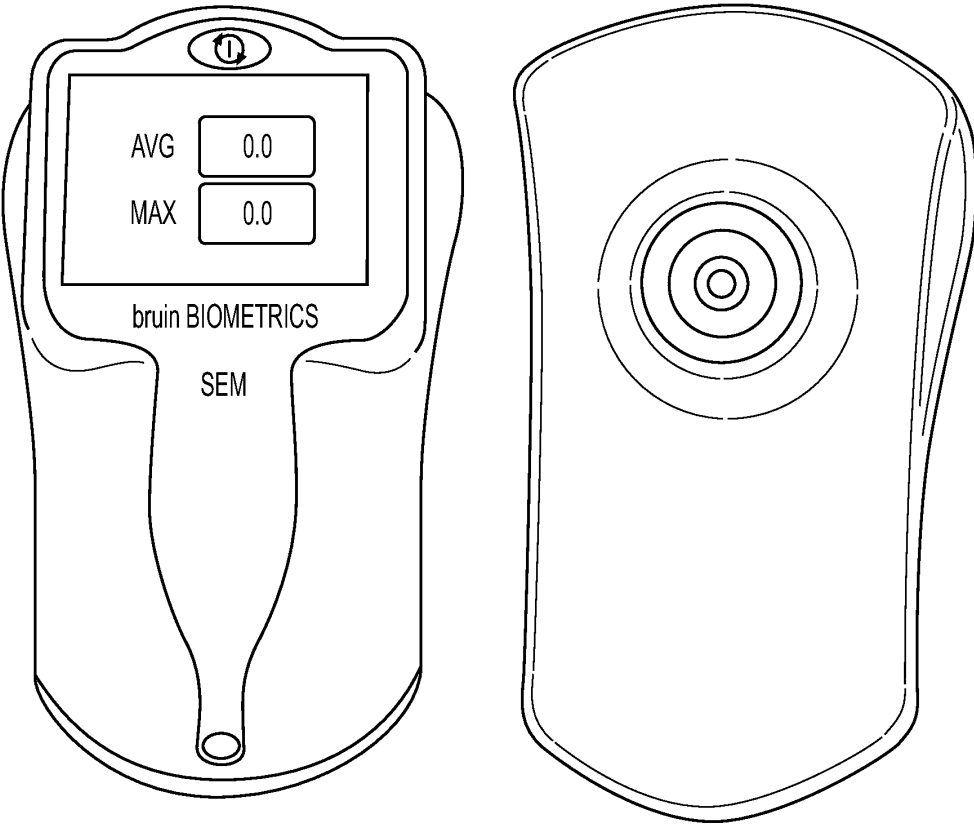


FIG. 1A

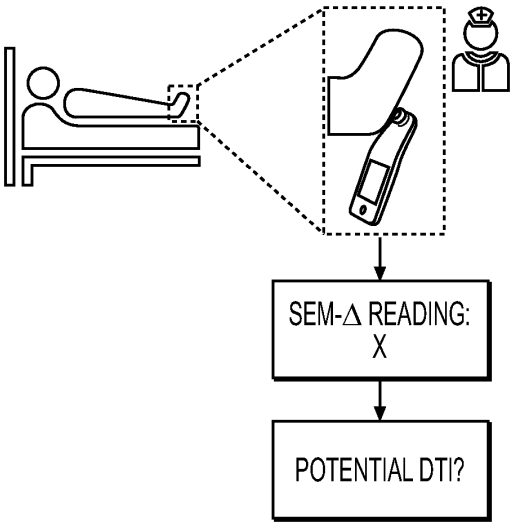


FIG. 1B

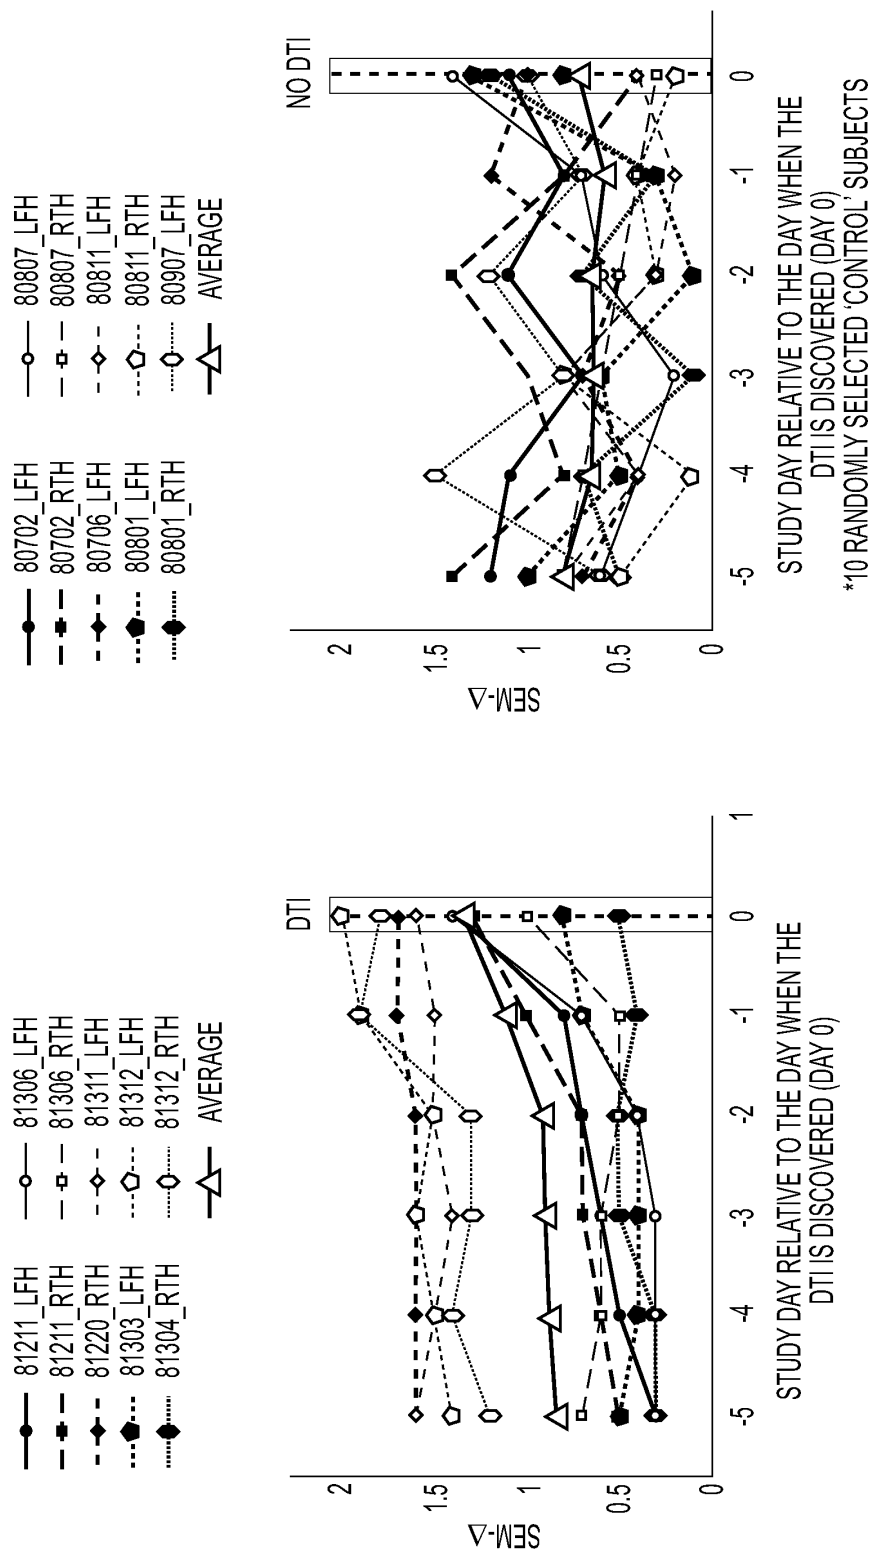


FIG. 2A

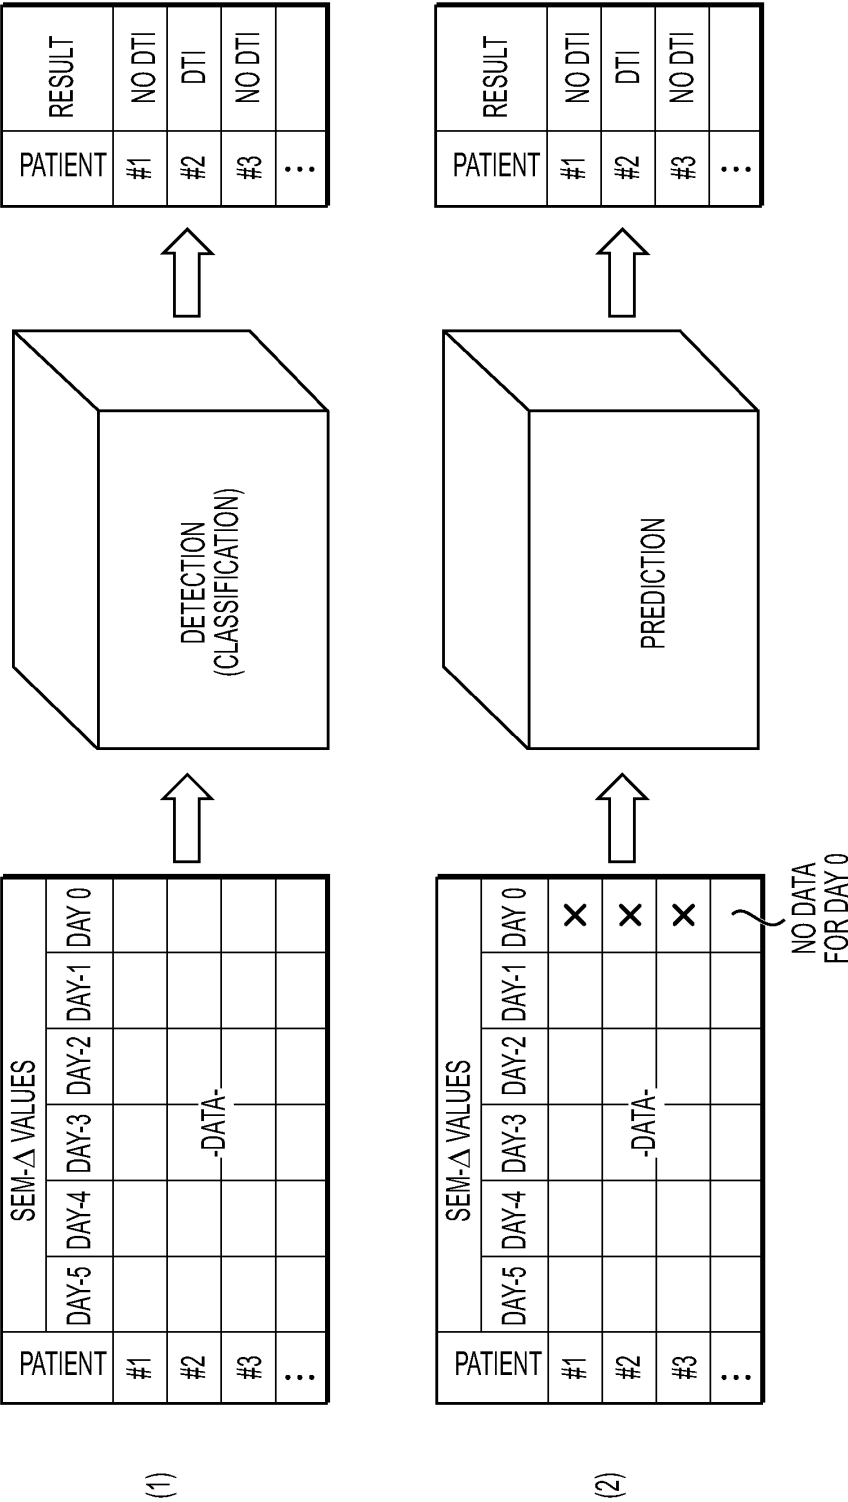


FIG. 2B

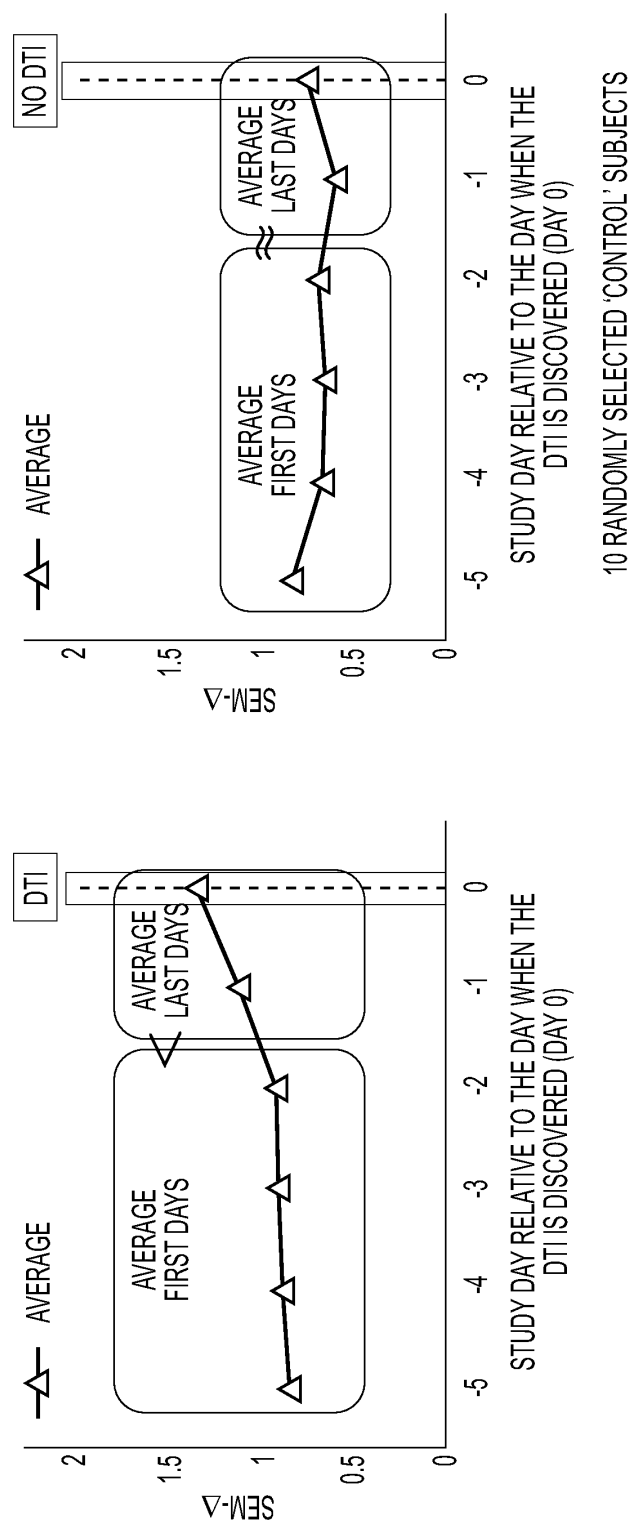
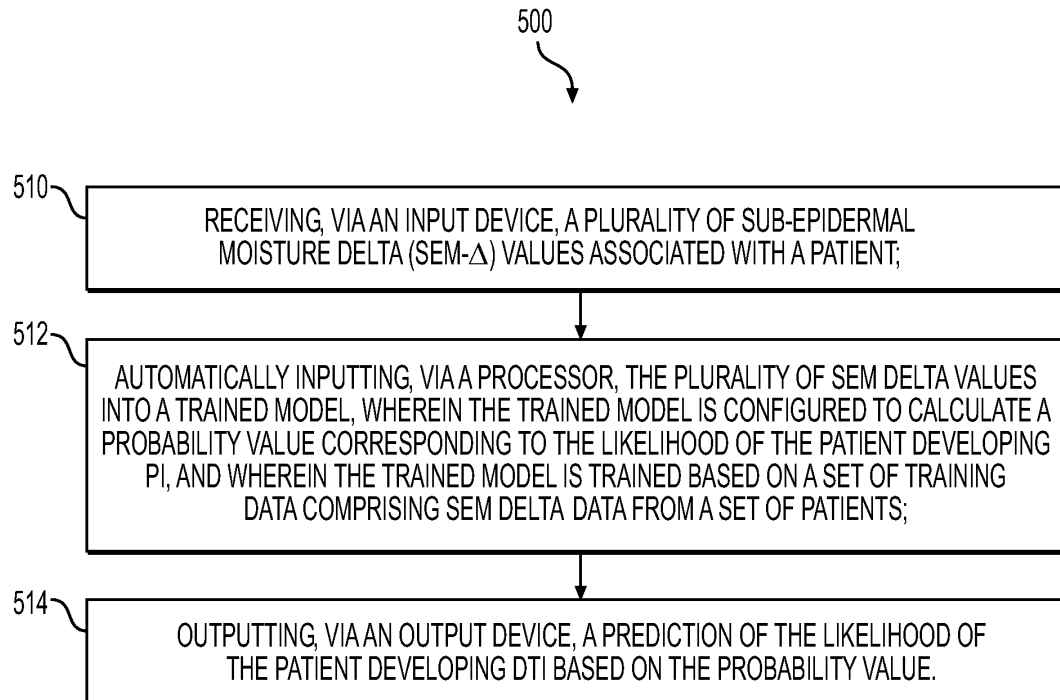
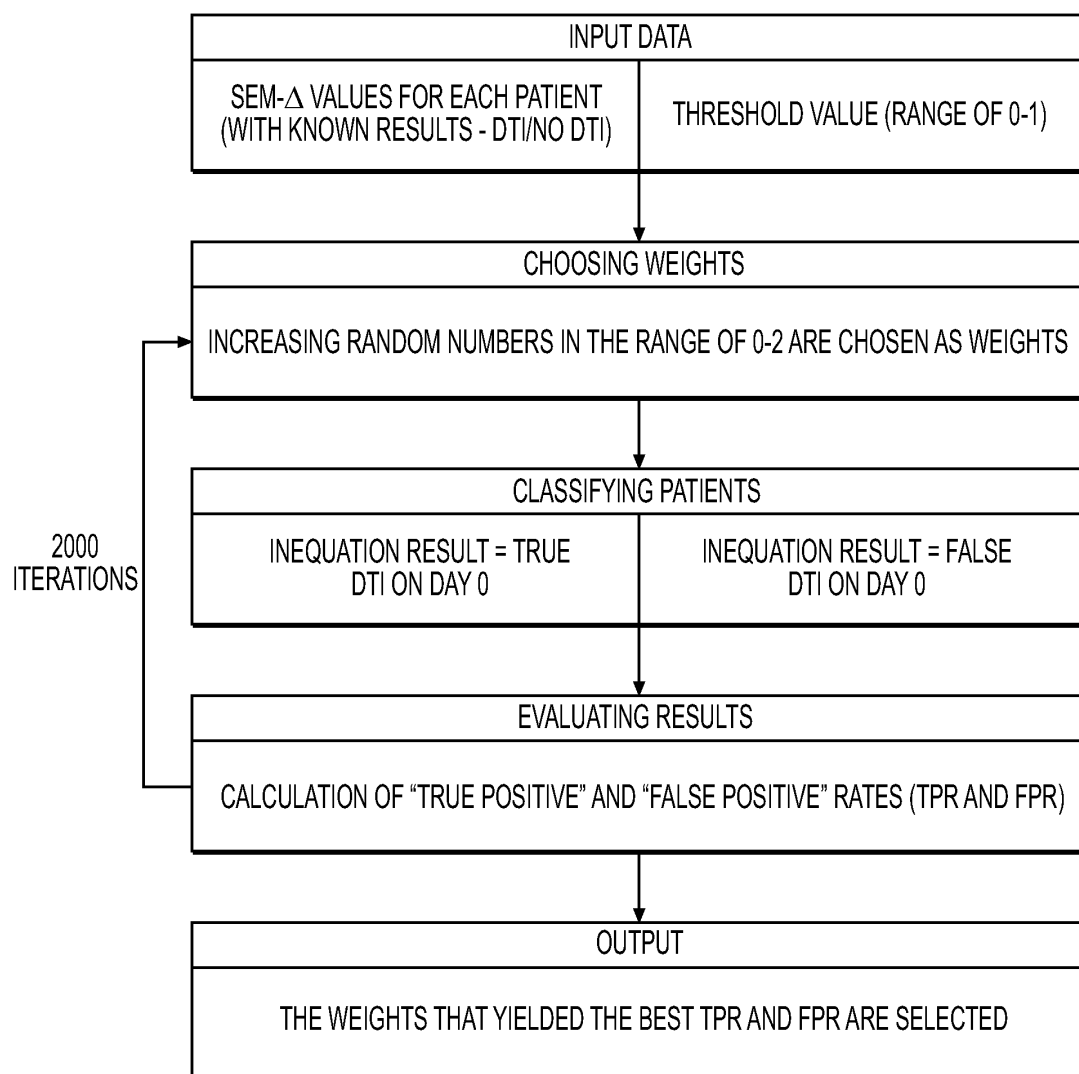


FIG. 3

**FIG. 5A**

**FIG. 5B**

THRESHOLD	FIRST DAYS						LAST DAY		
	W _{DAY-5}	W _{DAY-4}	W _{DAY-3}	W _{DAY-2}	W _{DAY-1}	W _{DAY-0}	TPR	FPR	ACCURACY
0.2	0.272	0.302	0.335	0.373	0.414	0.460	0.90	0.21	0.79
0.3	0.443	0.492	0.547	0.608	0.651	0.724	0.90	0.21	0.79
0.4	0.565	0.628	0.698	0.776	0.862	0.958	0.90	0.21	0.79
0.5	0.653	0.725	0.806	0.930	1.033	1.148	0.90	0.21	0.79
0.6	0.822	0.914	1.015	1.128	1.254	1.393	0.90	0.21	0.79
0.7	0.945	1.050	1.167	1.297	1.441	1.601	0.90	0.21	0.79
0.8	1.091	1.213	1.347	1.502	1.669	1.854	0.90	0.21	0.79

THRESHOLD	FIRST DAYS						LAST DAY		
	W _{DAY-5}	W _{DAY-4}	W _{DAY-3}	W _{DAY-2}	W _{DAY-1}	W _{DAY-0}	TPR	FPR	ACCURACY
0.7	1.094	1.216	1.351	1.501	1.668	1.859	0.90	0.21	0.79

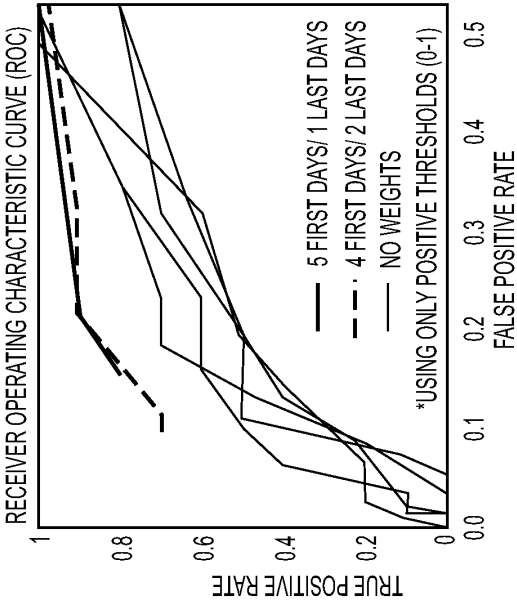


FIG. 6

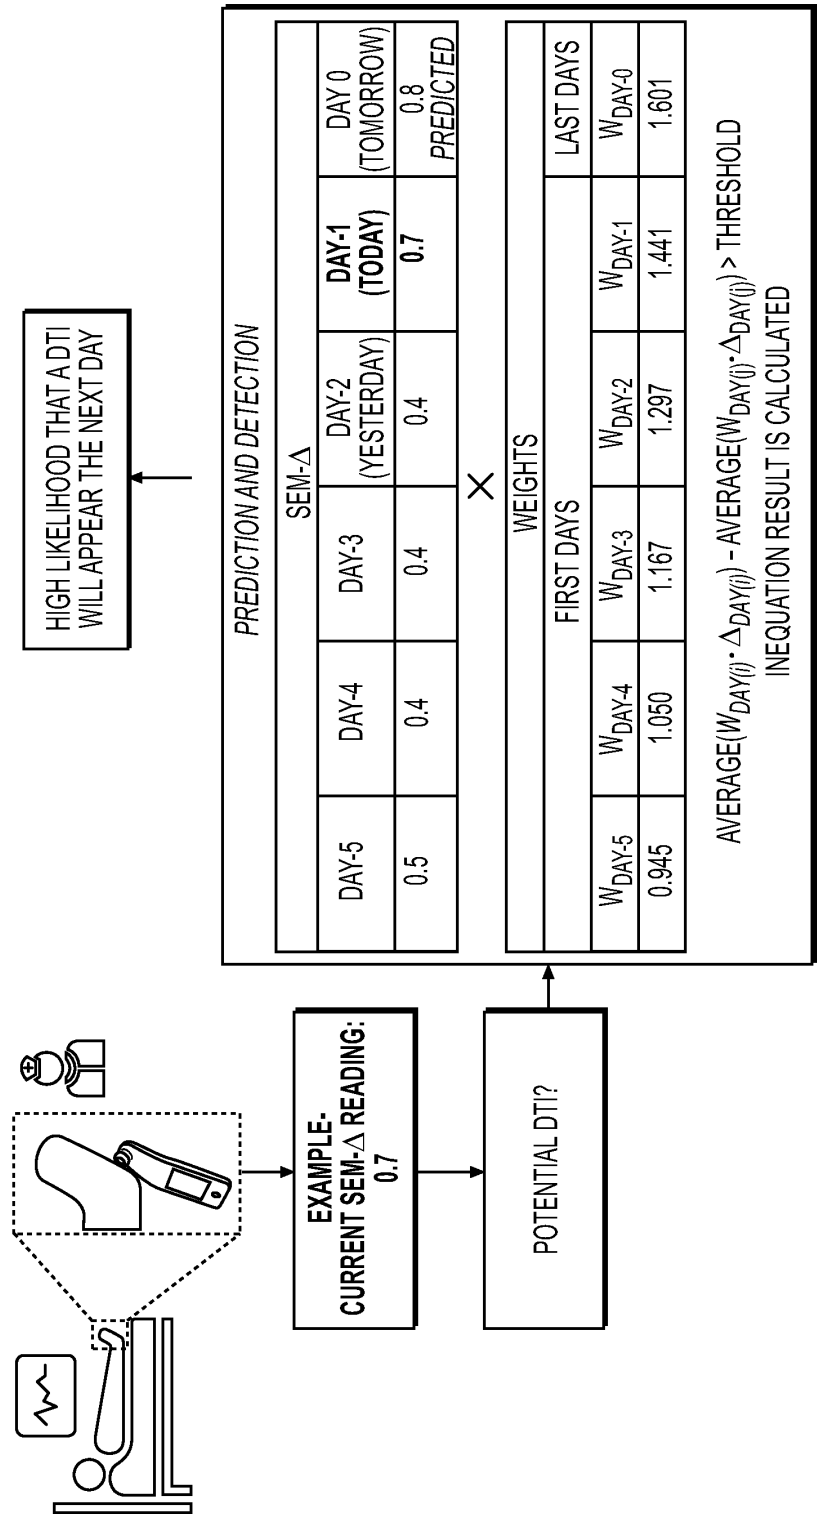
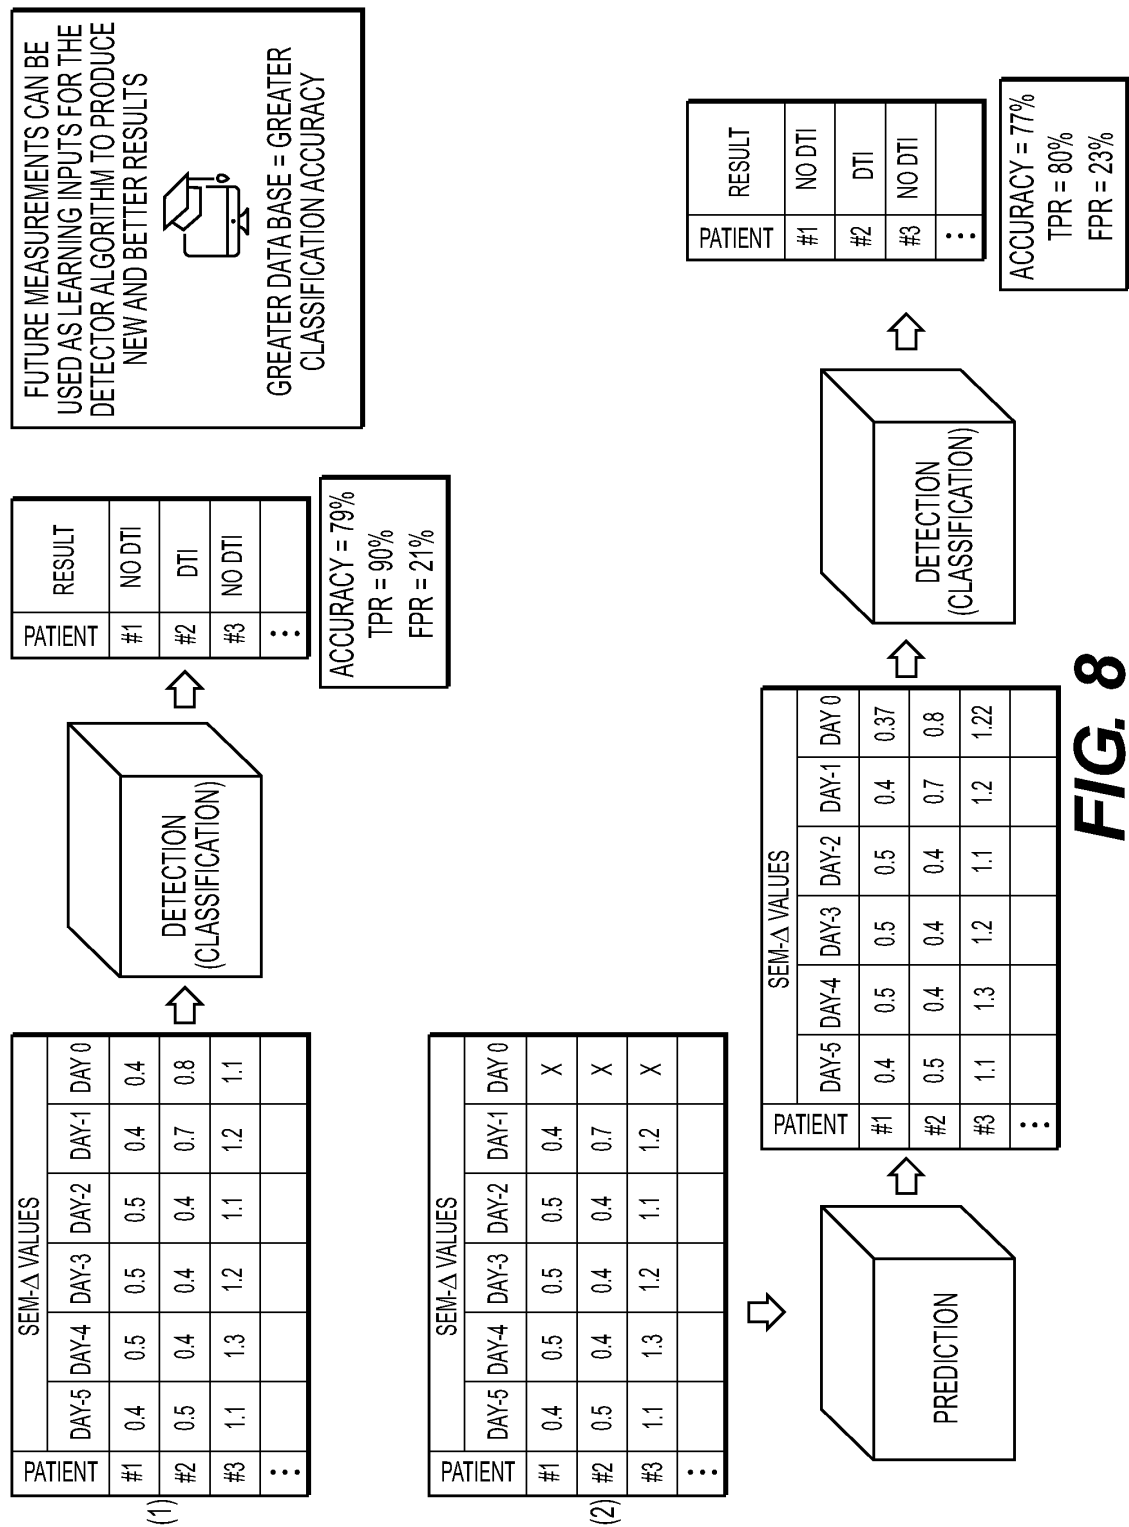


FIG. 7



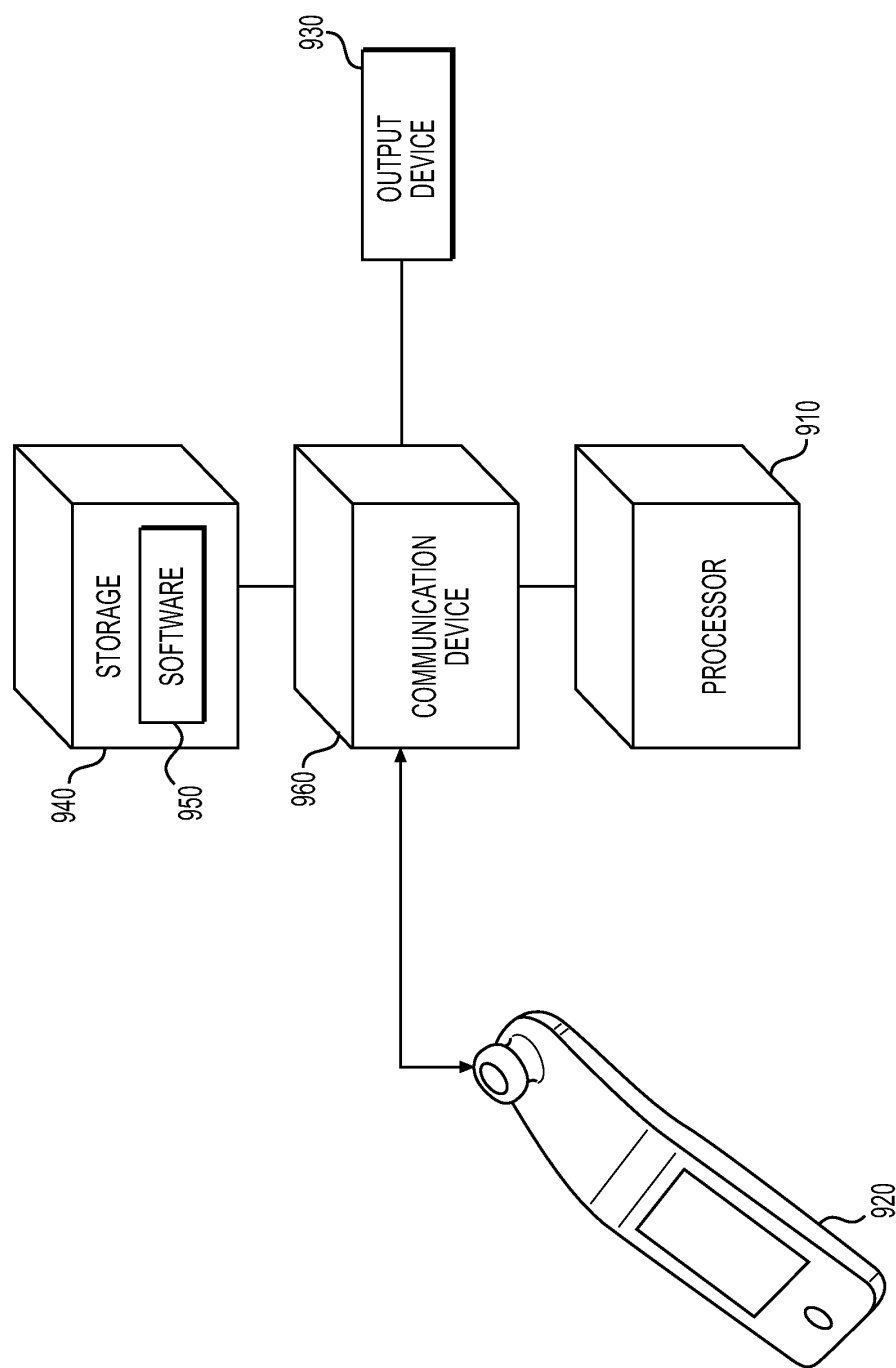


FIG. 9