

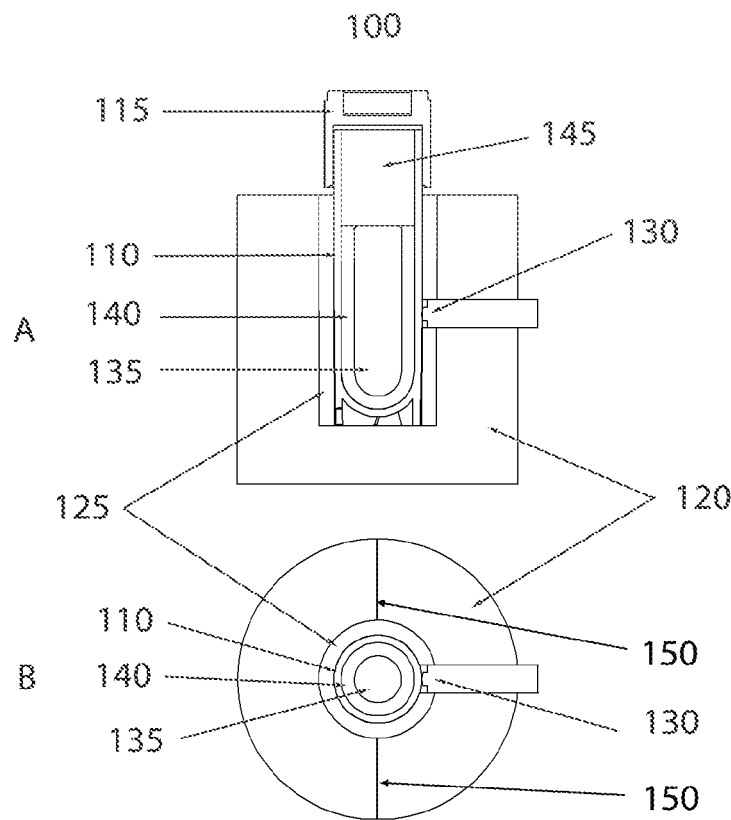


Figure 1A

2/27

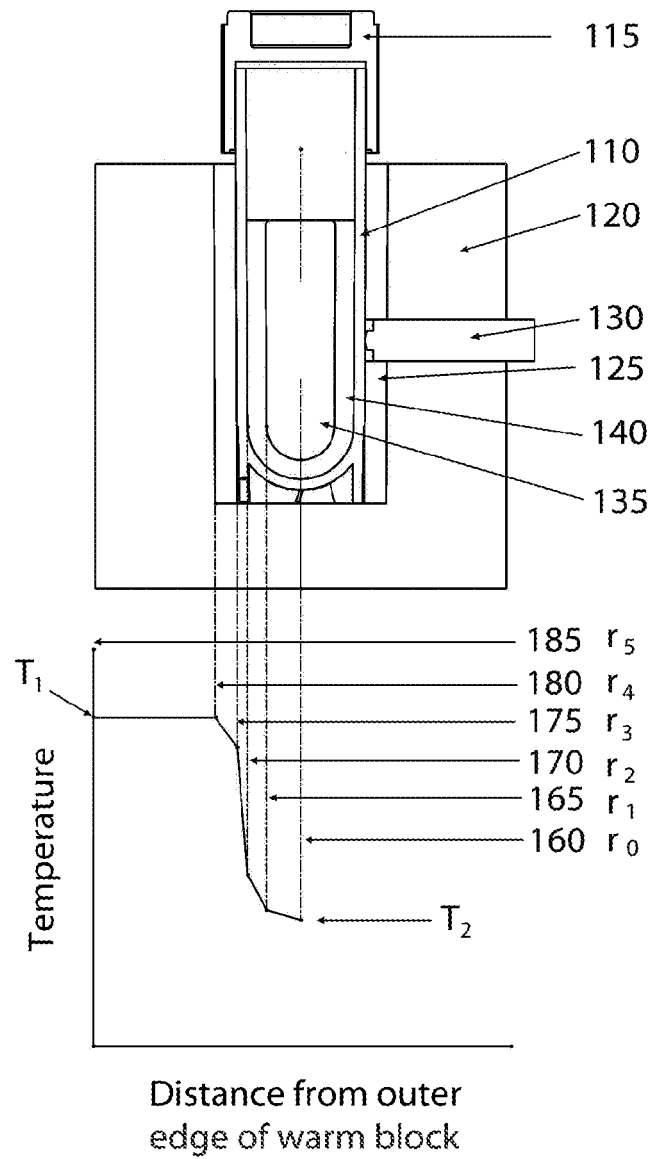


Figure 1B



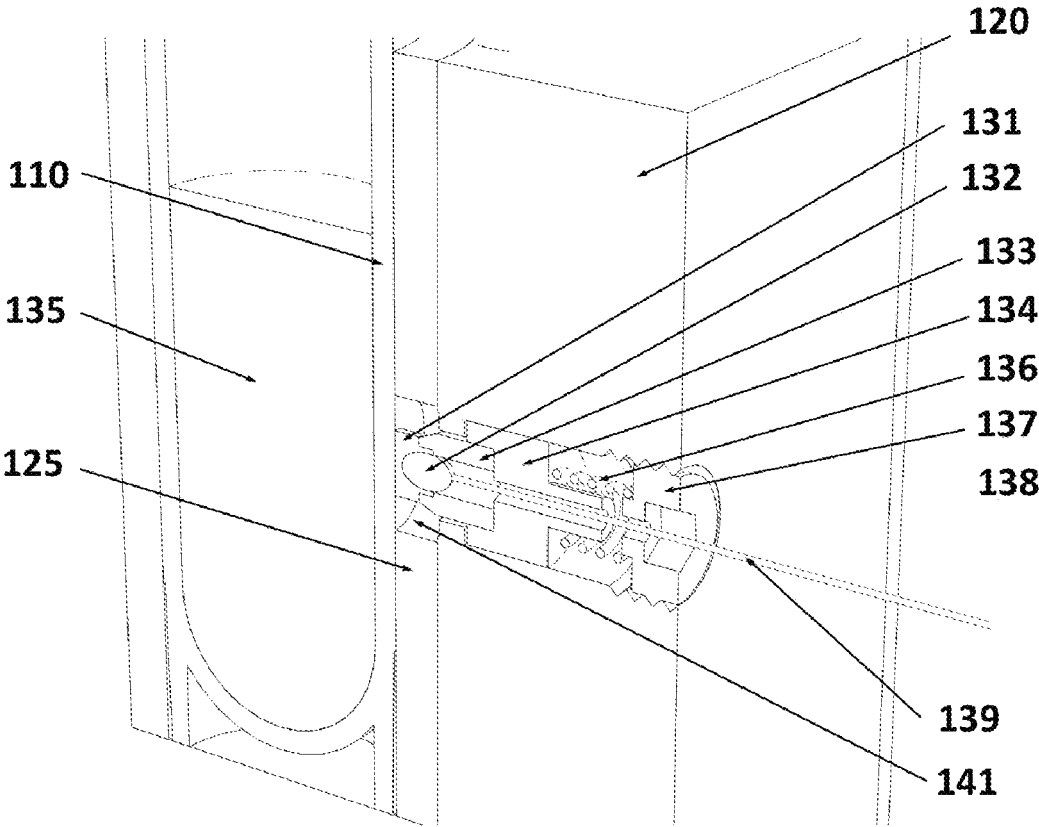


Figure 1C

4/27

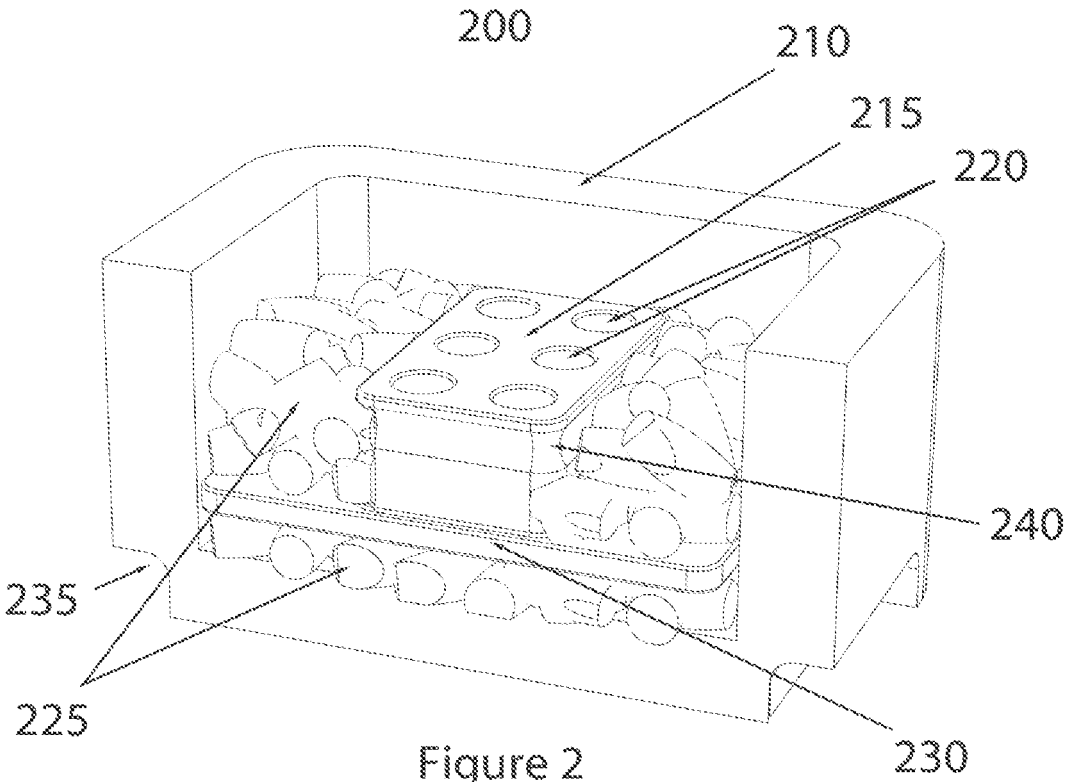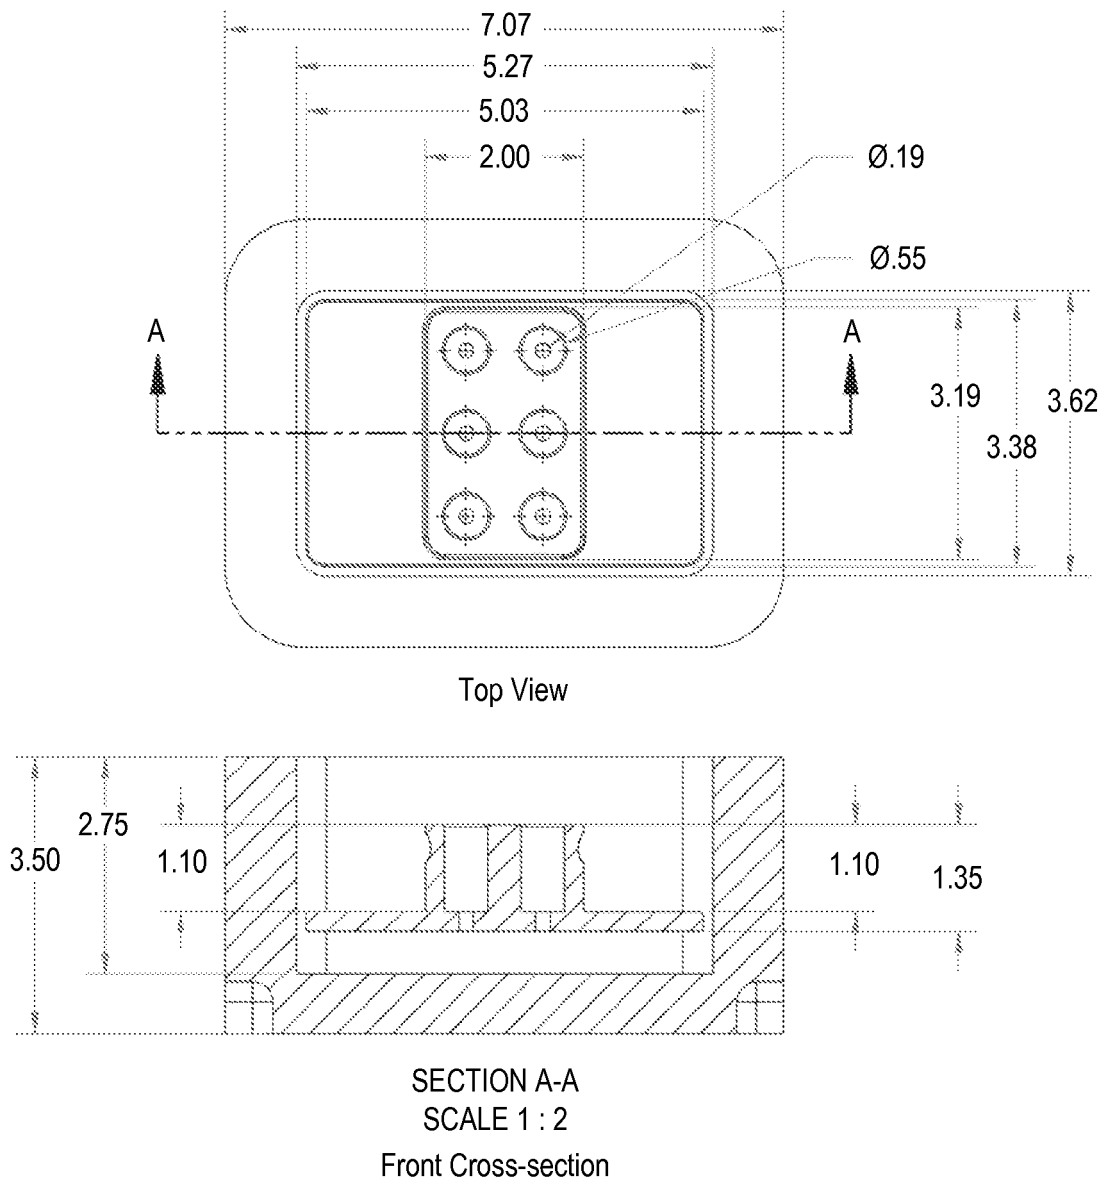

5/27

**Figure 3**

6/27

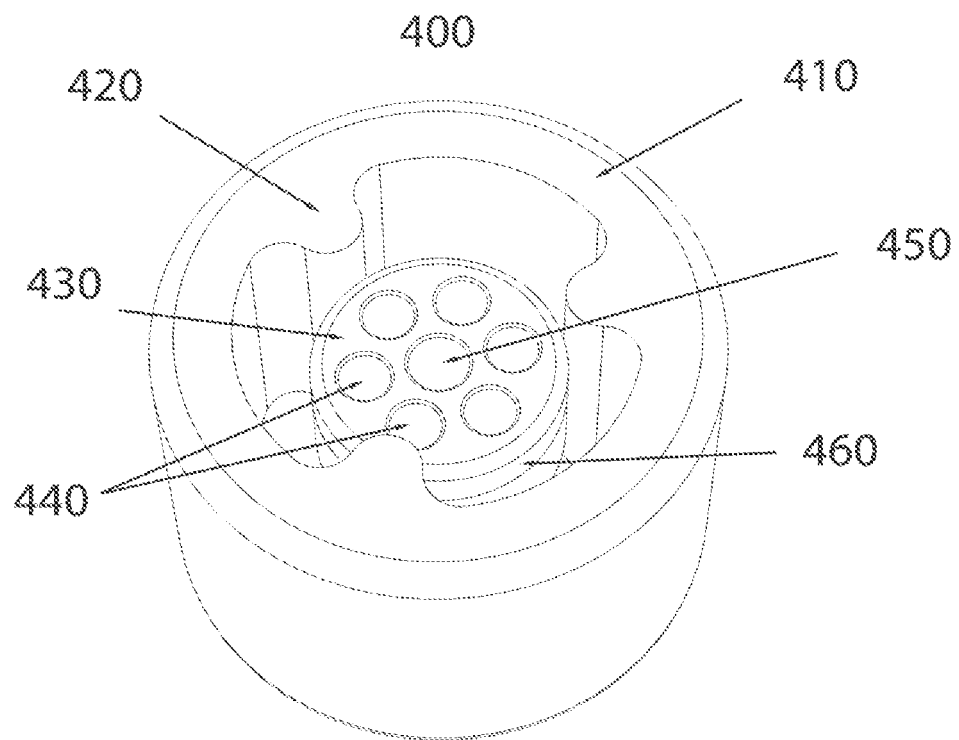


Figure 4

7/27

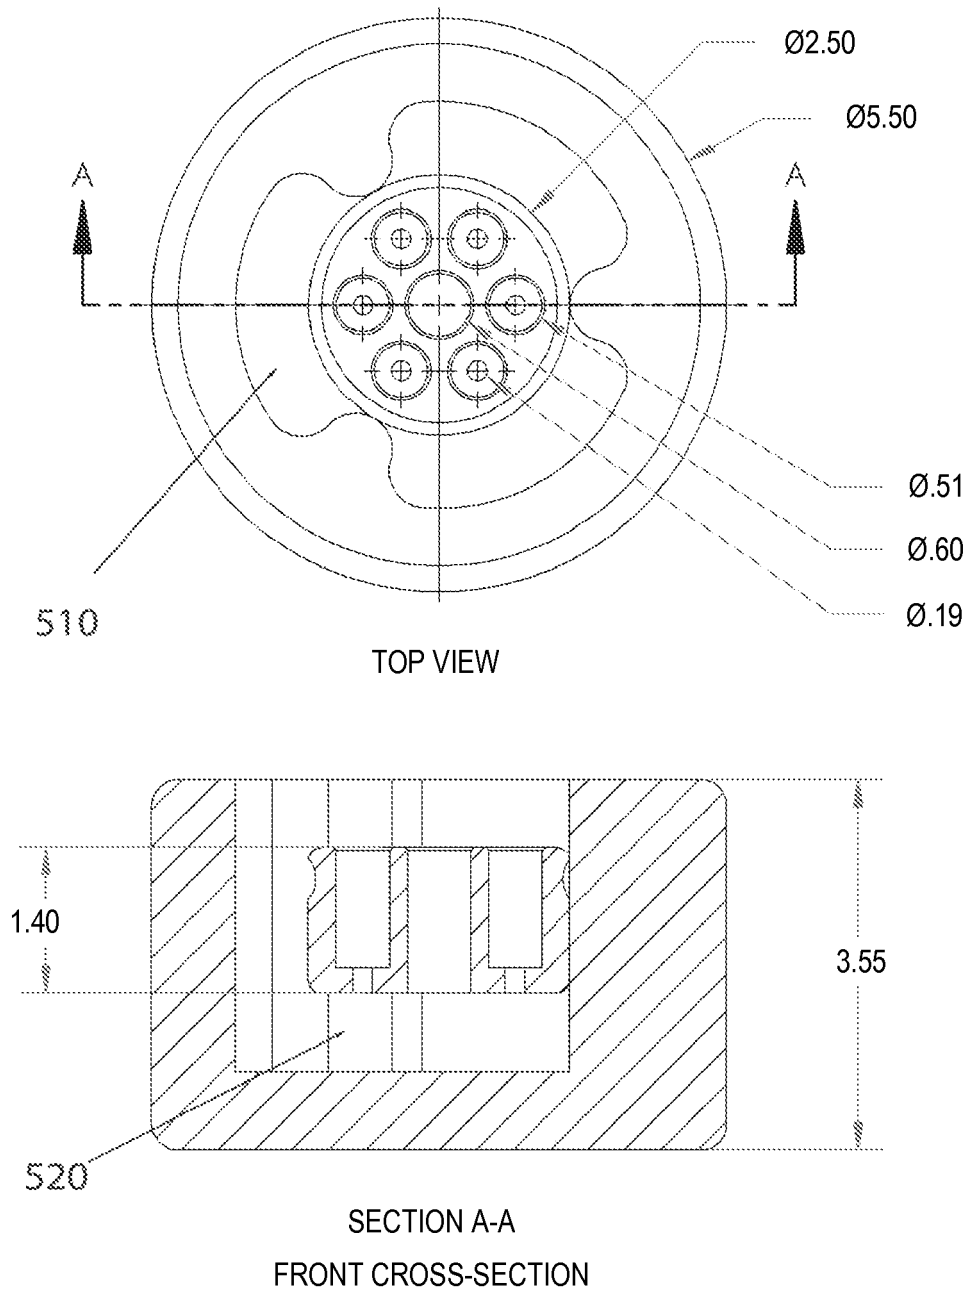
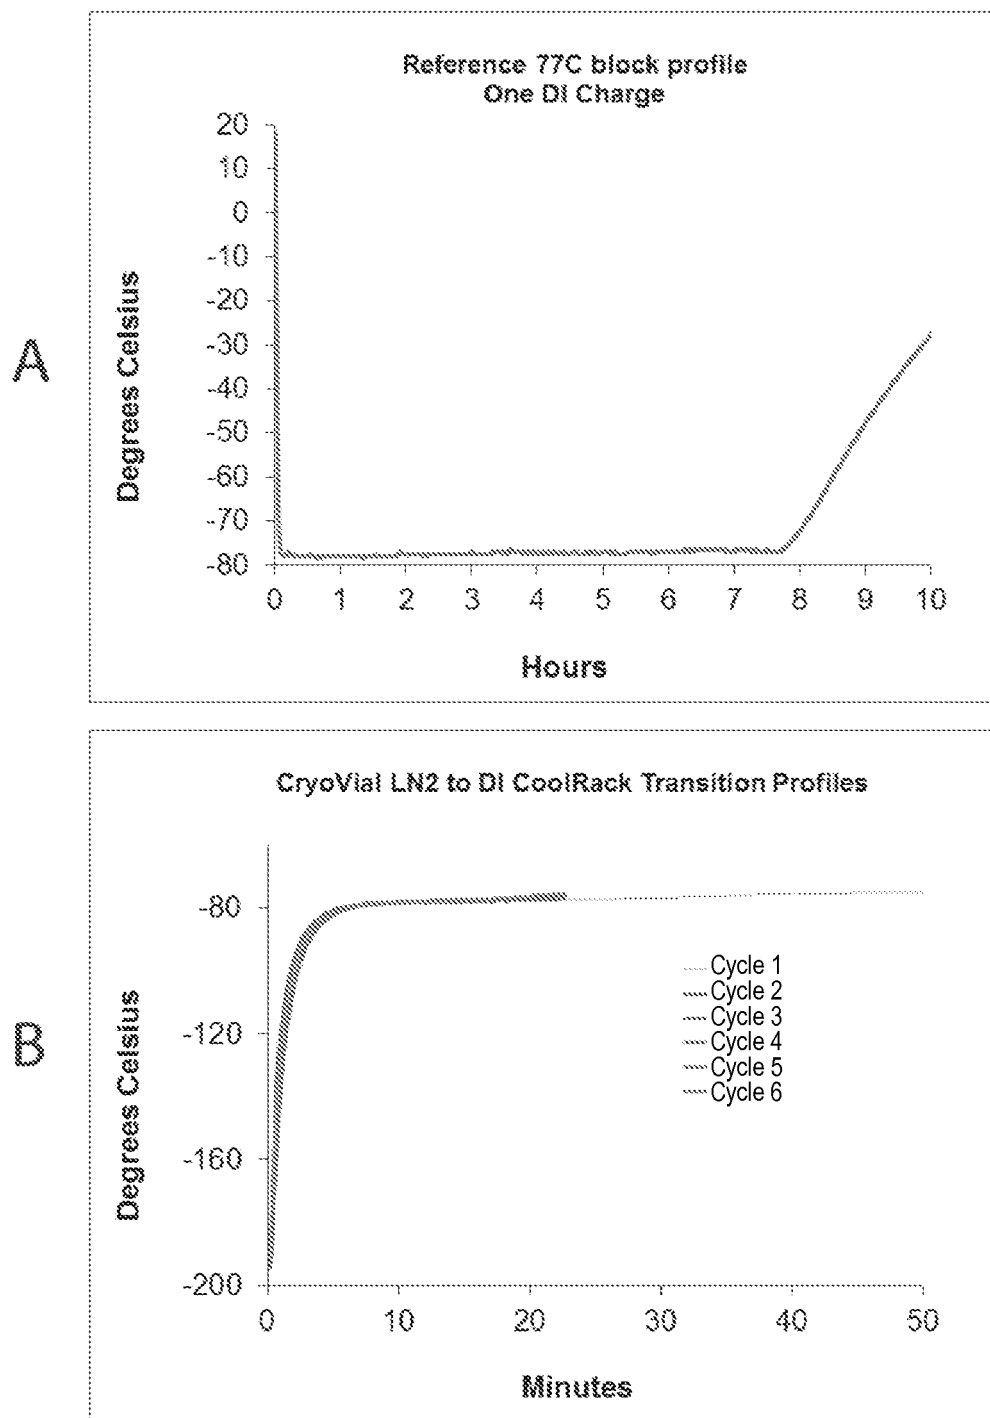


Figure 5

8/27

**Figure 6**

9/27

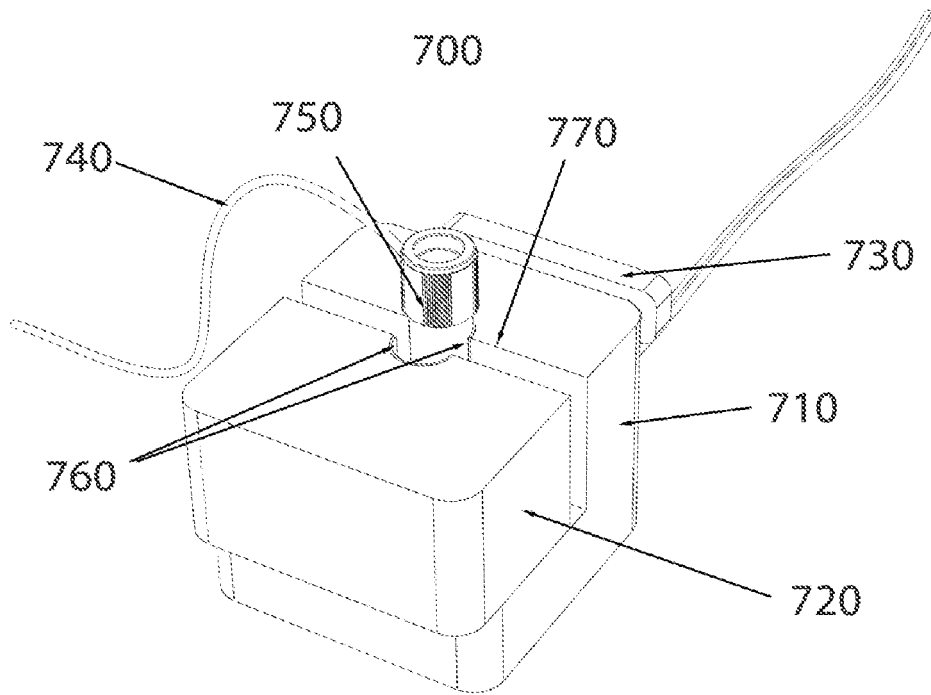


Figure 7

10/27

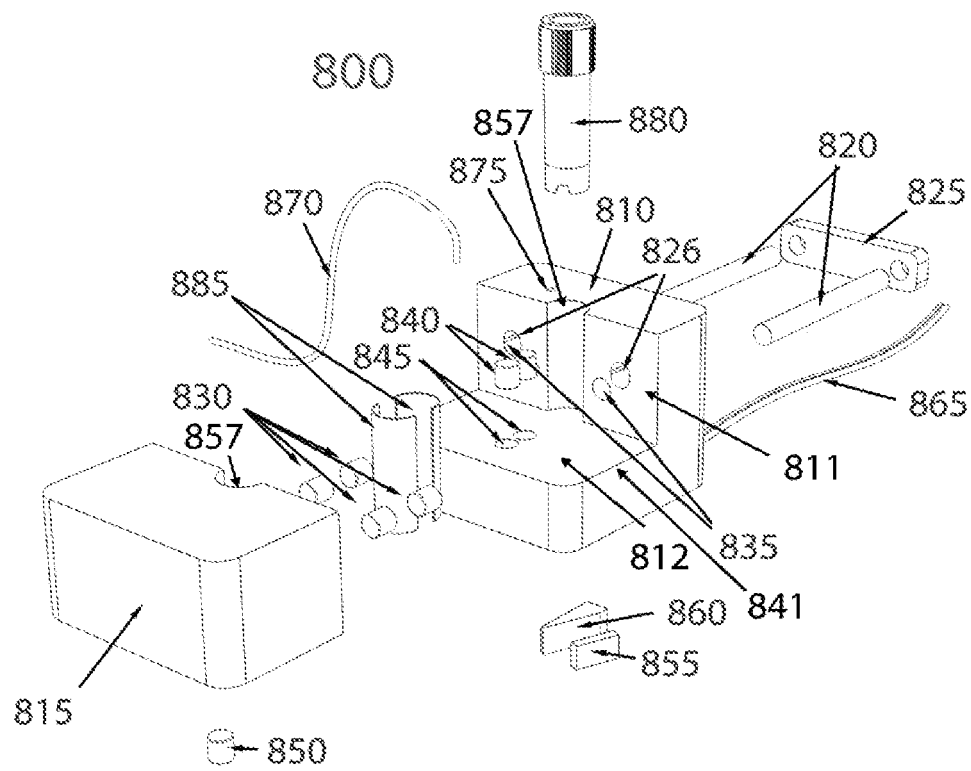
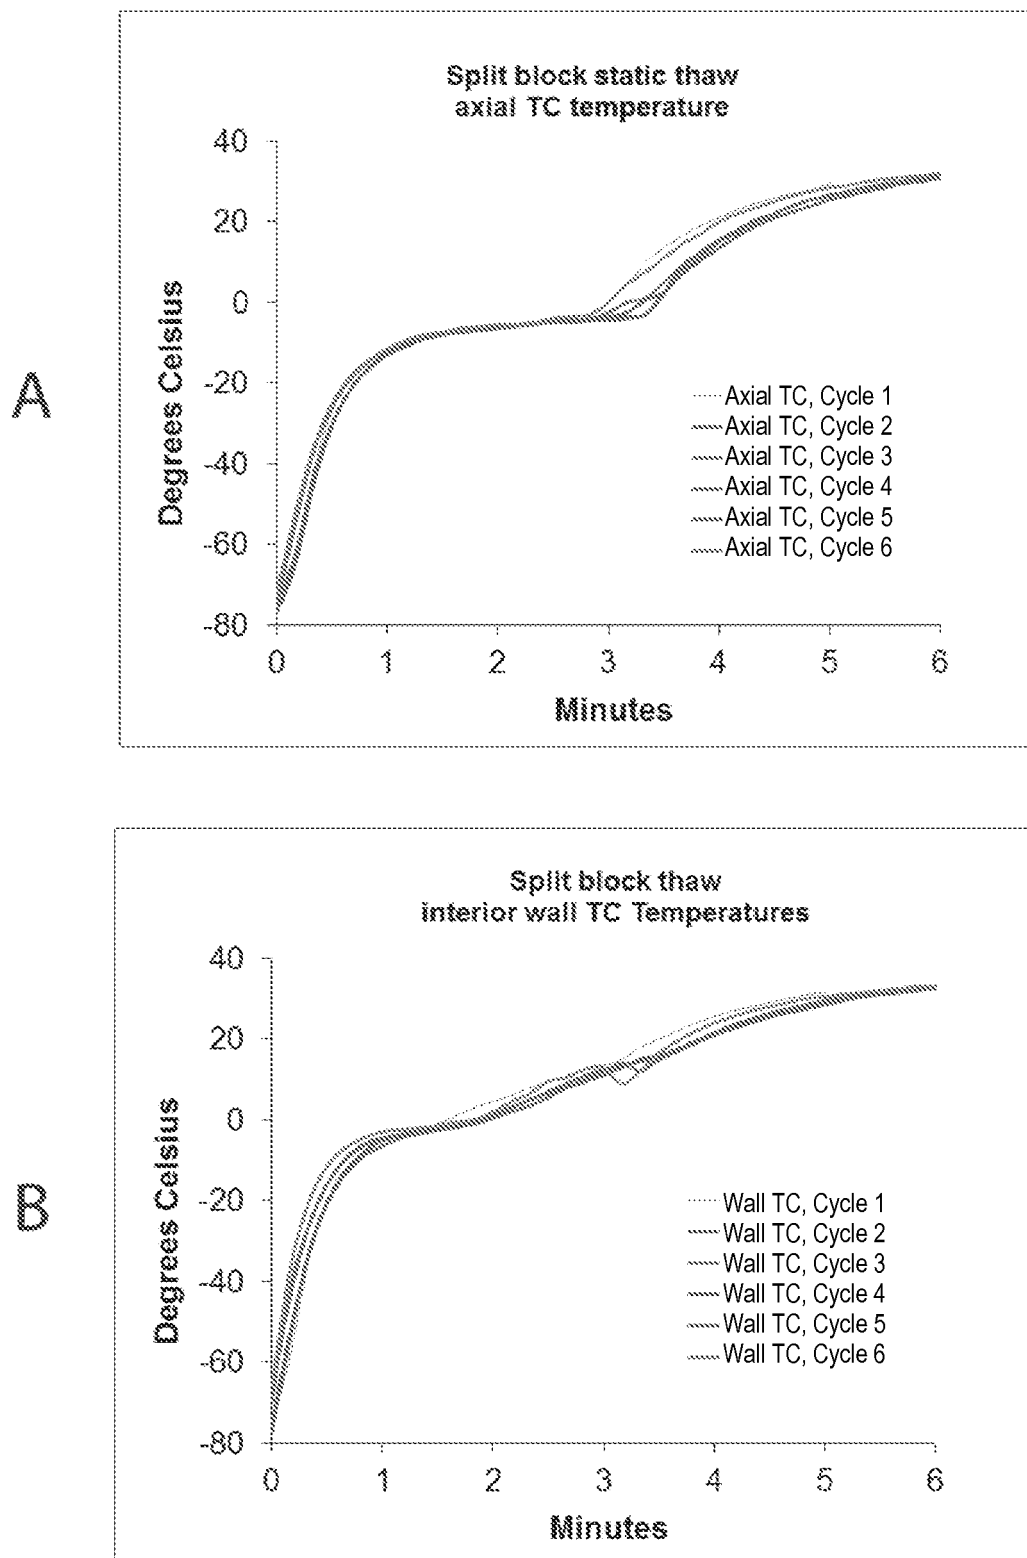


Figure 8

11/27

**Figure 9**

12/27

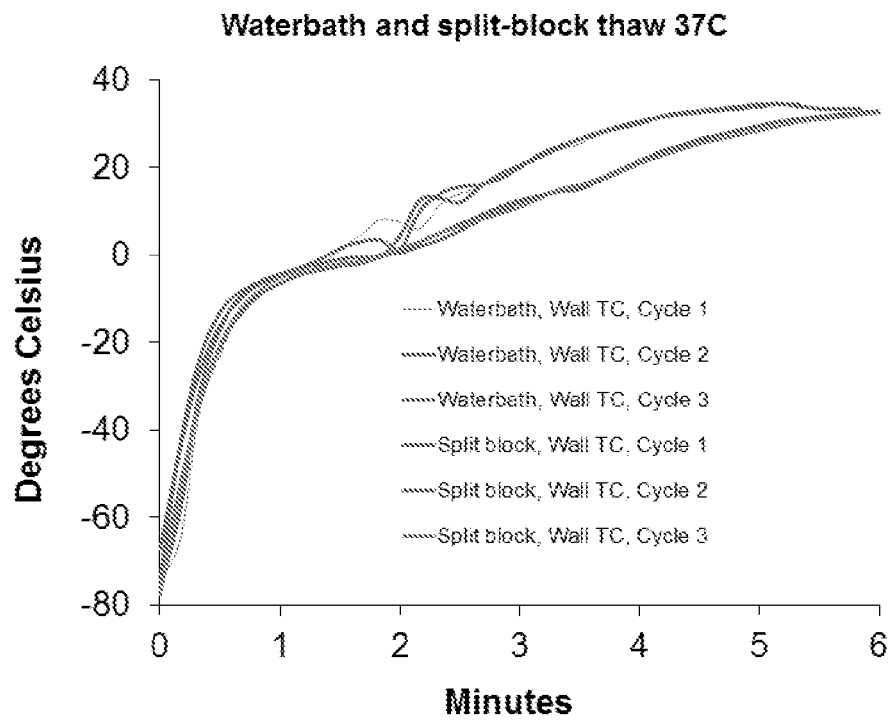


Figure 10

13/27

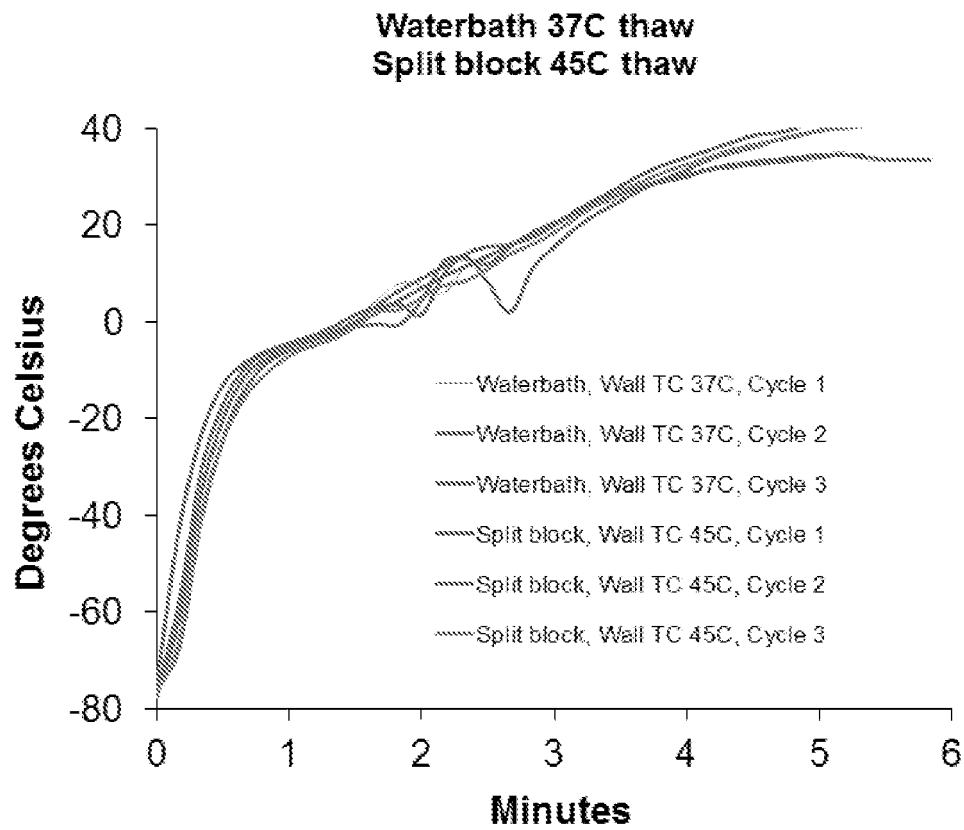


Figure 11

14/27

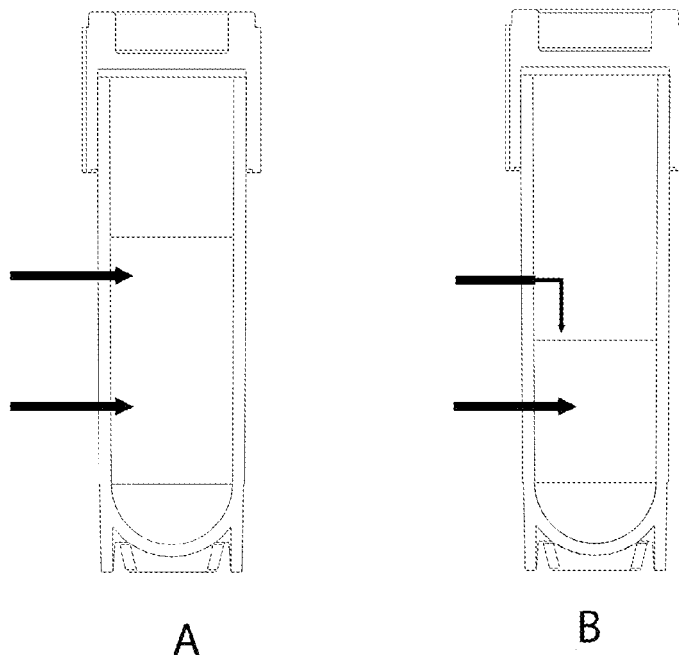
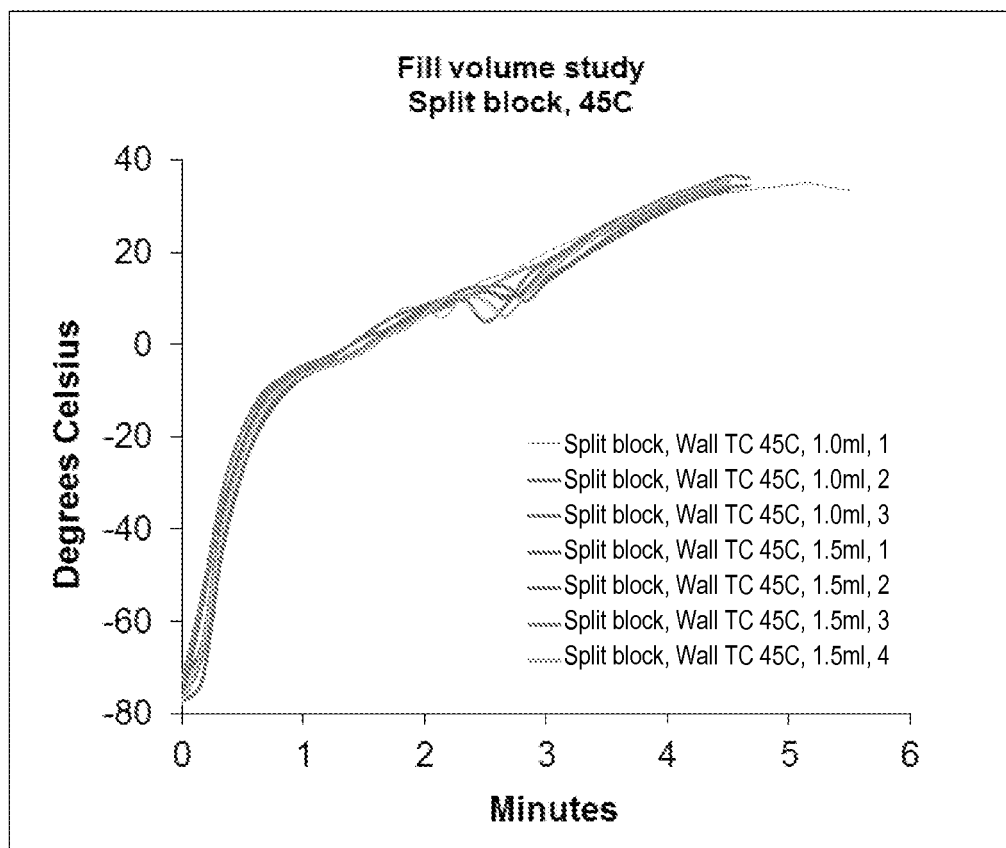


Figure 12

15/27

**Figure 13**

16/27

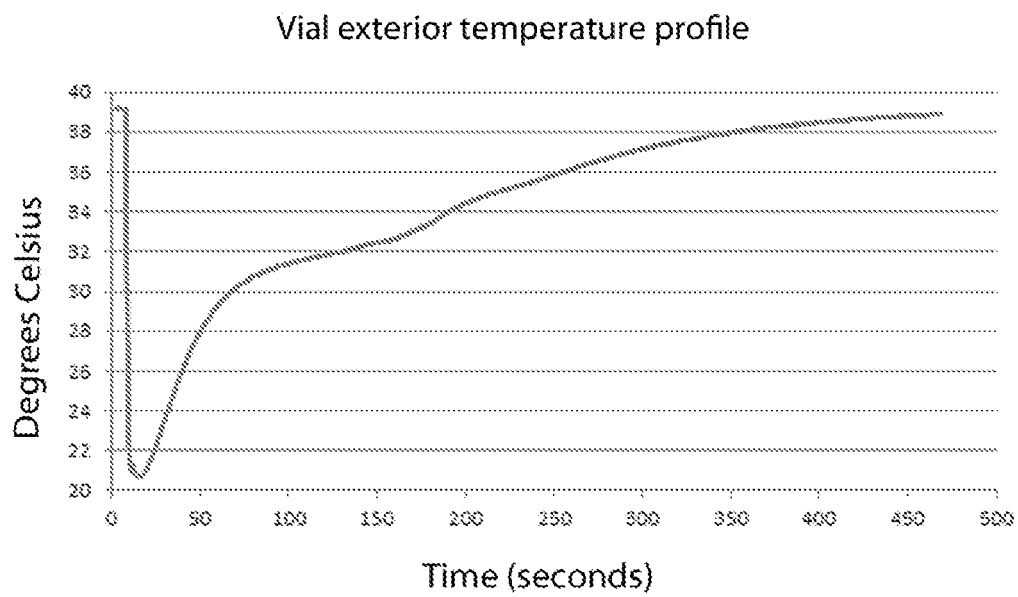


Figure 14

17/27

Time coefficient values derived from analysis
of external vial temperature data

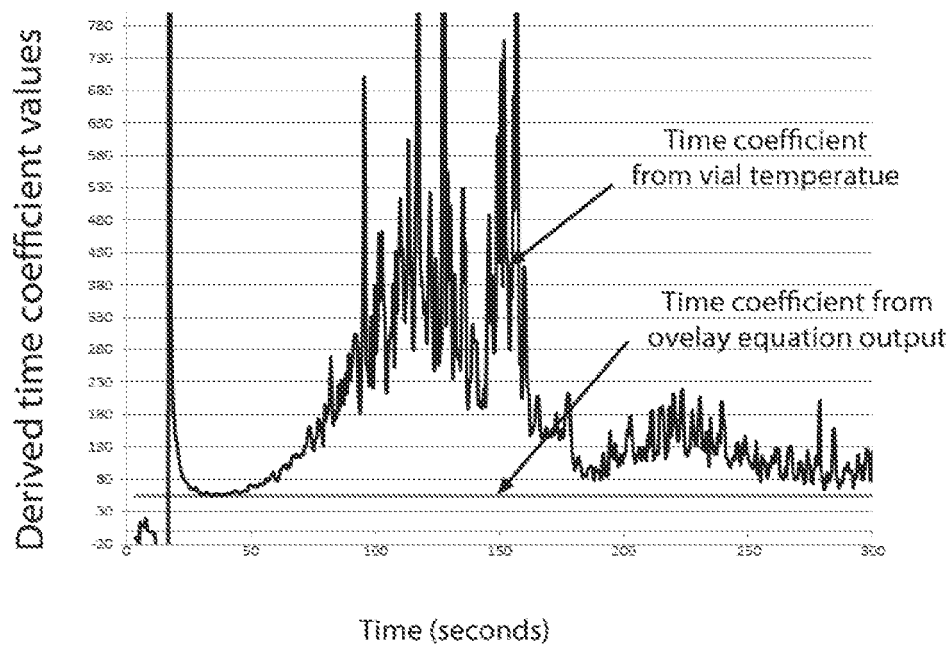


Figure 15A

18/27

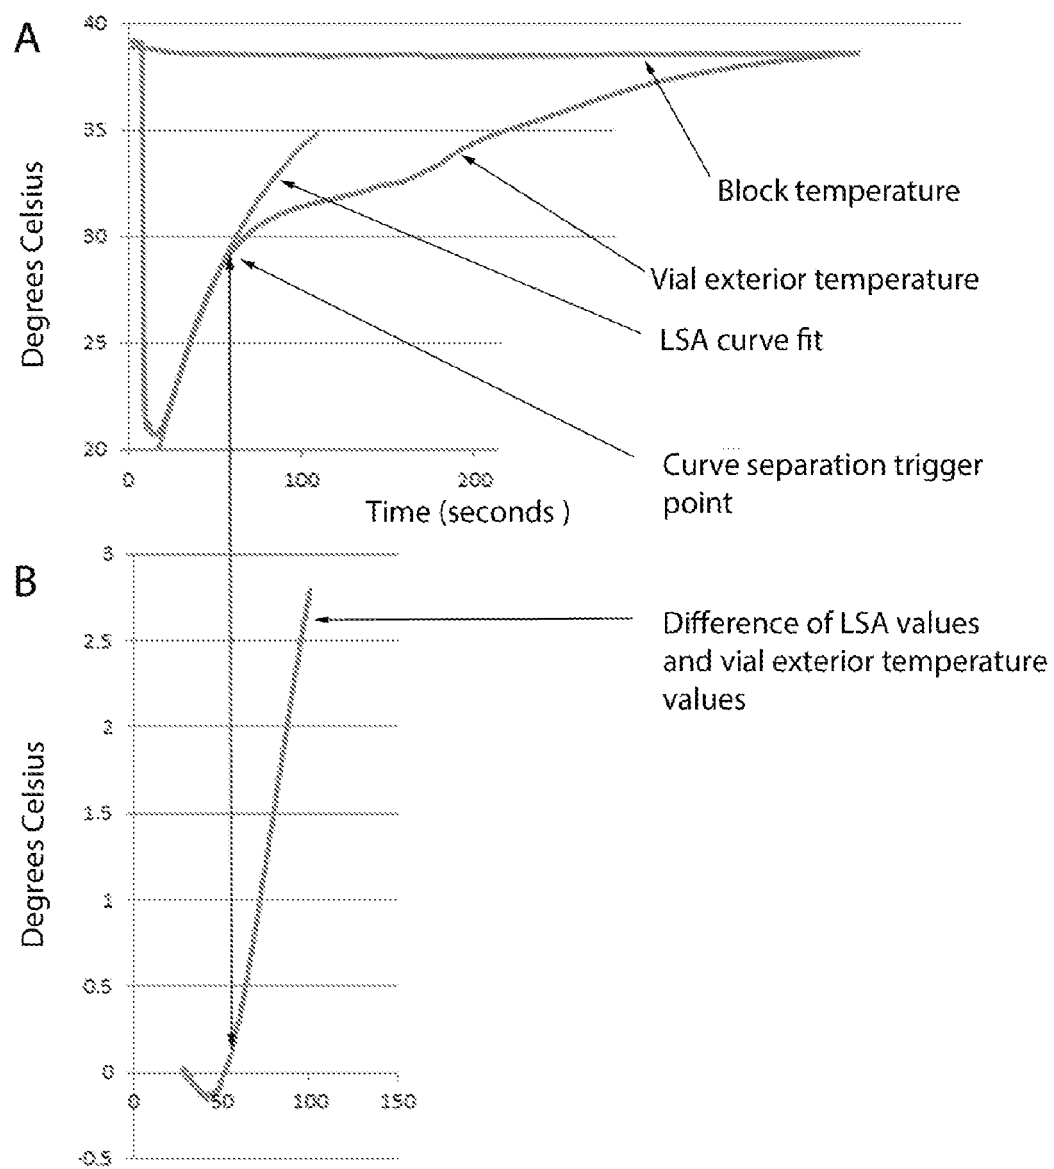


Figure 15B

19/27

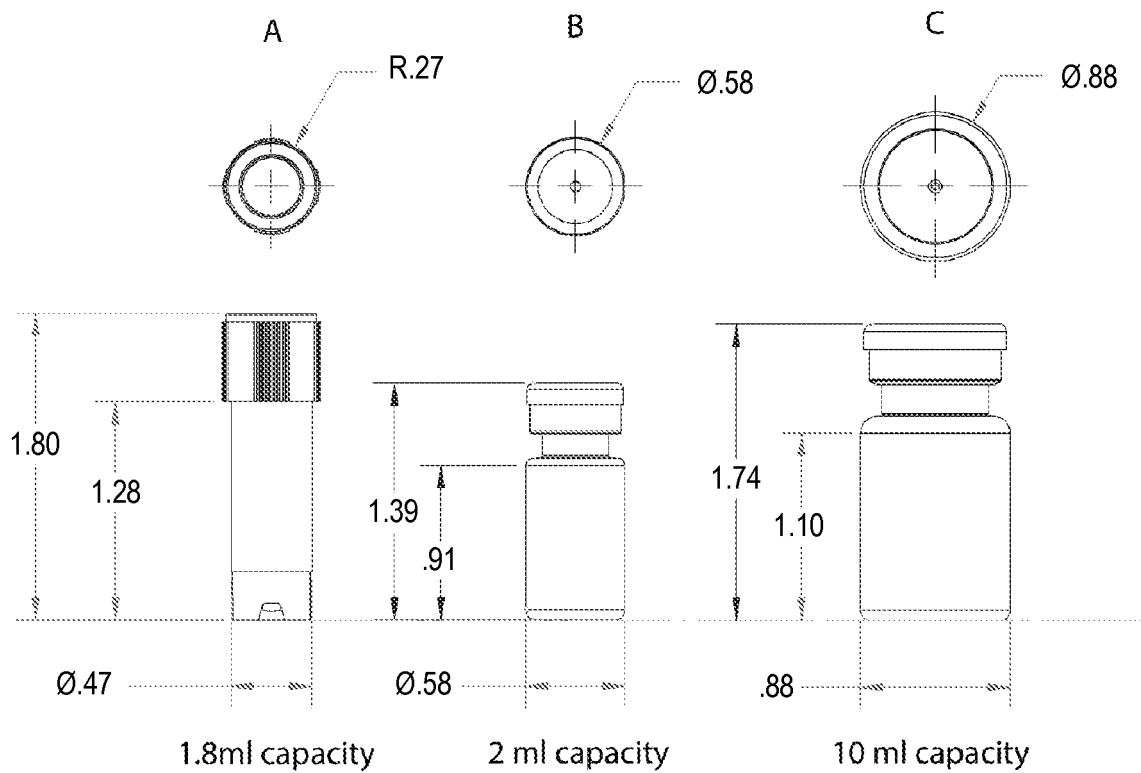


Figure 16

20/27

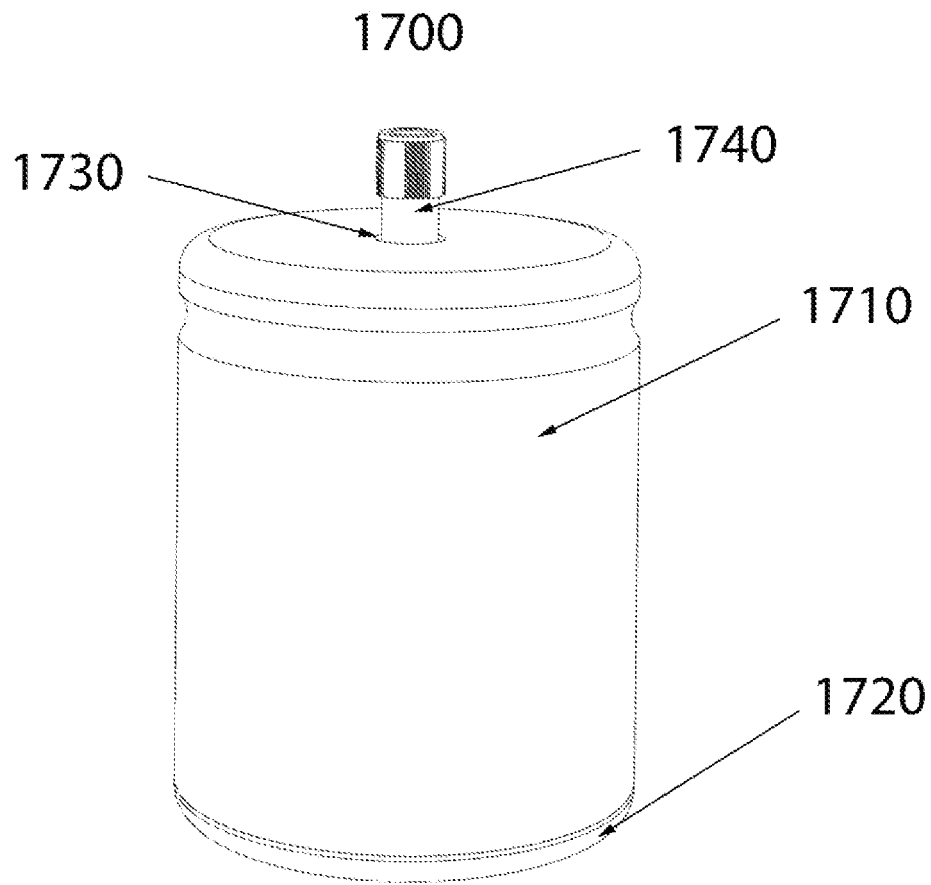


Figure 17

21/27

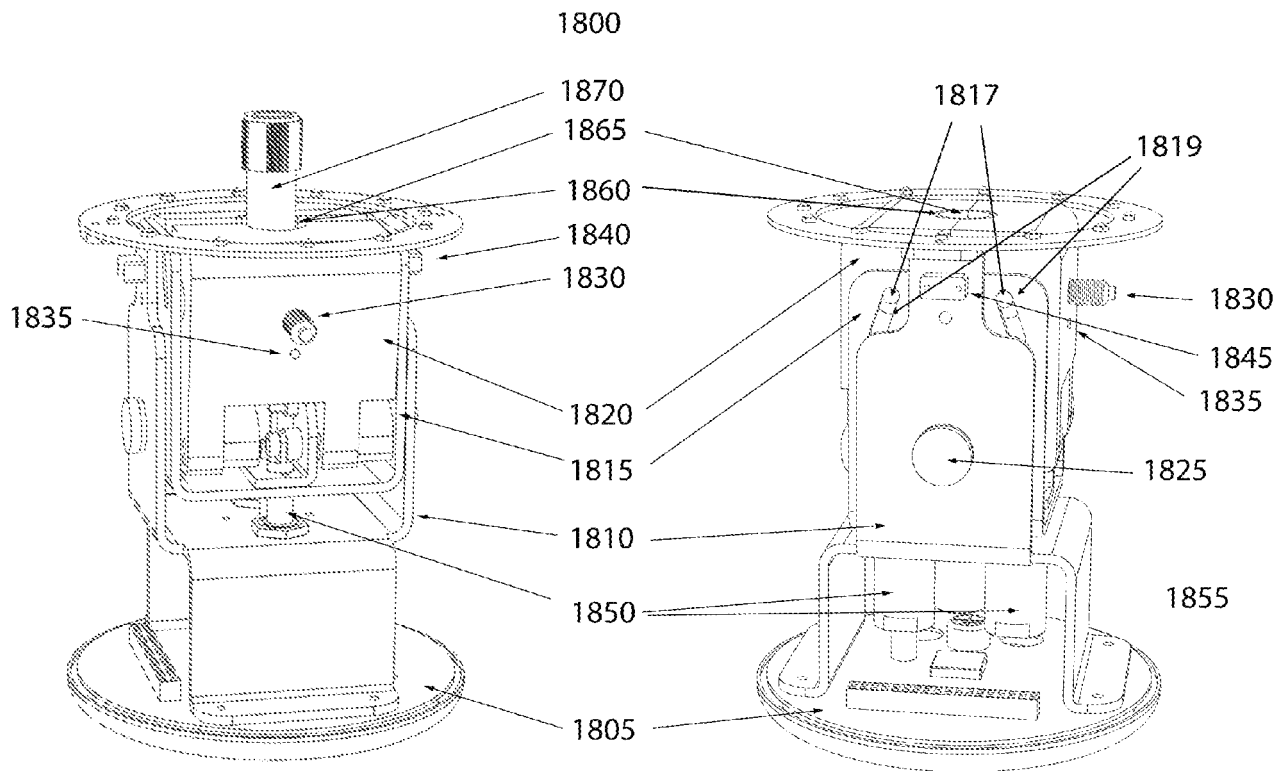
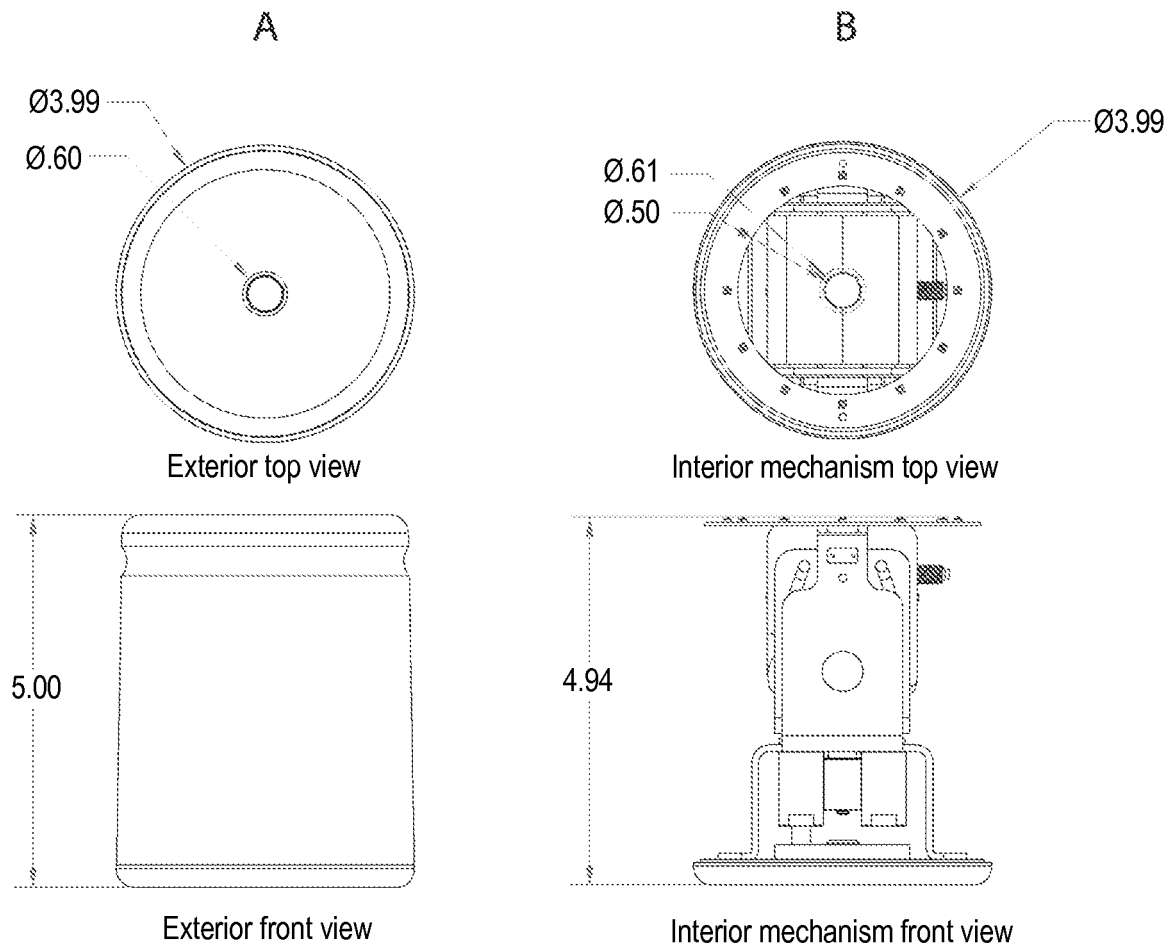


Figure 18

22/27

**Figure 19**

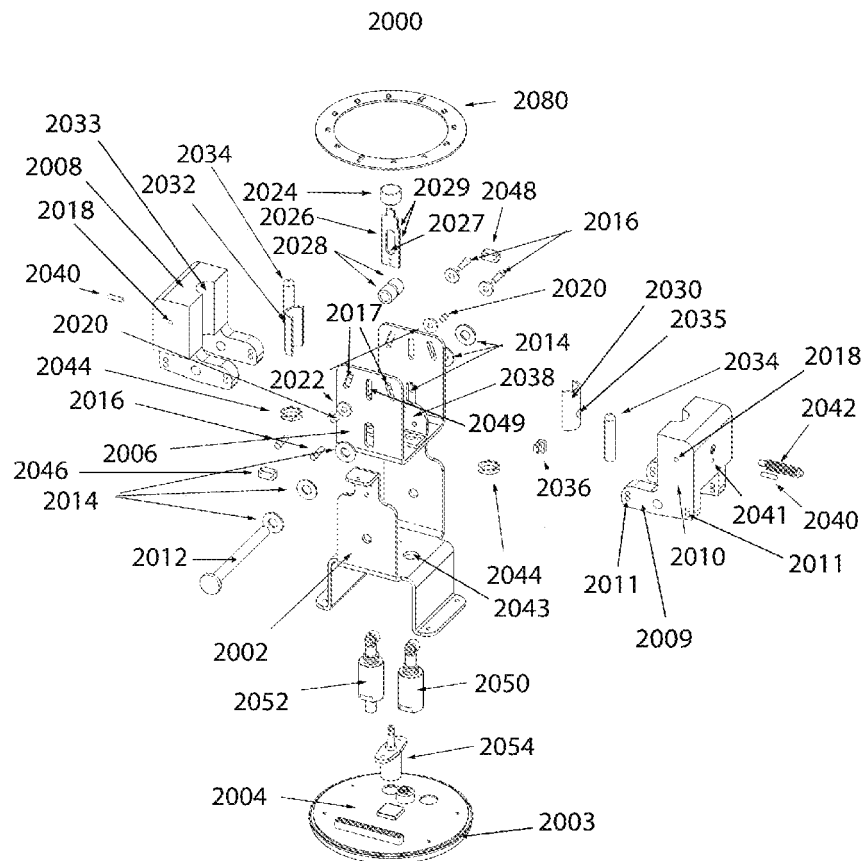


Figure 20

24/27

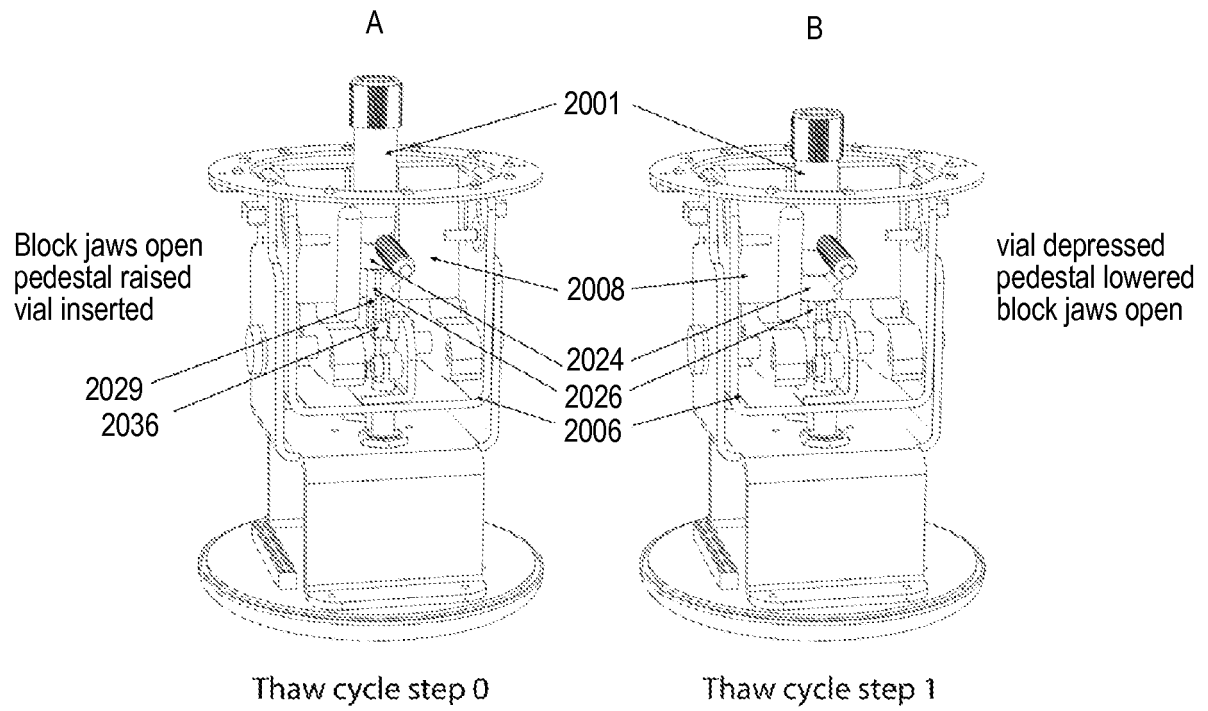


Figure 21

25/27

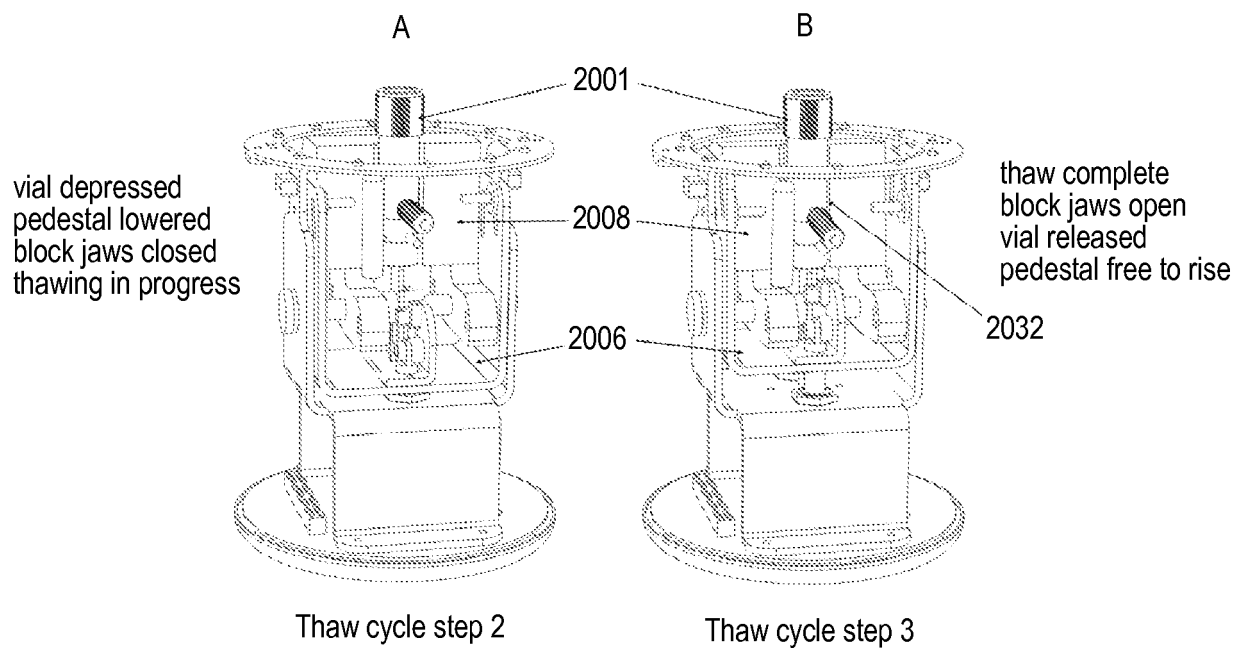


Figure 22

26/27

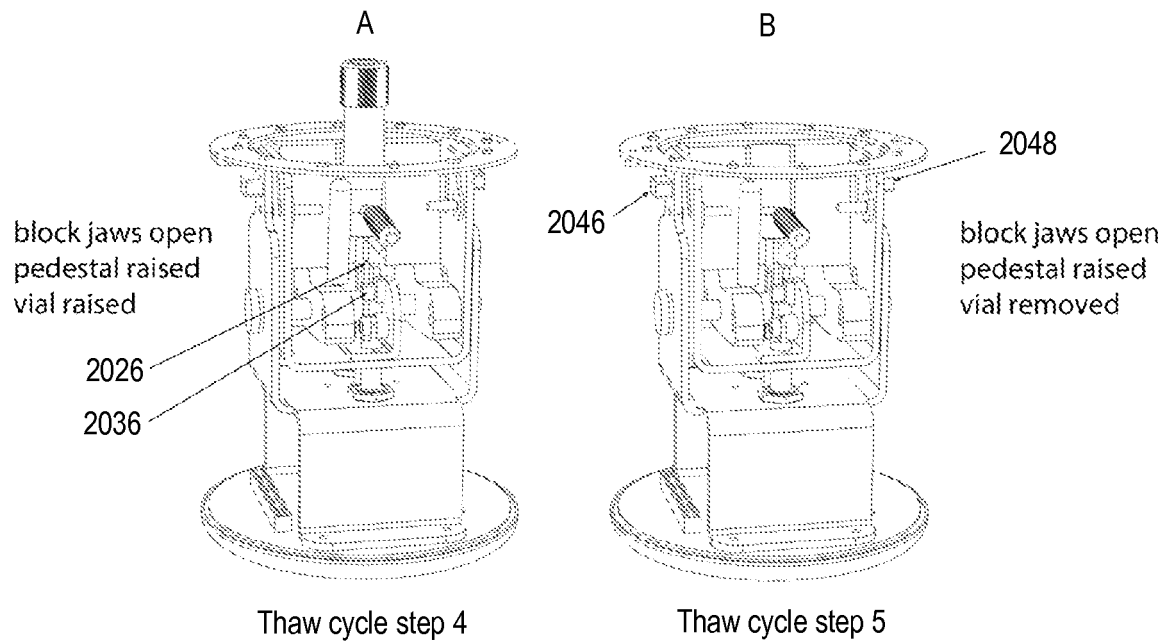


Figure 23

27/27

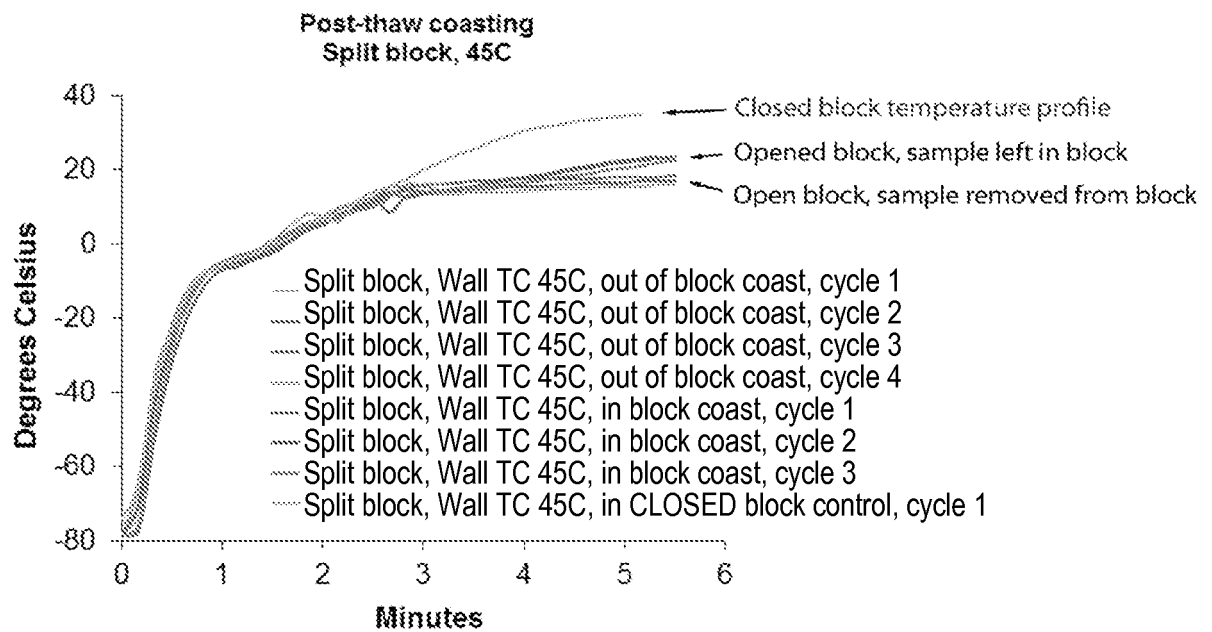


Figure 24