FIG. 1

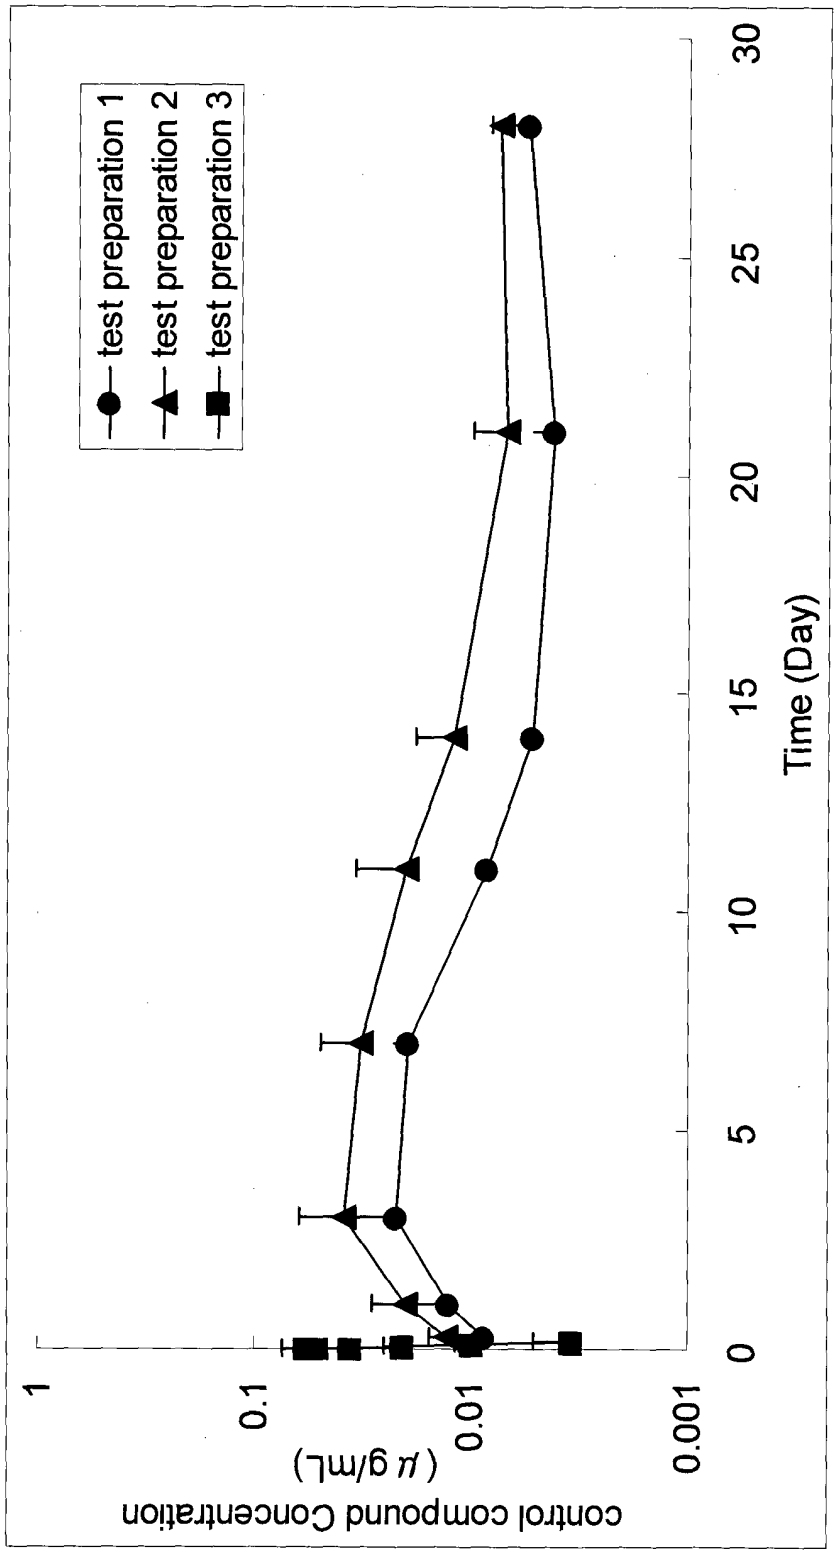
test preparation 1
test preparation 2
test preparation 3
control compound Concentration
(μg/mL)
1
0.1
0.01
0.001
0
5
10
15
20
25
30
Time (Day)