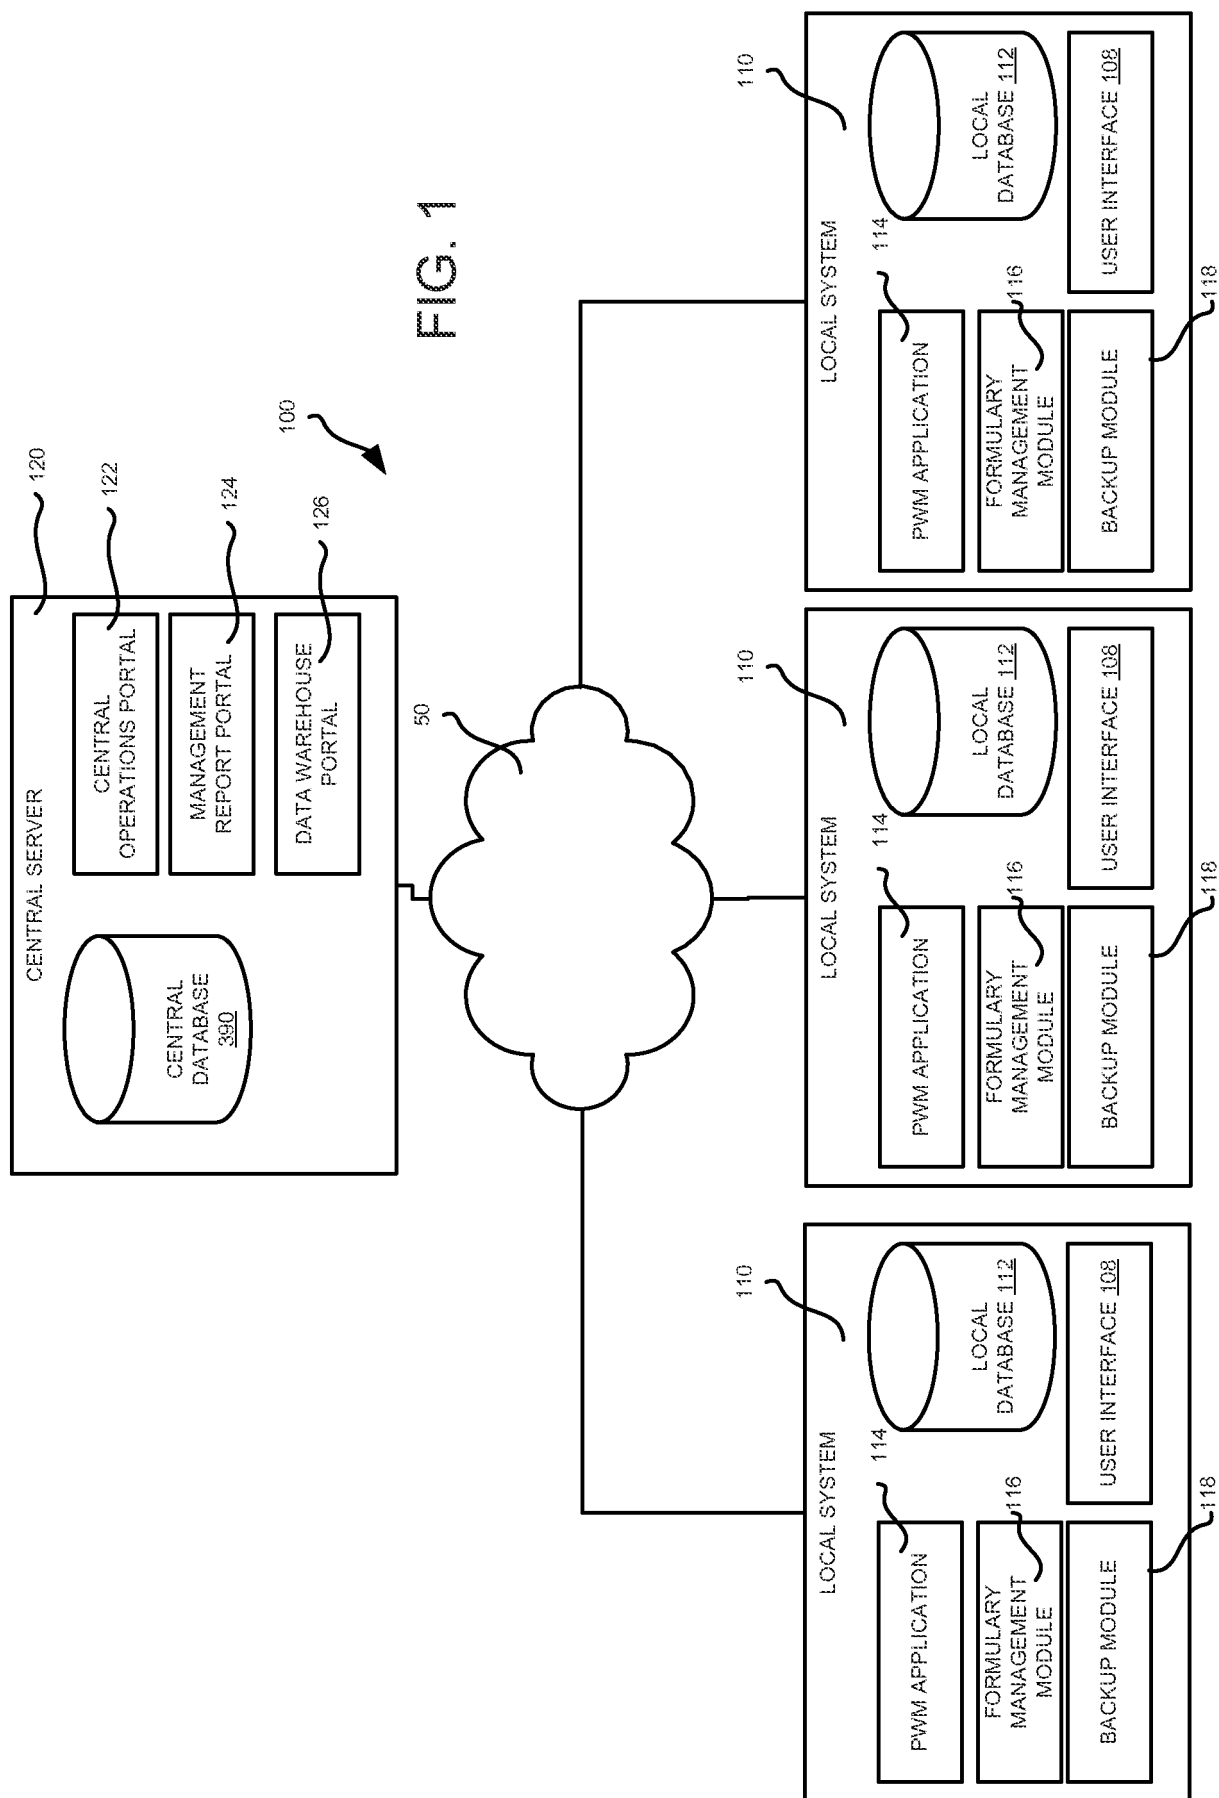
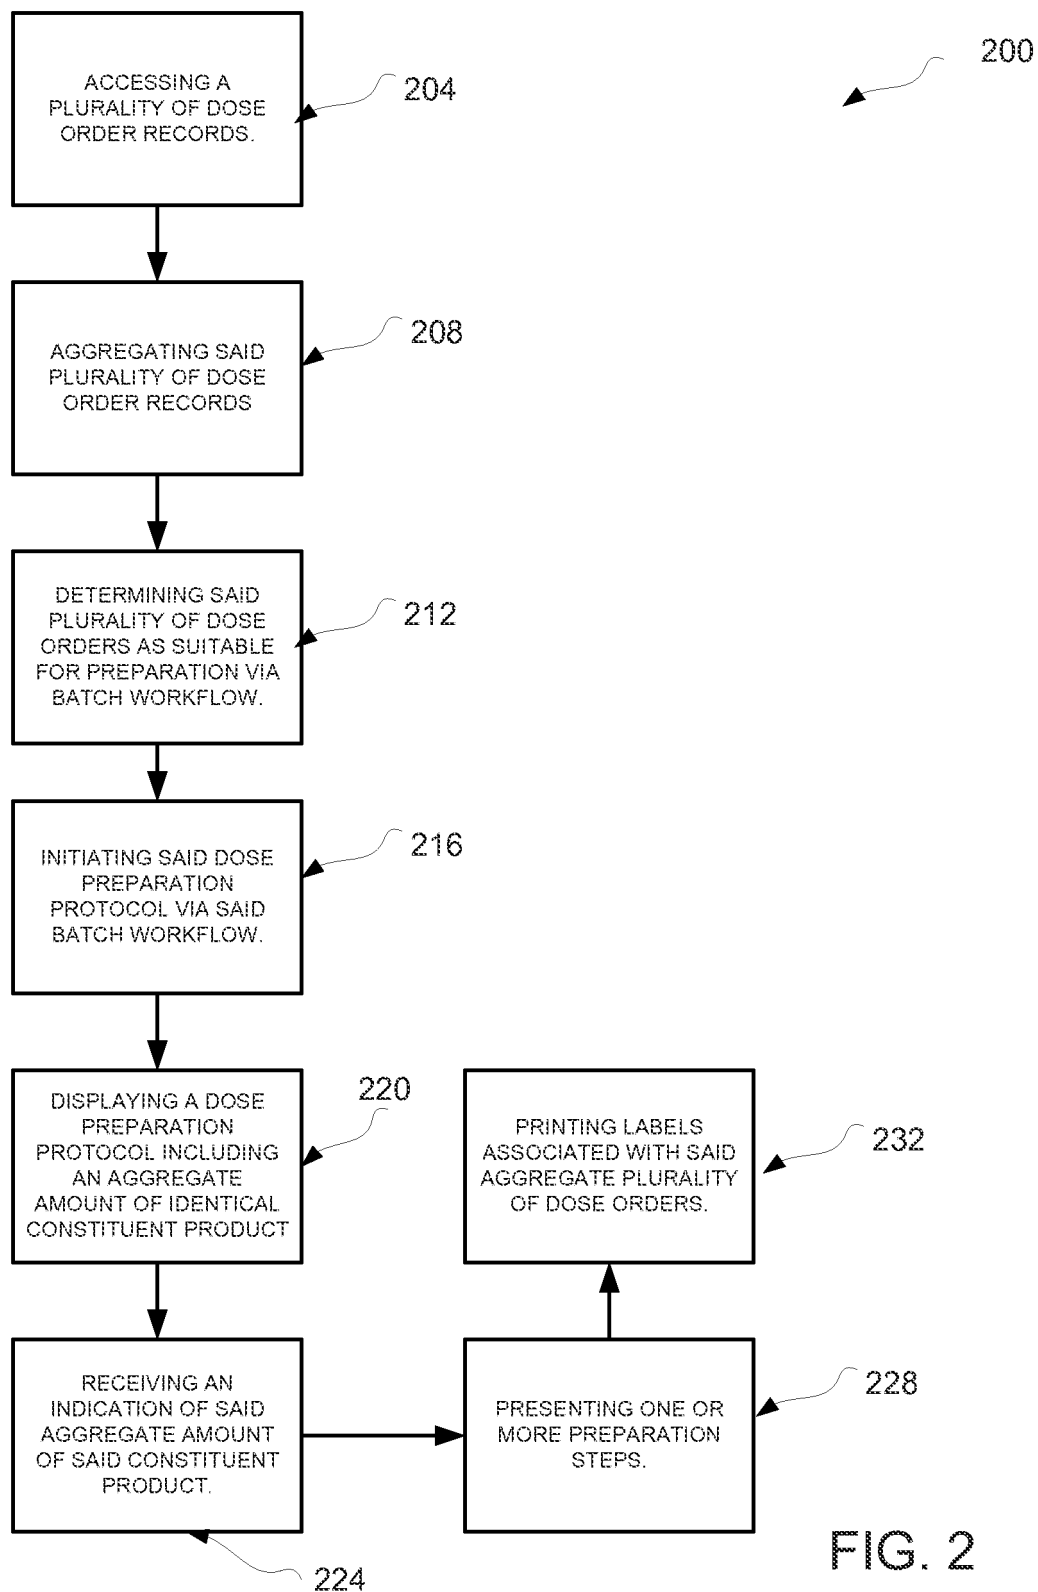






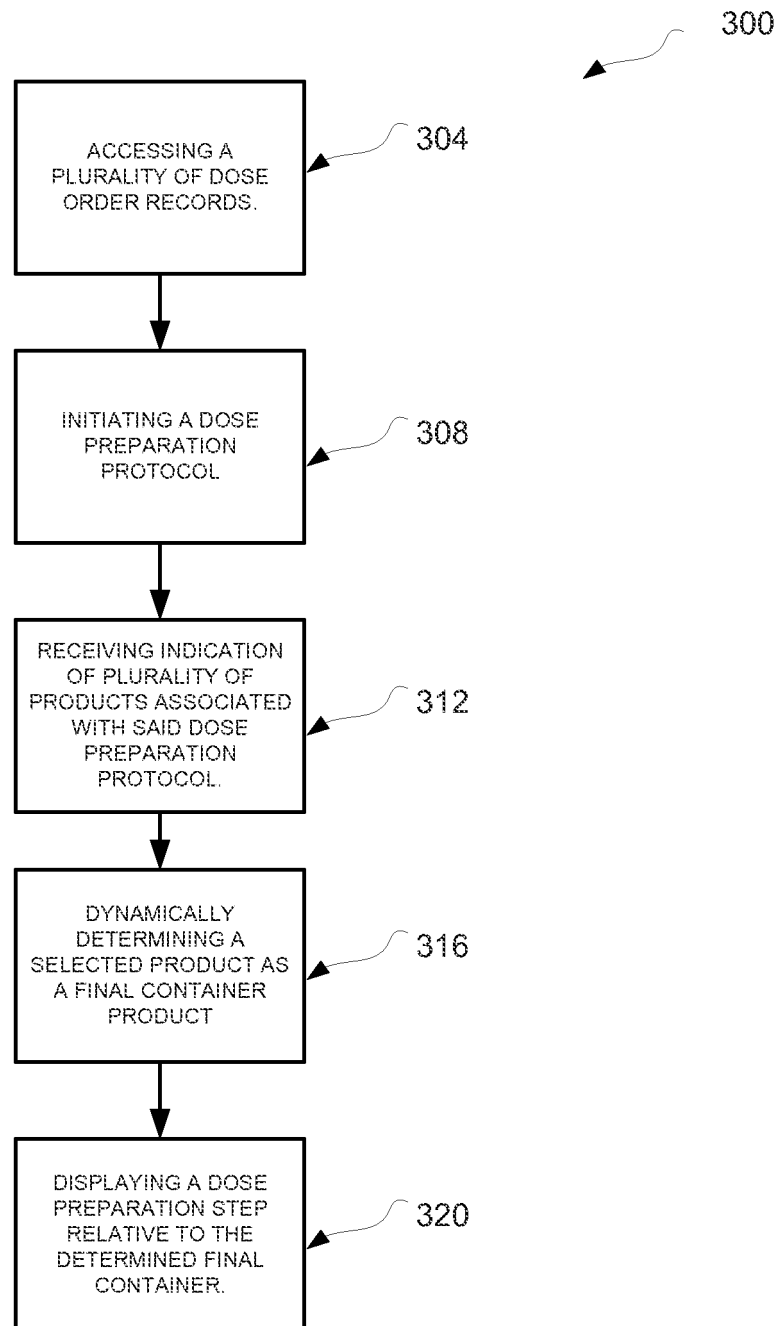


FIG. 3

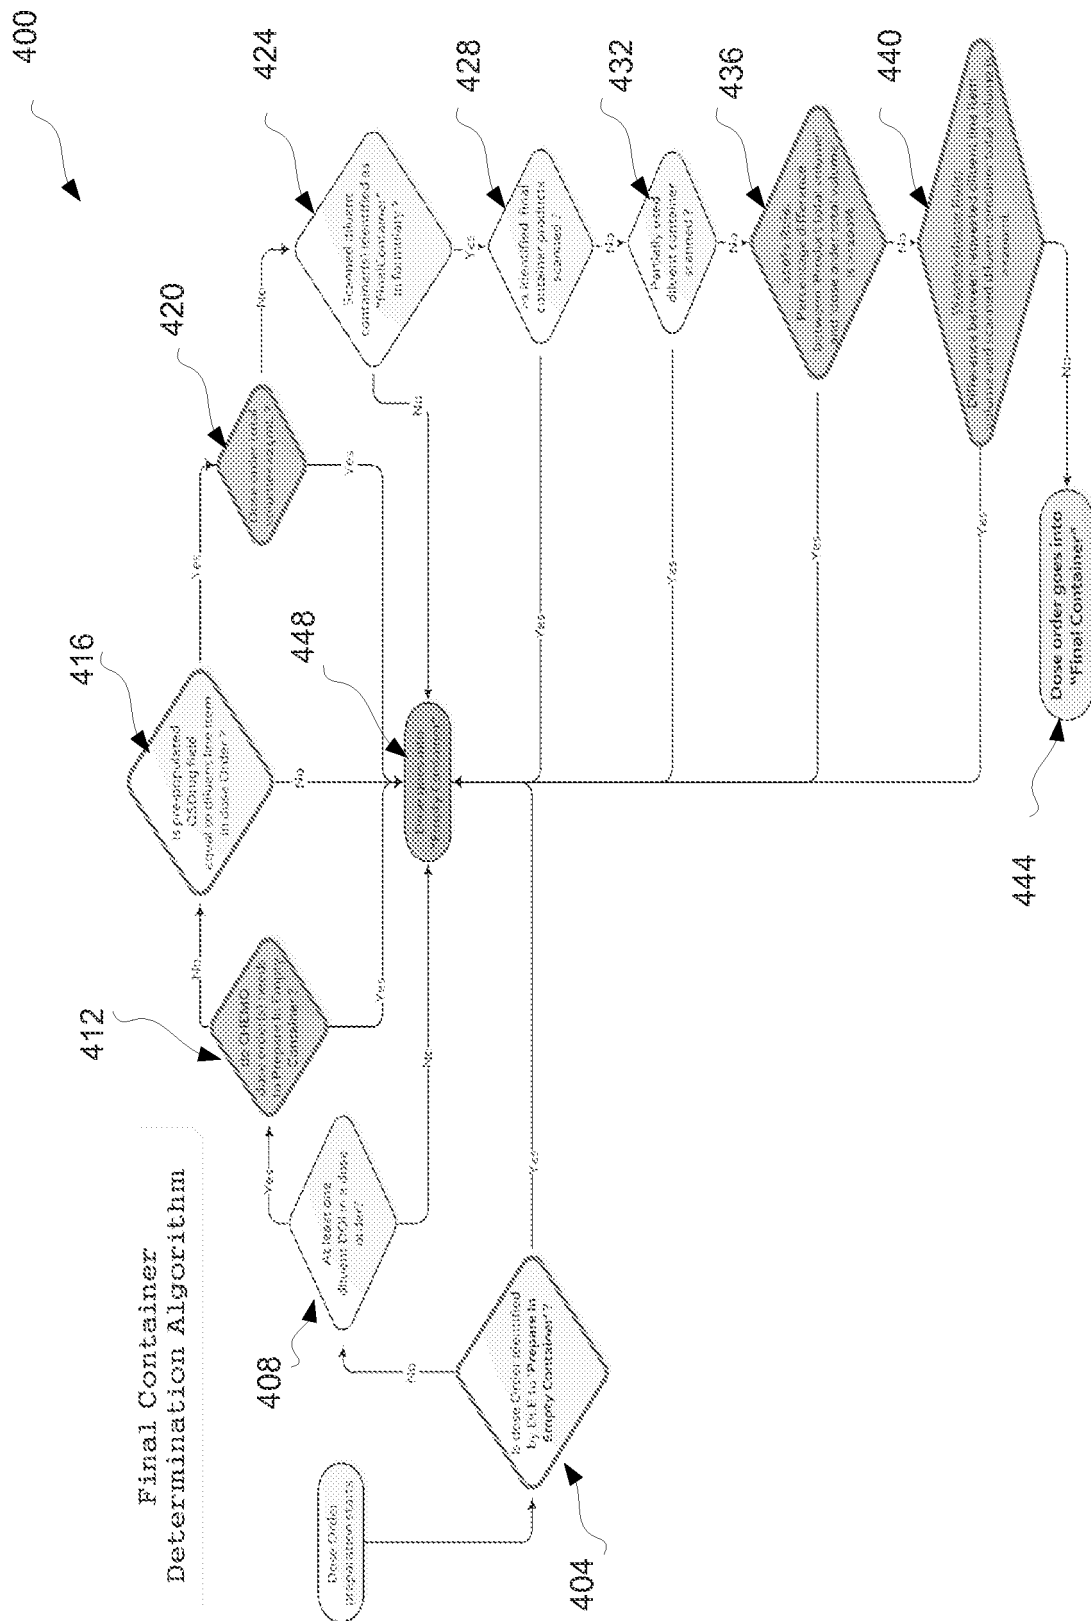
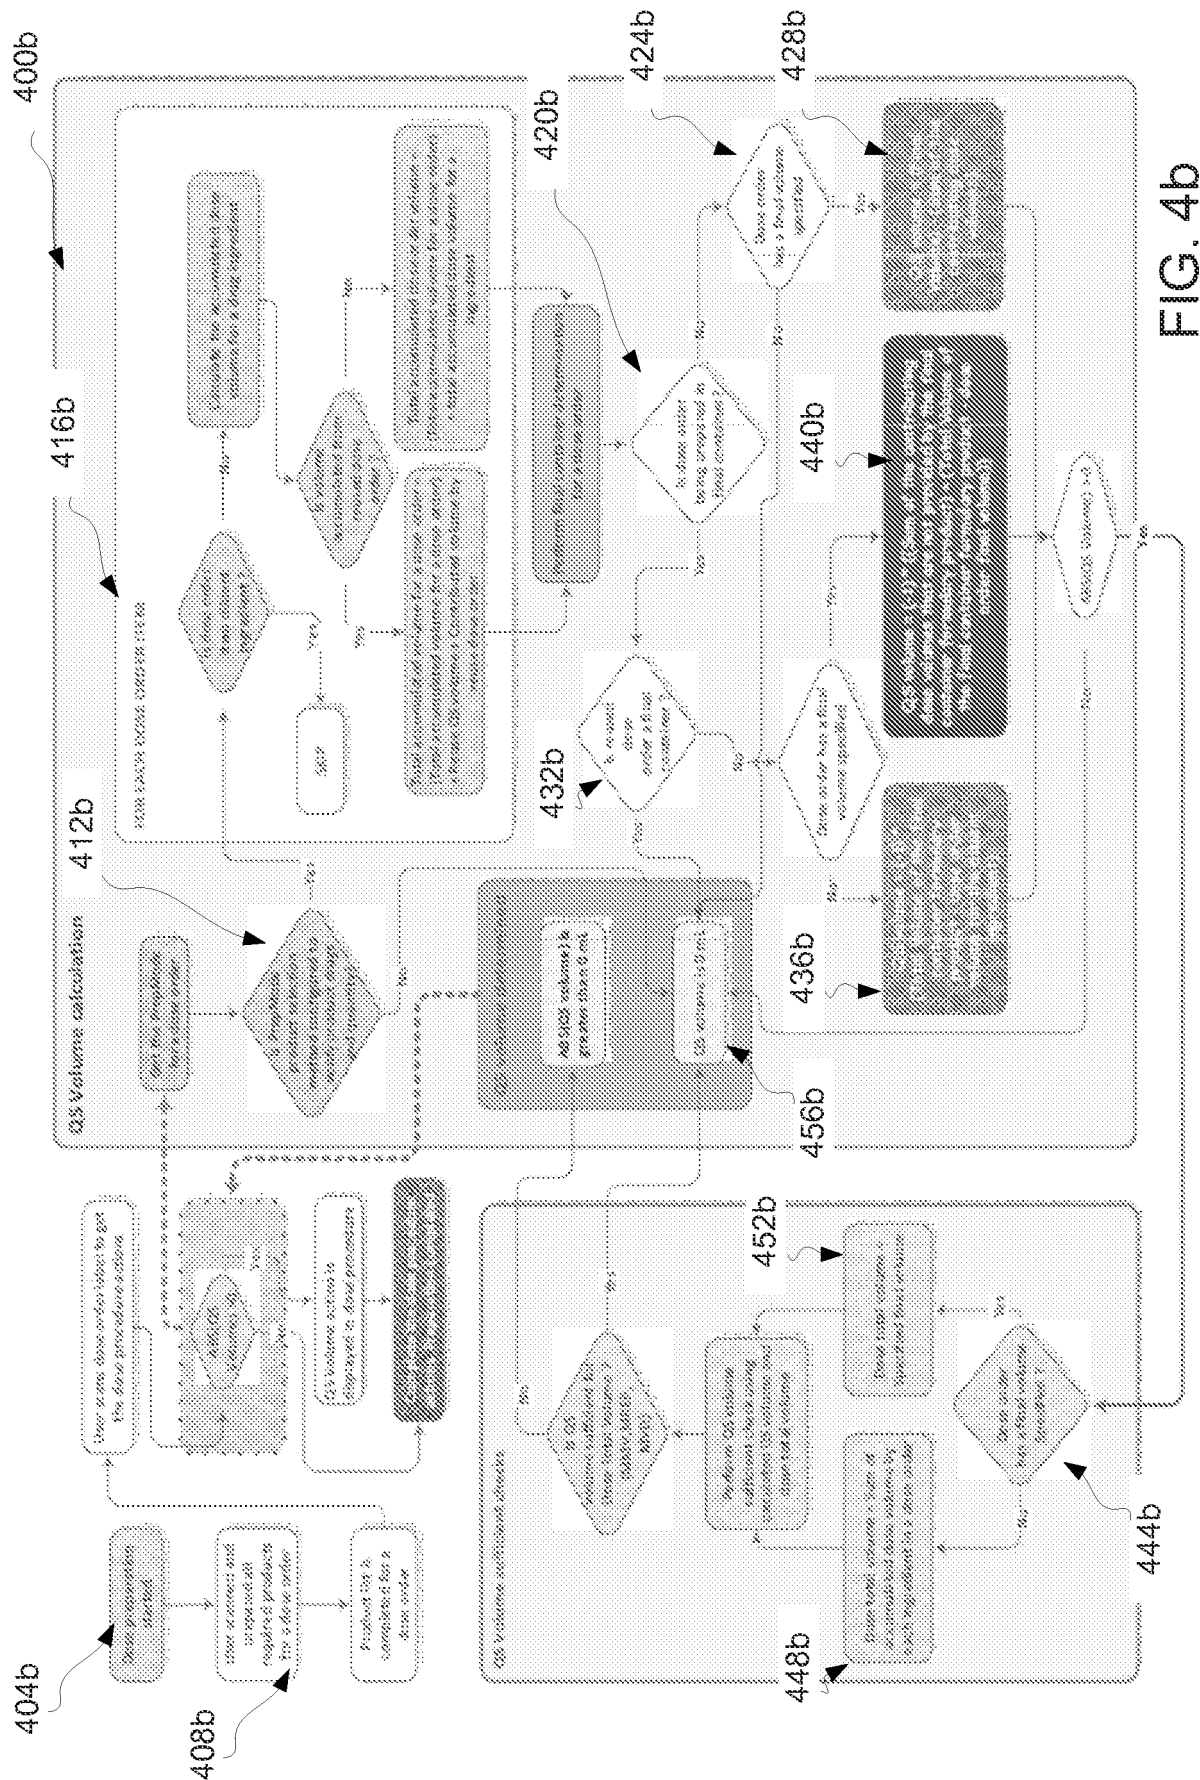


FIG. 4a



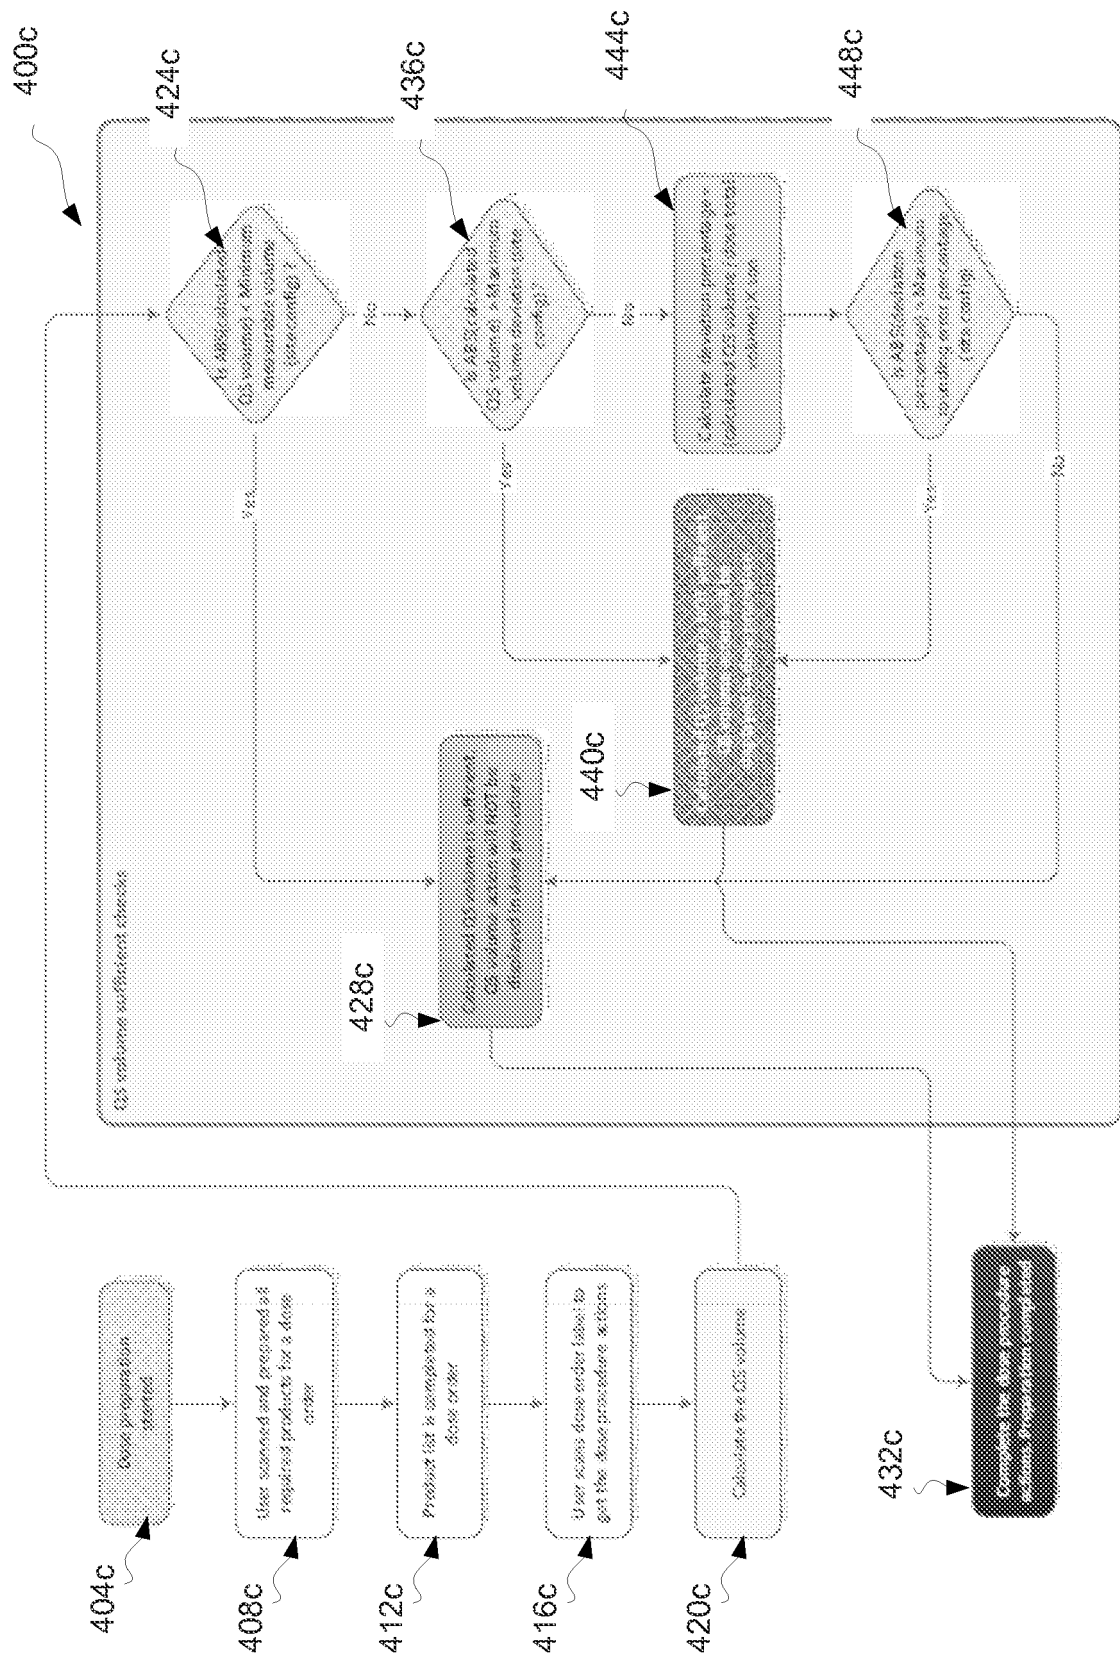


FIG. 4C

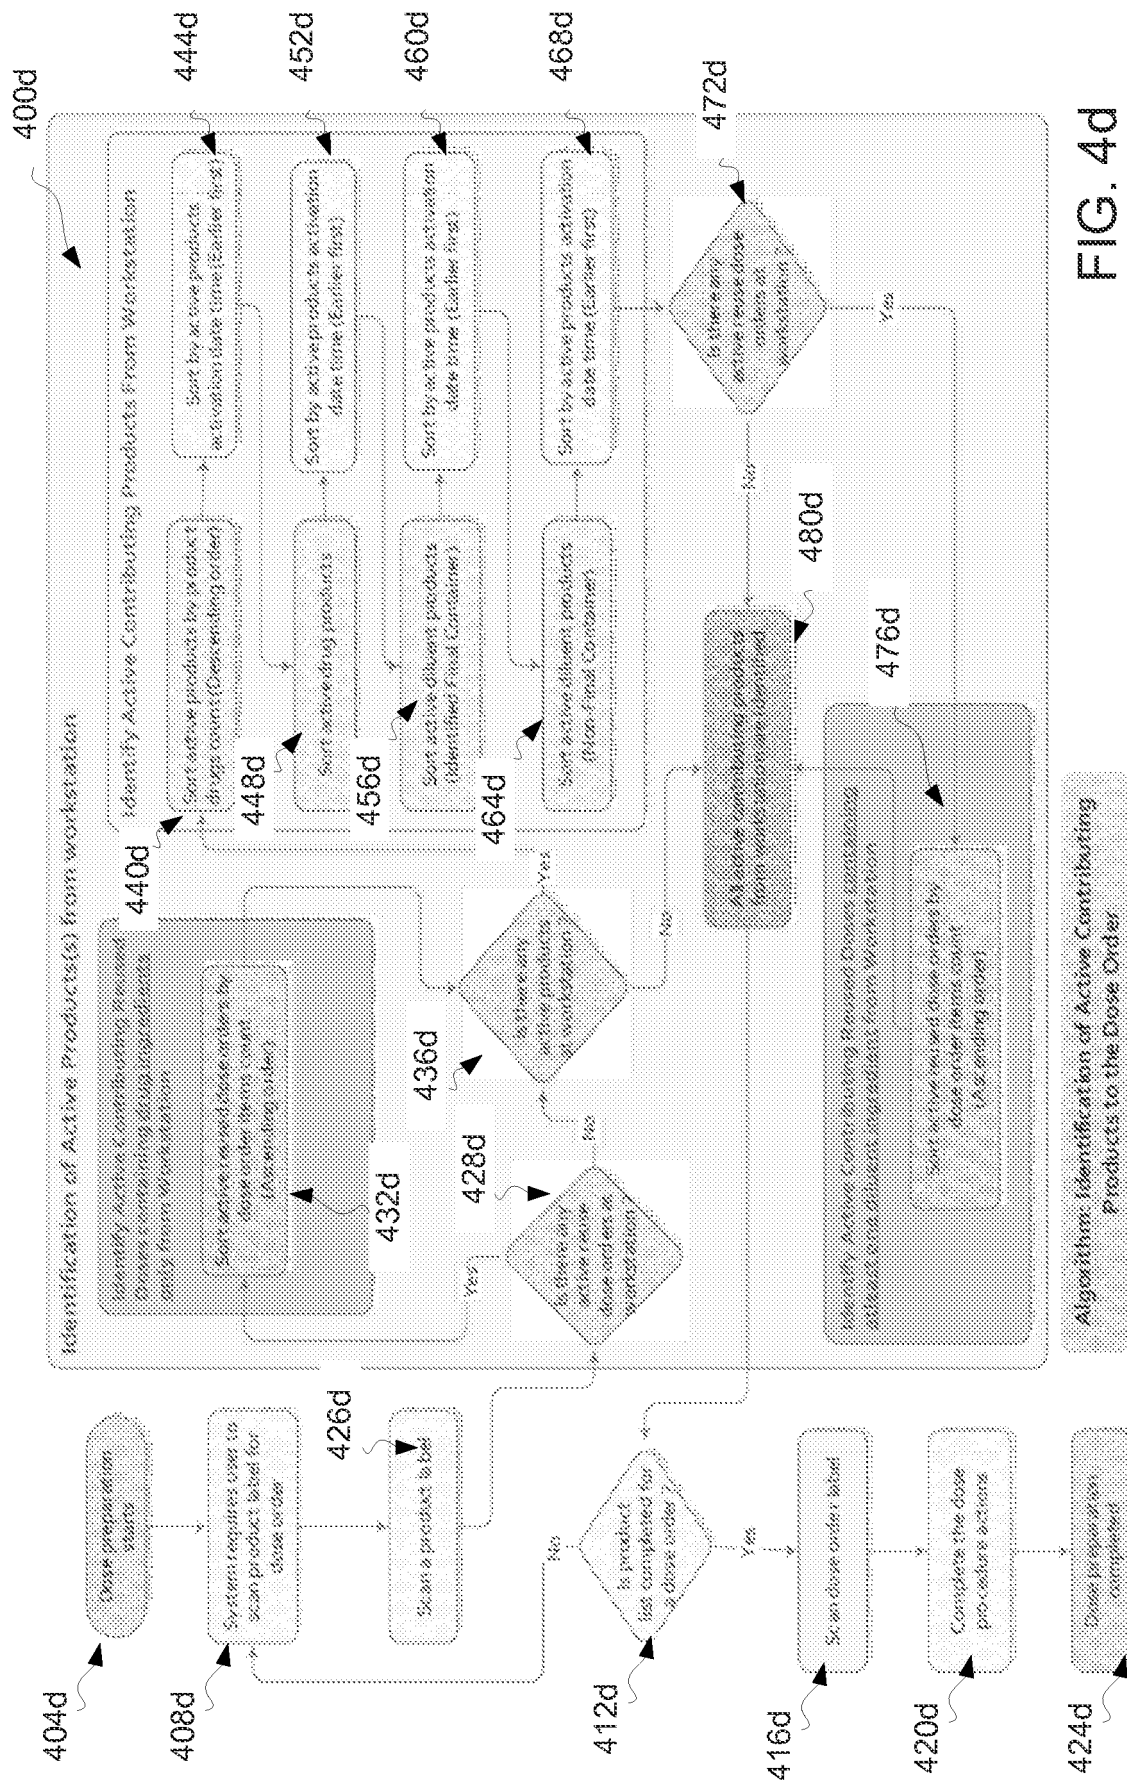


Figure 6 Identification of Active Product(s) from Workstation

400e

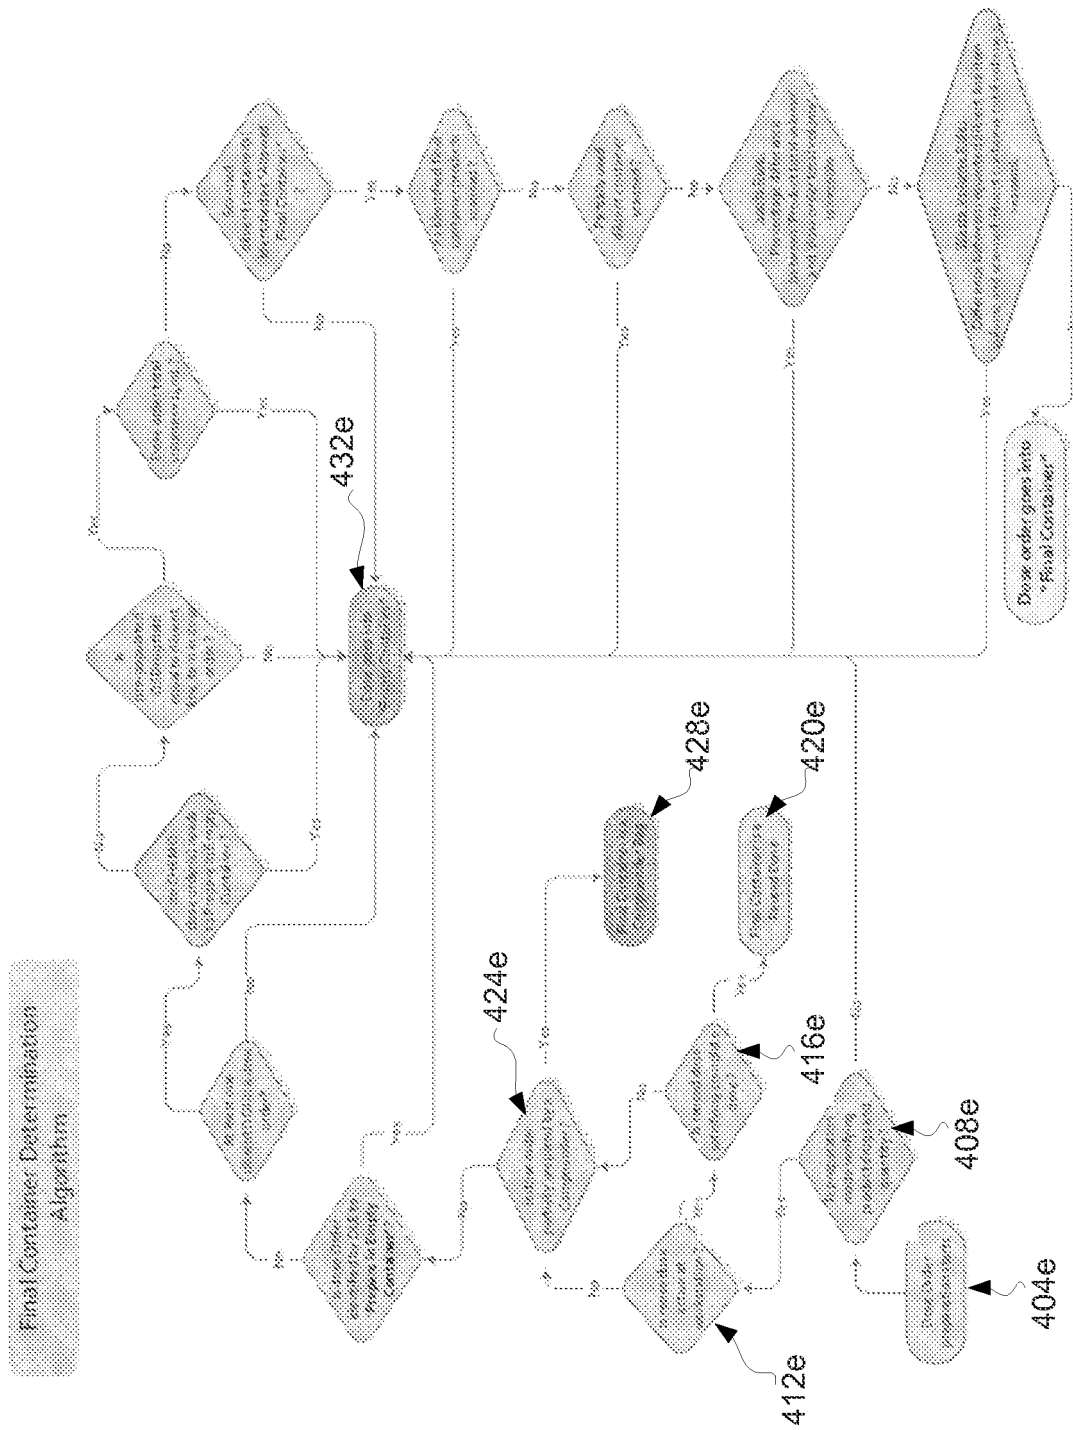


Figure 2 Flow Chart of Final Container Determination


FIG. 4e

500






 DEPARTMENT OF HEALTH AND HUMAN SERVICES

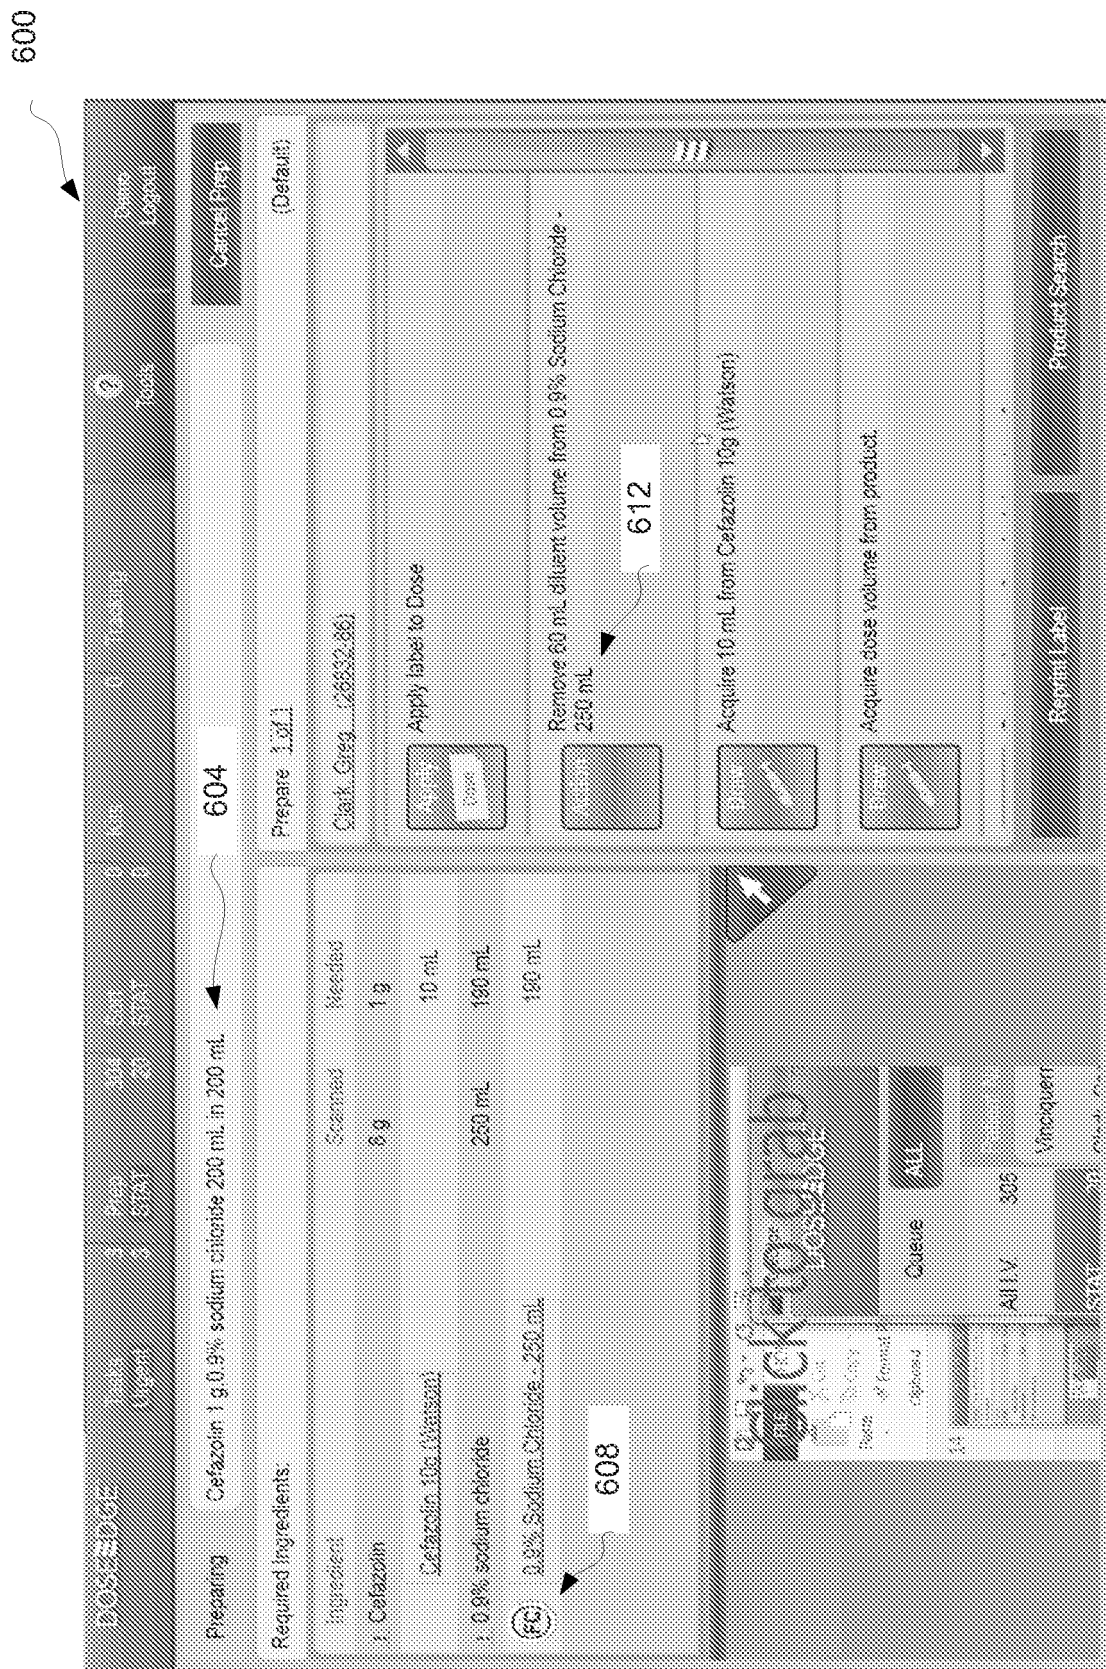



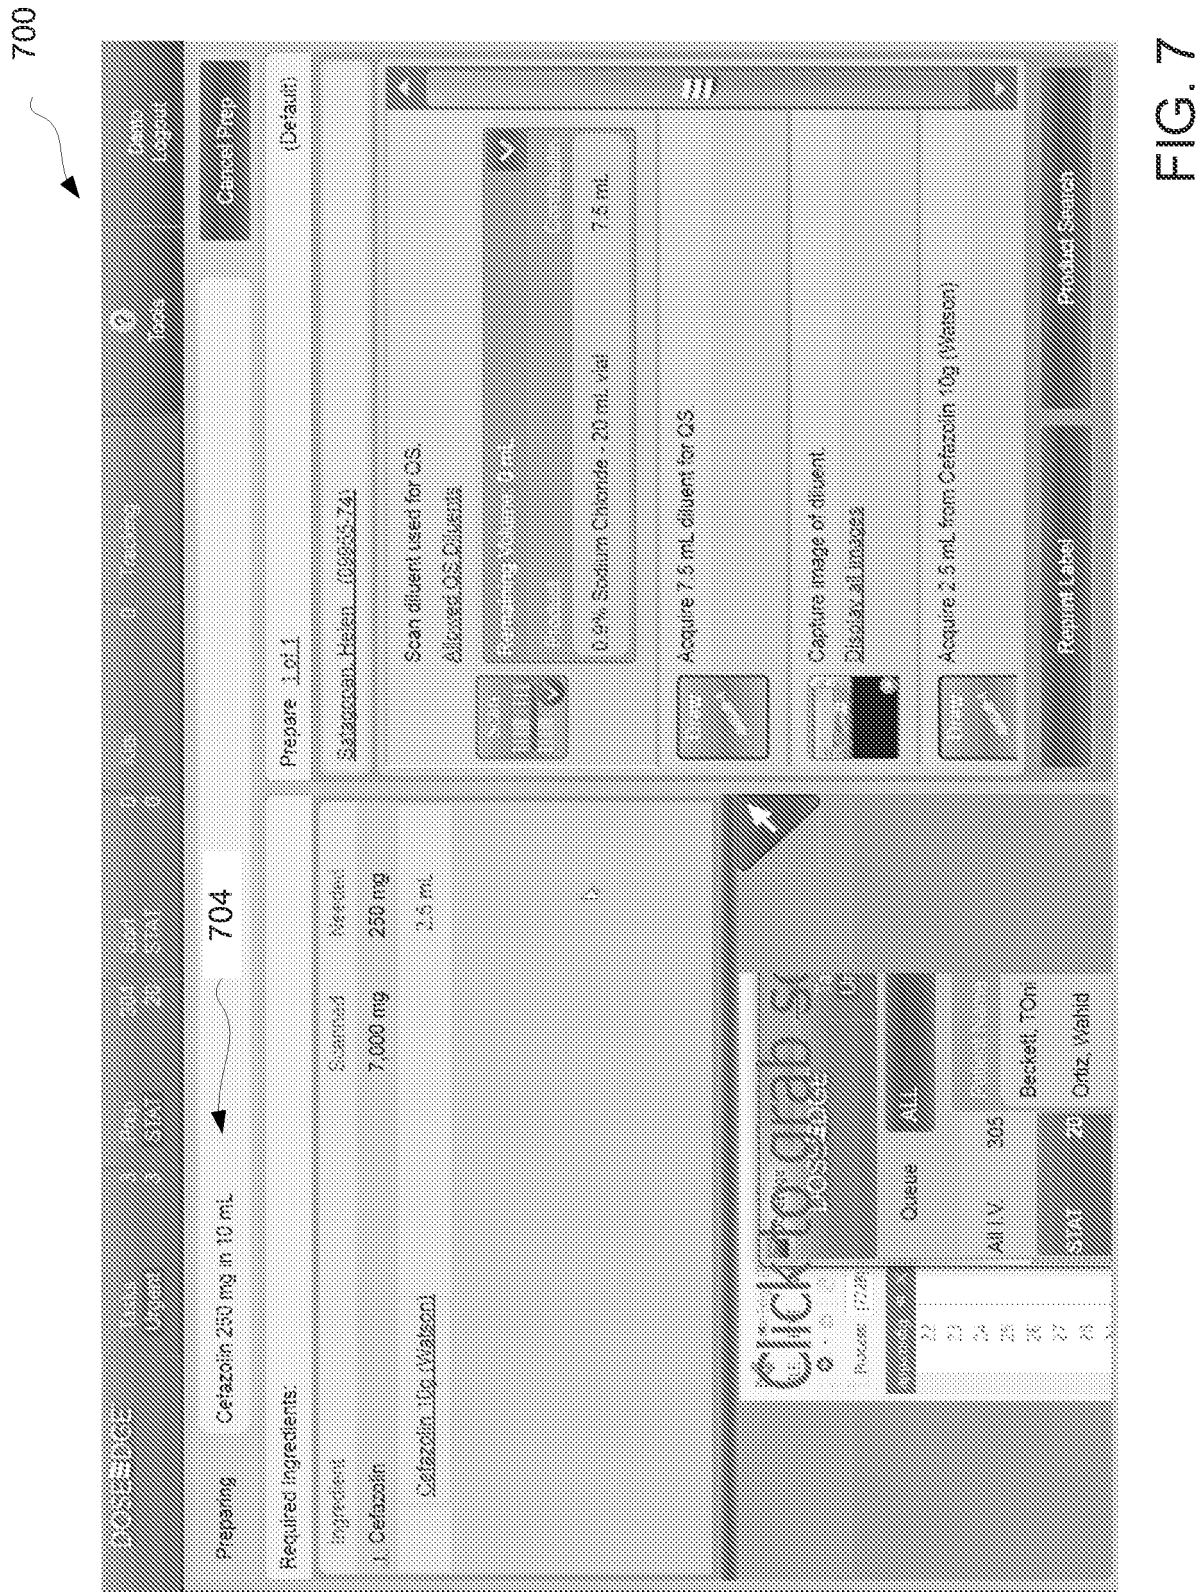





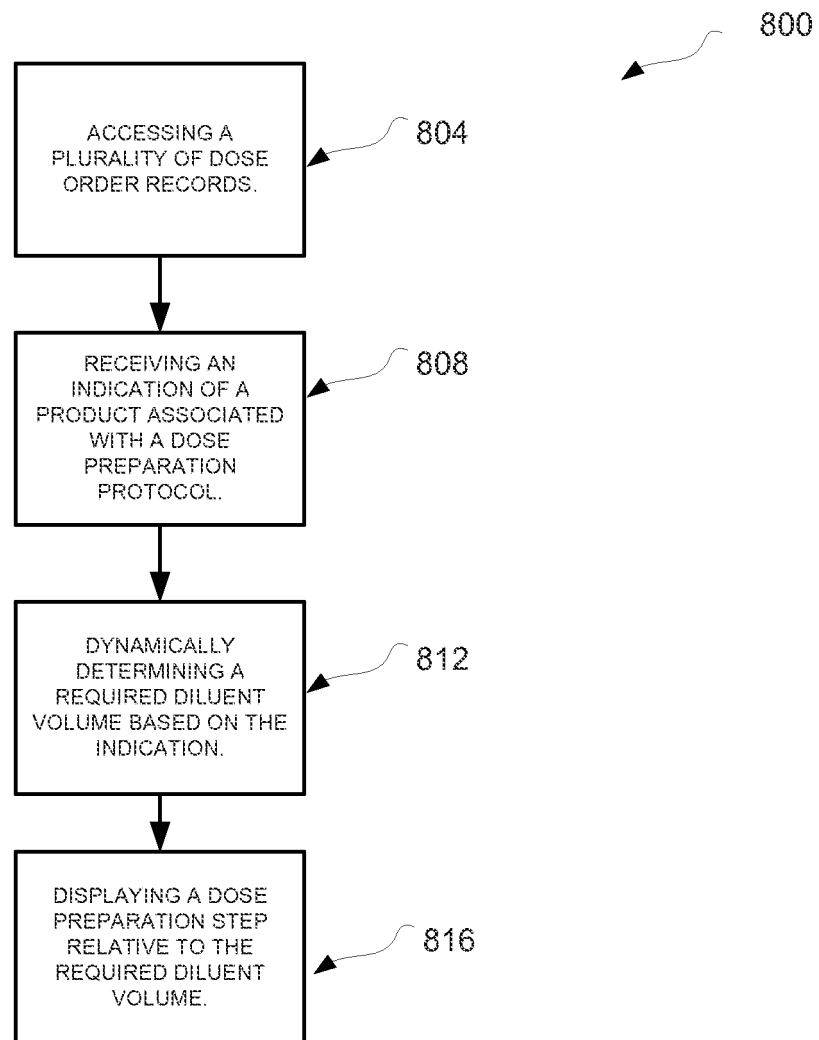


FIG. 8

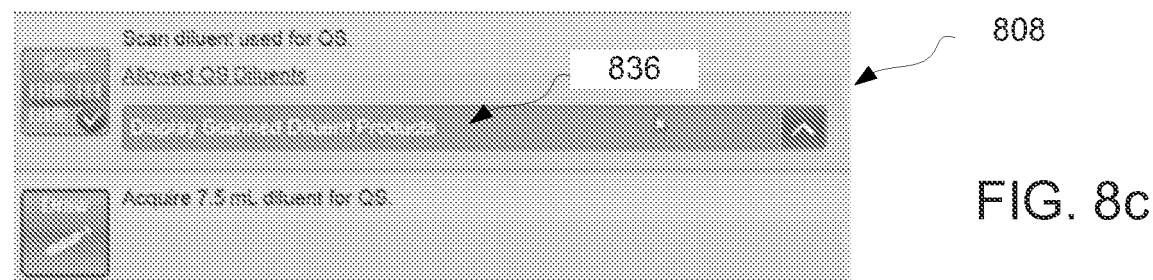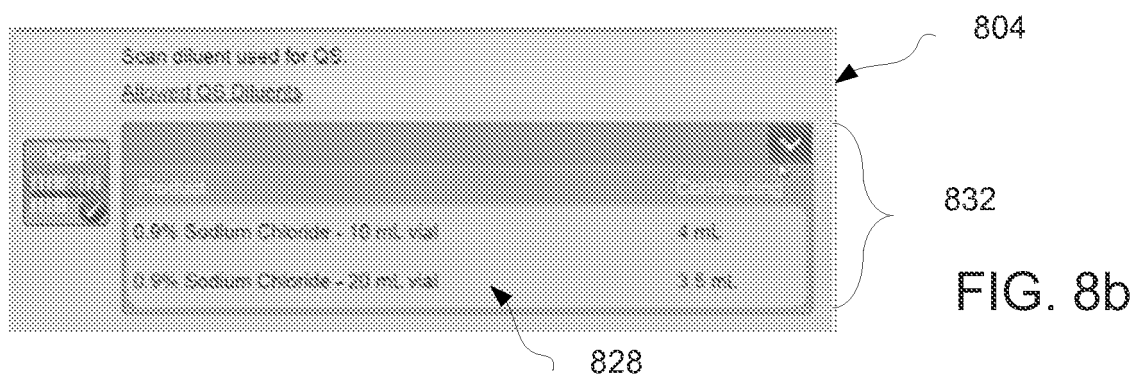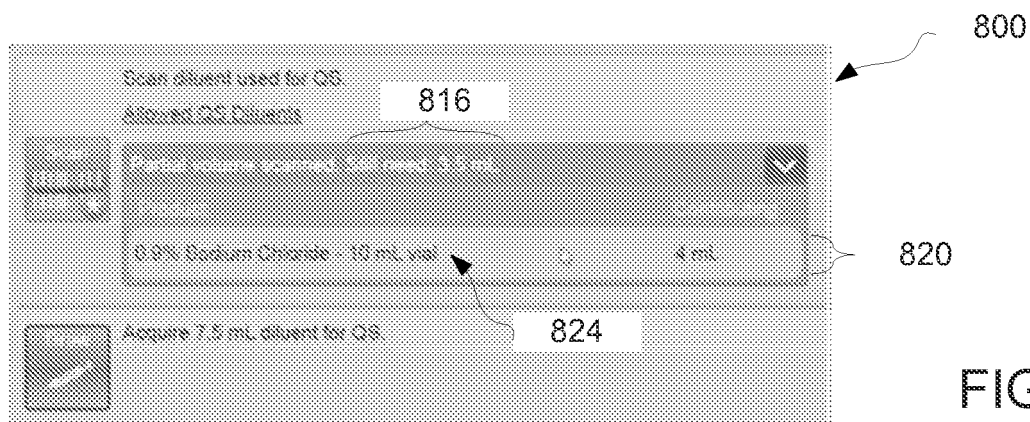

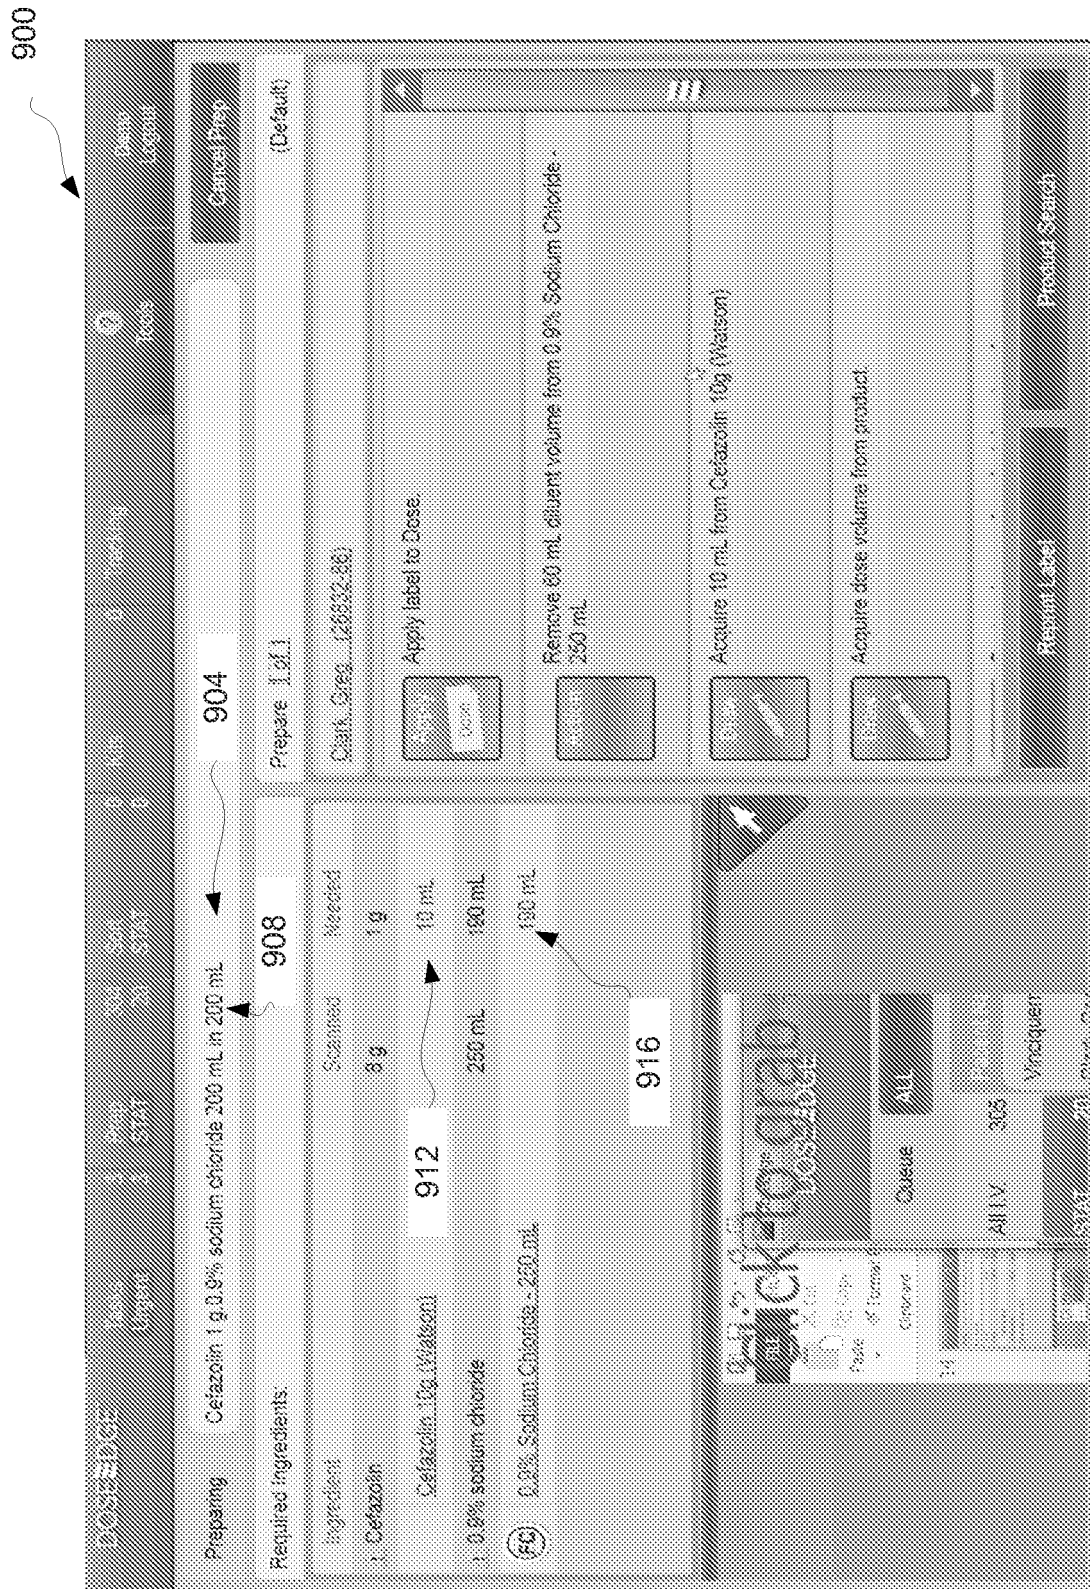

၁၅၆




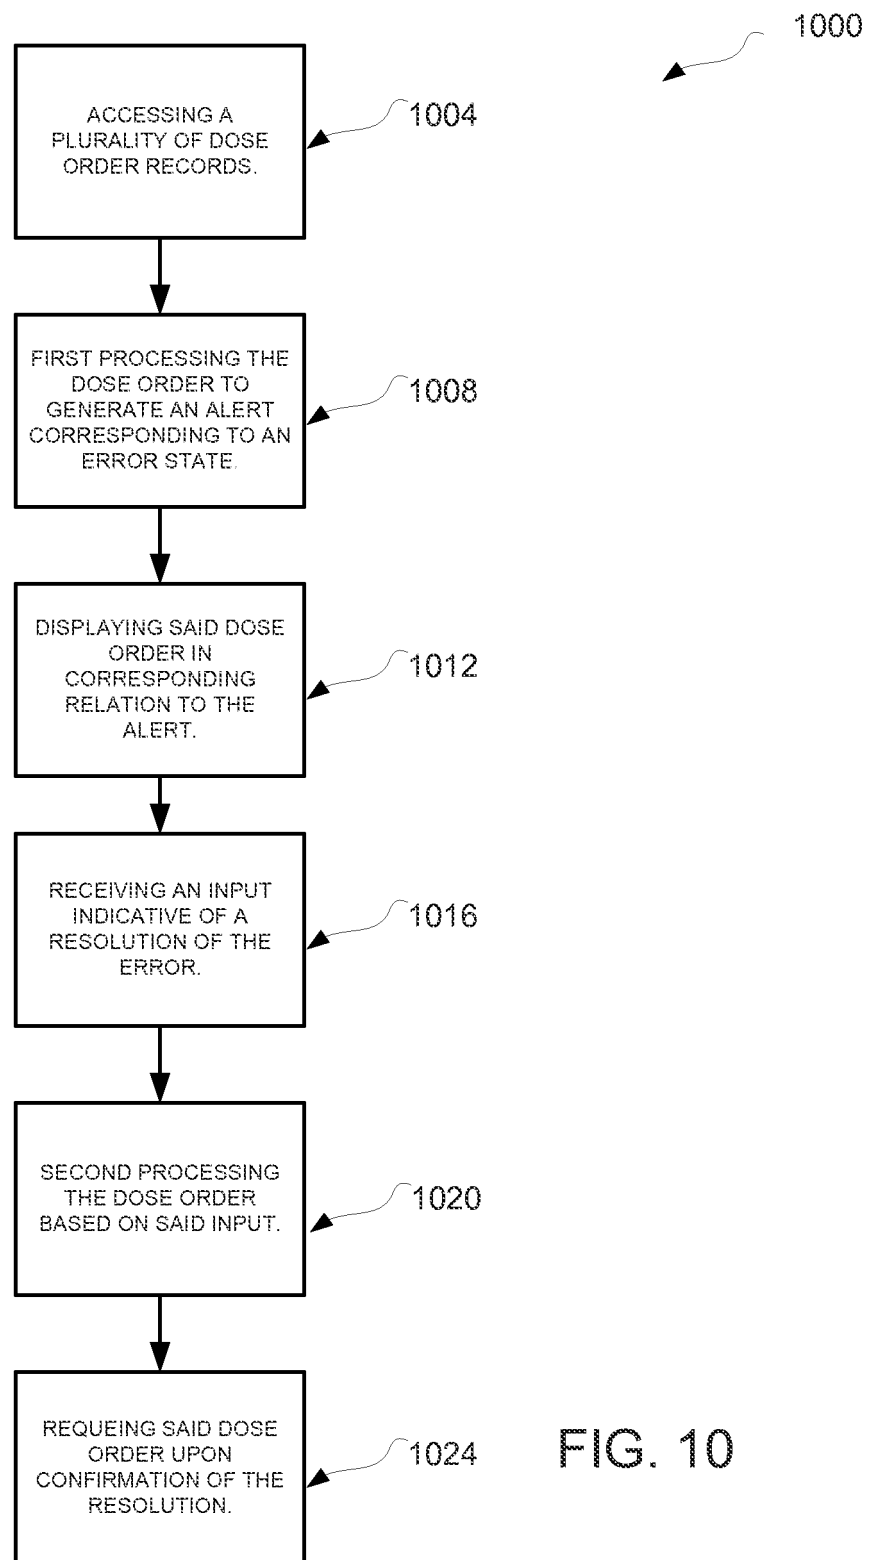



FIG. 10

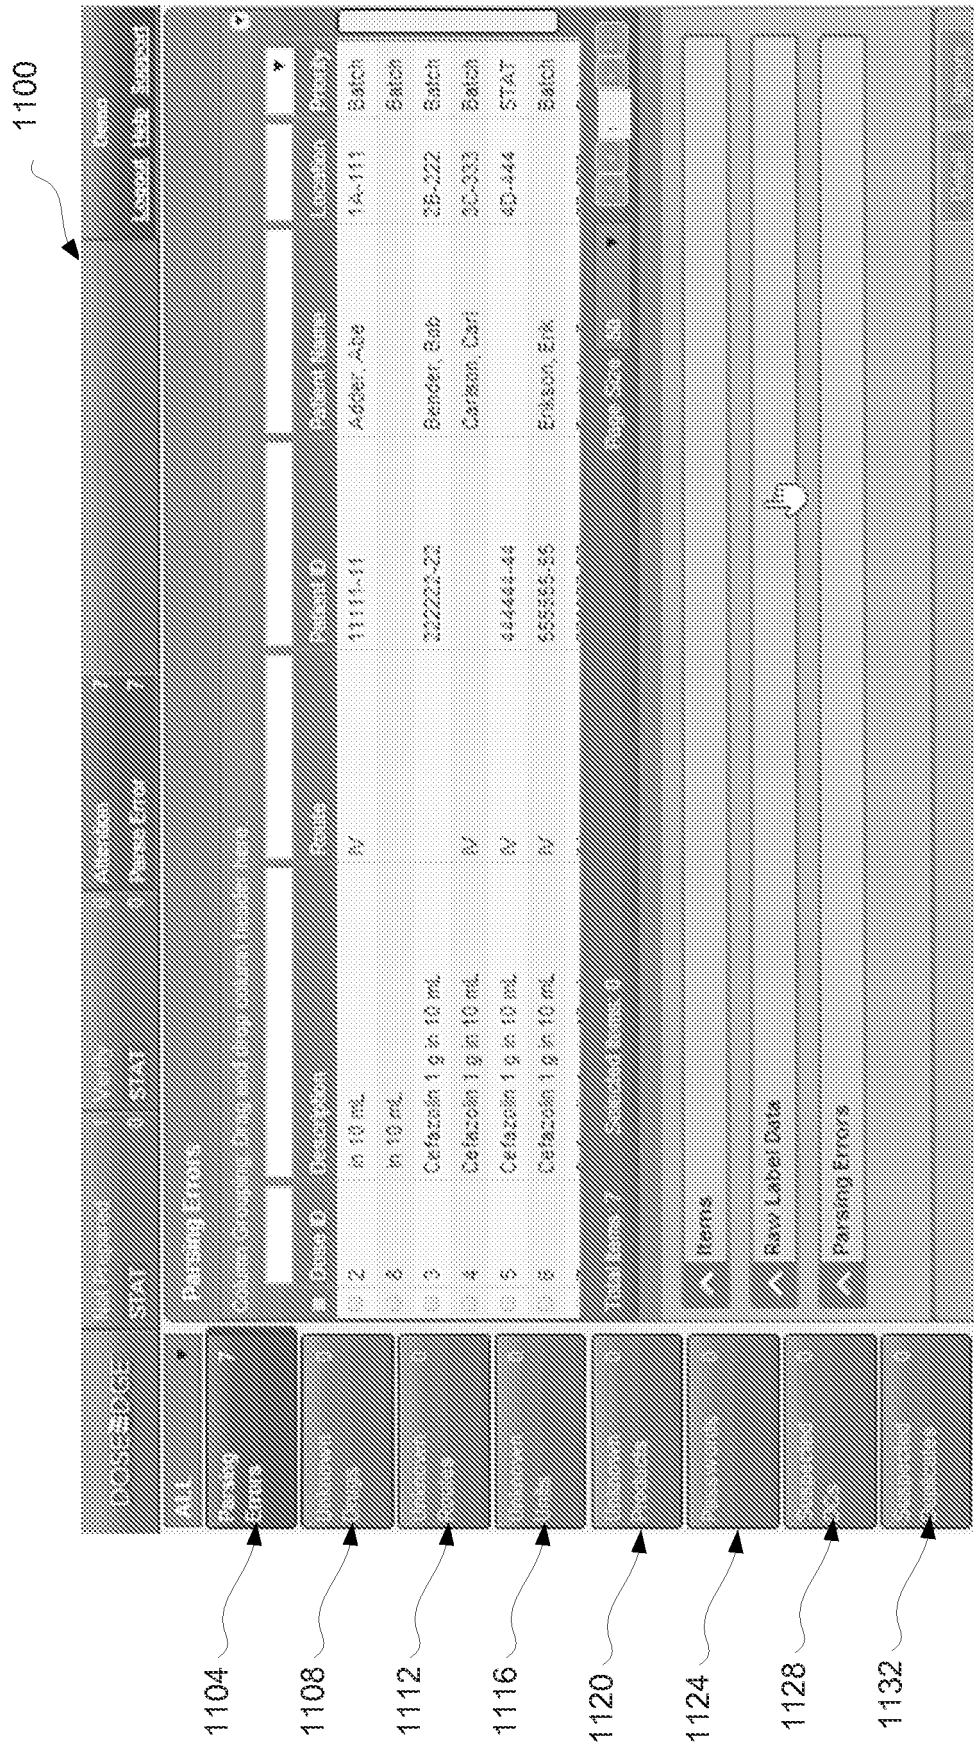

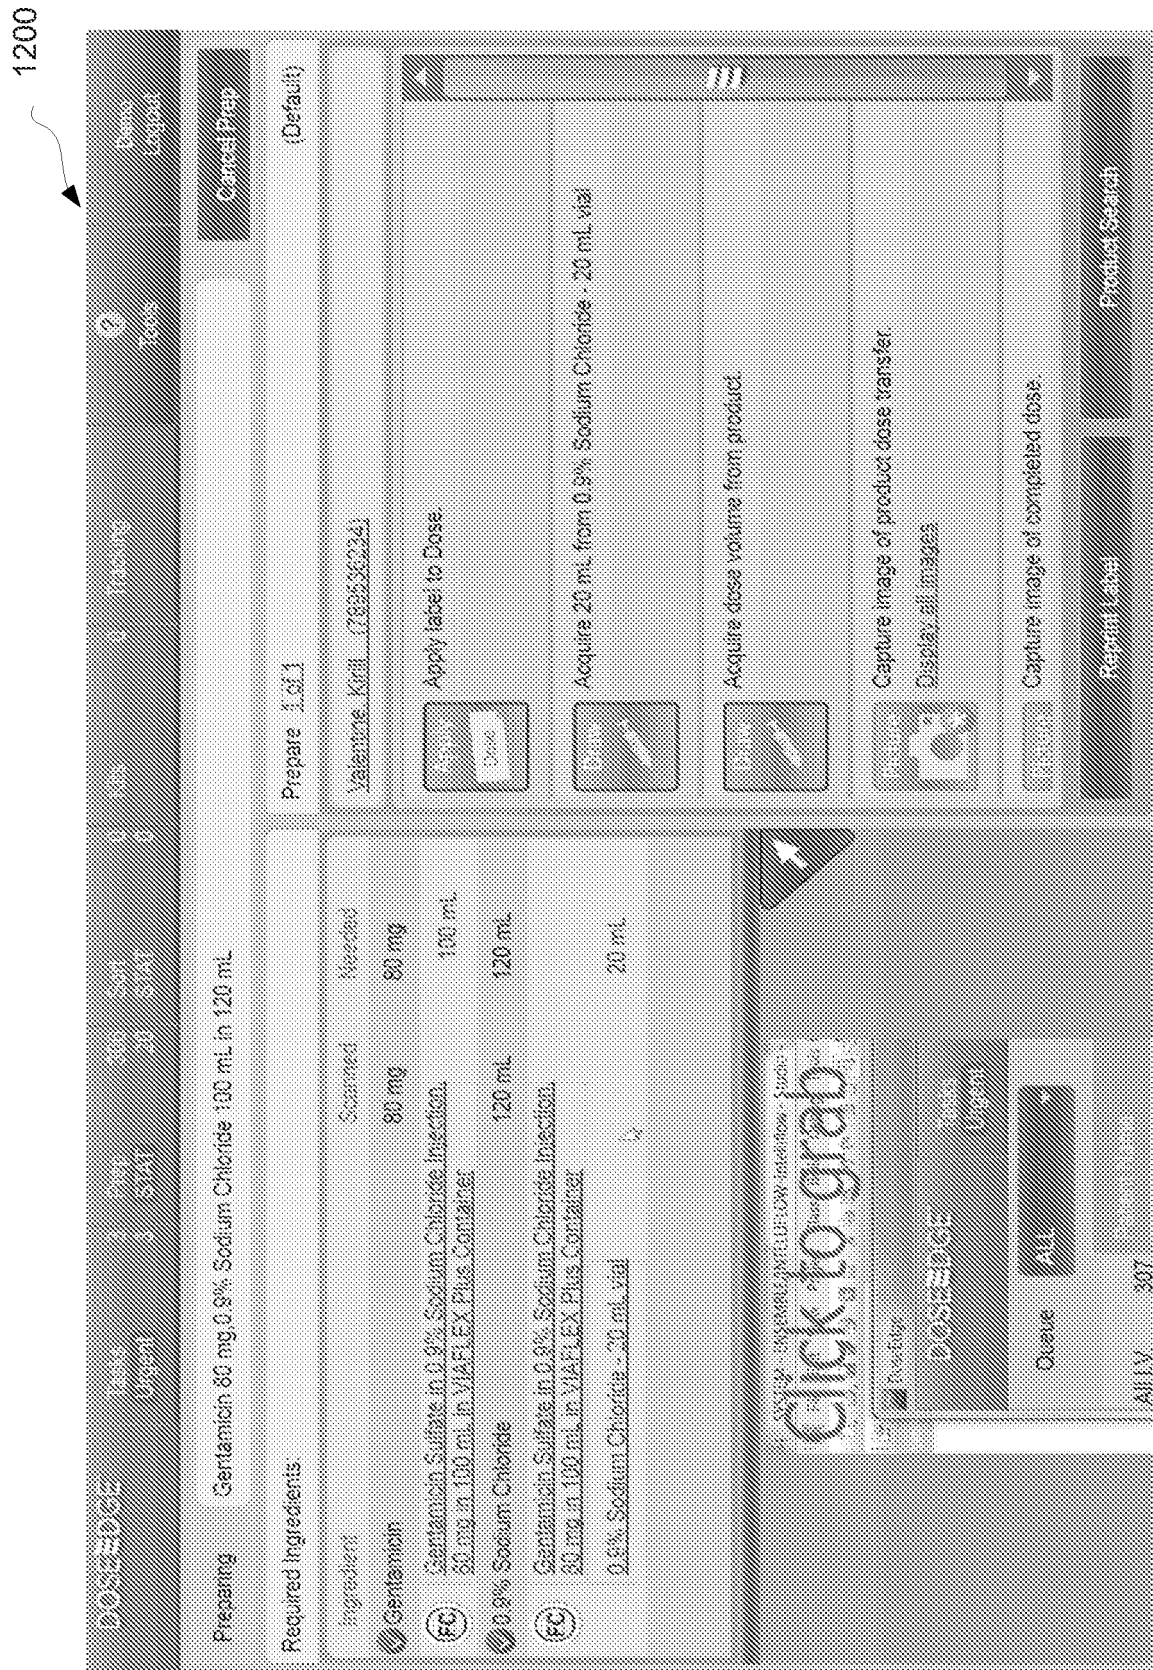

270

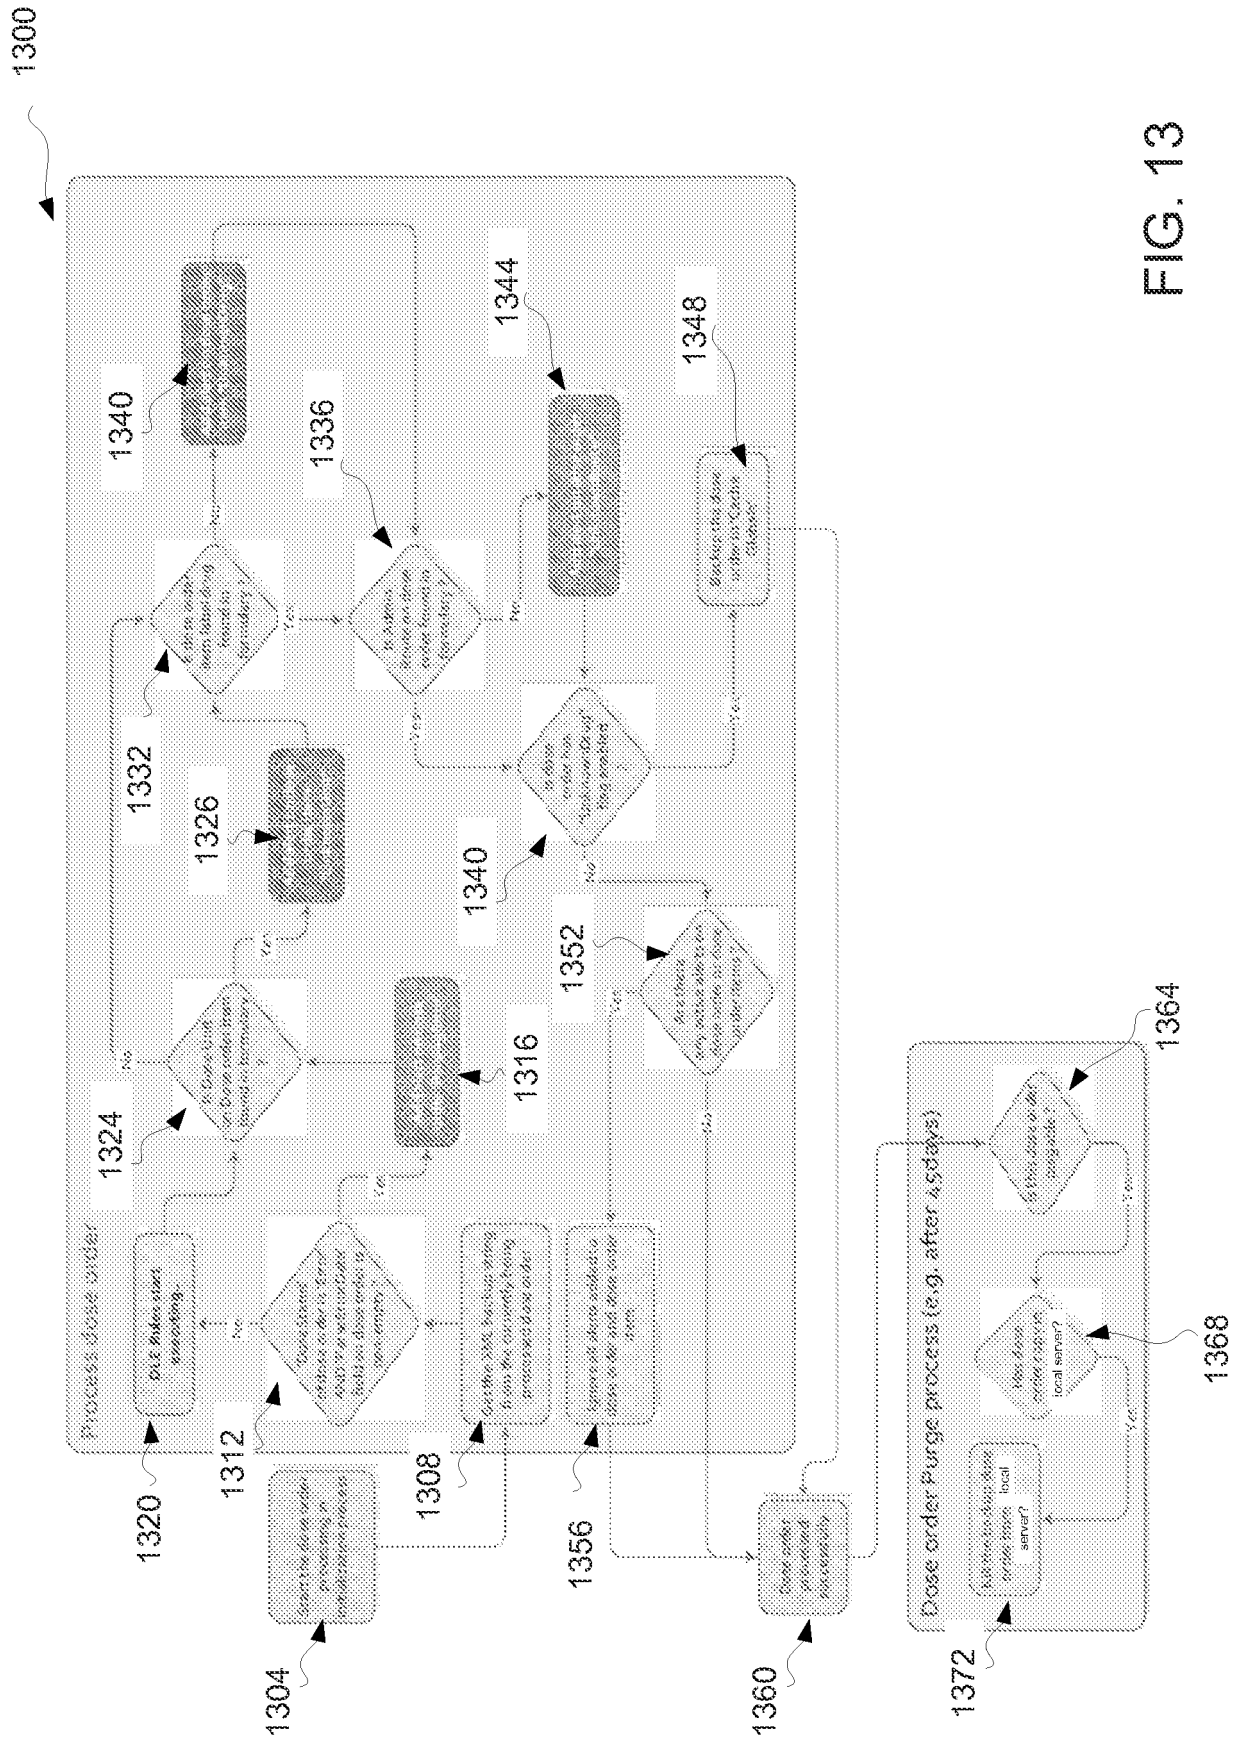

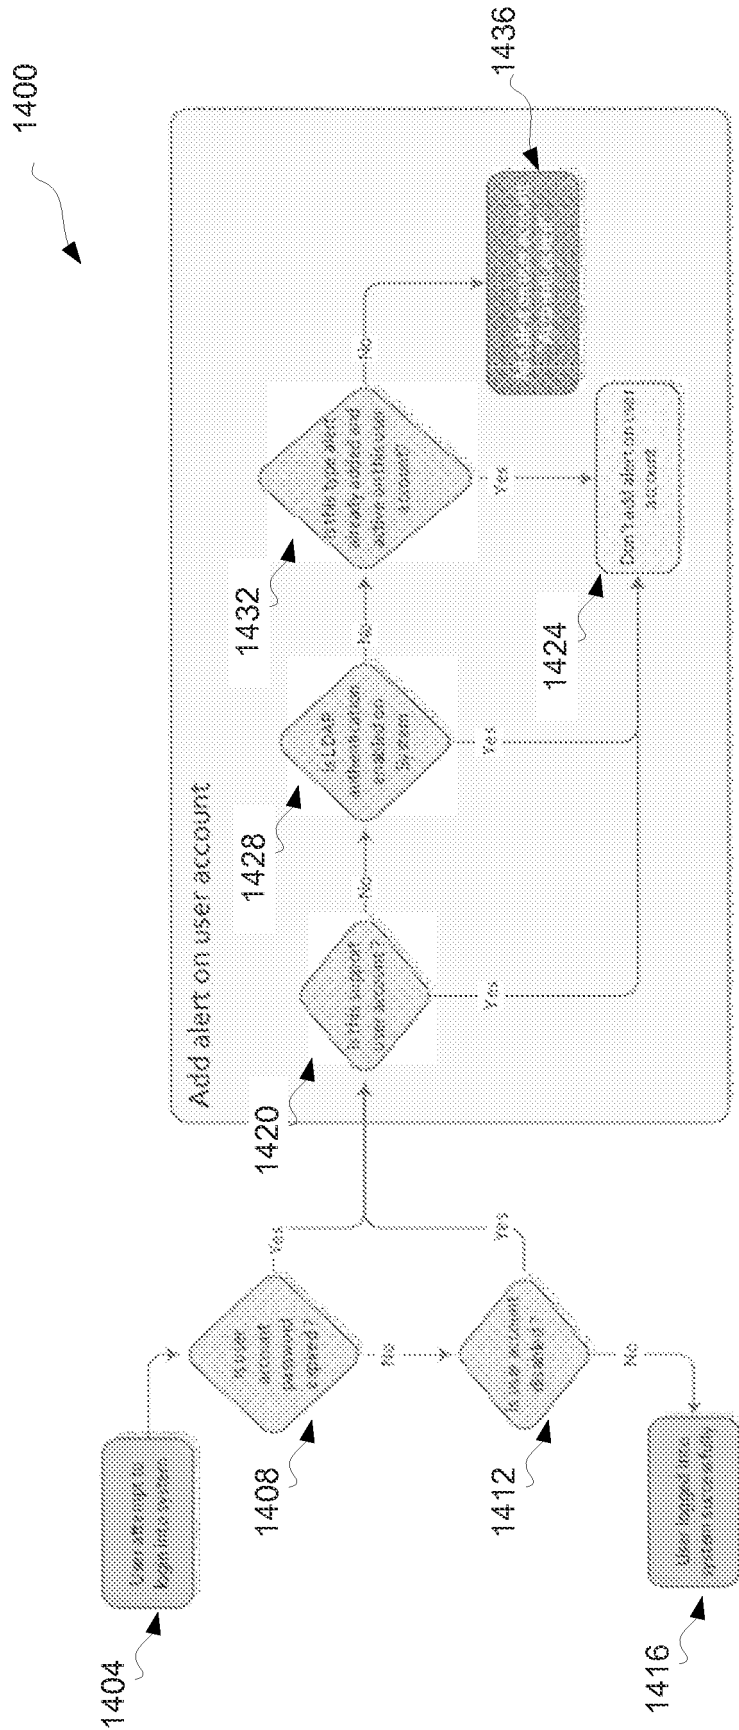

Attention Tab: Identify alerts on user account (Server side) 29th June 2014

FIG. 14


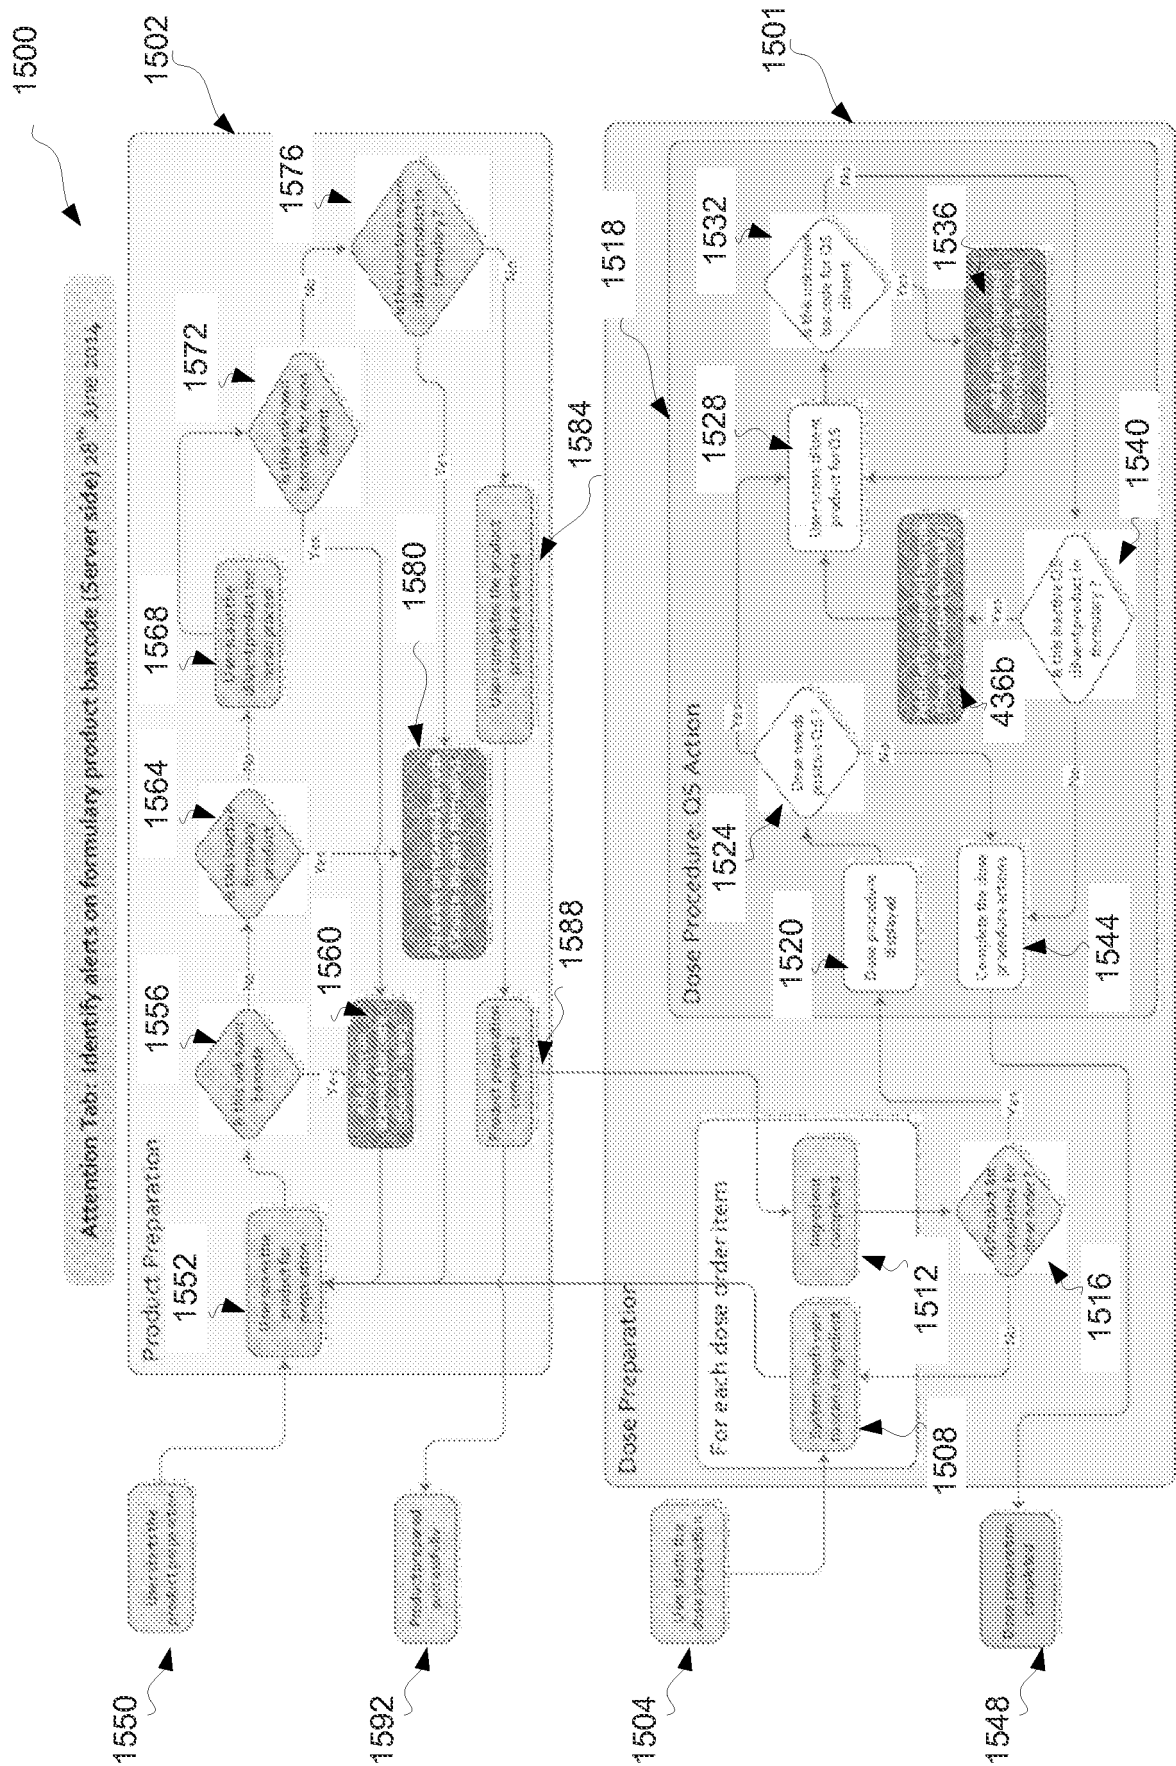


FIG. 15



Attention T4ds: Regressors problematic (see orders (server side) 27th June 2014).

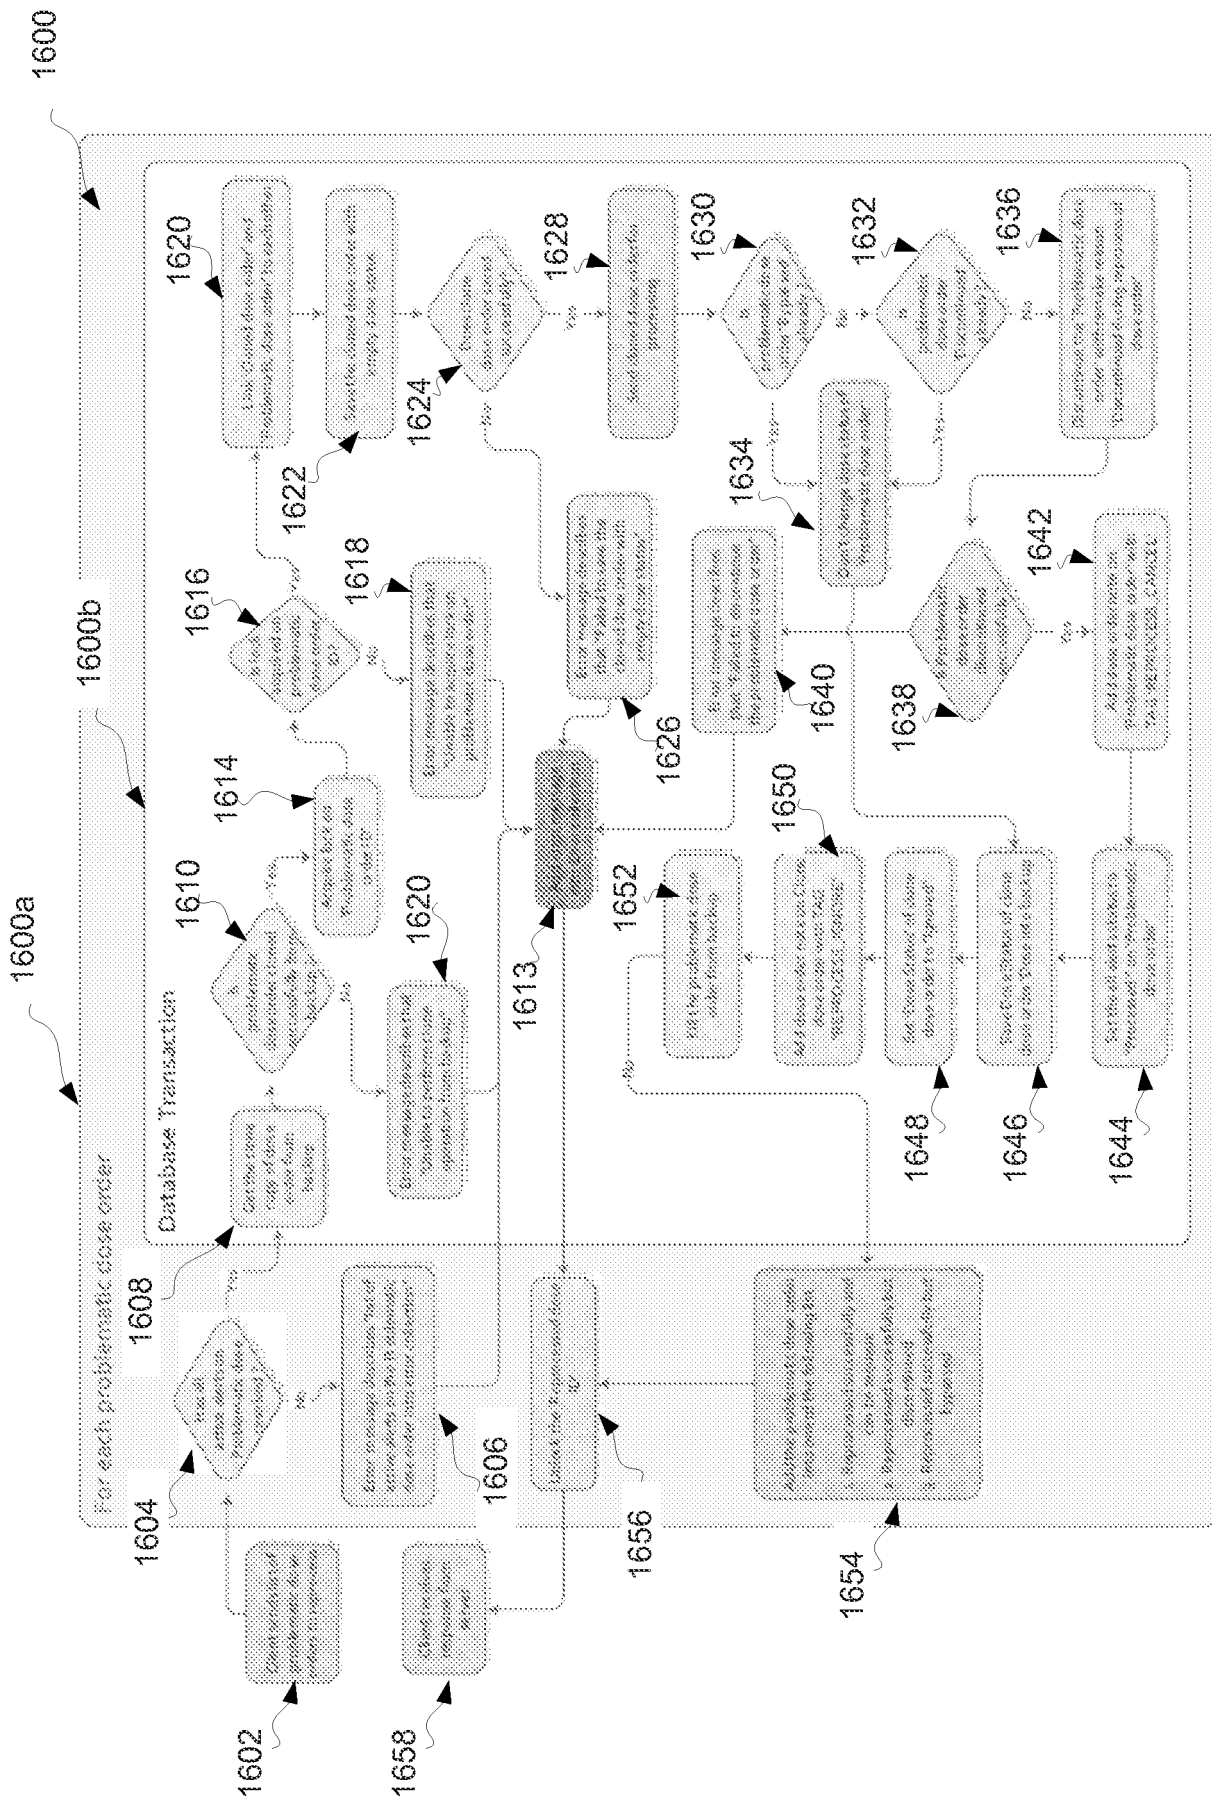