

FIG. 1

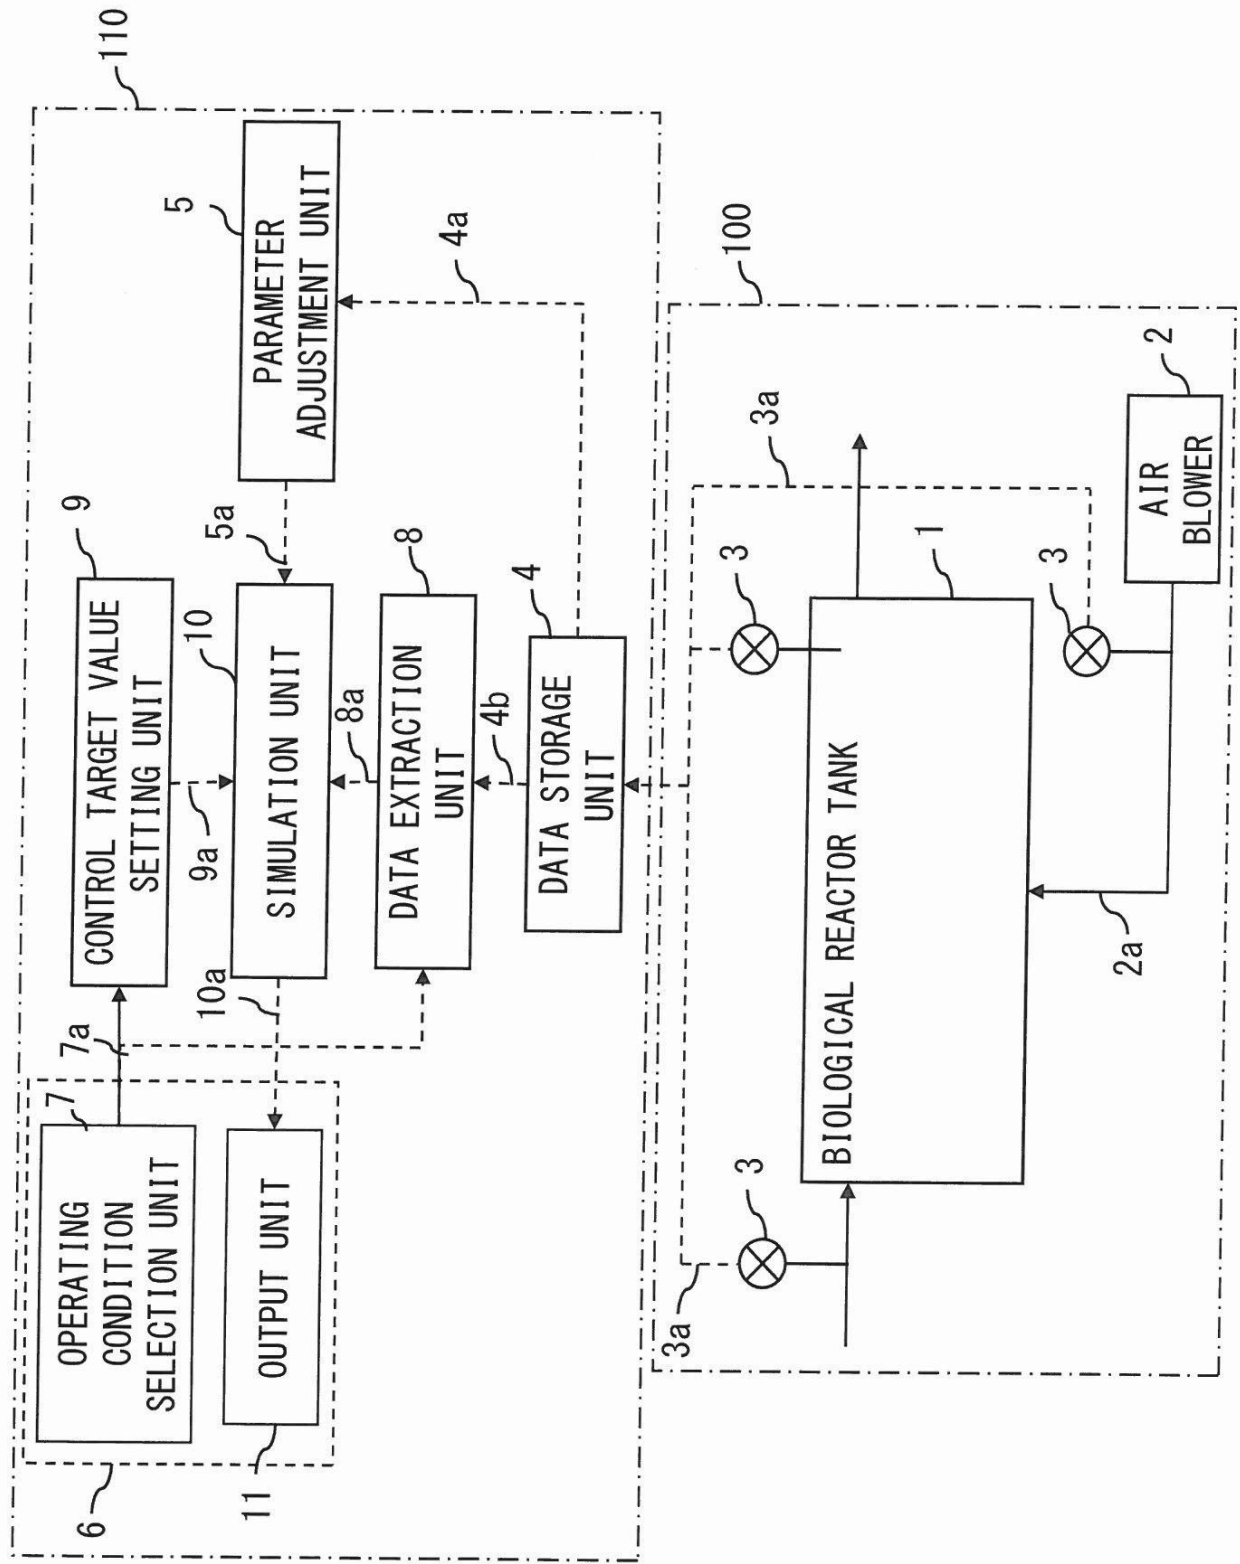


FIG. 2

PERIODS:

APRIL 1, 00:00 TO APRIL 2, 00:00

VOLUME OF PUMPED WATER :

ONE UNIT OPERATION	TWO UNITS OPERATION 	THREE UNITS OPERATION
-----------------------	---	--------------------------

VOLUME OF AERATION :

LOW 	MEDIUM	HIGH
--	--------	------

VOLUME OF RETURNED SLUDGE :

LOW	MEDIUM	HIGH 
-----	--------	---

.
.
.

FIG. 3

VOLUME OF PUMPED WATER :

1000m³/hr

DO TARGET VALUE :

0.5mg/L

RETURN SLUDGE RATIO :

DOUBLE

.
.
.

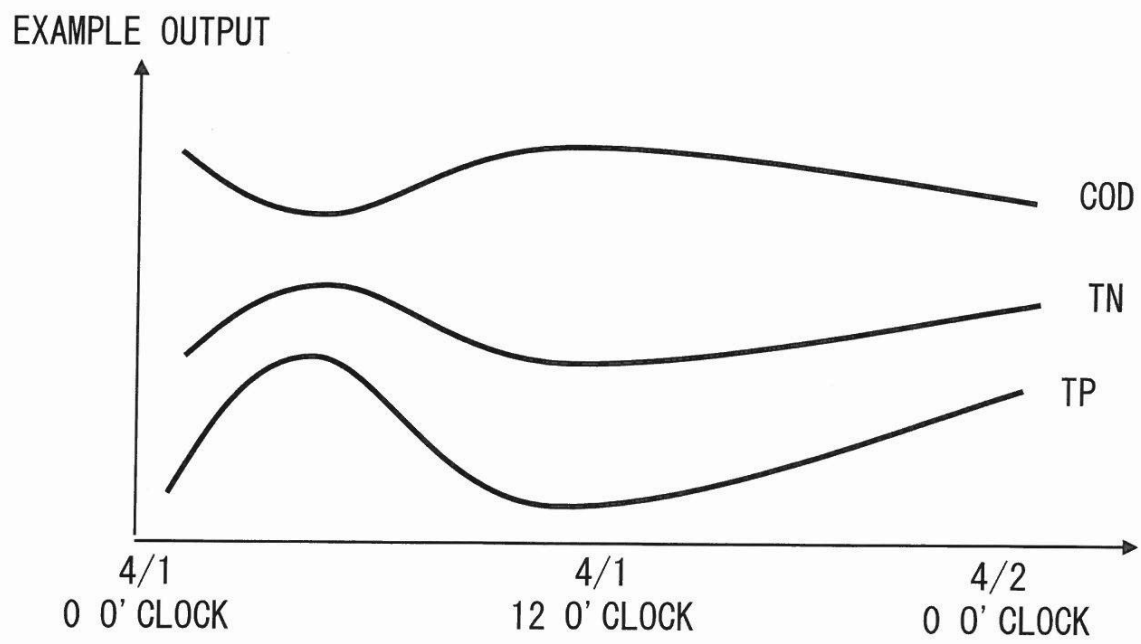
FIG. 4

FIG. 5

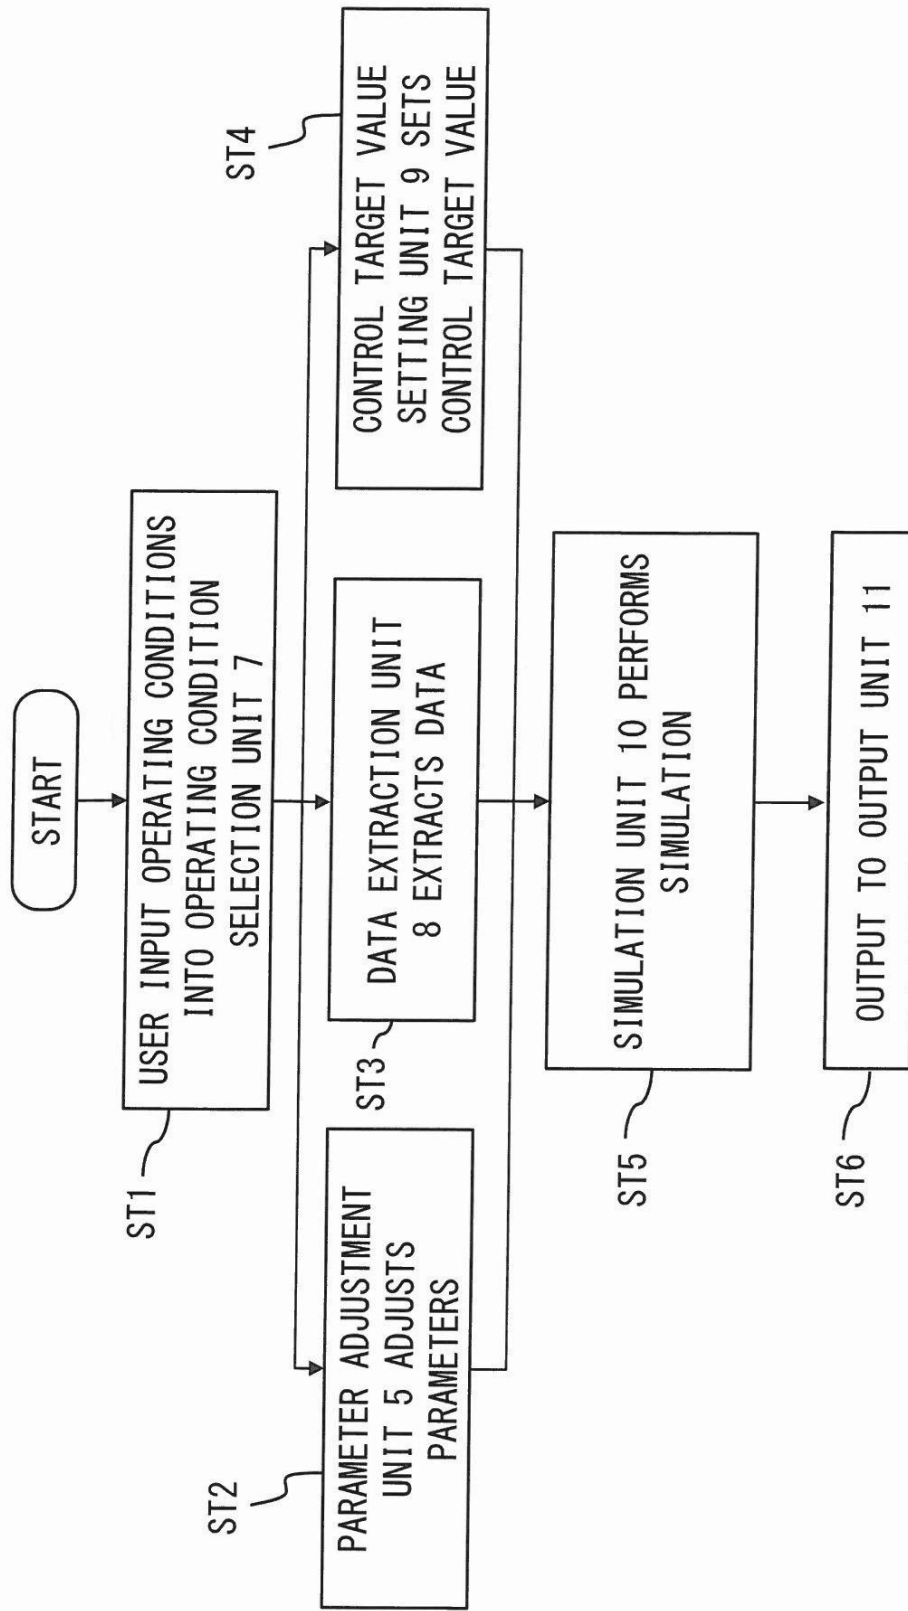
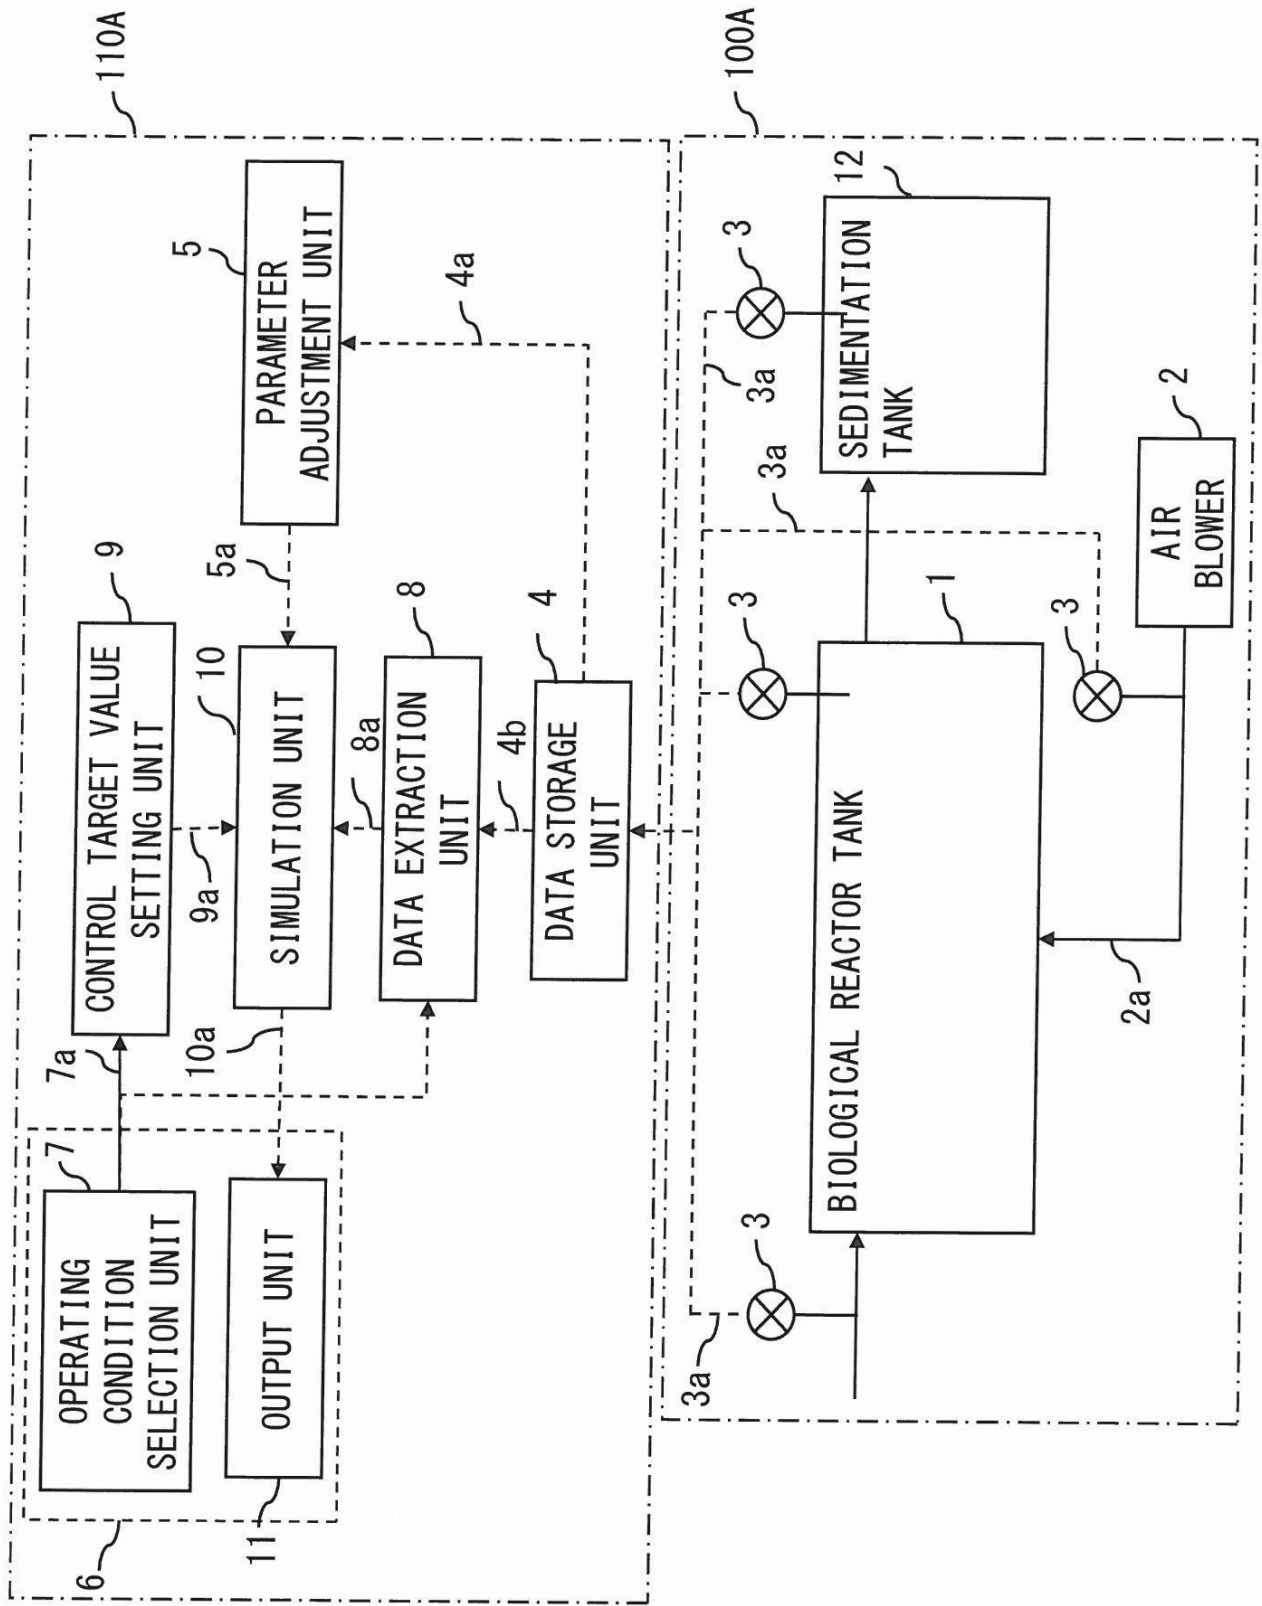


FIG. 6



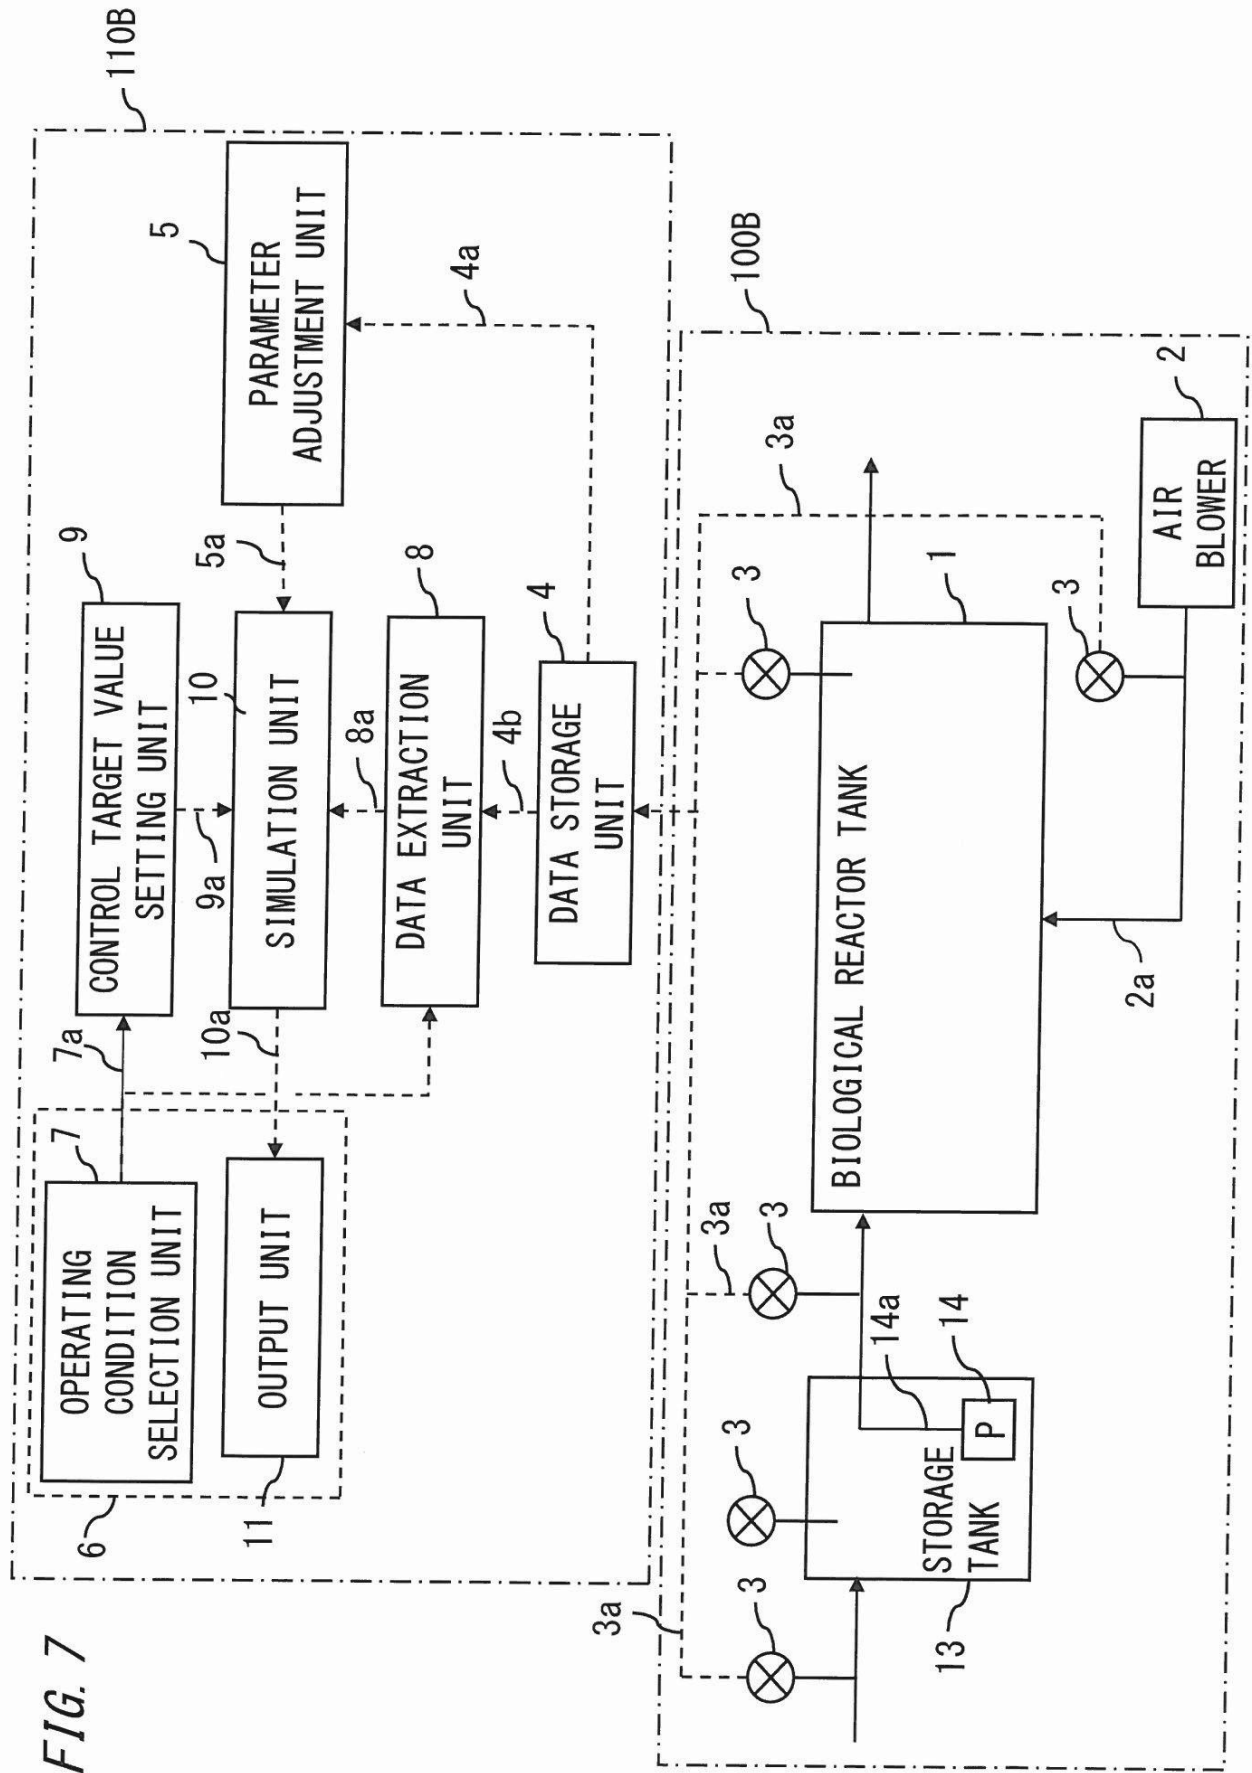


FIG. 8

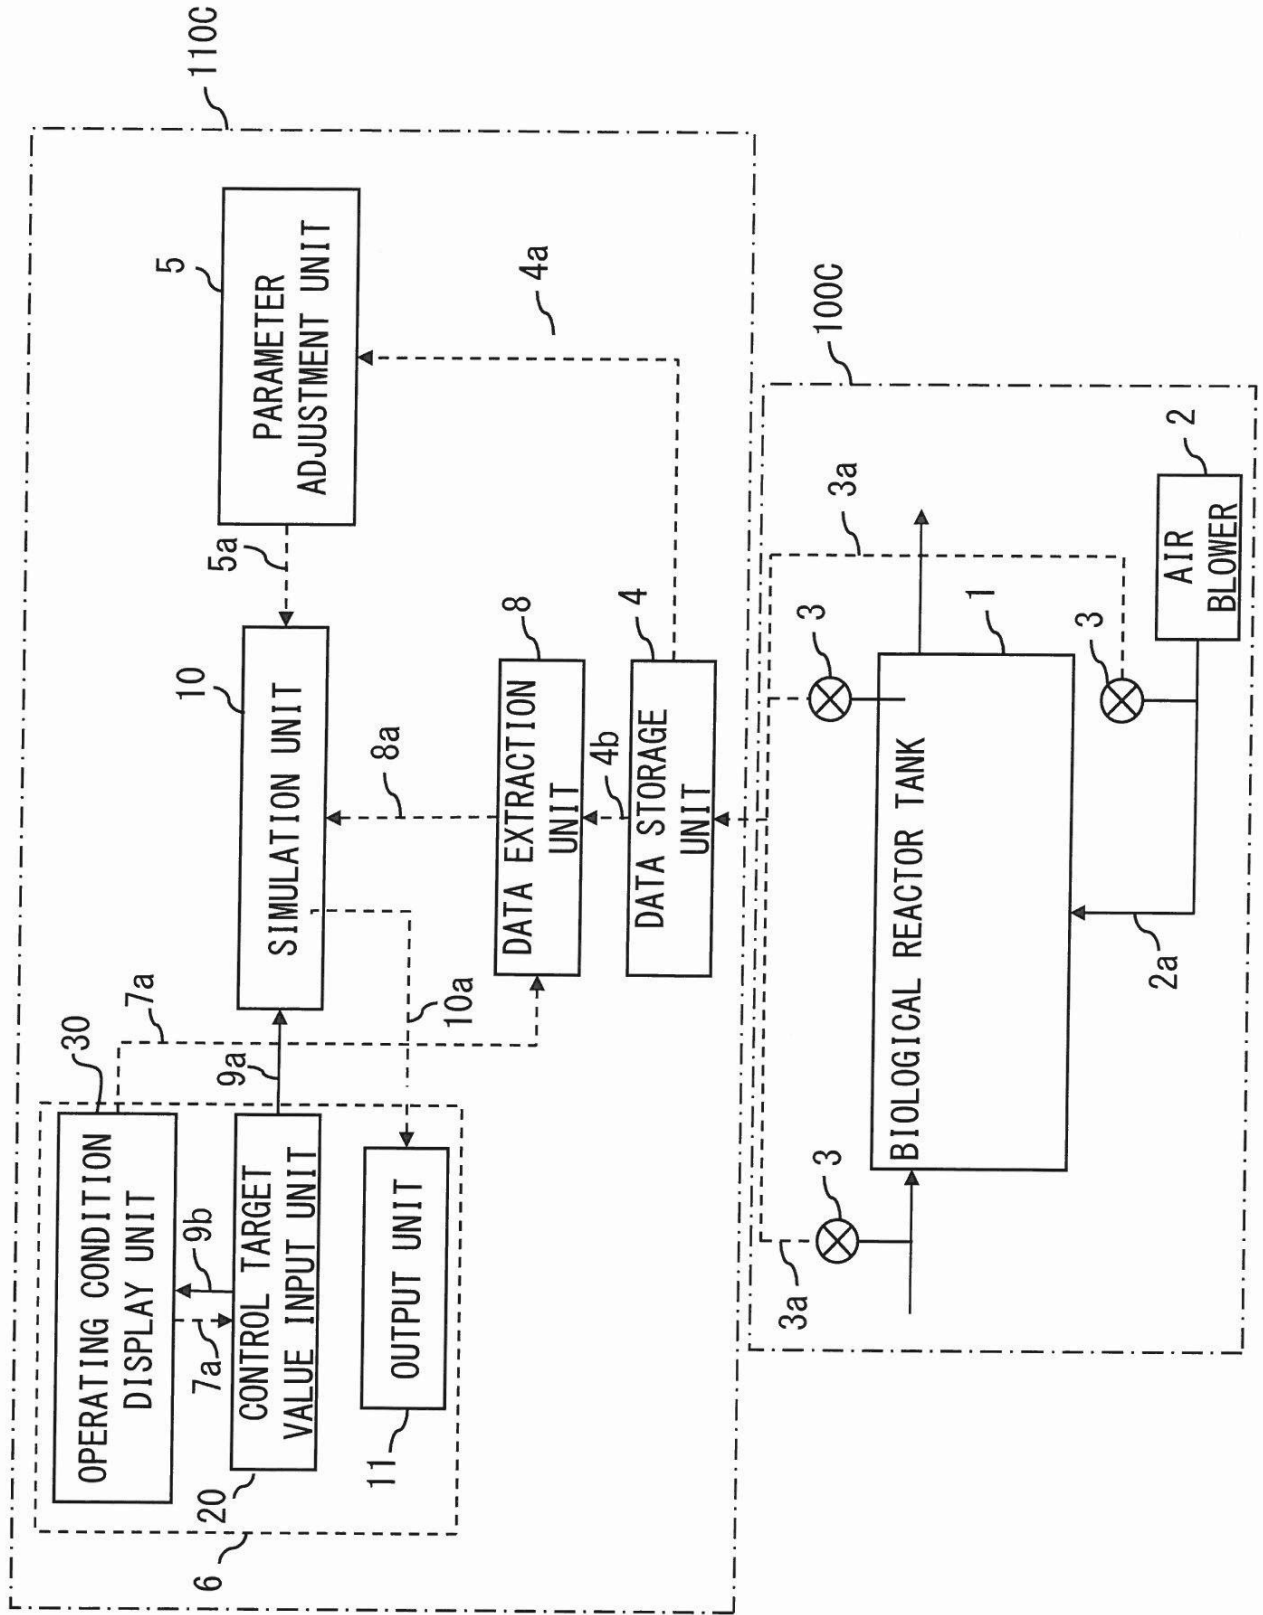


FIG. 9

