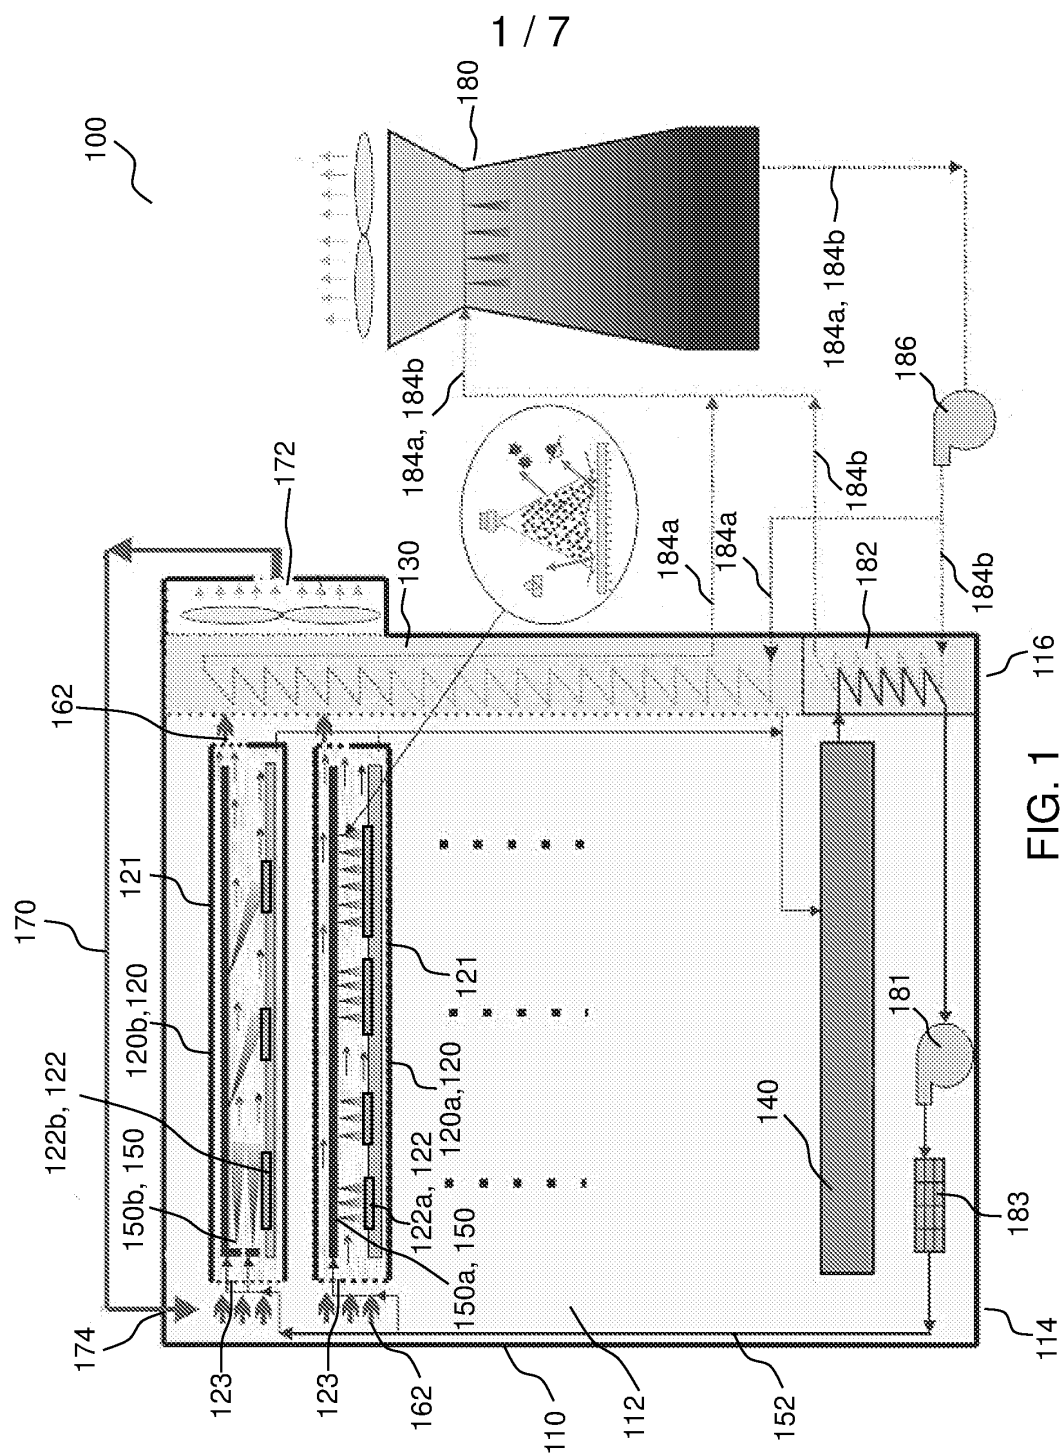




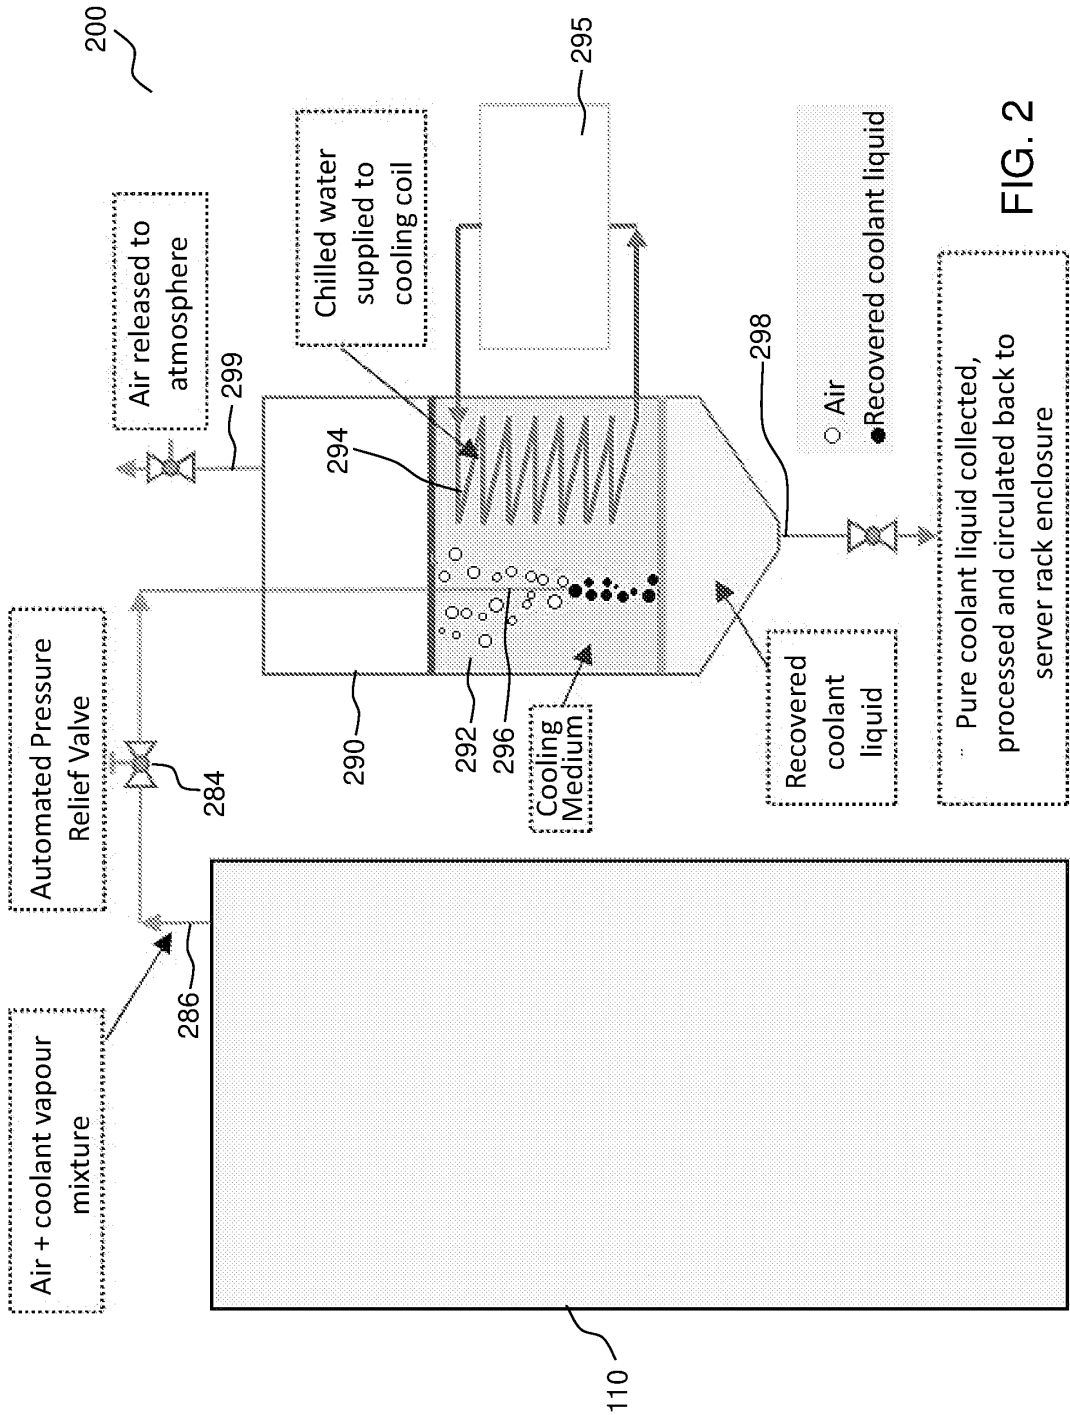


FIG. 2

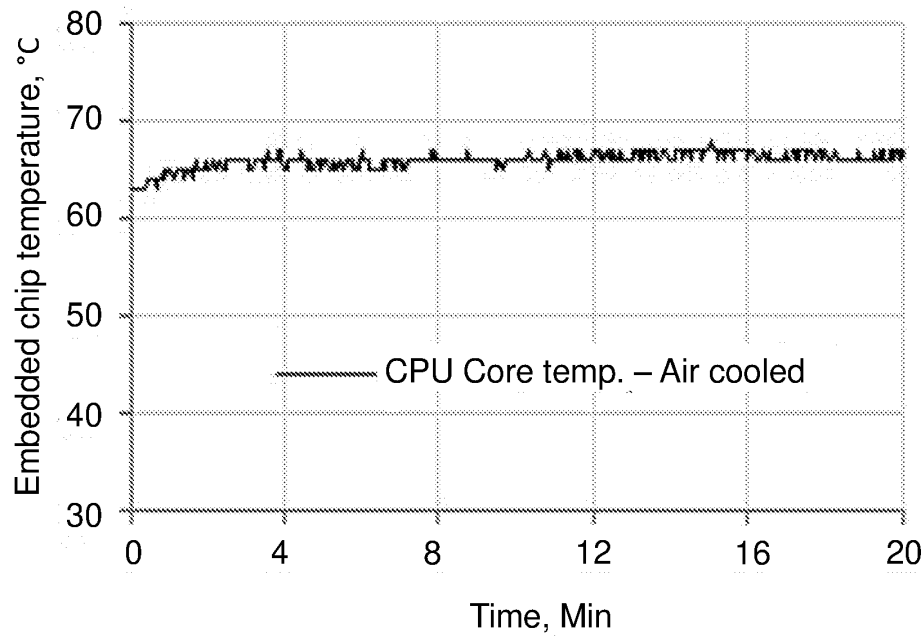


FIG. 3A

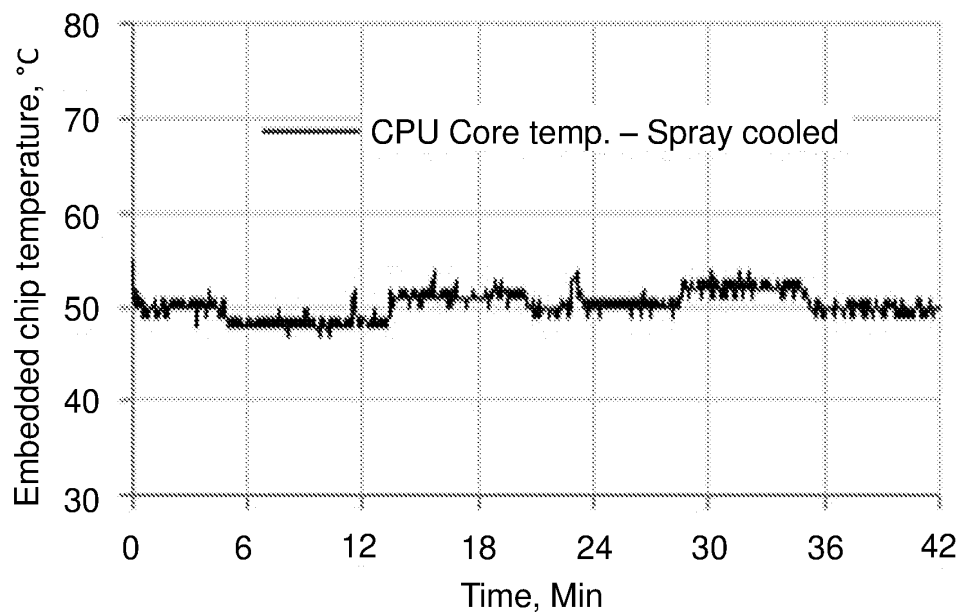


FIG. 3B

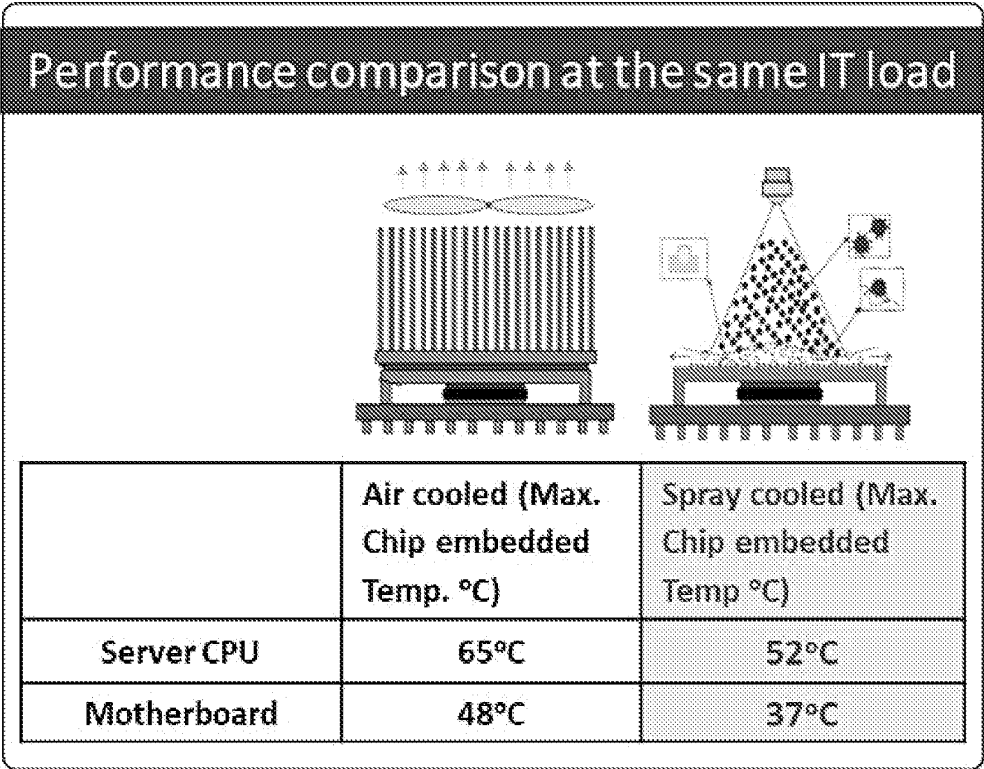


FIG. 3C

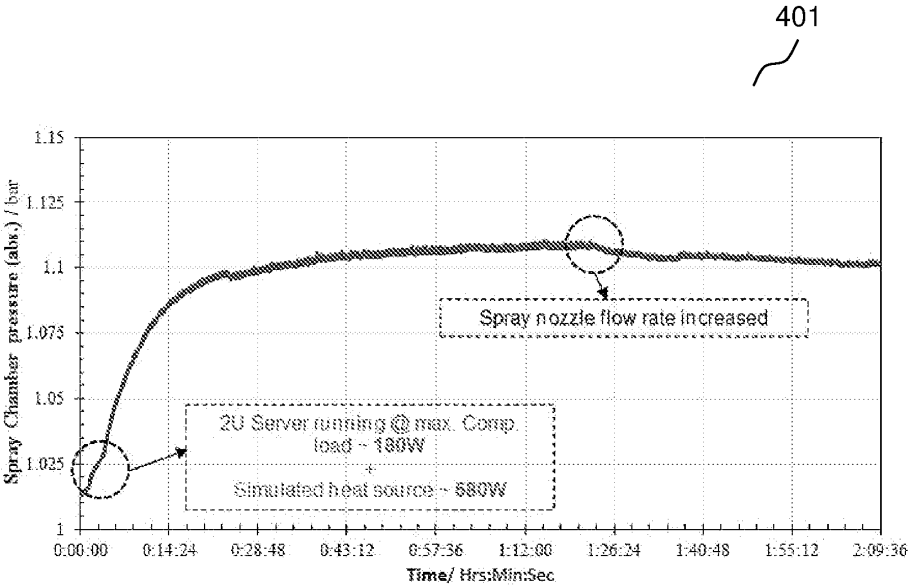


FIG. 4A



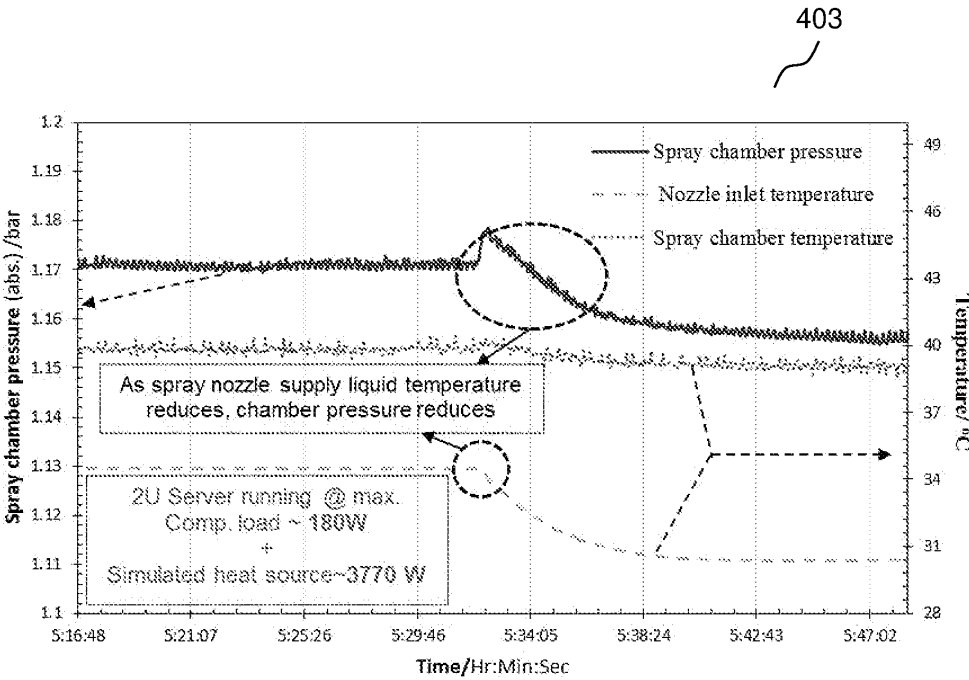


FIG. 4B

6 / 7

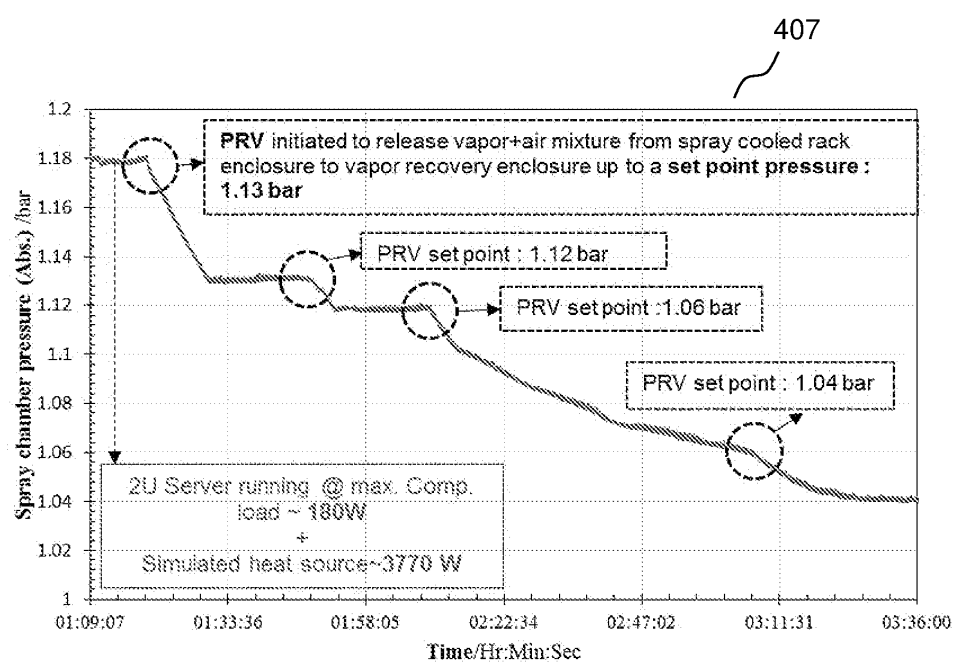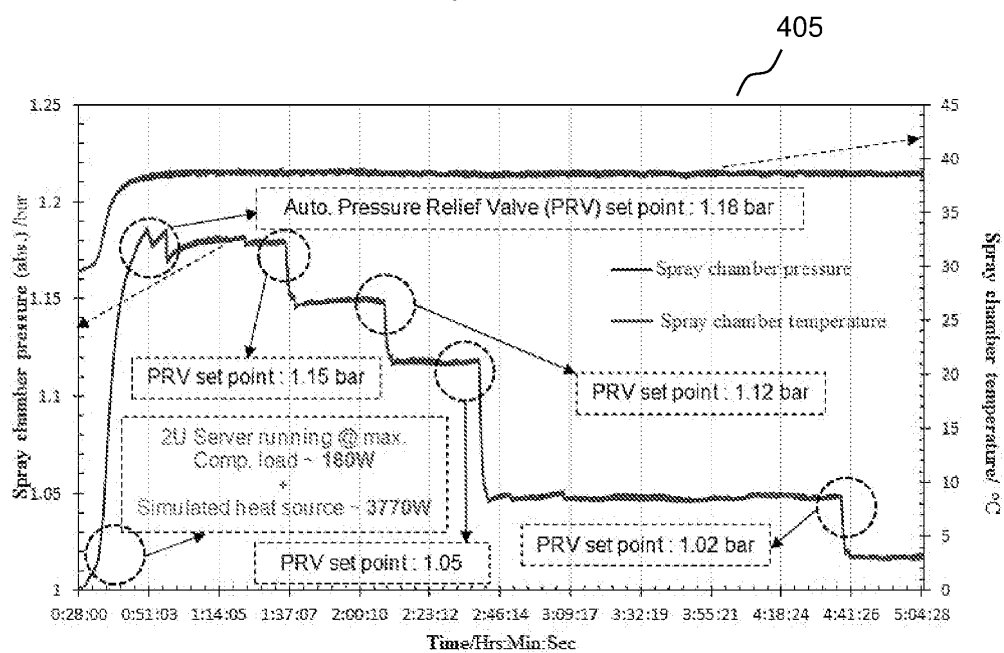

7 / 7

	Average heat rejection capacity (kW)	Volume (m ³)	Density (kW/m ³)
Current commercial air cooled rack (42U)	<7**	~1	~7
Our lab-scale Spray Cooled Server (8U equivalent)	~4	0.24	~16

FIG. 4E