

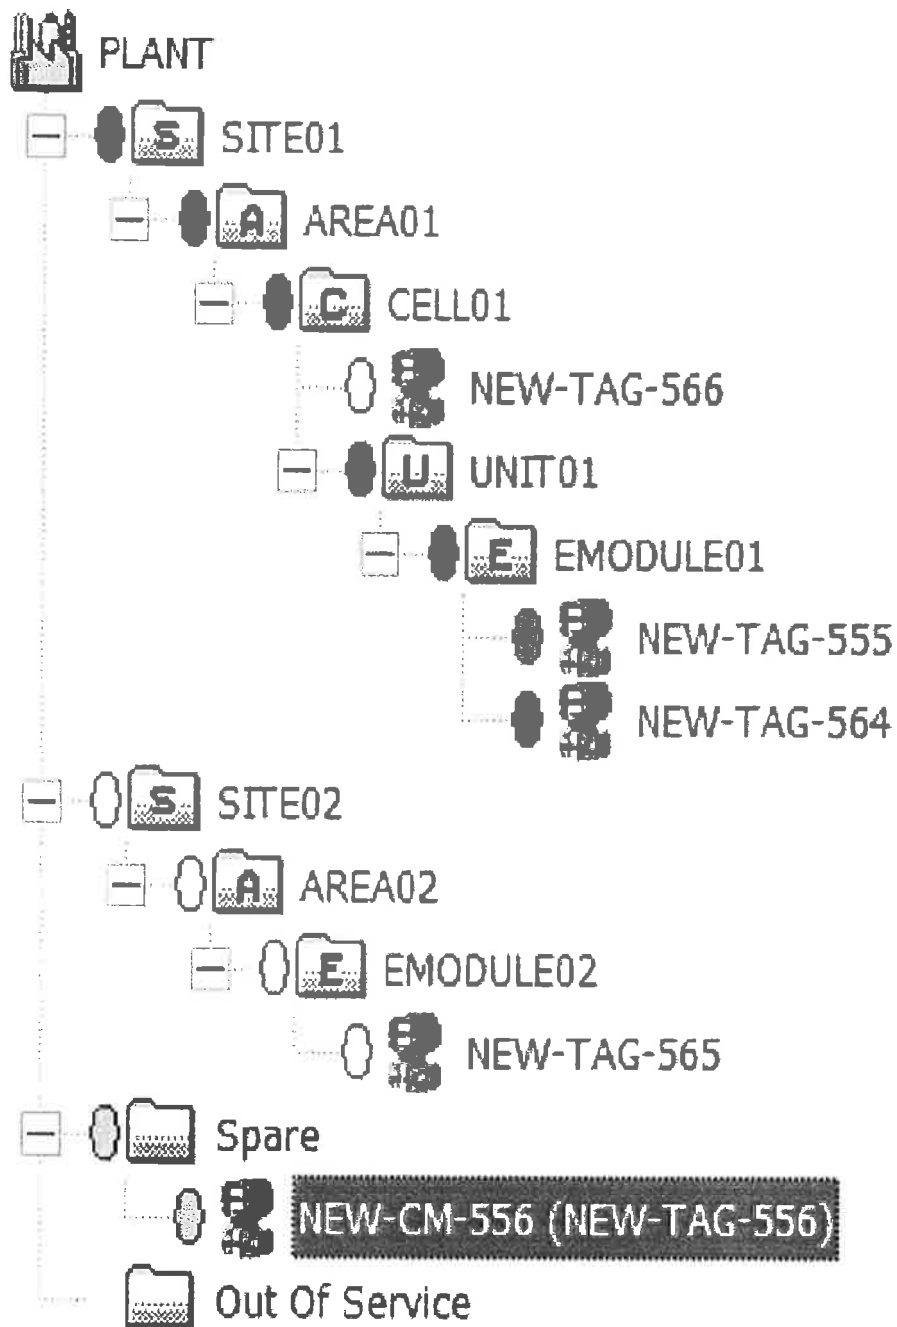


FIGURE 1

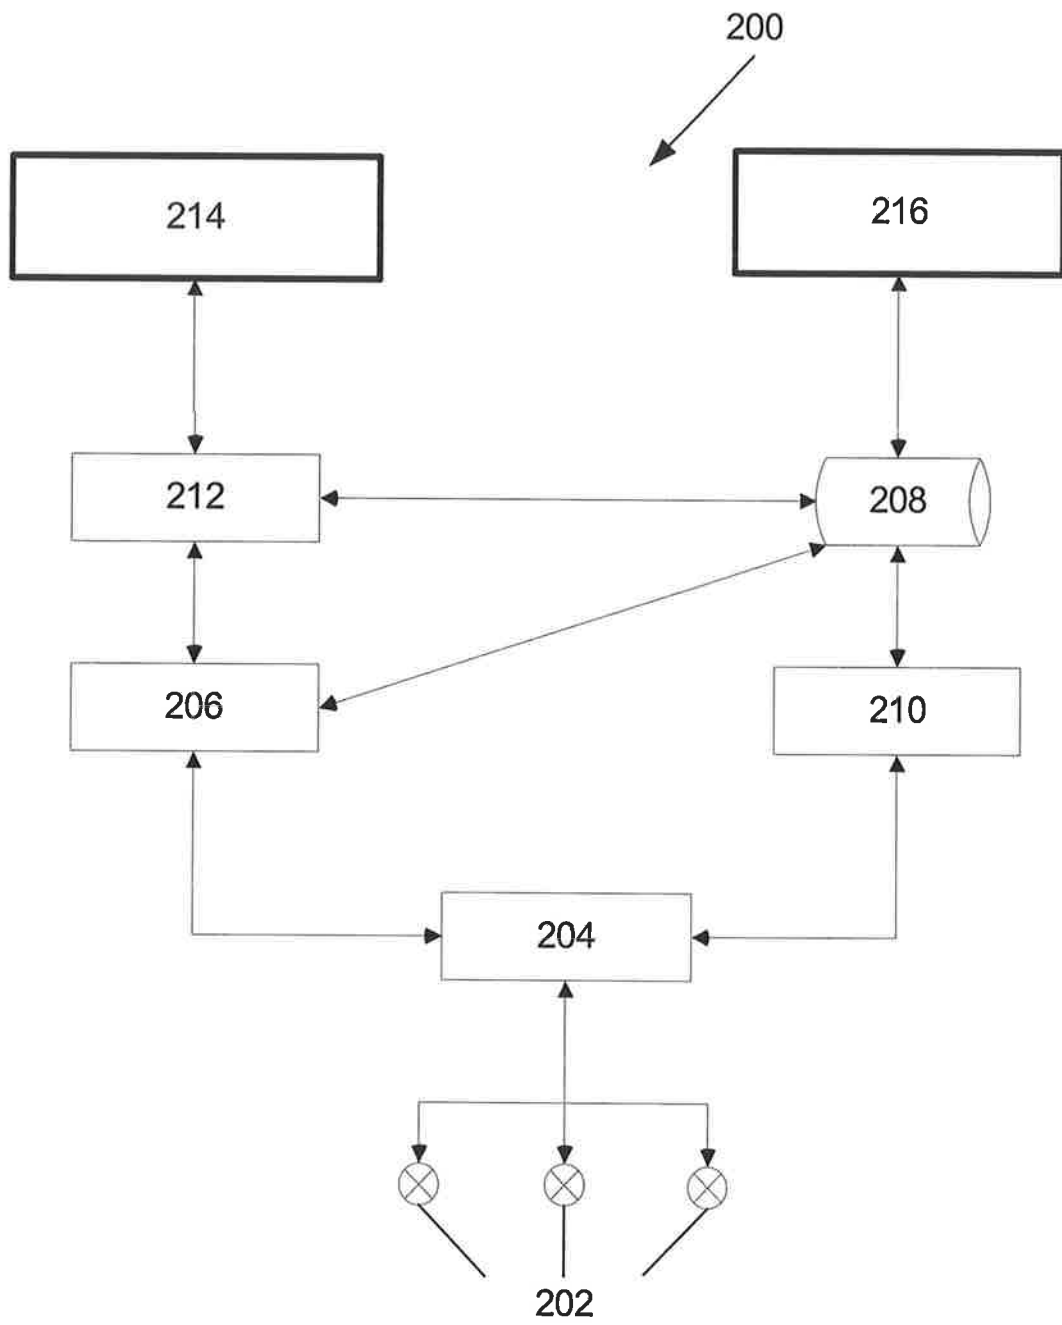


FIGURE 2

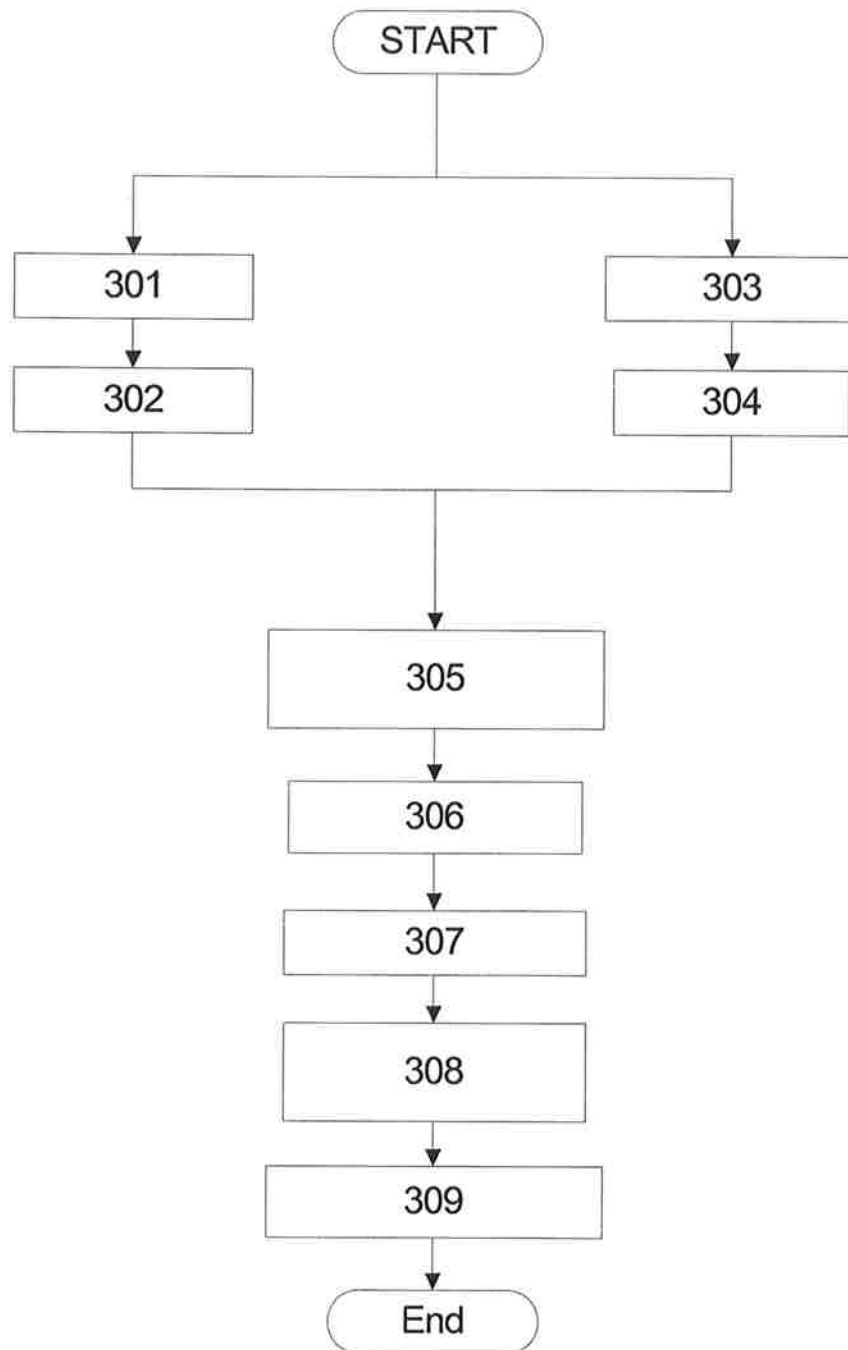


FIGURE 3

4 / 4

404 403 402 401

0	1	2	3	4	5	6
	Diagnostic Target	Diagnostic Item	Diagnosis Name	Diagnosis Time	Diagnosing Type	Module Status
0	☒ DY-FF01	Basic Diagnosis		01/02/2006 12:34:12		
0	☐ DY-FF01	Manual Status Input				
0	☐ DY-FF01	PrmUserDiag2000	PrmUserDiag2000	02/04/2006 07:34:12	FF-H1 device	Running
0	☒ DY-FF01	PrmUserDiag2001	PrmUserDiag2001	11/04/2006 07:44:12	FF-H1 device	Running
0	☒ DY-FF02	Basic Diagnosis		01/02/2006 12:34:12		
0	☐ DY-FF02	Manual Status Input				
0	☐ DY-FF02	PrmUserDiag3000	PrmUserDiag3000	26/05/2006 07:34:12	FF-H1 device	Stopped
0	☐ DY-FF02	PrmUserDiag3001	PrmUserDiag3001	03/04/2006 07:34:12	FF-H1 device	Running

FIGURE 4A

413 412 411

0	1	2	3	4	5	6
	Diagnostic Target	Diagnostic Item	Diagnosis Name	Diagnosis Time	Diagnosing Type	Module Status
0	☒ DY-FF01	Basic Diagnosis		01/02/2006 12:34:12		
0	☐ DY-FF01	Manual Status Input				
0	☐ DY-FF01	PrmUserDiag2000	PrmUserDiag2000	02/04/2006 07:34:12	FF-H1 device	Running
0	☒ DY-FF01	PrmUserDiag2001	PrmUserDiag2001	11/04/2006 07:44:12	FF-H1 device	Running
0	☐ DY-FF02	Basic Diagnosis		01/02/2006 12:34:12		
0	☐ DY-FF02	Manual Status Input				
0	☐ DY-FF02	PrmUserDiag3000	PrmUserDiag3000	26/05/2006 07:34:12	FF-H1 device	Stopped
0	☐ DY-FF02	PrmUserDiag3001	PrmUserDiag3001	03/04/2006 07:34:12	FF-H1 device	Running

FIGURE 4B