

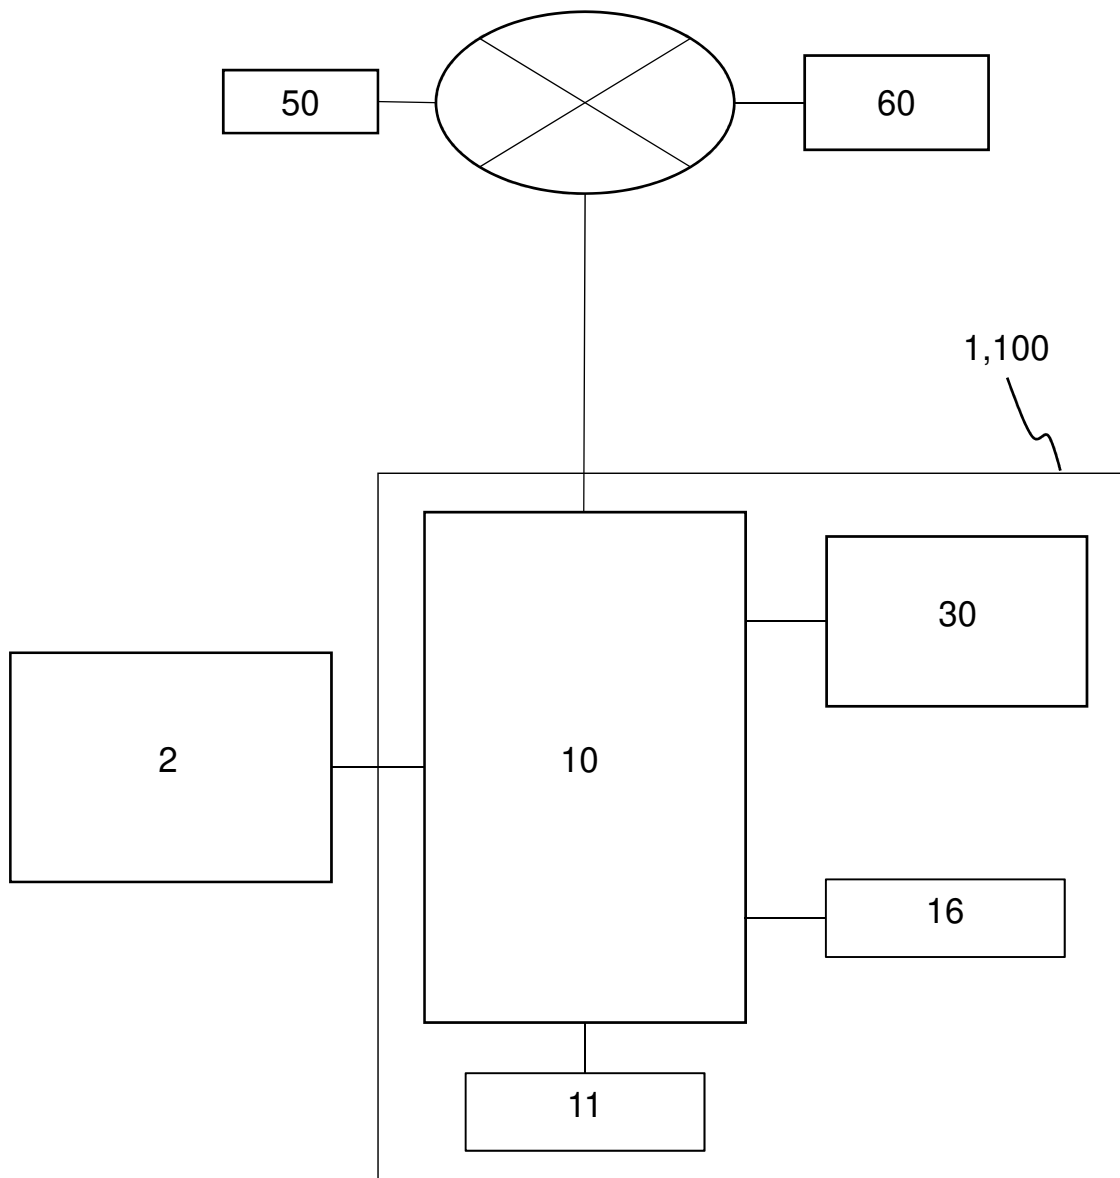


FIG. 1A

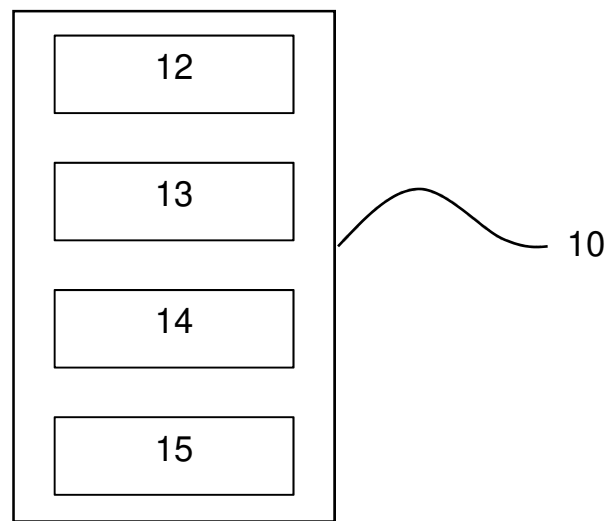


FIG. 1B

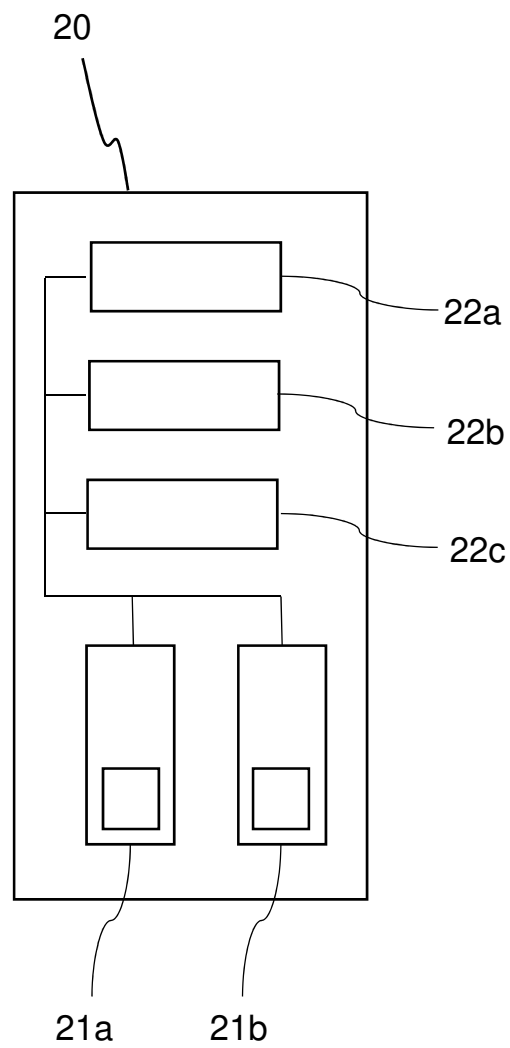


FIG. 2

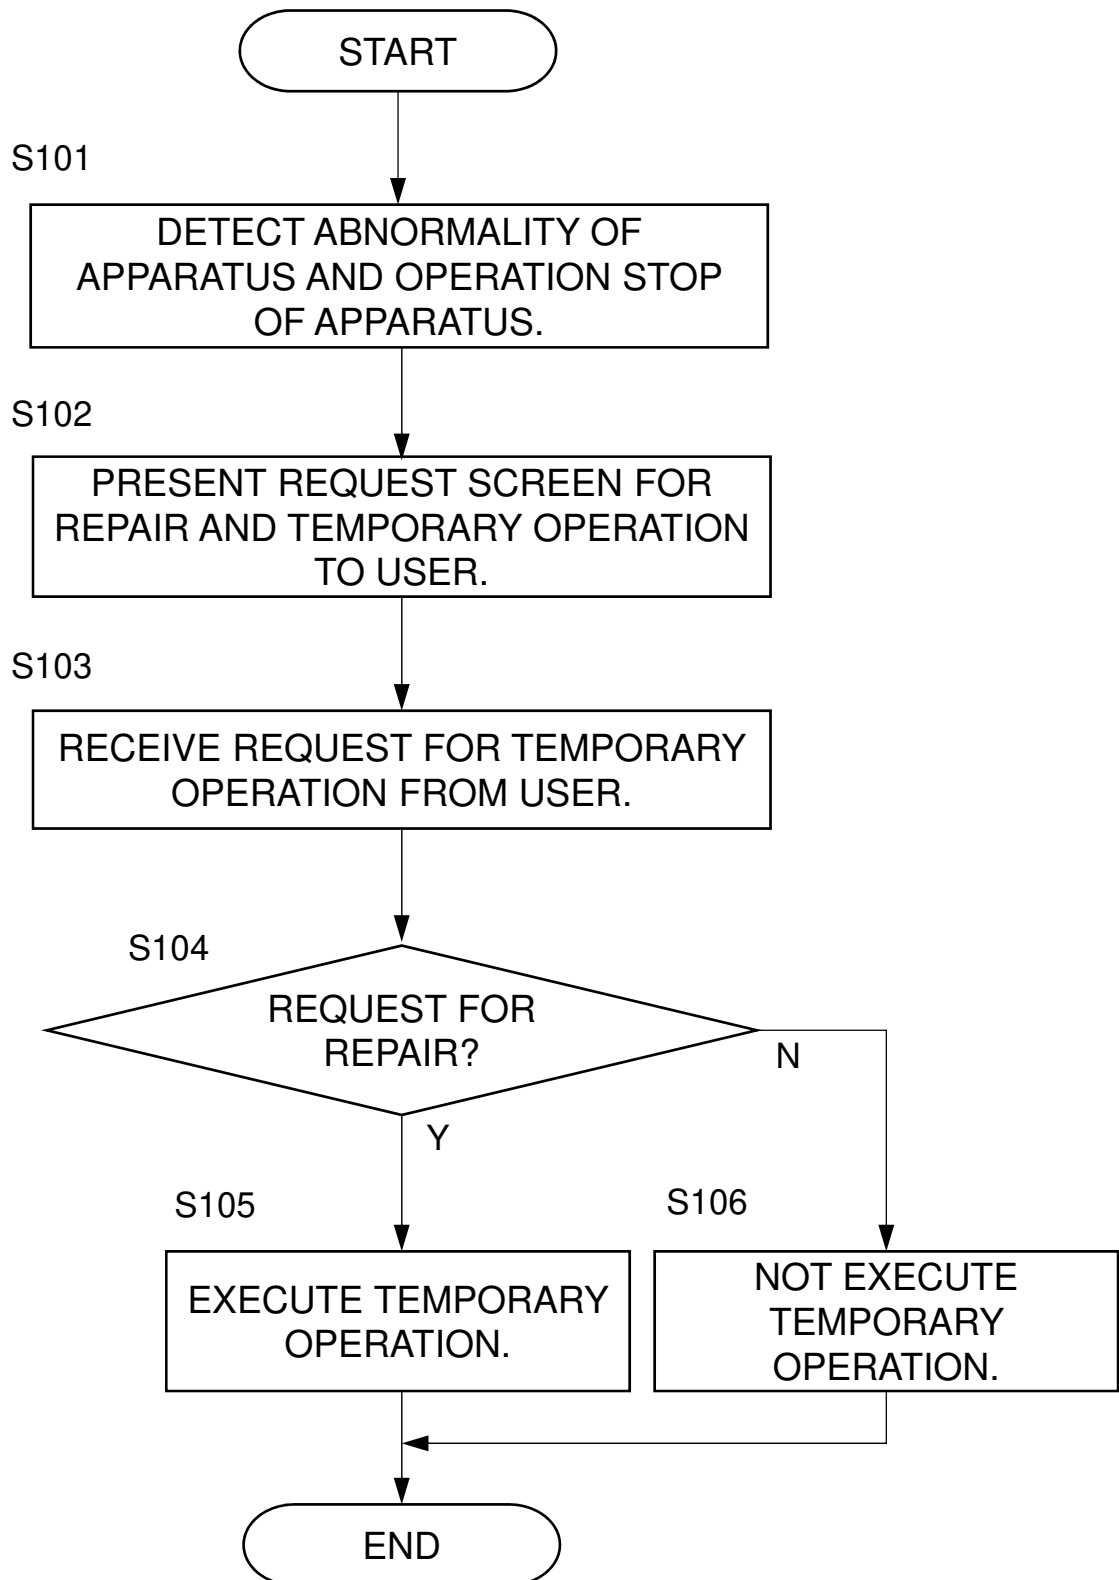


FIG. 3

30

33

31

APPLICATION FOR REPAIR AND
TEMPORARY OPERATION

STATE OF SELECTED APPARATUS
DELIVERY DESTINATION NAME: YY BUILDING
AIR CONDITIONER SYSTEM NAME
(MODEL TYPE/APPARATUS NUMBER)
YY ROOM (RXYP615DAE/A0001)
△ ABNORMALLY STOPPED FOR
ABNORMAL CODE: L5.

PLEASE APPLY FOR REPAIR AT ABNORMAL STOP.

32


CONSULTATION
AND APPLICATION
FOR REPAIR

APPLICATION FOR
REPAIR IS HERE

TARO AIR-CONDITIONING

LOGOUT

APPLICATION FOR TEMPORARY OPERATION IS
AVAILABLE UNTIL APPARATUS IS RECOVERED.


APPLICATION FOR
TEMPORARY
OPERATION

APPLICATION FOR
TEMPORARY
OPERATION (WEB)
IS HERE

FIG. 4

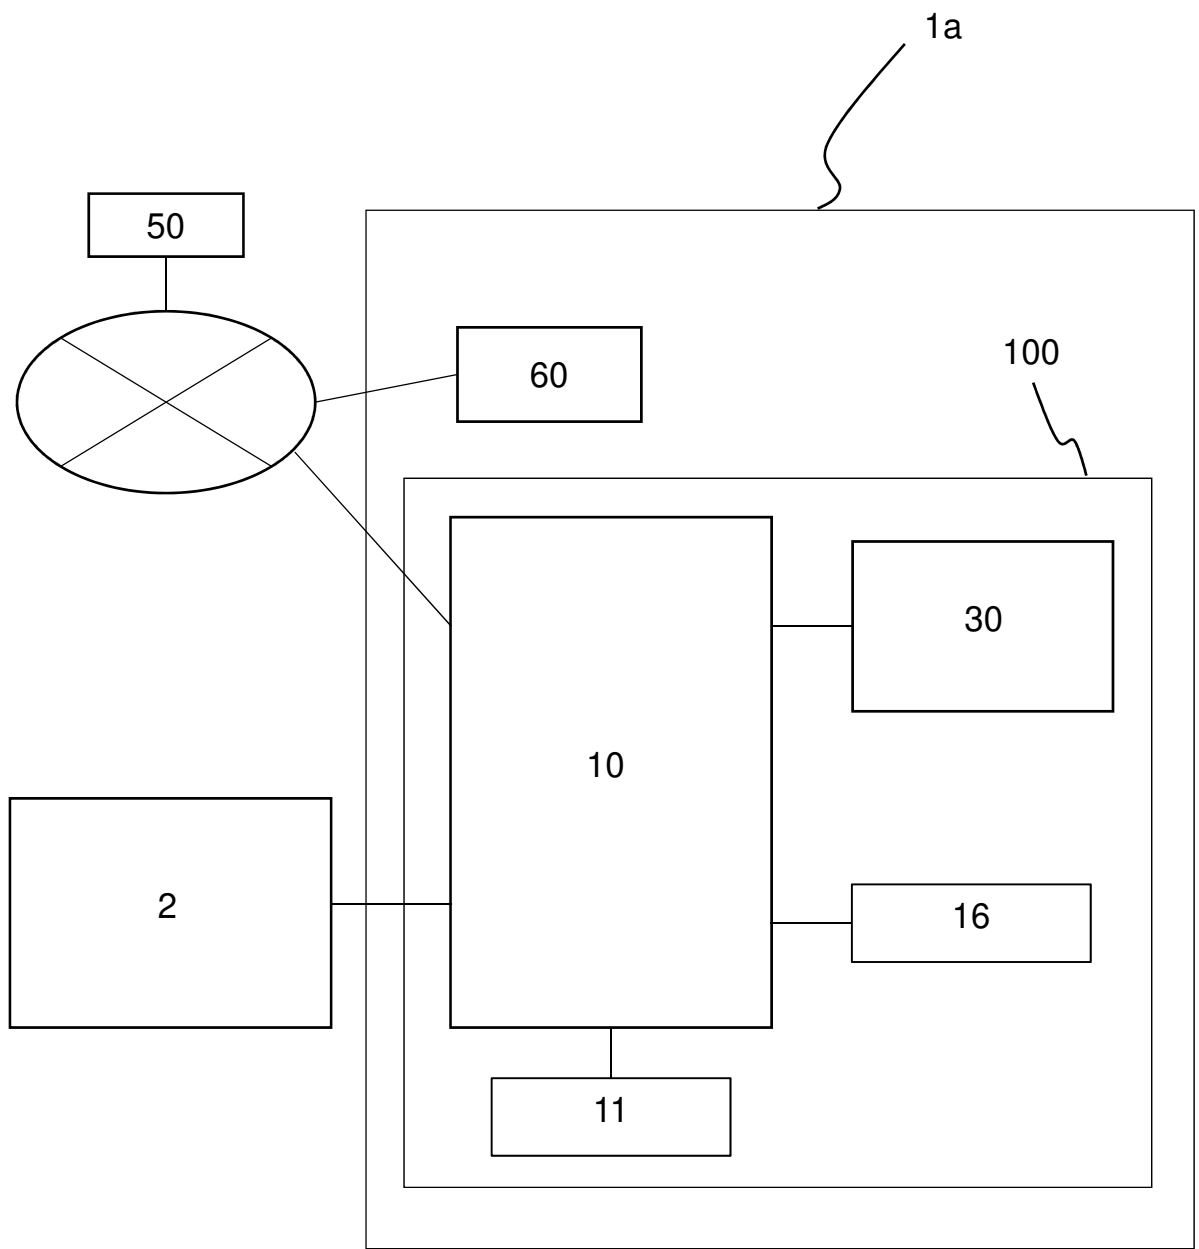


FIG. 5

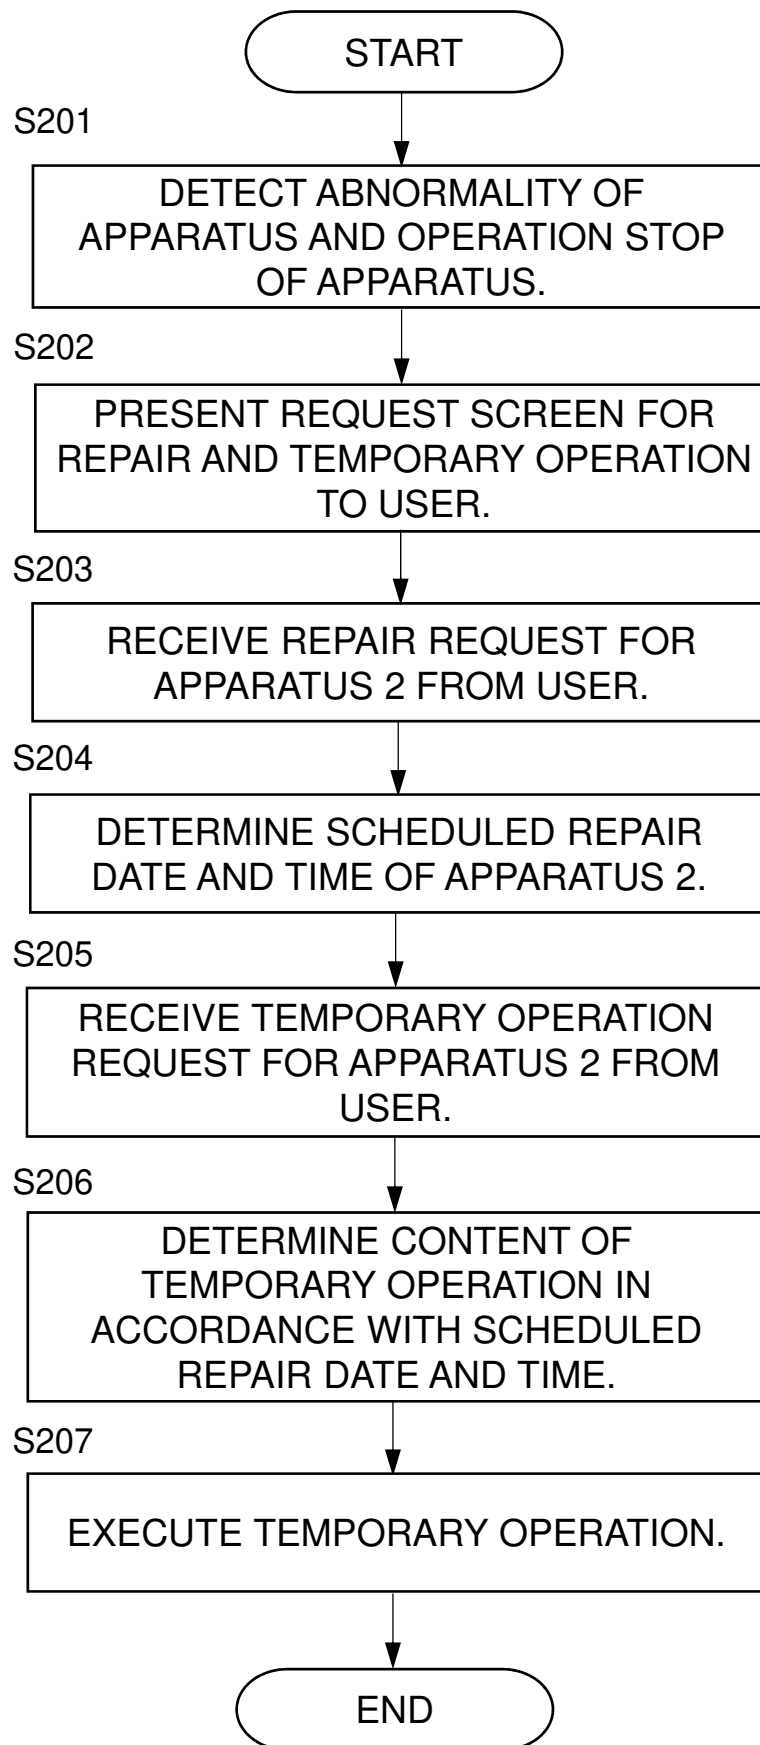
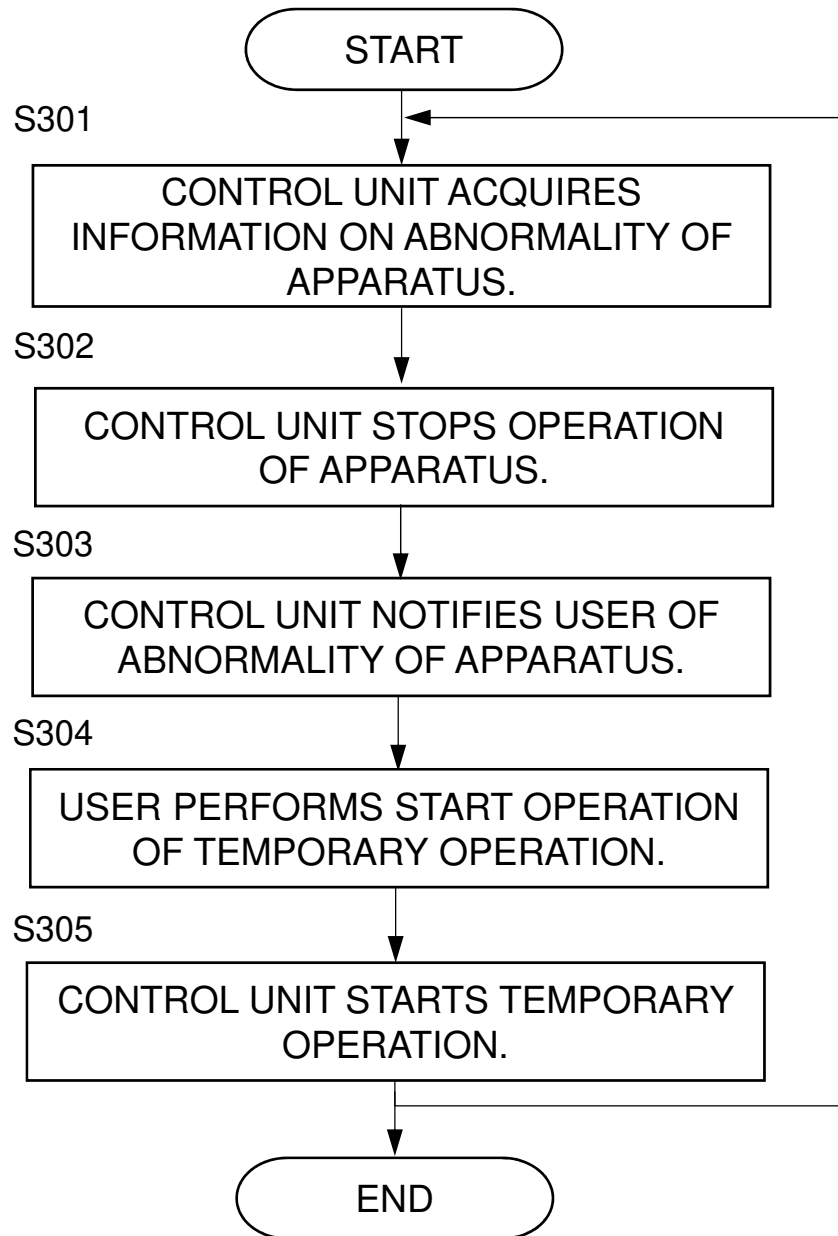


FIG. 6

**FIG. 7**

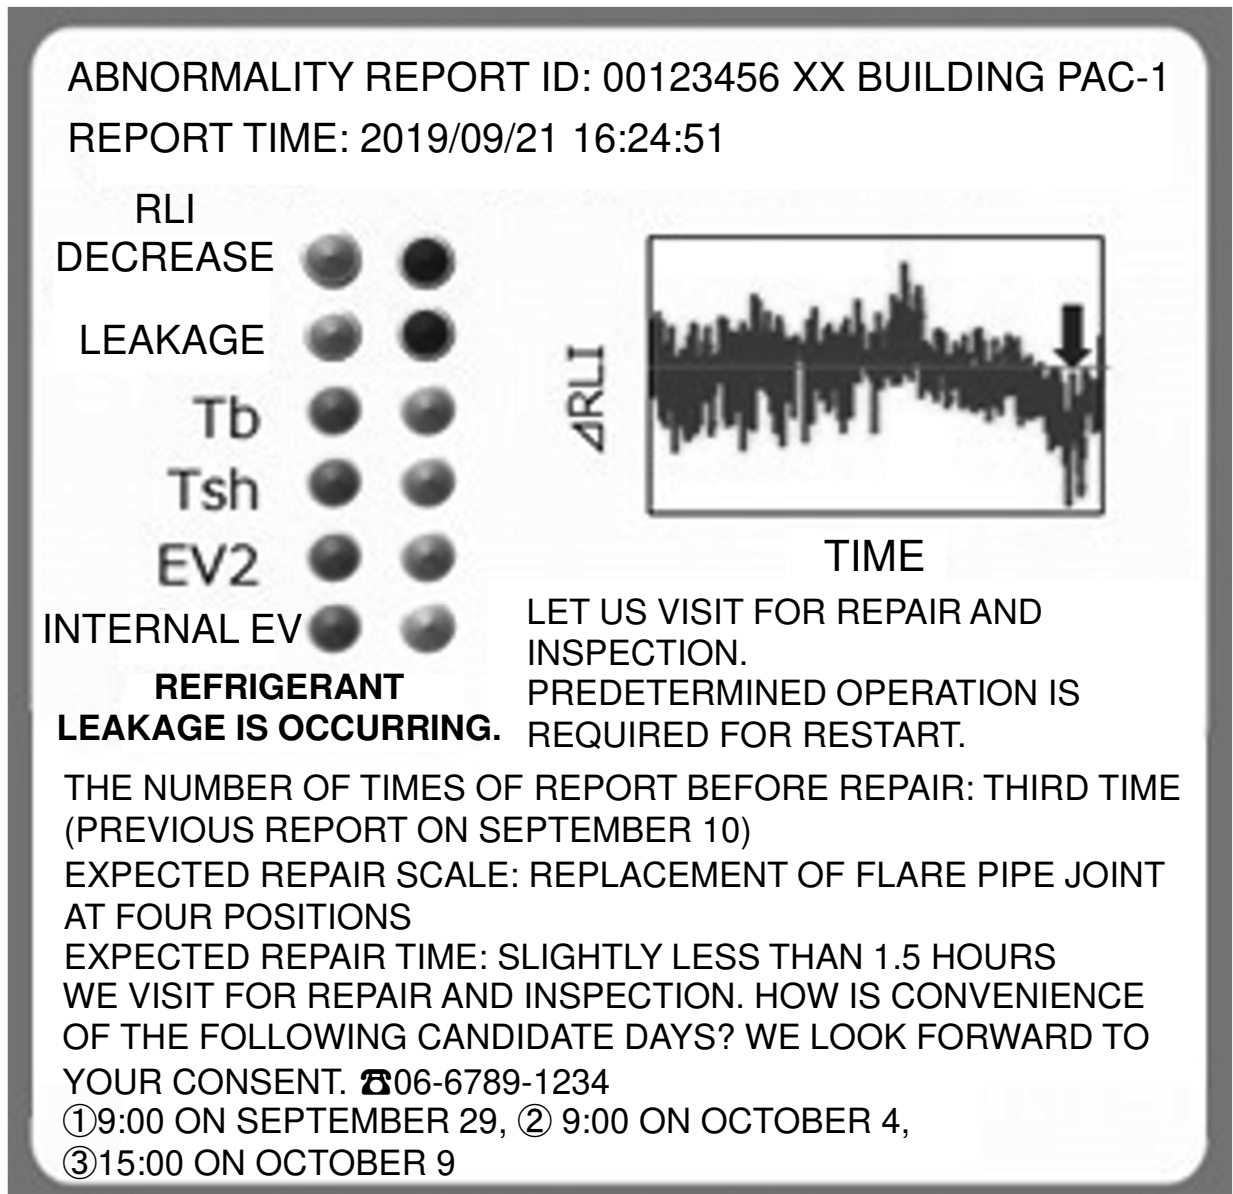


FIG. 8