

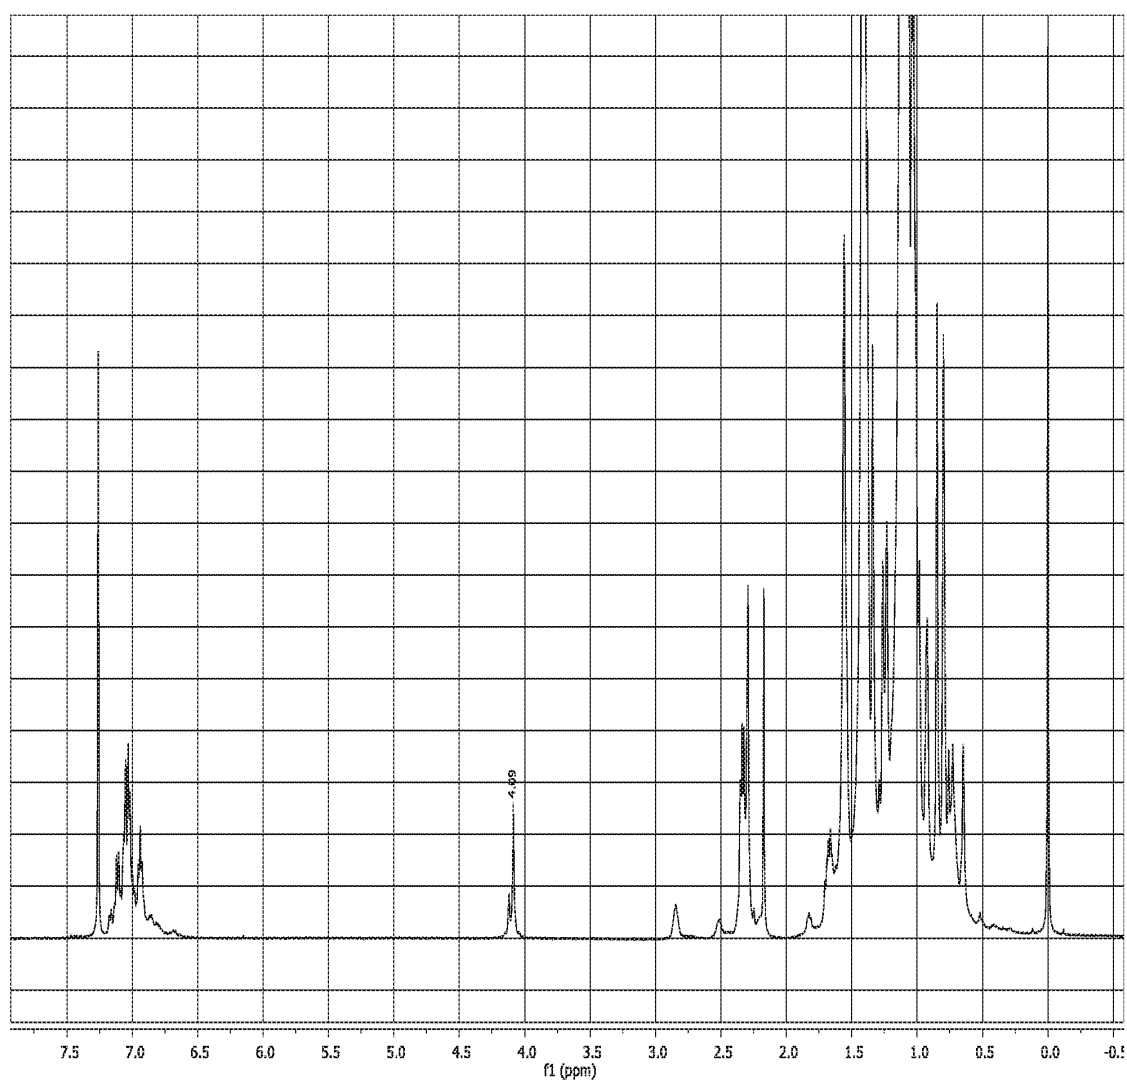


FIG. 1

SUBSTITUTE SHEET (RULE 26)

2/5

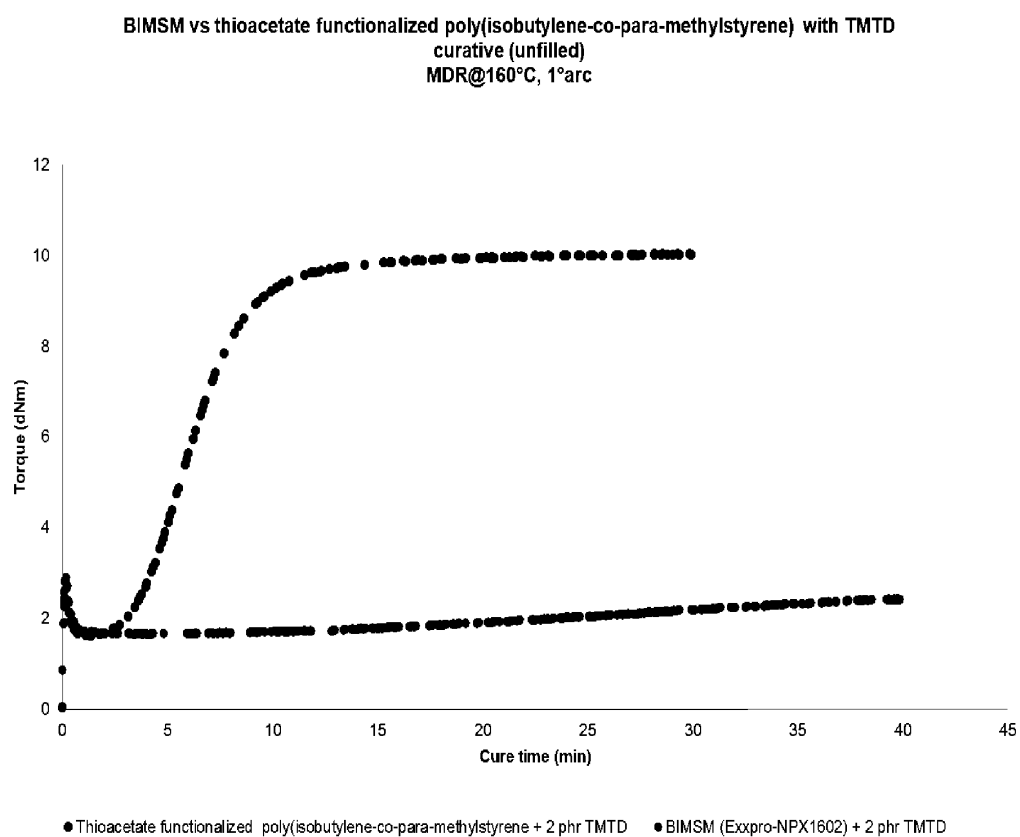


FIG. 2

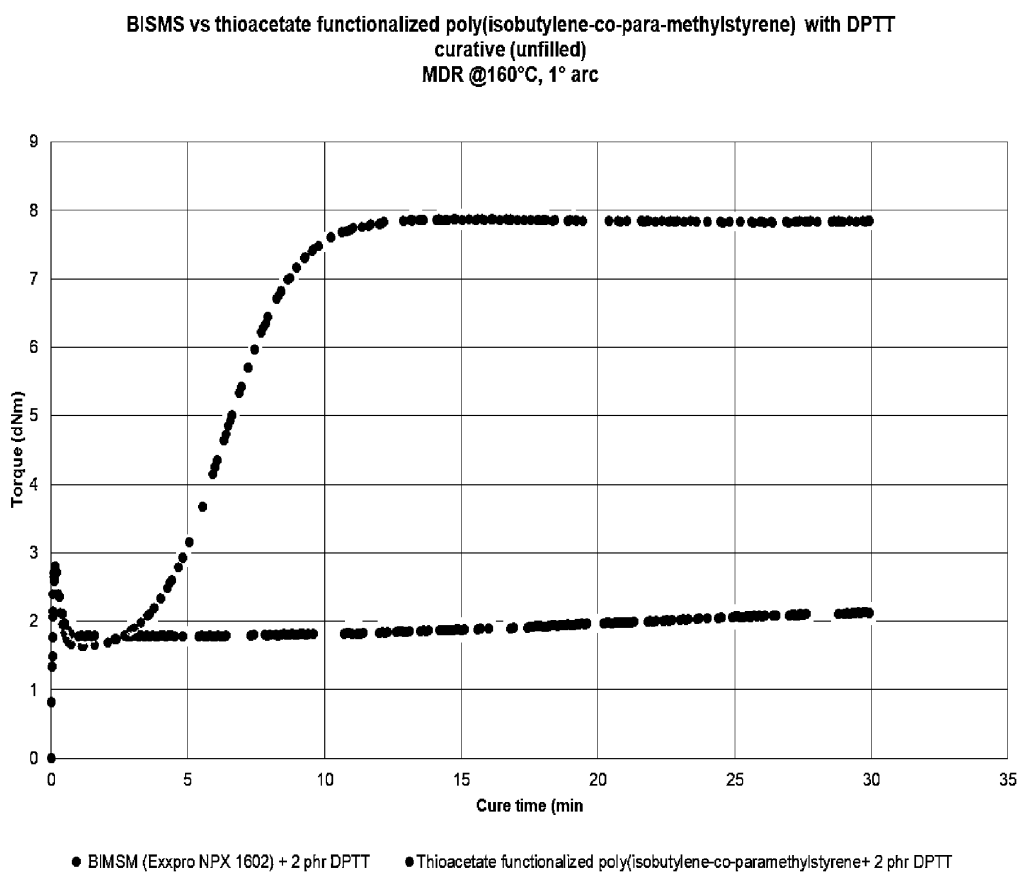


FIG. 3

SUBSTITUTE SHEET (RULE 26)

BIMSM vs thioacetate functionalized poly(isobutylene-co-para-methylstyrene) with varying levels of TMTD curative
MDR@160°C, 1°arc

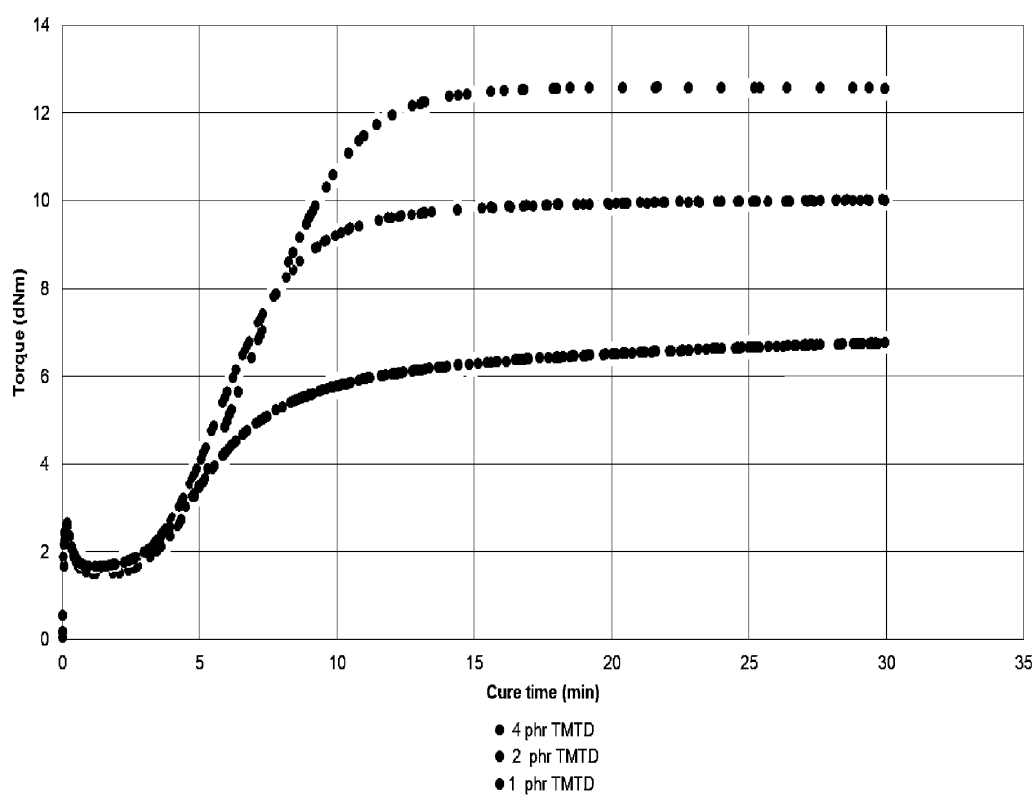


FIG. 4

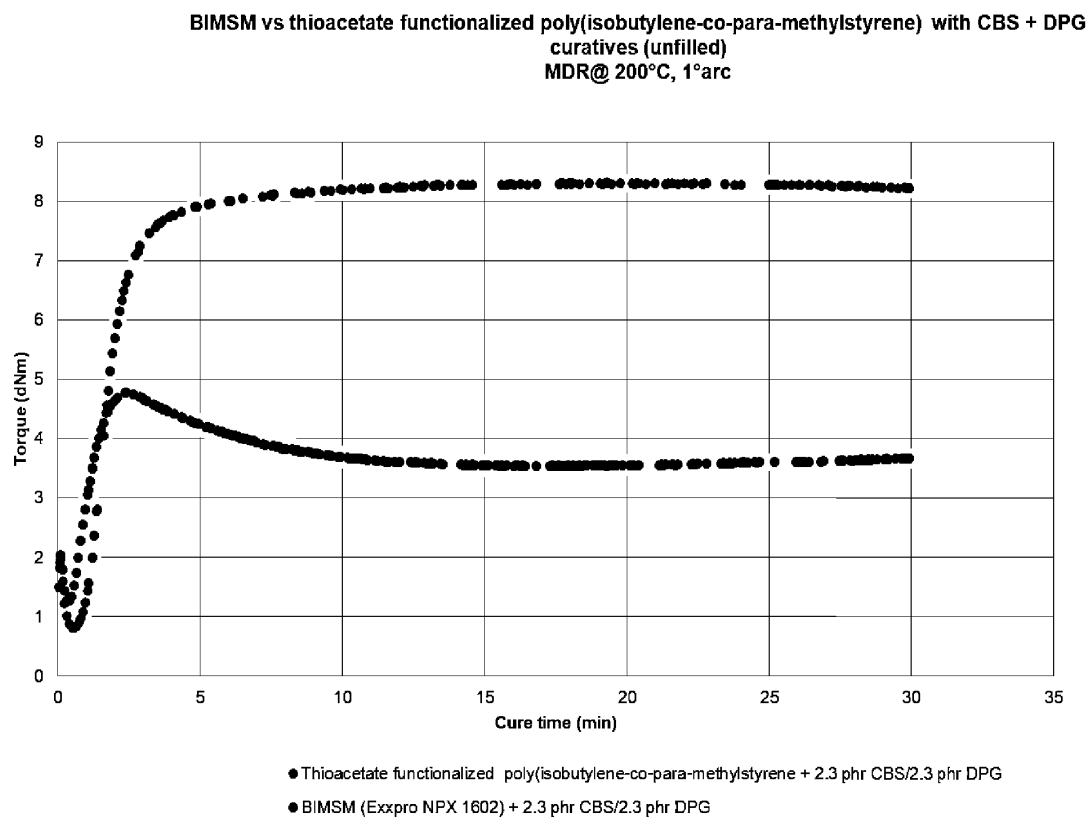


FIG. 5