

FIG. 1

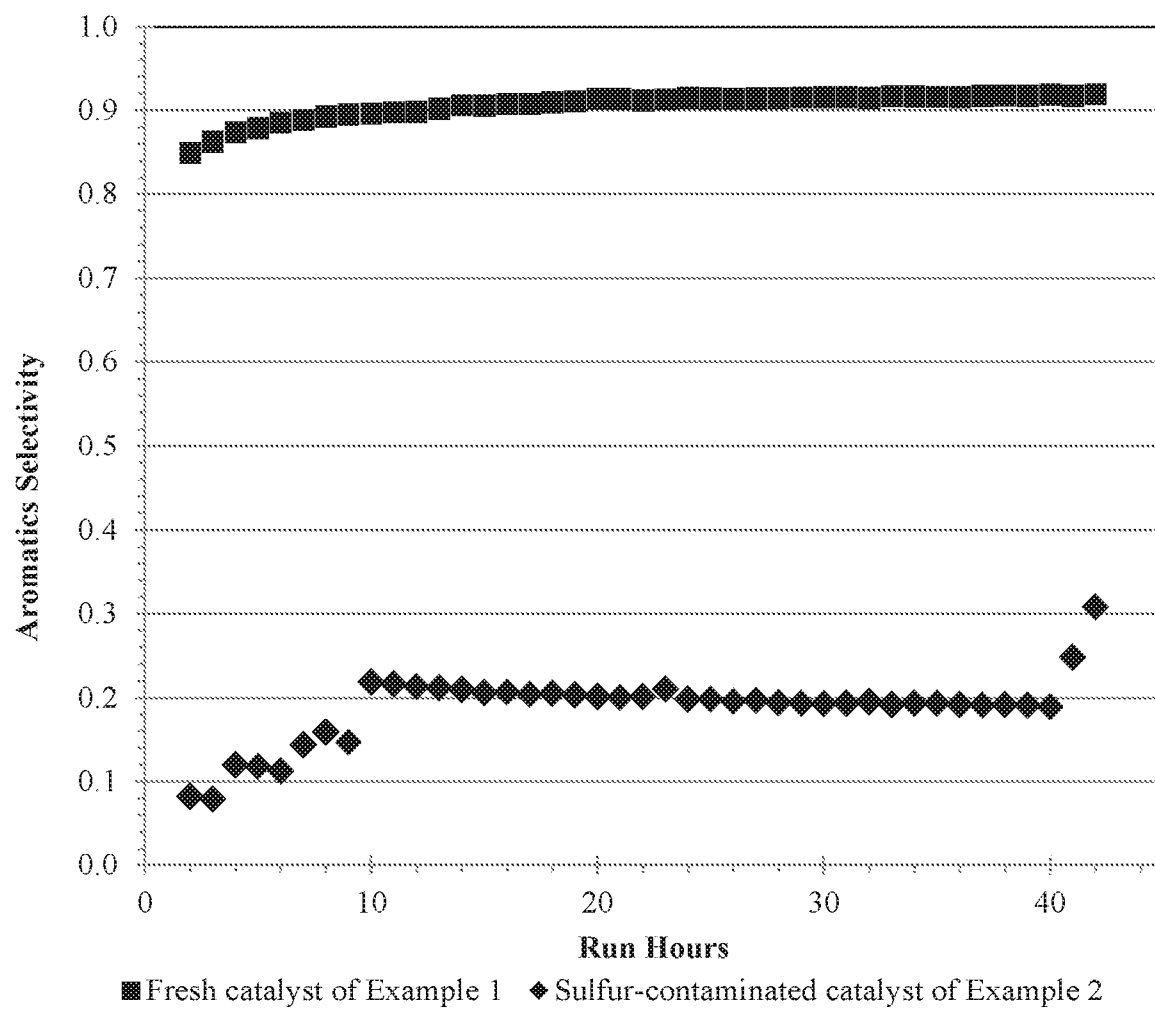


FIG. 2

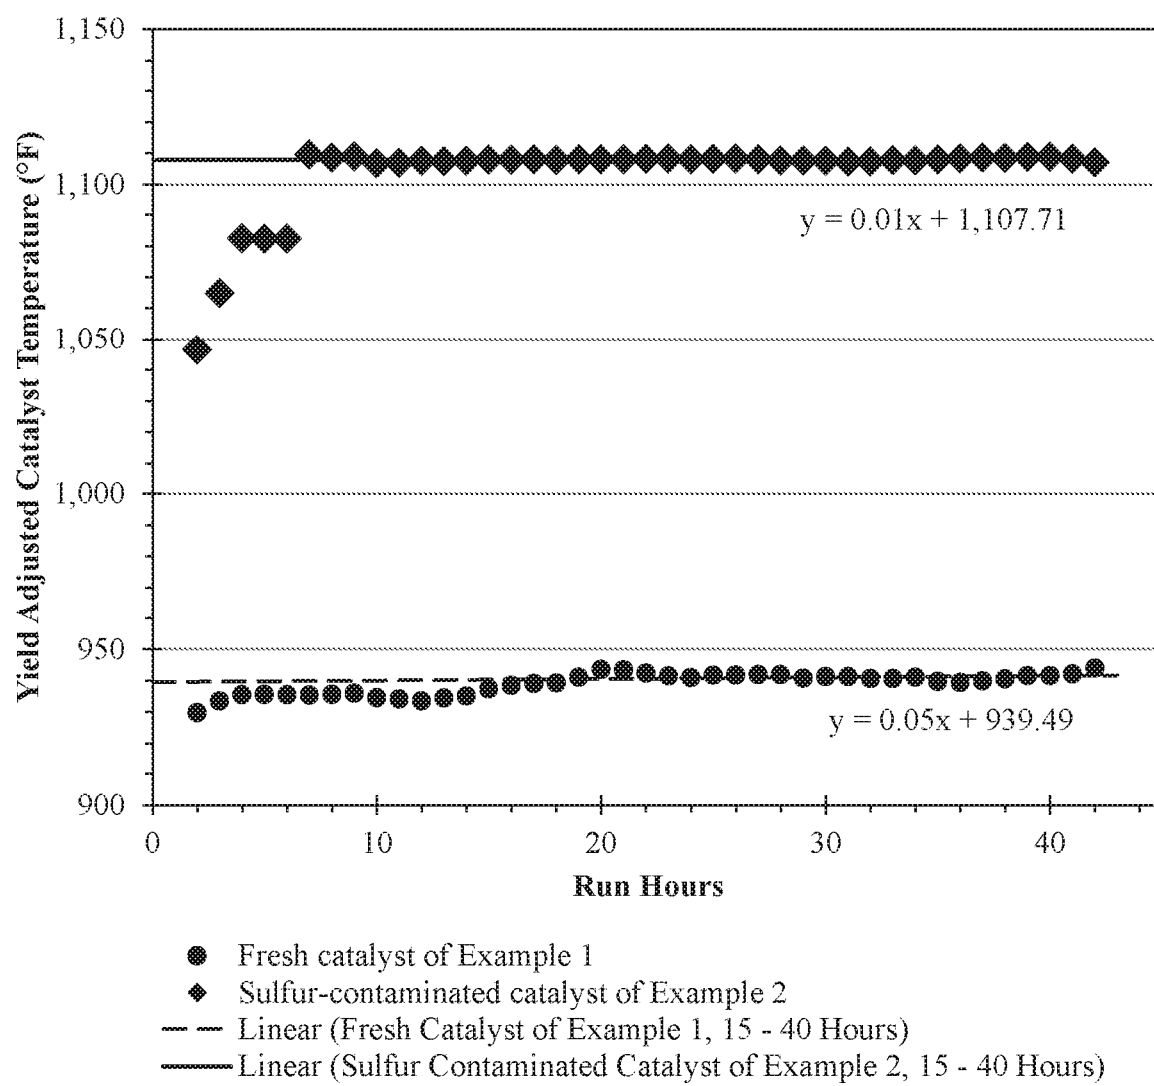


FIG. 3

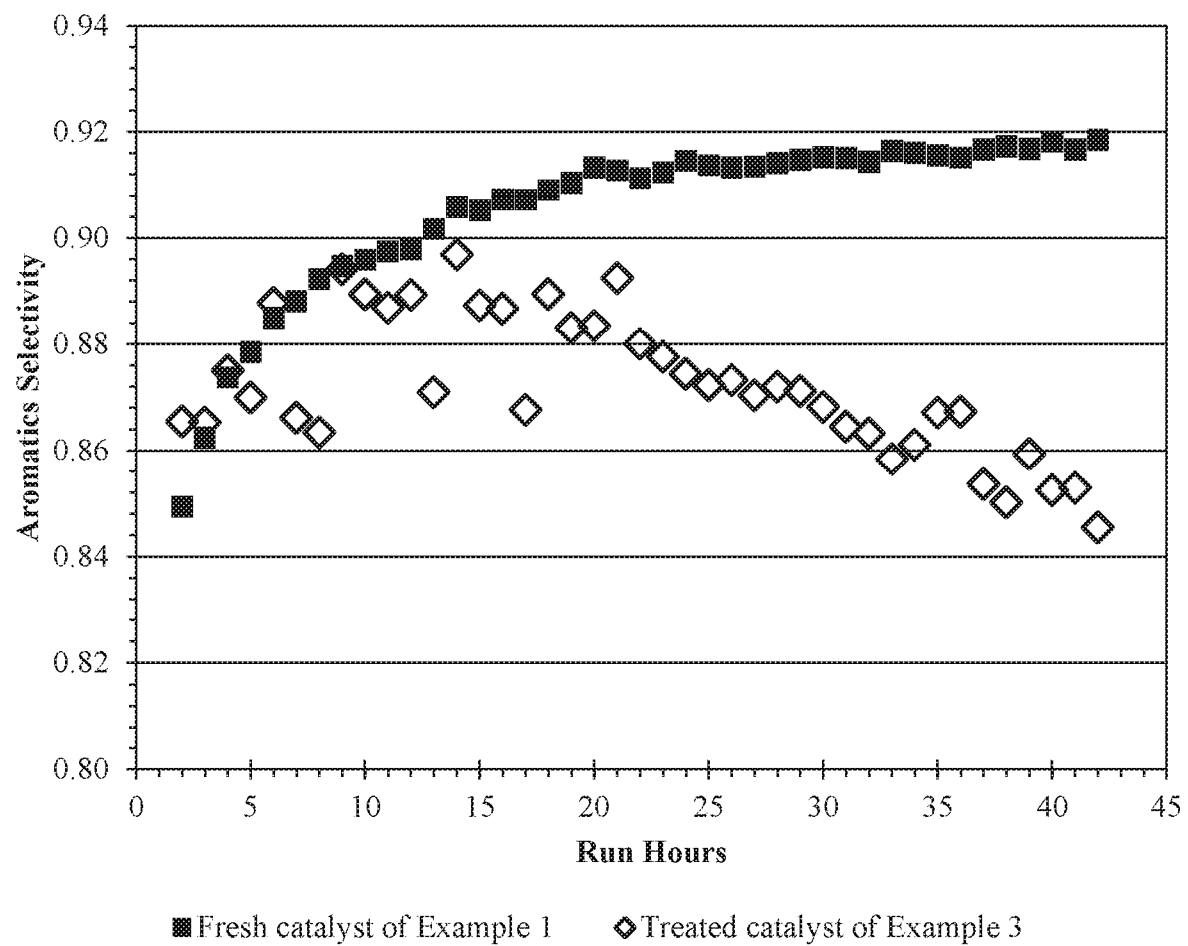


FIG. 4

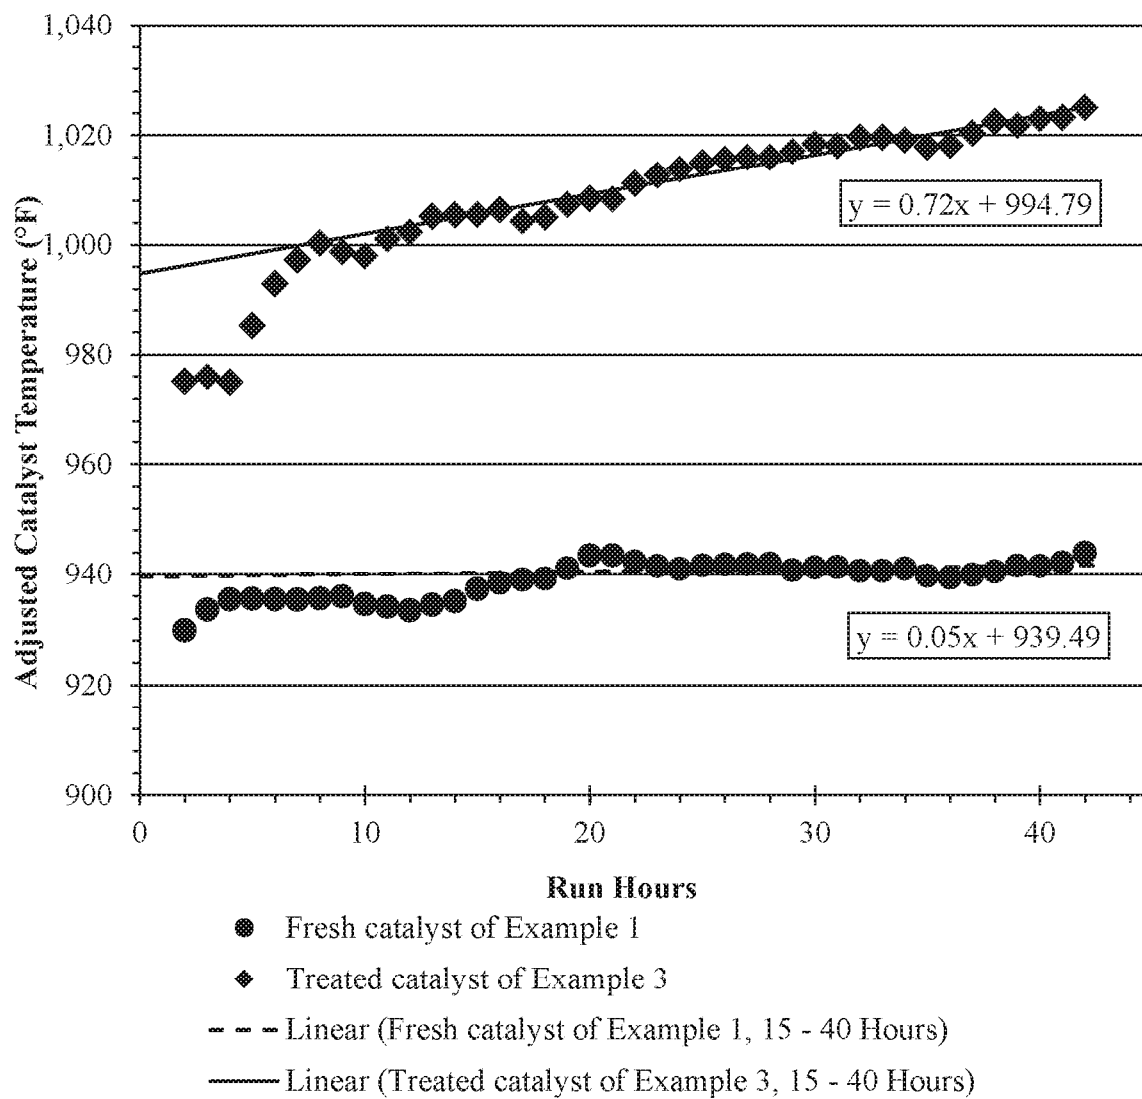


FIG. 5


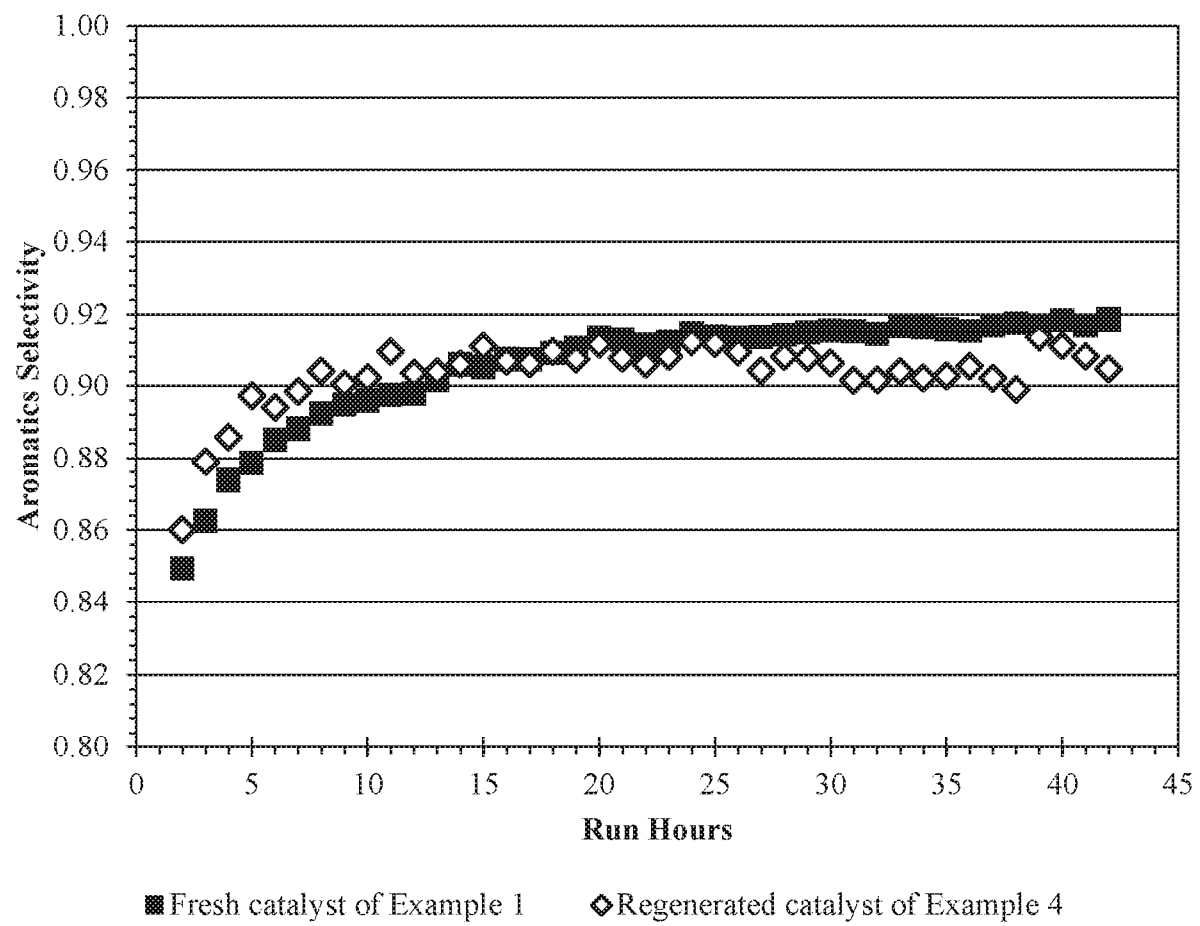


FIG. 6

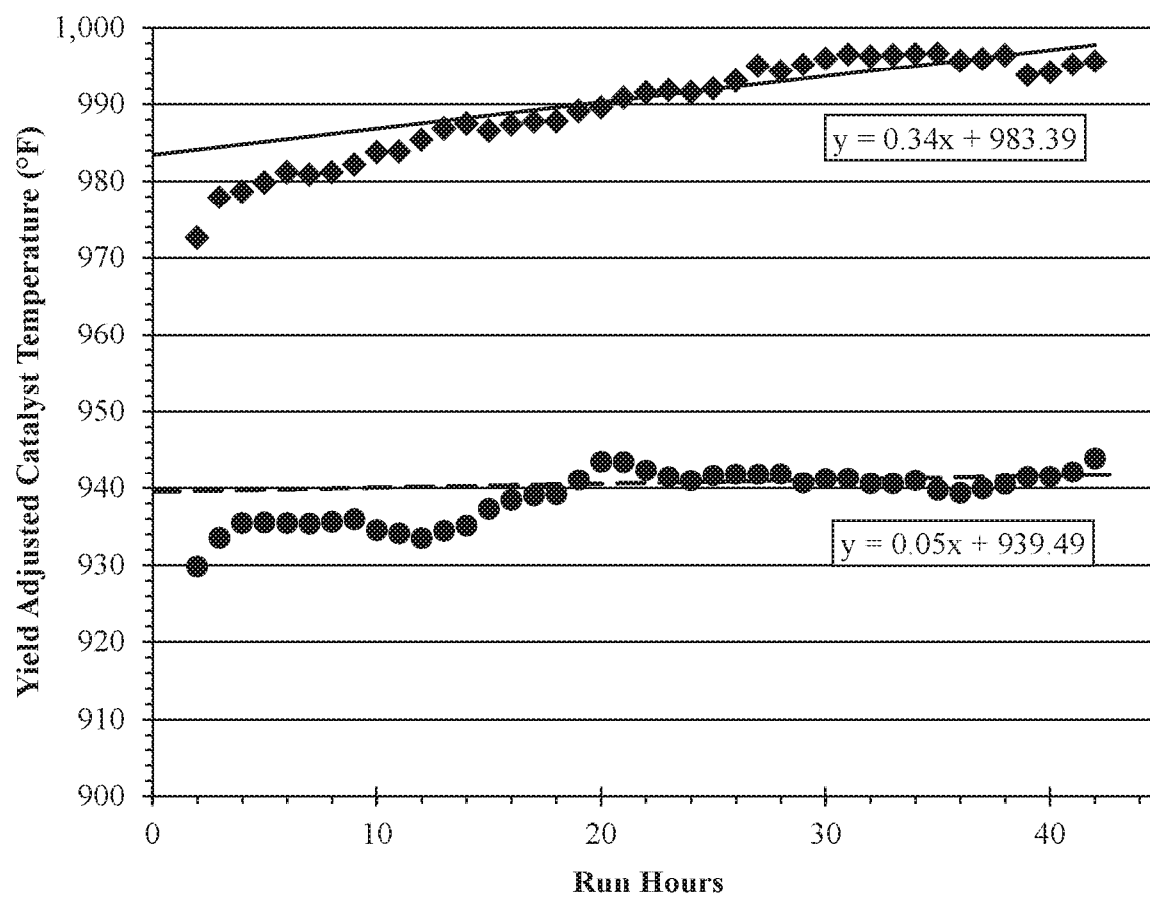

- Fresh catalyst of Example 1
- ◆ Regenerated catalyst of Example 4
- Linear (Fresh catalyst of Example 1, 15 - 40 Hours)
- Linear (Regenerated catalyst of Example 4, 15 - 40 Hours)

FIG. 7

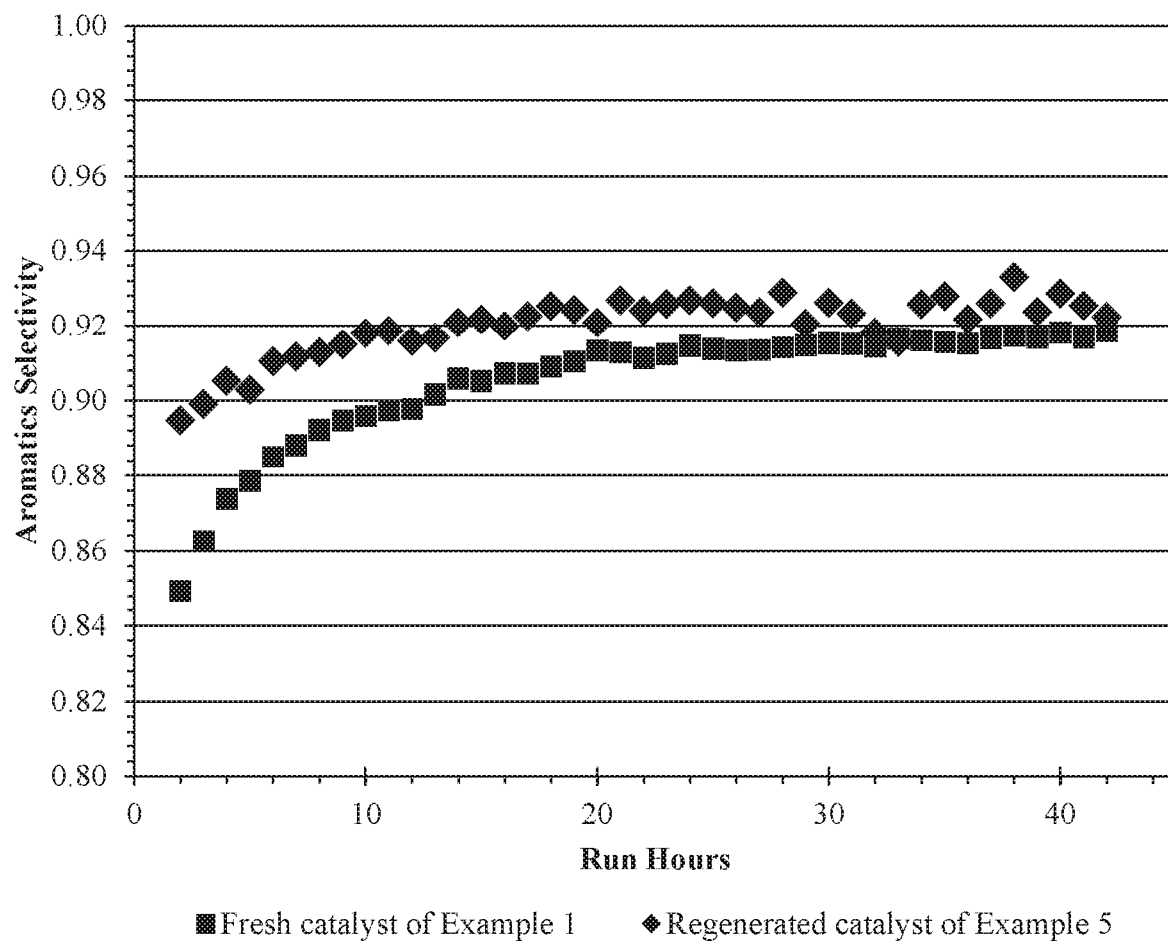


FIG. 8

