Figure 3



Figure 4

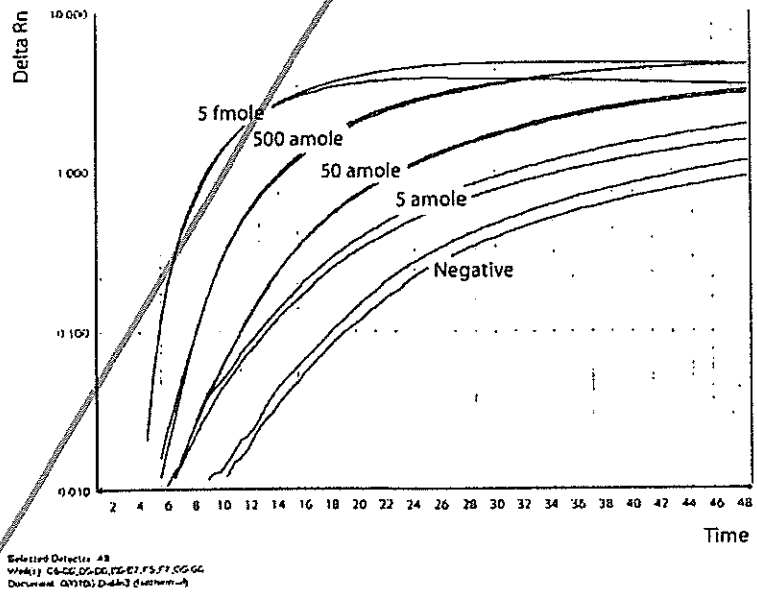


Figure 5

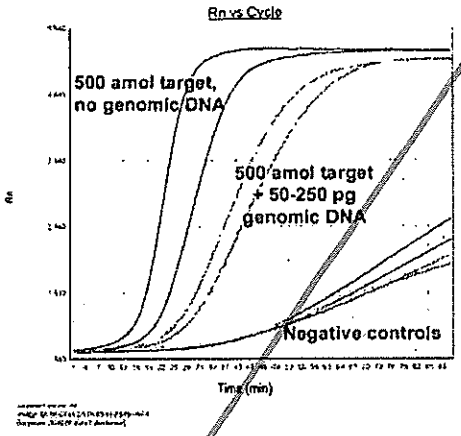
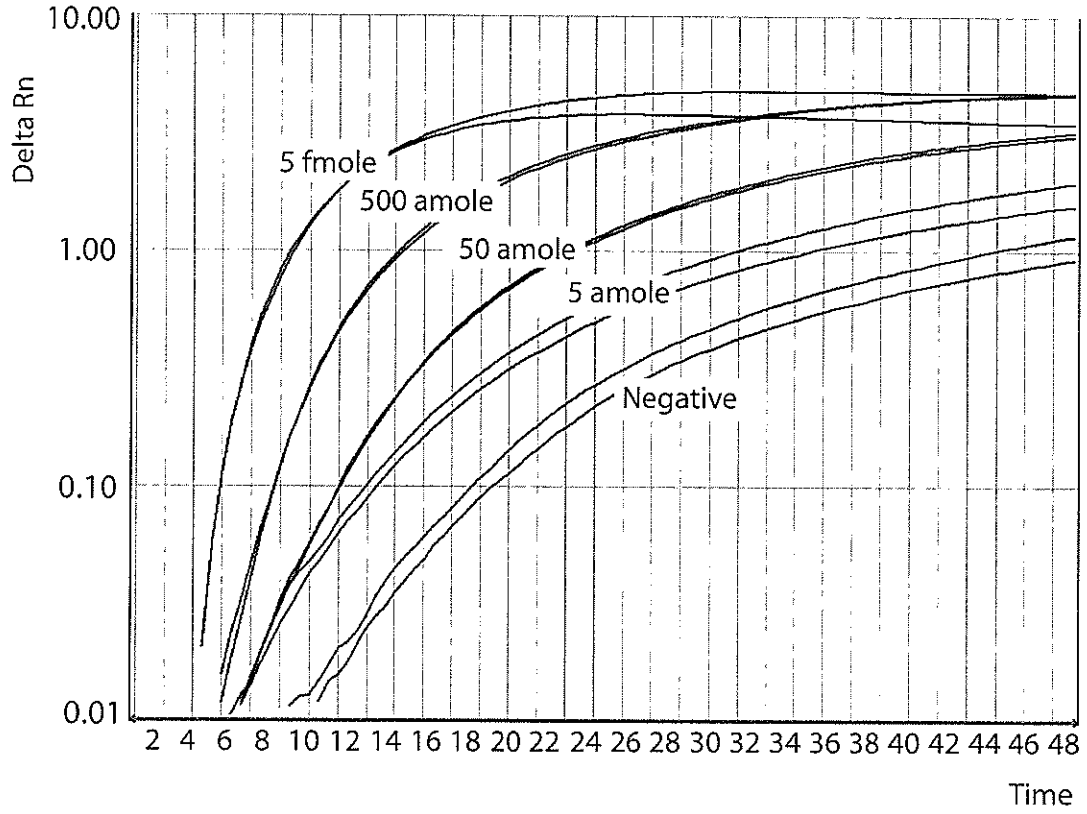

Rn vs Cycle
500 amol target, no genomic DNA
500 amol target + 50-250 pg genomic DNA
Negative controls
Time (min)

Figure 3



Figure 4



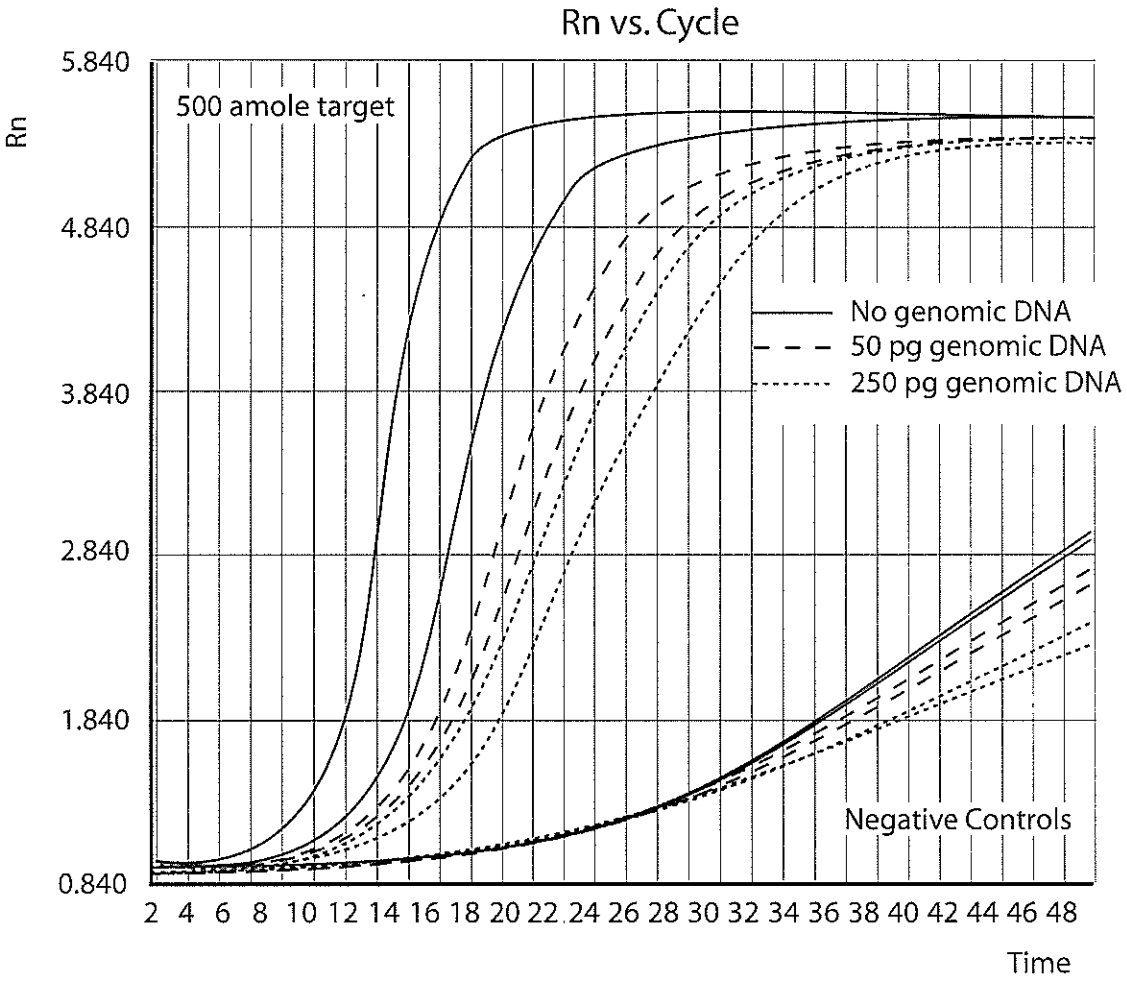

Rn vs. Cycle
Rn
5.840
4.840
3.840
2.840
1.840
0.840
500 amole target
No genomic DNA
50 pg genomic DNA
250 pg genomic DNA
Negative Controls
2 4 6 8 10 12 14 16 18 20 22 24 26 28 30 32 34 36 38 40 42 44 46 48
Time

Figure 5