Fig. 1

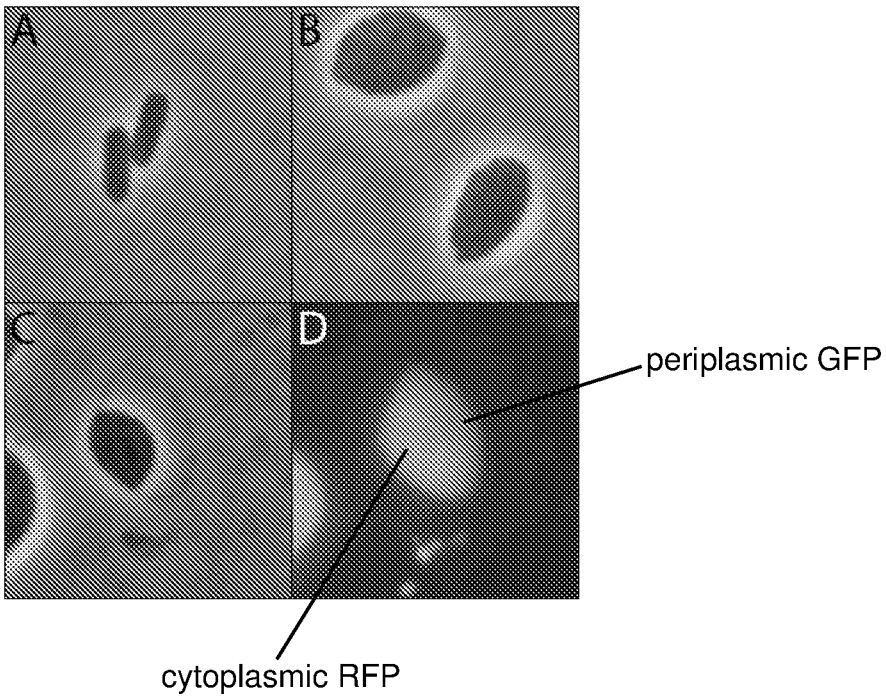


Fig. 2

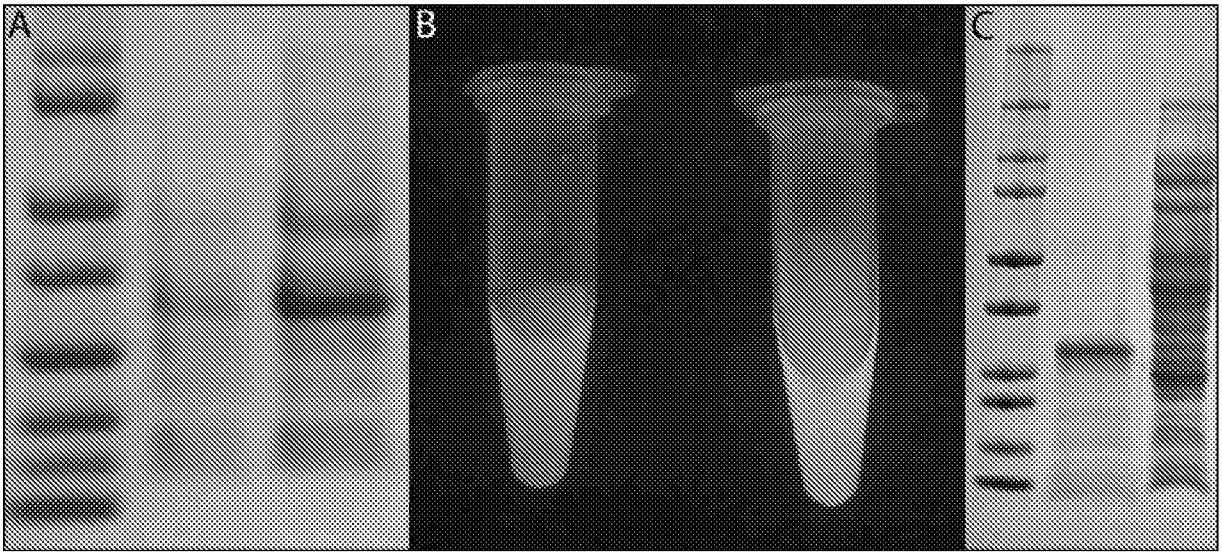


Fig. 3


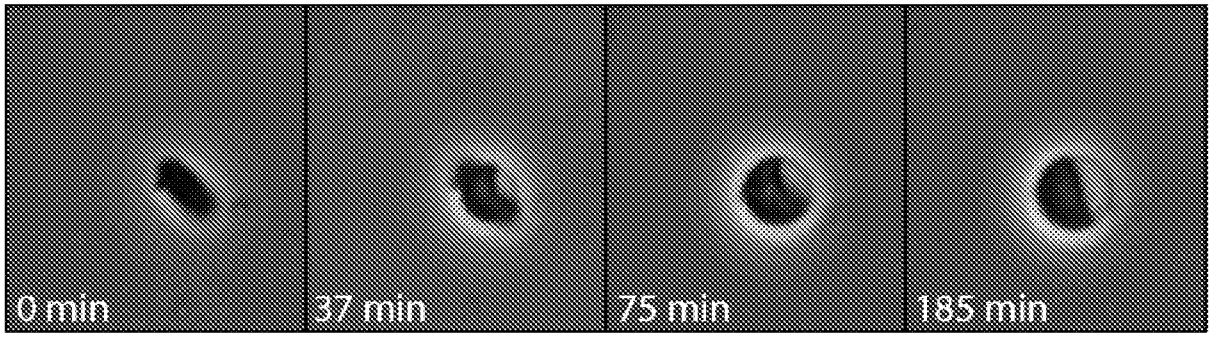


Fig. 4

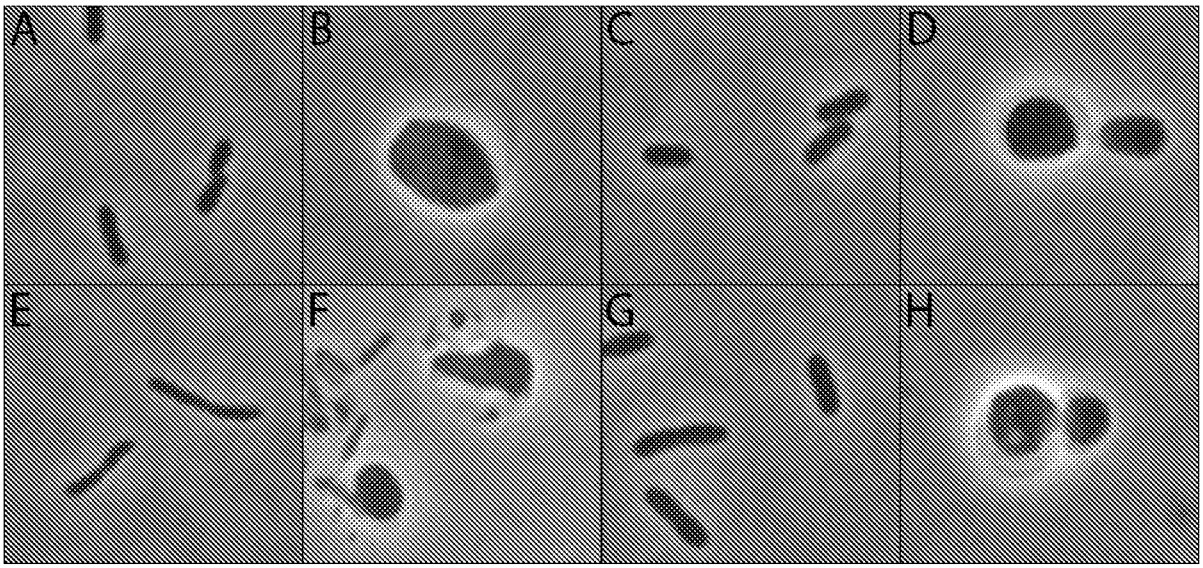

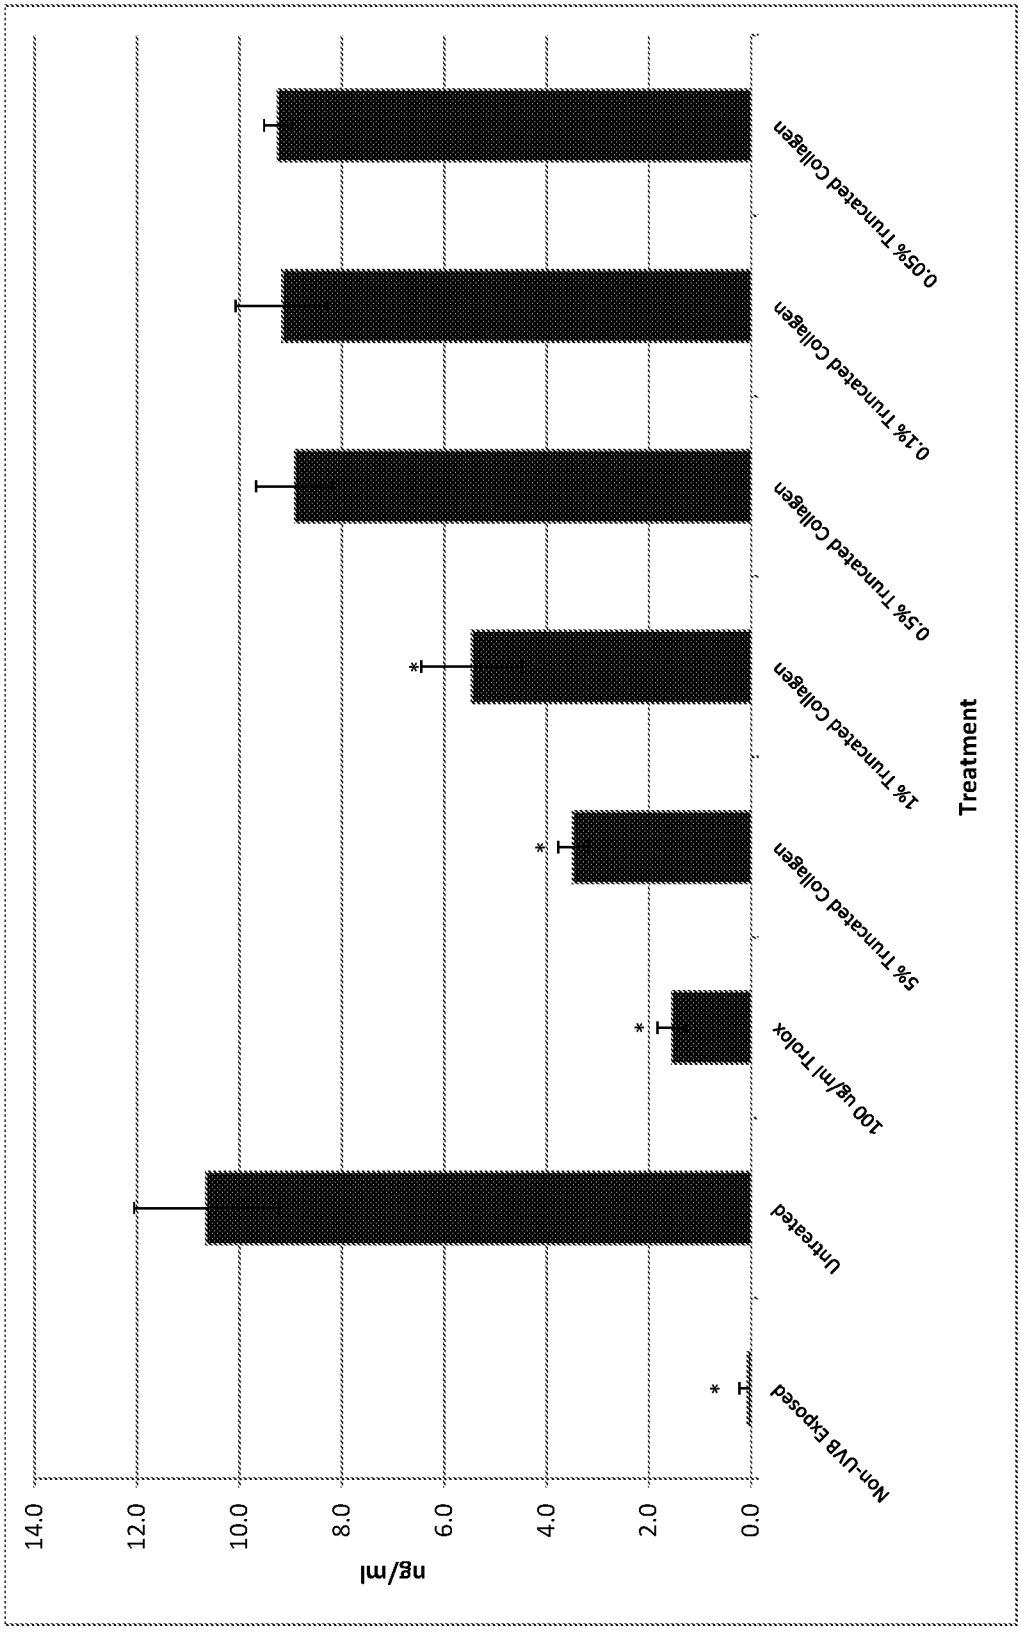

14.0
12.0
10.0
8.0
6.0
4.0
2.0
0.0
ng/ml
Non-UVB Exposed
Untreated
100 ug/ml Trolox
5% Truncated Collagen
1% Truncated Collagen
0.5% Truncated Collagen
0.1% Truncated Collagen
0.05% Truncated Collagen
Treatment

Fig. 5