

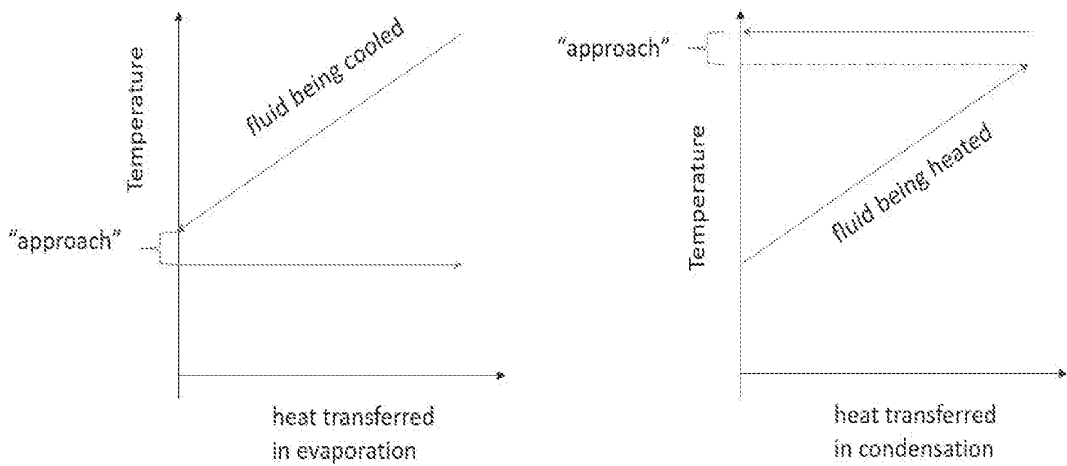


Figure 1 – temperatures in heat exchangers for single refrigerant or azeotropic refrigerant

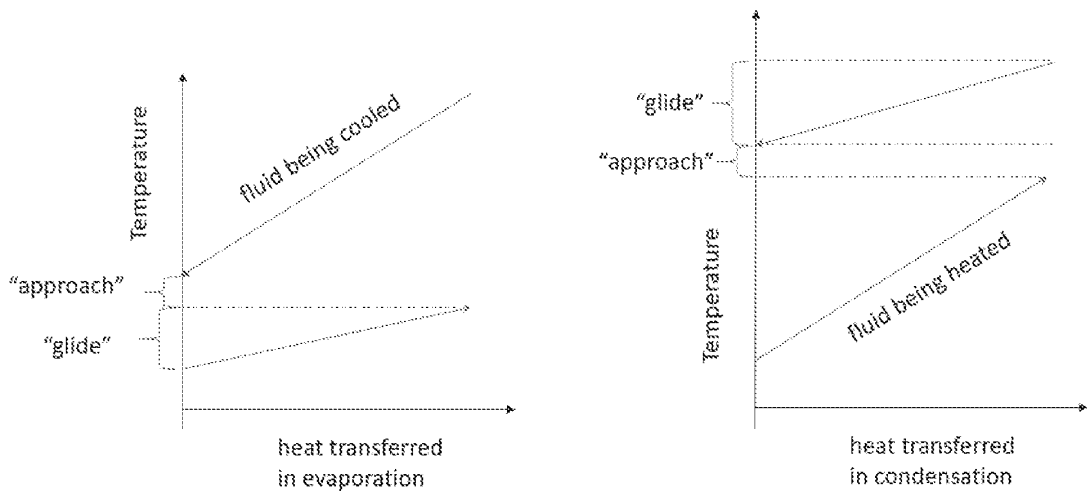


Figure 2 – temperatures in crossflow heat exchangers for non-azeotropic refrigerant

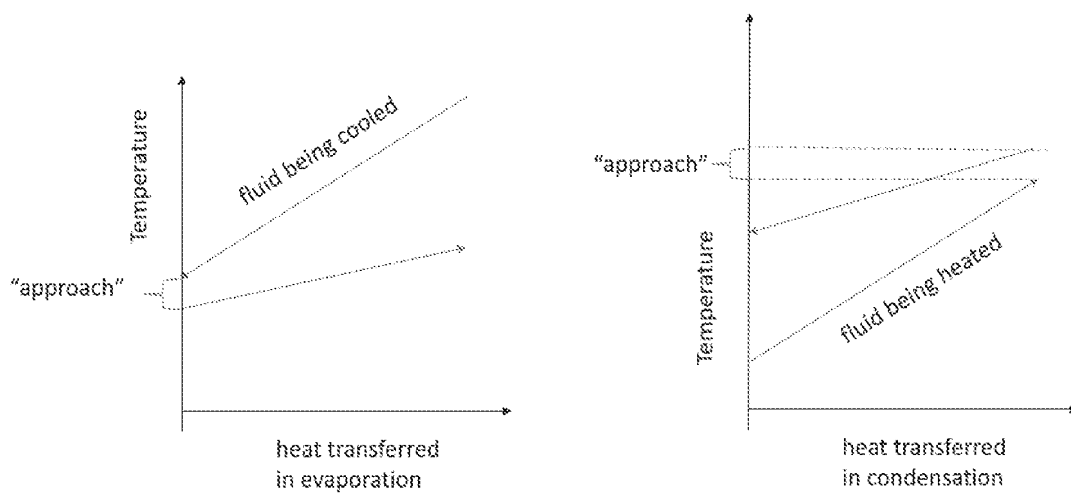


Figure 3 – temperatures in counterflow heat exchangers for non-azeotropic refrigerant