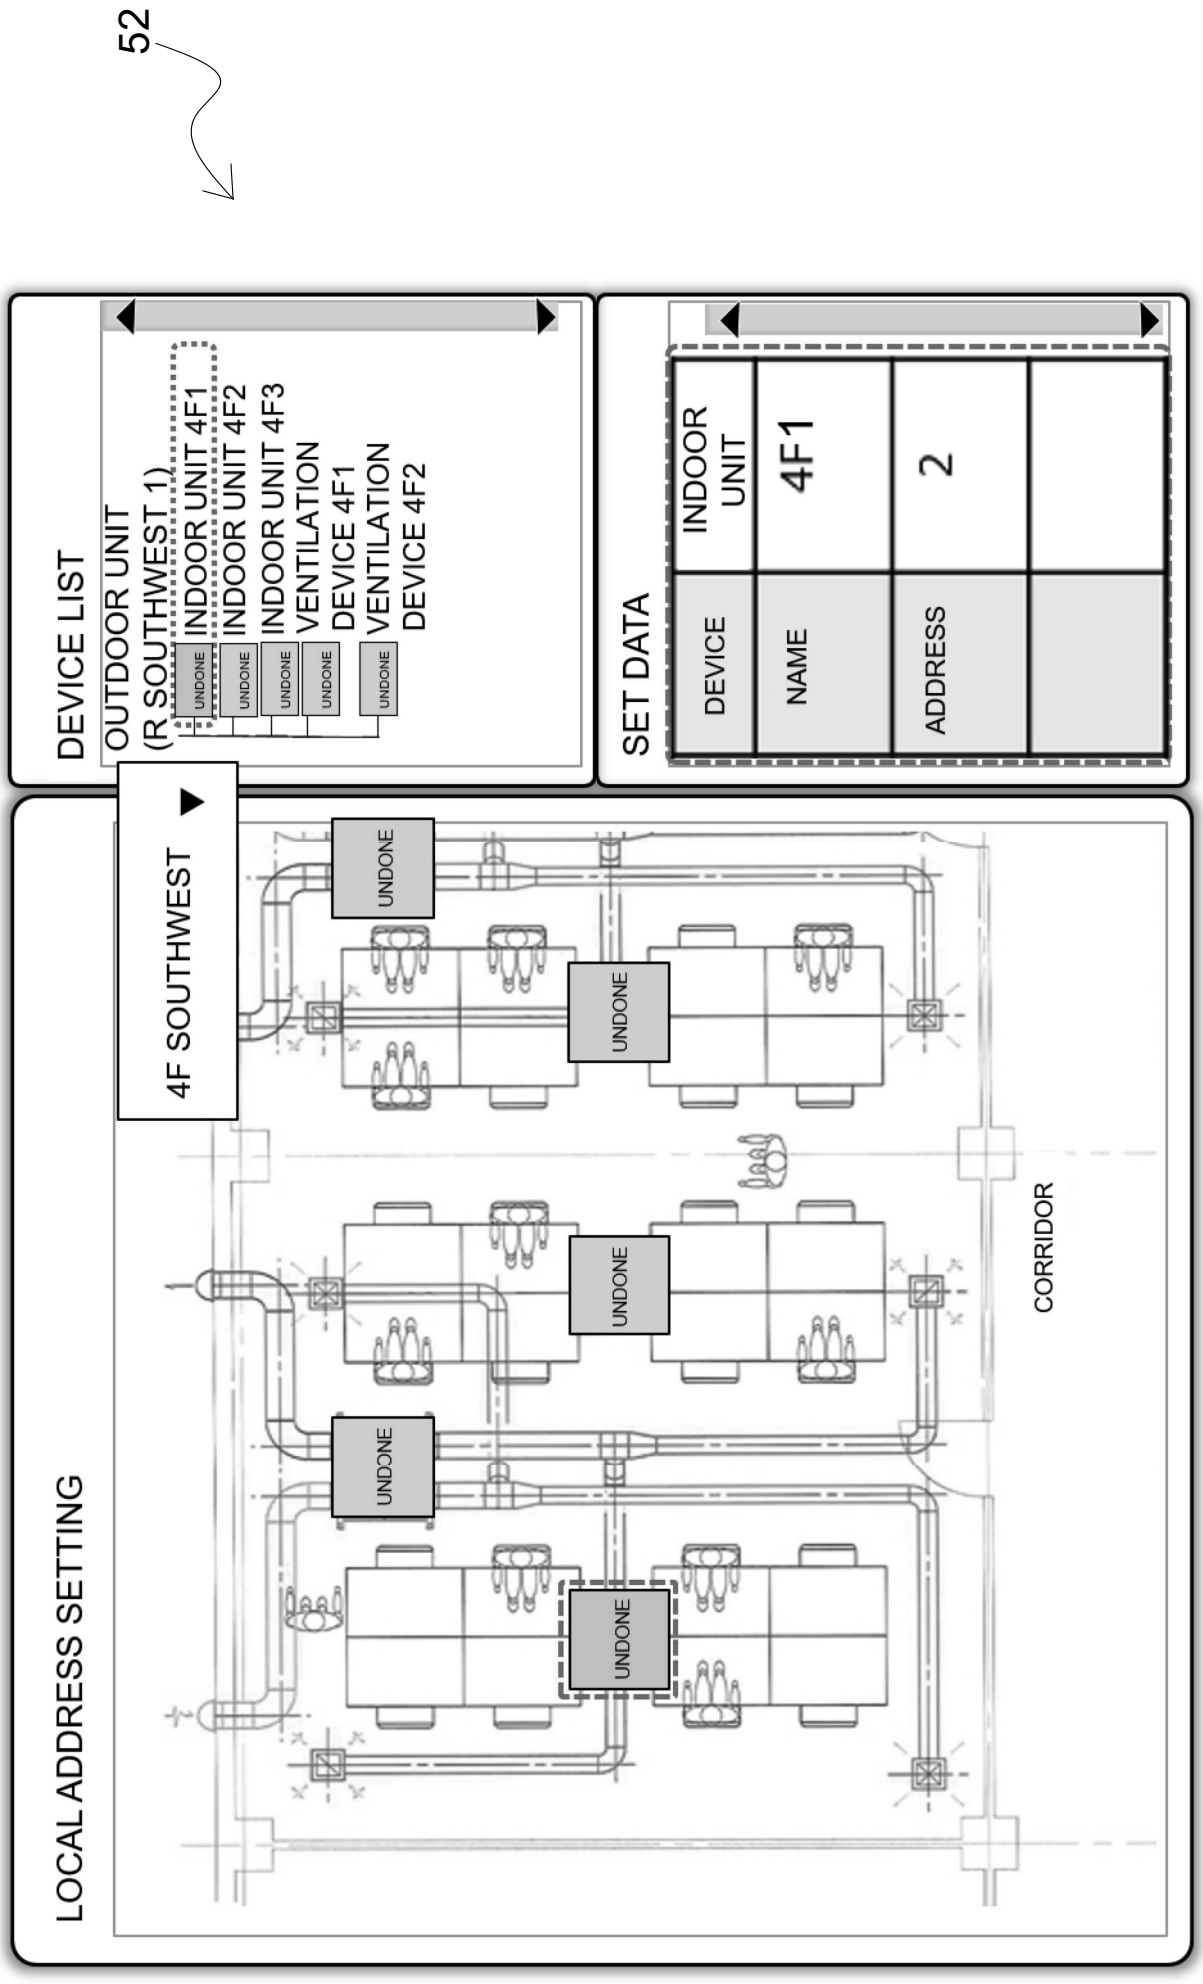
52
LOCAL ADDRESS SETTING
4F SOUTHWEST
UNDONE
UNDONE
UNDONE
UNDONE
UNDONE
CORRIDOR
DEVICE LIST
OUTDOOR UNIT
(R SOUTHWEST 1)
INDOOR UNIT 4F1
INDOOR UNIT 4F2
INDOOR UNIT 4F3
VENTILATION
DEVICE 4F1
VENTILATION
DEVICE 4F2
UNDONE
UNDONE
UNDONE
UNDONE
UNDONE
SET DATA
DEVICE
INDOOR UNIT
NAME
4F1
ADDRESS
2

FIG. 3

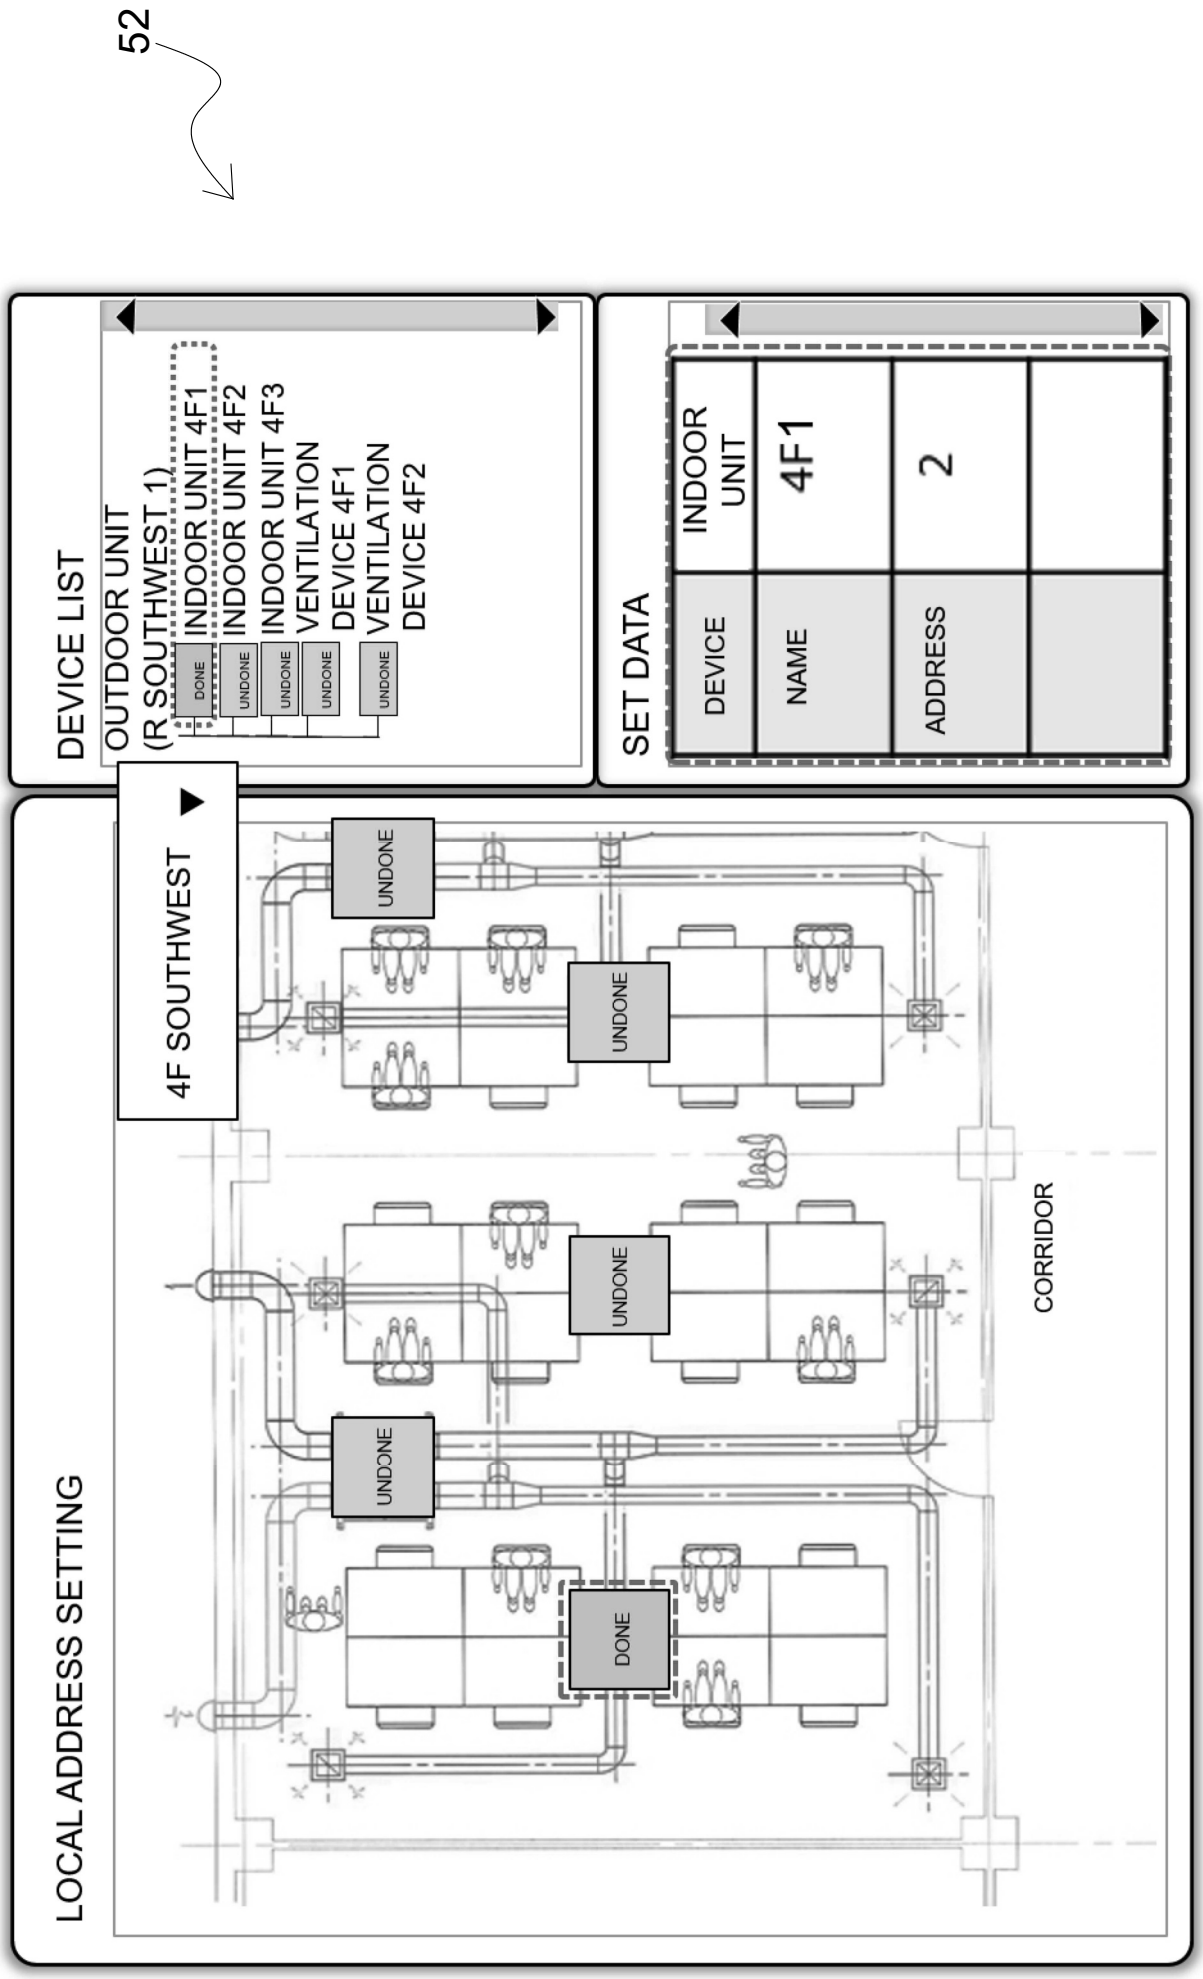
52
LOCAL ADDRESS SETTING
4F SOUTHWEST
DONE
UNDONE
UNDONE
UNDONE
UNDONE
CORRIDOR
DEVICE LIST
OUTDOOR UNIT
(R SOUTHWEST 1)
DONE
INDOOR UNIT 4F1
UNDONE
INDOOR UNIT 4F2
UNDONE
INDOOR UNIT 4F3
UNDONE
VENTILATION
DEVICE 4F1
UNDONE
VENTILATION
DEVICE 4F2
SET DATA
DEVICE
INDOOR UNIT
NAME
4F1
ADDRESS
2

FIG. 4