FIG. 1

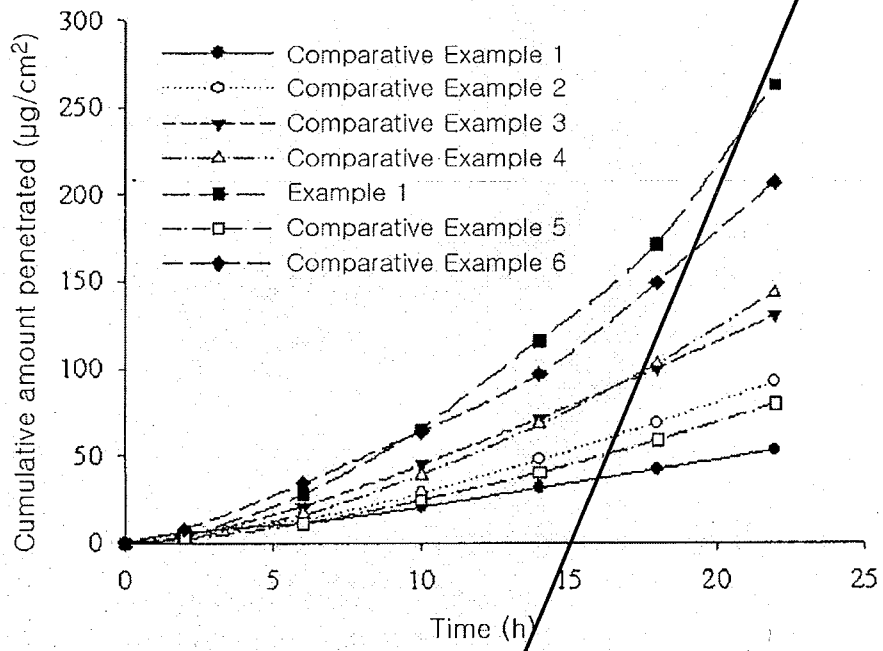
Cumulative amount penetrated (μg/cm²)
300
250
200
150
100
50
0
0
5
10
15
20
25
Time (h)
Comparative Example 1
Comparative Example 2
Comparative Example 3
Comparative Example 4
Example 1
Comparative Example 5
Comparative Example 6

FIG. 2

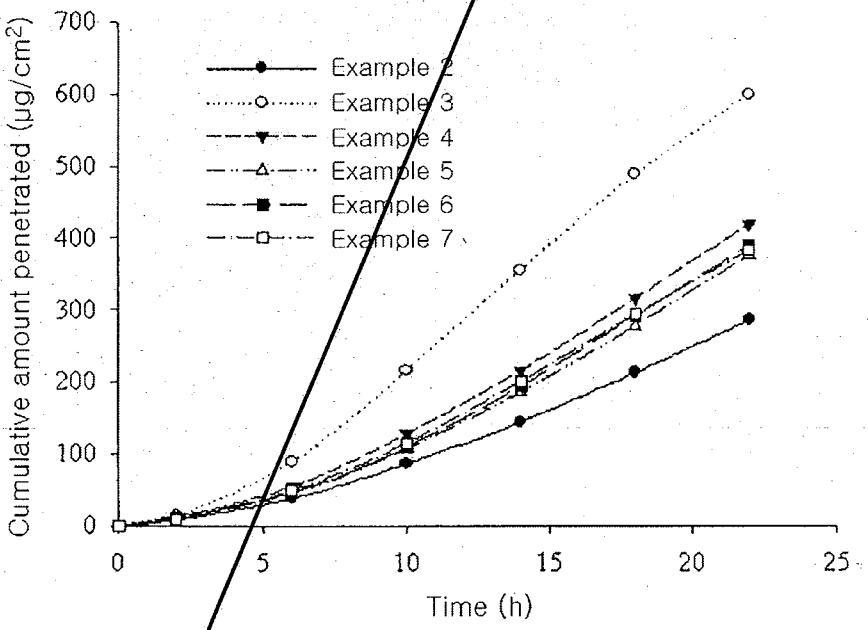
Cumulative amount penetrated (μg/cm²)
700
600
500
400
300
200
100
0
0
5
10
15
20
25
Time (h)
Example 2
Example 3
Example 4
Example 5
Example 6
Example 7

FIG. 3

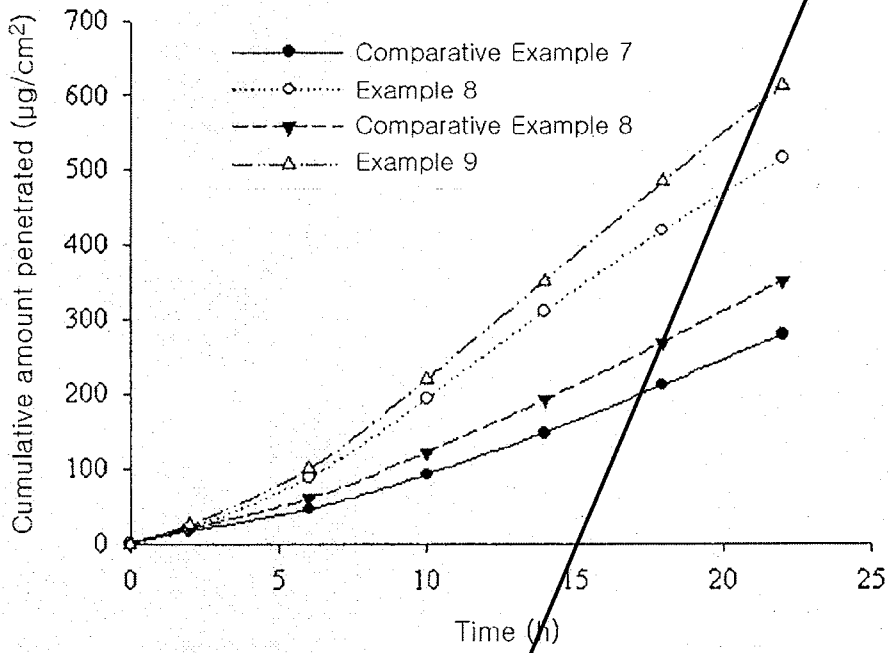
Cumulative amount penetrated (μg/cm²)
700
600
500
400
300
200
100
0
0
5
10
15
20
25
Time (h)
Comparative Example 7
Example 8
Comparative Example 8
Example 9

FIG. 4

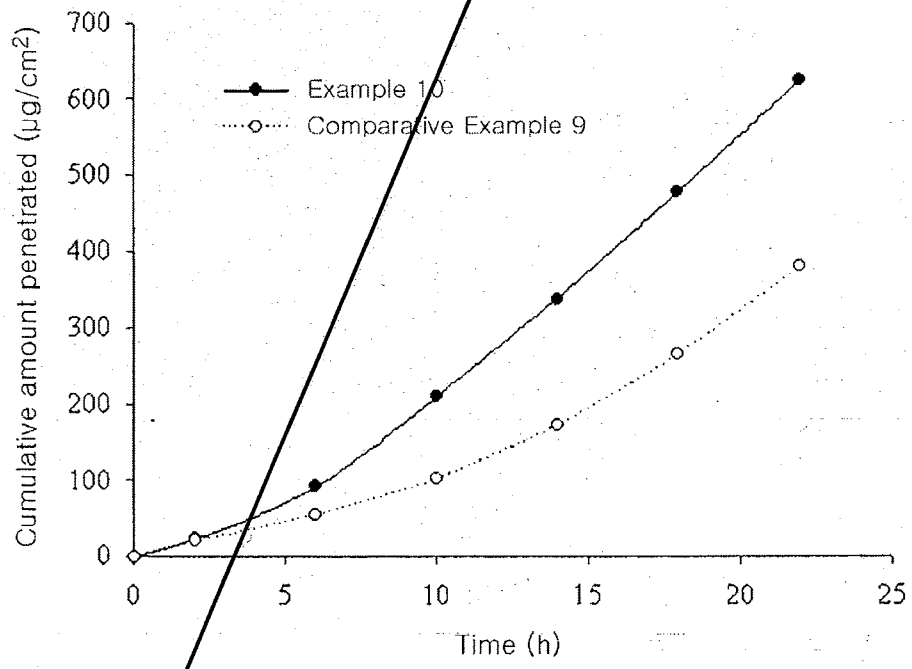
Cumulative amount penetrated (μg/cm²)
700
600
500
400
300
200
100
0
0
5
10
15
20
25
Time (h)
Example 10
Comparative Example 9

FIG. 5

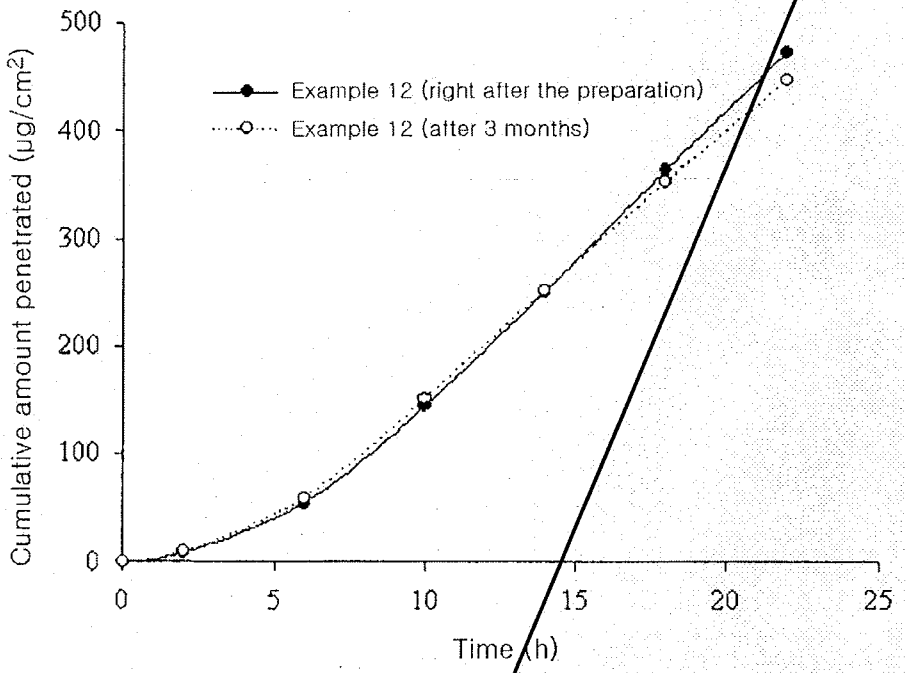
Cumulative amount penetrated (μg/cm²)
500
400
300
200
100
0
Example 12 (right after the preparation)
Example 12 (after 3 months)
0
5
10
15
20
25
Time (h)

FIG. 1

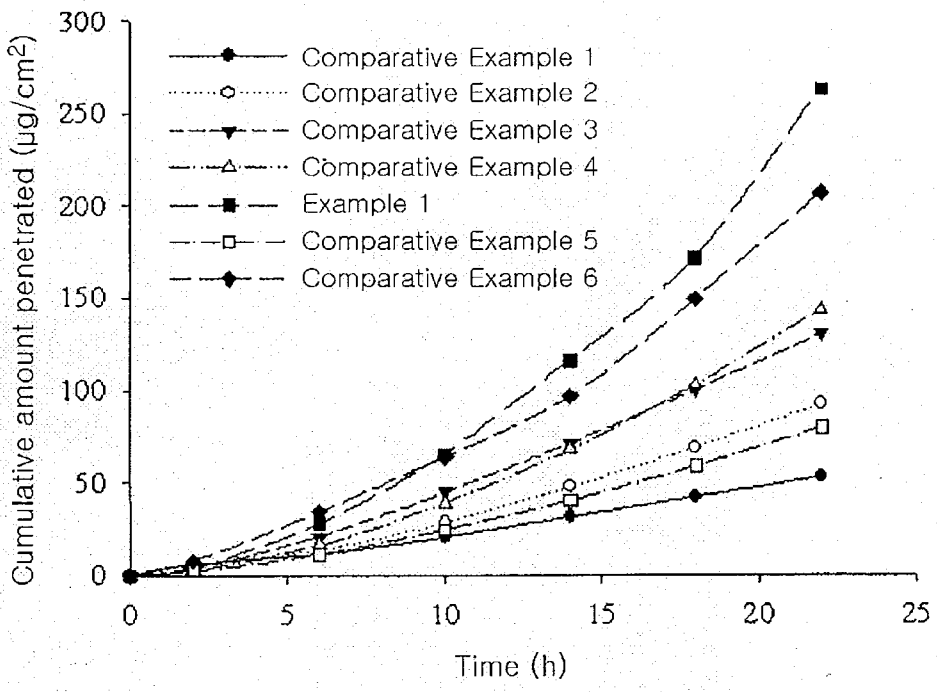
Cumulative amount penetrated (μg/cm²)
300
250
200
150
100
50
0
0
5
10
15
20
25
Time (h)
Comparative Example 1
Comparative Example 2
Comparative Example 3
Comparative Example 4
Example 1
Comparative Example 5
Comparative Example 6

FIG. 2

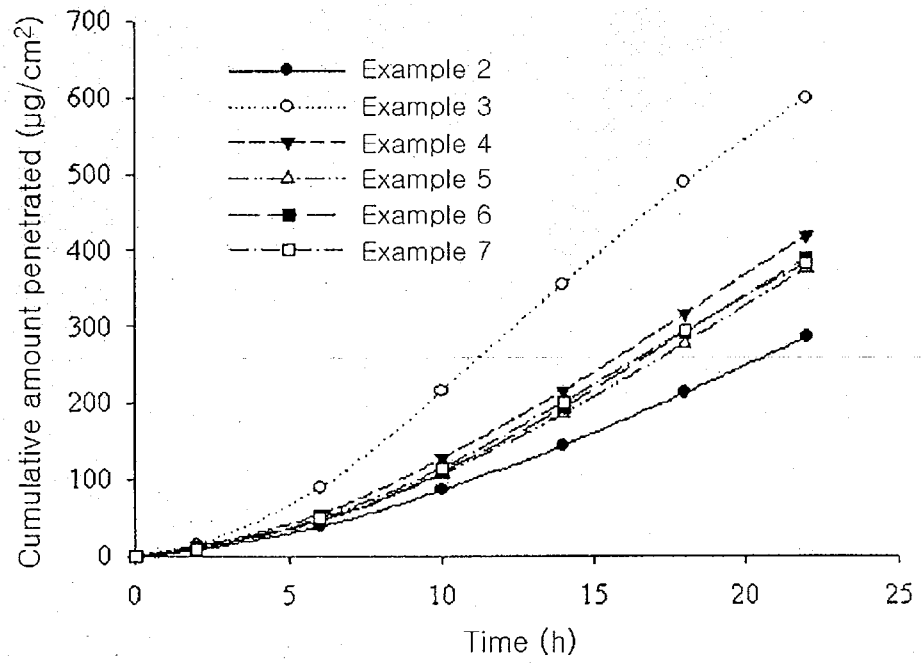
Cumulative amount penetrated (μg/cm²)
700
600
500
400
300
200
100
0
0
5
10
15
20
25
Time (h)
Example 2
Example 3
Example 4
Example 5
Example 6
Example 7

FIG. 3

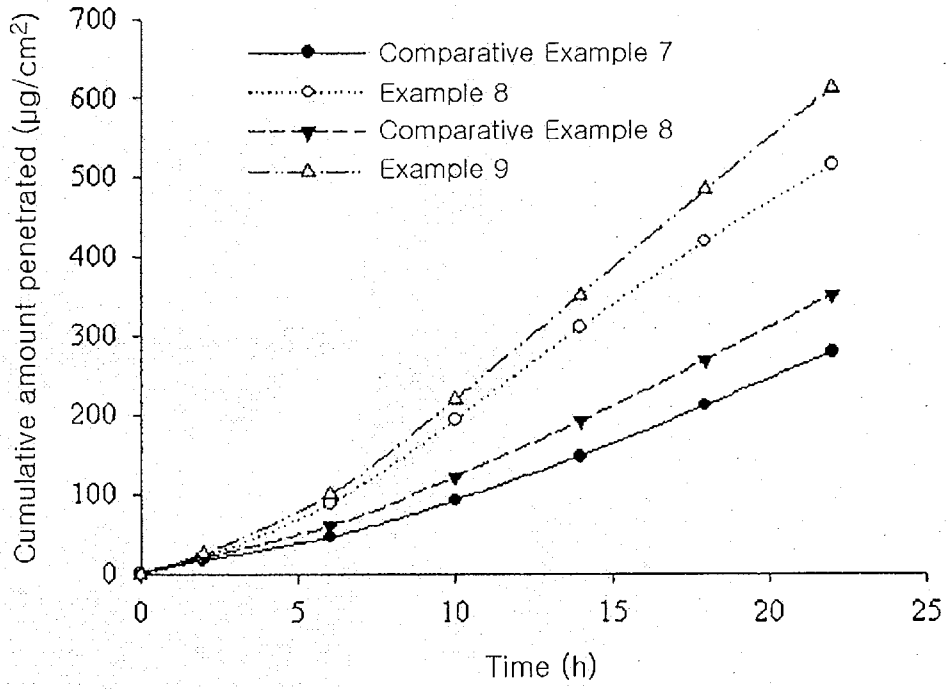
Comparative Example 7
Example 8
Comparative Example 8
Example 9
Cumulative amount penetrated (μg/cm²)
700
600
500
400
300
200
100
0
0
5
10
15
20
25
Time (h)

FIG. 4

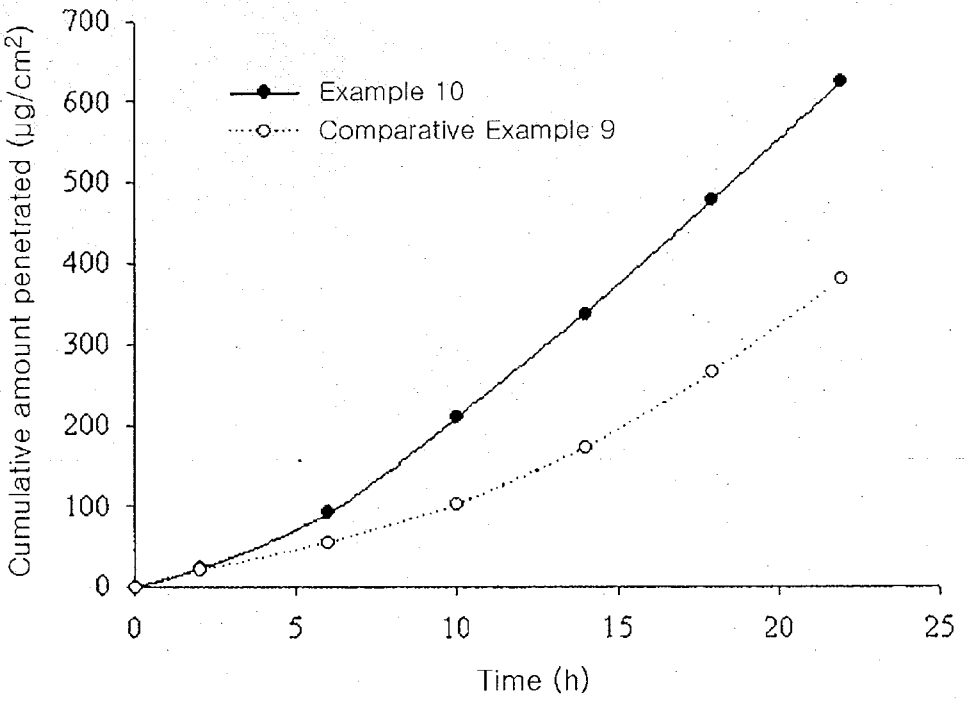
Example 10
Comparative Example 9
Cumulative amount penetrated (μg/cm²)
700
600
500
400
300
200
100
0
0
5
10
15
20
25
Time (h)

FIG. 5

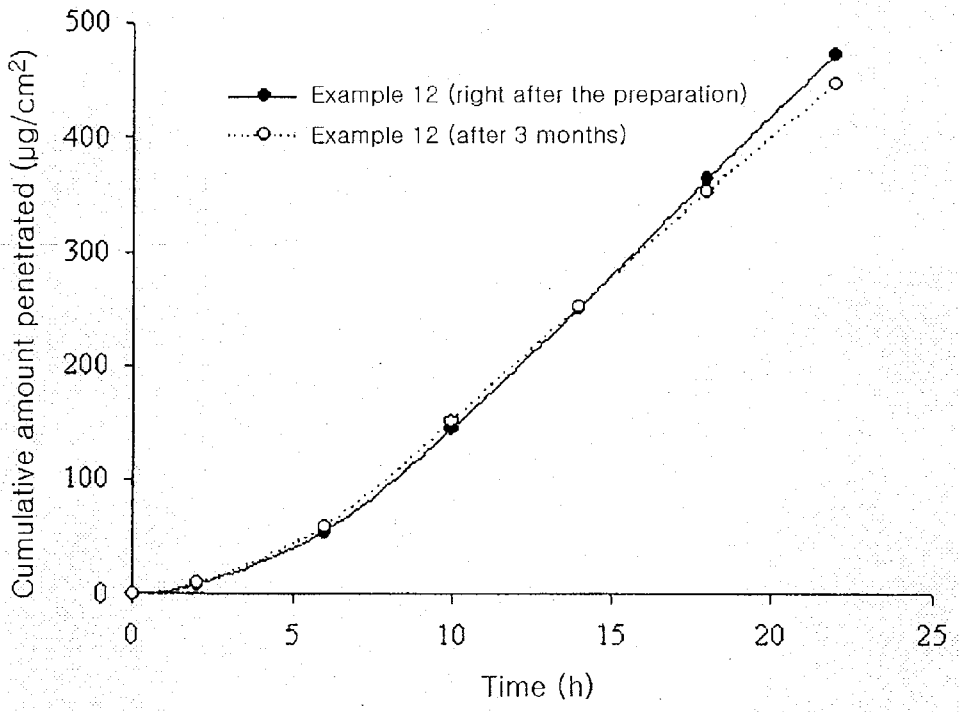
Example 12 (right after the preparation)
Example 12 (after 3 months)
Cumulative amount penetrated (μg/cm²)
500
400
300
200
100
0
0
5
10
15
20
25
Time (h)