




F I G . 1

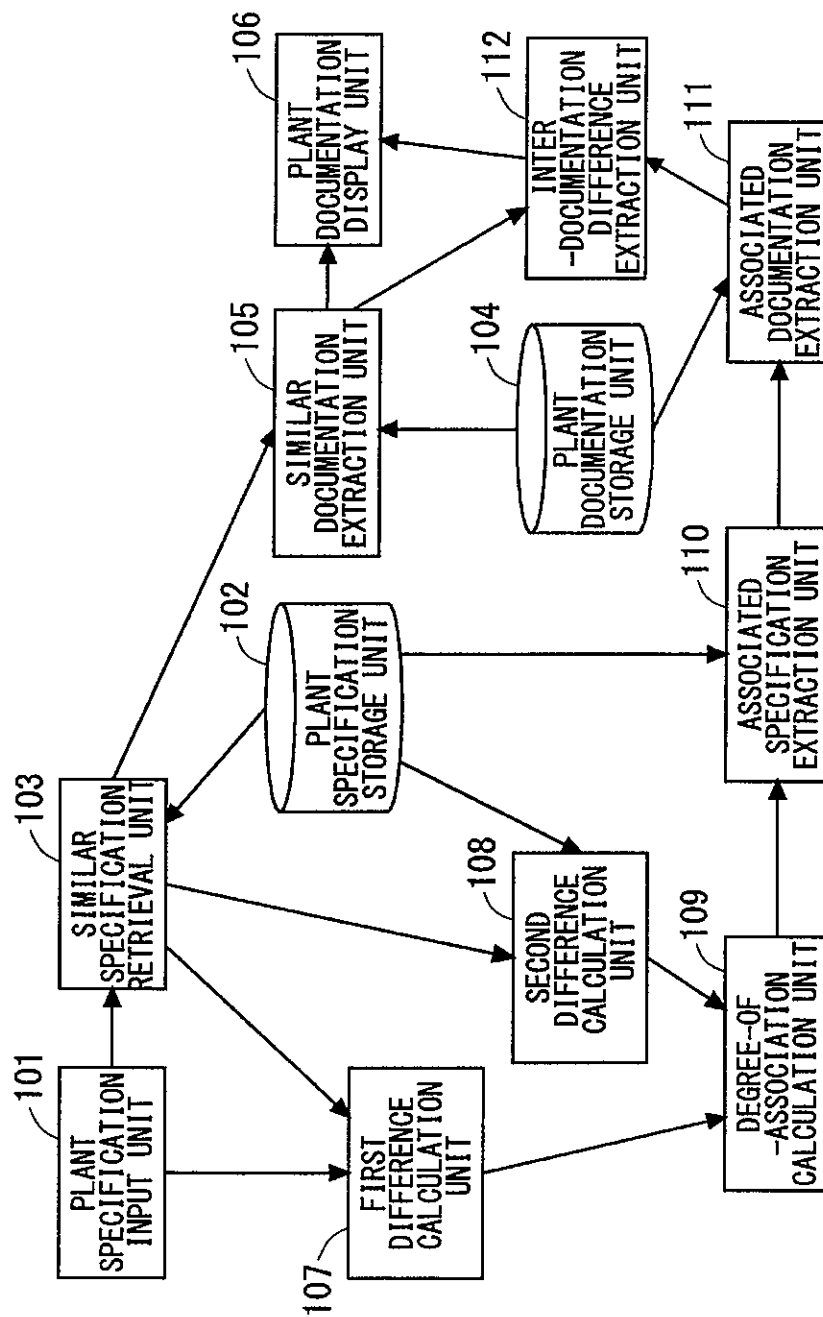

F I G . 2

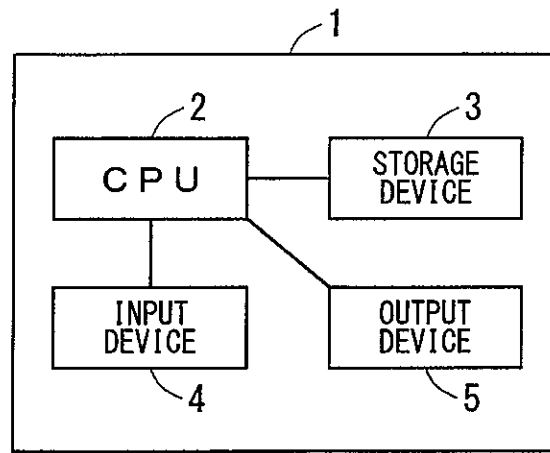

F I G . 3

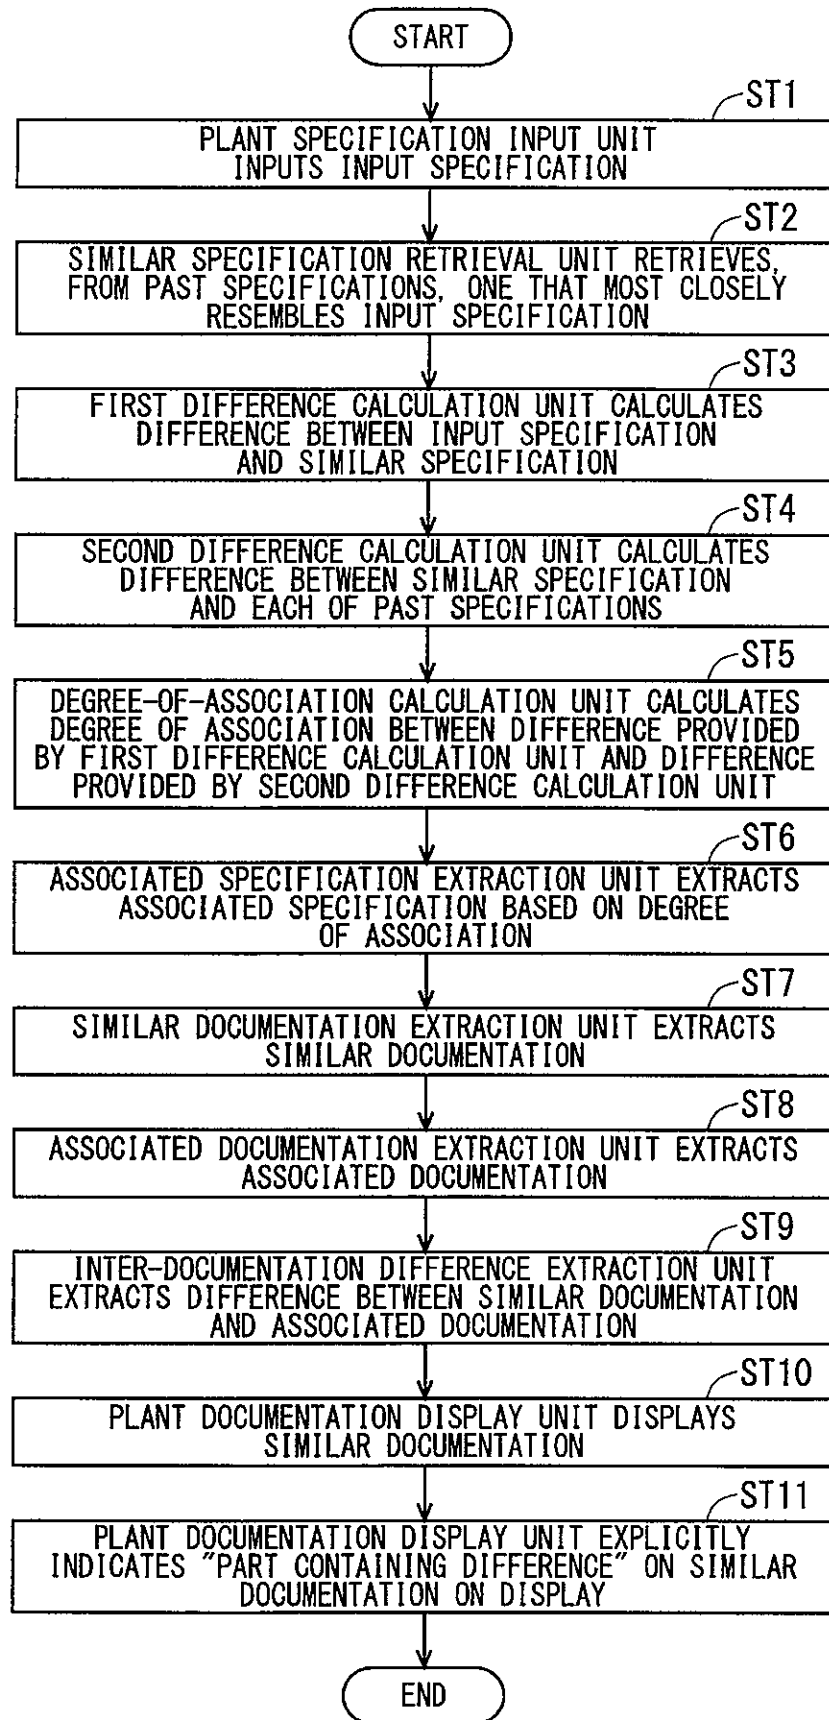

F I G . 4

SPECIFICATION 1: TAILORED TO MUNICIPALITY A, STANDARD HIGH-WATER LEVEL 90
 SPECIFICATION 2: TAILORED TO MUNICIPALITY A, STANDARD HIGH-WATER LEVEL 60
 SPECIFICATION 3: TAILORED TO MUNICIPALITY B, STANDARD HIGH-WATER LEVEL 50
 SPECIFICATION 4: TAILORED TO MUNICIPALITY B, STANDARD HIGH-WATER LEVEL 60

F I G . 5

DOCUMENTATION 1

WHEN WATER LEVEL REACHES OR EXCEEDS 80, ALARM IS ACTIVATED
 WHEN WATER LEVEL REACHES OR EXCEEDS 80, DRAINAGE PUMP STARTS UP

DOCUMENTATION 2

WHEN WATER LEVEL REACHES OR EXCEEDS 80, ALARM IS ACTIVATED
 WHEN WATER LEVEL REACHES OR EXCEEDS 60, DRAINAGE PUMP STARTS UP

DOCUMENTATION 3

WHEN WATER LEVEL REACHES OR EXCEEDS 90, ALARM IS ACTIVATED
 WHEN WATER LEVEL REACHES OR EXCEEDS 50, DRAINAGE PUMP STARTS UP

DOCUMENTATION 4:

WHEN WATER LEVEL REACHES OR EXCEEDS 90, ALARM IS ACTIVATED
 WHEN WATER LEVEL REACHES OR EXCEEDS 60, DRAINAGE PUMP STARTS UP

F I G . 6

TAILORED TO MUNICIPALITY B, STANDARD HIGH-WATER LEVEL 40

F I G . 7

DIFFERENCE IN MUNICIPALITY OF INTEREST: NONE,
 DIFFERENCE IN STANDARD HIGH-WATER LEVEL: 10

F I G . 8

DIFFERENCE 1
 DIFFERENCE IN MUNICIPALITY OF INTEREST : DIFFERENCE CONTAINED
 DIFFERENCE IN STANDARD HIGH-WATER LEVEL : 30

DIFFERENCE 2
 DIFFERENCE IN MUNICIPALITY OF INTEREST : DIFFERENCE CONTAINED
 DIFFERENCE IN STANDARD HIGH-WATER LEVEL : 10

DIFFERENCE 3
 DIFFERENCE IN MUNICIPALITY OF INTEREST : NO DIFFERENCE CONTAINED
 DIFFERENCE IN STANDARD HIGH-WATER LEVEL : NONE

DIFFERENCE 4
 DIFFERENCE IN MUNICIPALITY OF INTEREST : NO DIFFERENCE CONTAINED
 DIFFERENCE IN STANDARD HIGH-WATER LEVEL : 10

F I G . 9

DEGREE OF ASSOCIATION 1
 DIFFERENCE IN MUNICIPALITY OF INTEREST : NO MATCH
 DIFFERENCE IN STANDARD HIGH-WATER LEVEL : MATCH

DEGREE OF ASSOCIATION 2
 DIFFERENCE IN MUNICIPALITY OF INTEREST : NO MATCH
 DIFFERENCE IN STANDARD HIGH-WATER LEVEL : MATCH

DEGREE OF ASSOCIATION 3
 DIFFERENCE IN MUNICIPALITY OF INTEREST : MATCH
 DIFFERENCE IN STANDARD HIGH-WATER LEVEL : NO MATCH

DEGREE OF ASSOCIATION 4
 DIFFERENCE IN MUNICIPALITY OF INTEREST : MATCH
 DIFFERENCE IN STANDARD HIGH-WATER LEVEL : MATCH

F I G . 1 0

WHEN WATER LEVEL REACHES OR EXCEEDS 90, ALARM IS ACTIVATED
 WHEN WATER LEVEL REACHES OR EXCEEDS 0, DRAINAGE PUMP STARTS UP

F I G . 1 1

WHEN WATER LEVEL REACHES OR EXCEEDS 90, ALARM IS ACTIVATED
 WHEN WATER LEVEL REACHES OR EXCEEDS 50, DRAINAGE PUMP STARTS UP

F I G . 1 2

SPECIFICATION NUMBER	MUNICIPALITY OF INTEREST	STANDARD HIGH-WATER LEVEL
1	A	80
2	A	60
3	B	50
4	B	60

F I G . 1 3

DOCUMENTATION NUMBER	ALARM ACTIVATION WATER LEVEL	DRAINAGE PUMP STARTUP WATER LEVEL
1	80	80
2	80	60
3	90	50
4	90	60

F I G . 1 4

MUNICIPALITY OF INTEREST	STANDARD HIGH-WATER LEVEL
B	40

F I G . 1 5

MUNICIPALITY OF INTEREST	STANDARD HIGH-WATER LEVEL	
PRESENCE OR ABSENCE OF DIFFERENCE	PRESENCE OR ABSENCE OF DIFFERENCE	DIFFERENCE VALUE
NO DIFFERENCE CONTAINED	DIFFERENCE CONTAINED	10

F I G . 1 6

DIFFERENCE NUMBER	MUNICIPALITY OF INTEREST	STANDARD HIGH-WATER LEVEL	
	PRESENCE OR ABSENCE OF DIFFERENCE	PRESENCE OR ABSENCE OF DIFFERENCE	DIFFERENCE VALUE
1	DIFFERENCE CONTAINED	DIFFERENCE CONTAINED	30
2	DIFFERENCE CONTAINED	DIFFERENCE CONTAINED	10
3	NO DIFFERENCE CONTAINED	NO DIFFERENCE CONTAINED	0
4	NO DIFFERENCE CONTAINED	DIFFERENCE CONTAINED	10

F I G . 1 7

DEGREE OF ASSOCIATION NUMBER	DIFFERENCE IN MUNICIPALITY OF INTEREST	DIFFERENCE IN STANDARD HIGH-WATER LEVEL
1	NO MATCH	MATCH
2	NO MATCH	MATCH
3	MATCH	NO MATCH
4	MATCH	MATCH

F I G . 1 8

ALARM ACTIVATION WATER LEVEL	DRAINAGE PUMP STARTUP WATER LEVEL
90	*

F I G . 1 9

ALARM ACTIVATION WATER LEVEL	DRAINAGE PUMP STARTUP WATER LEVEL
90	*50