

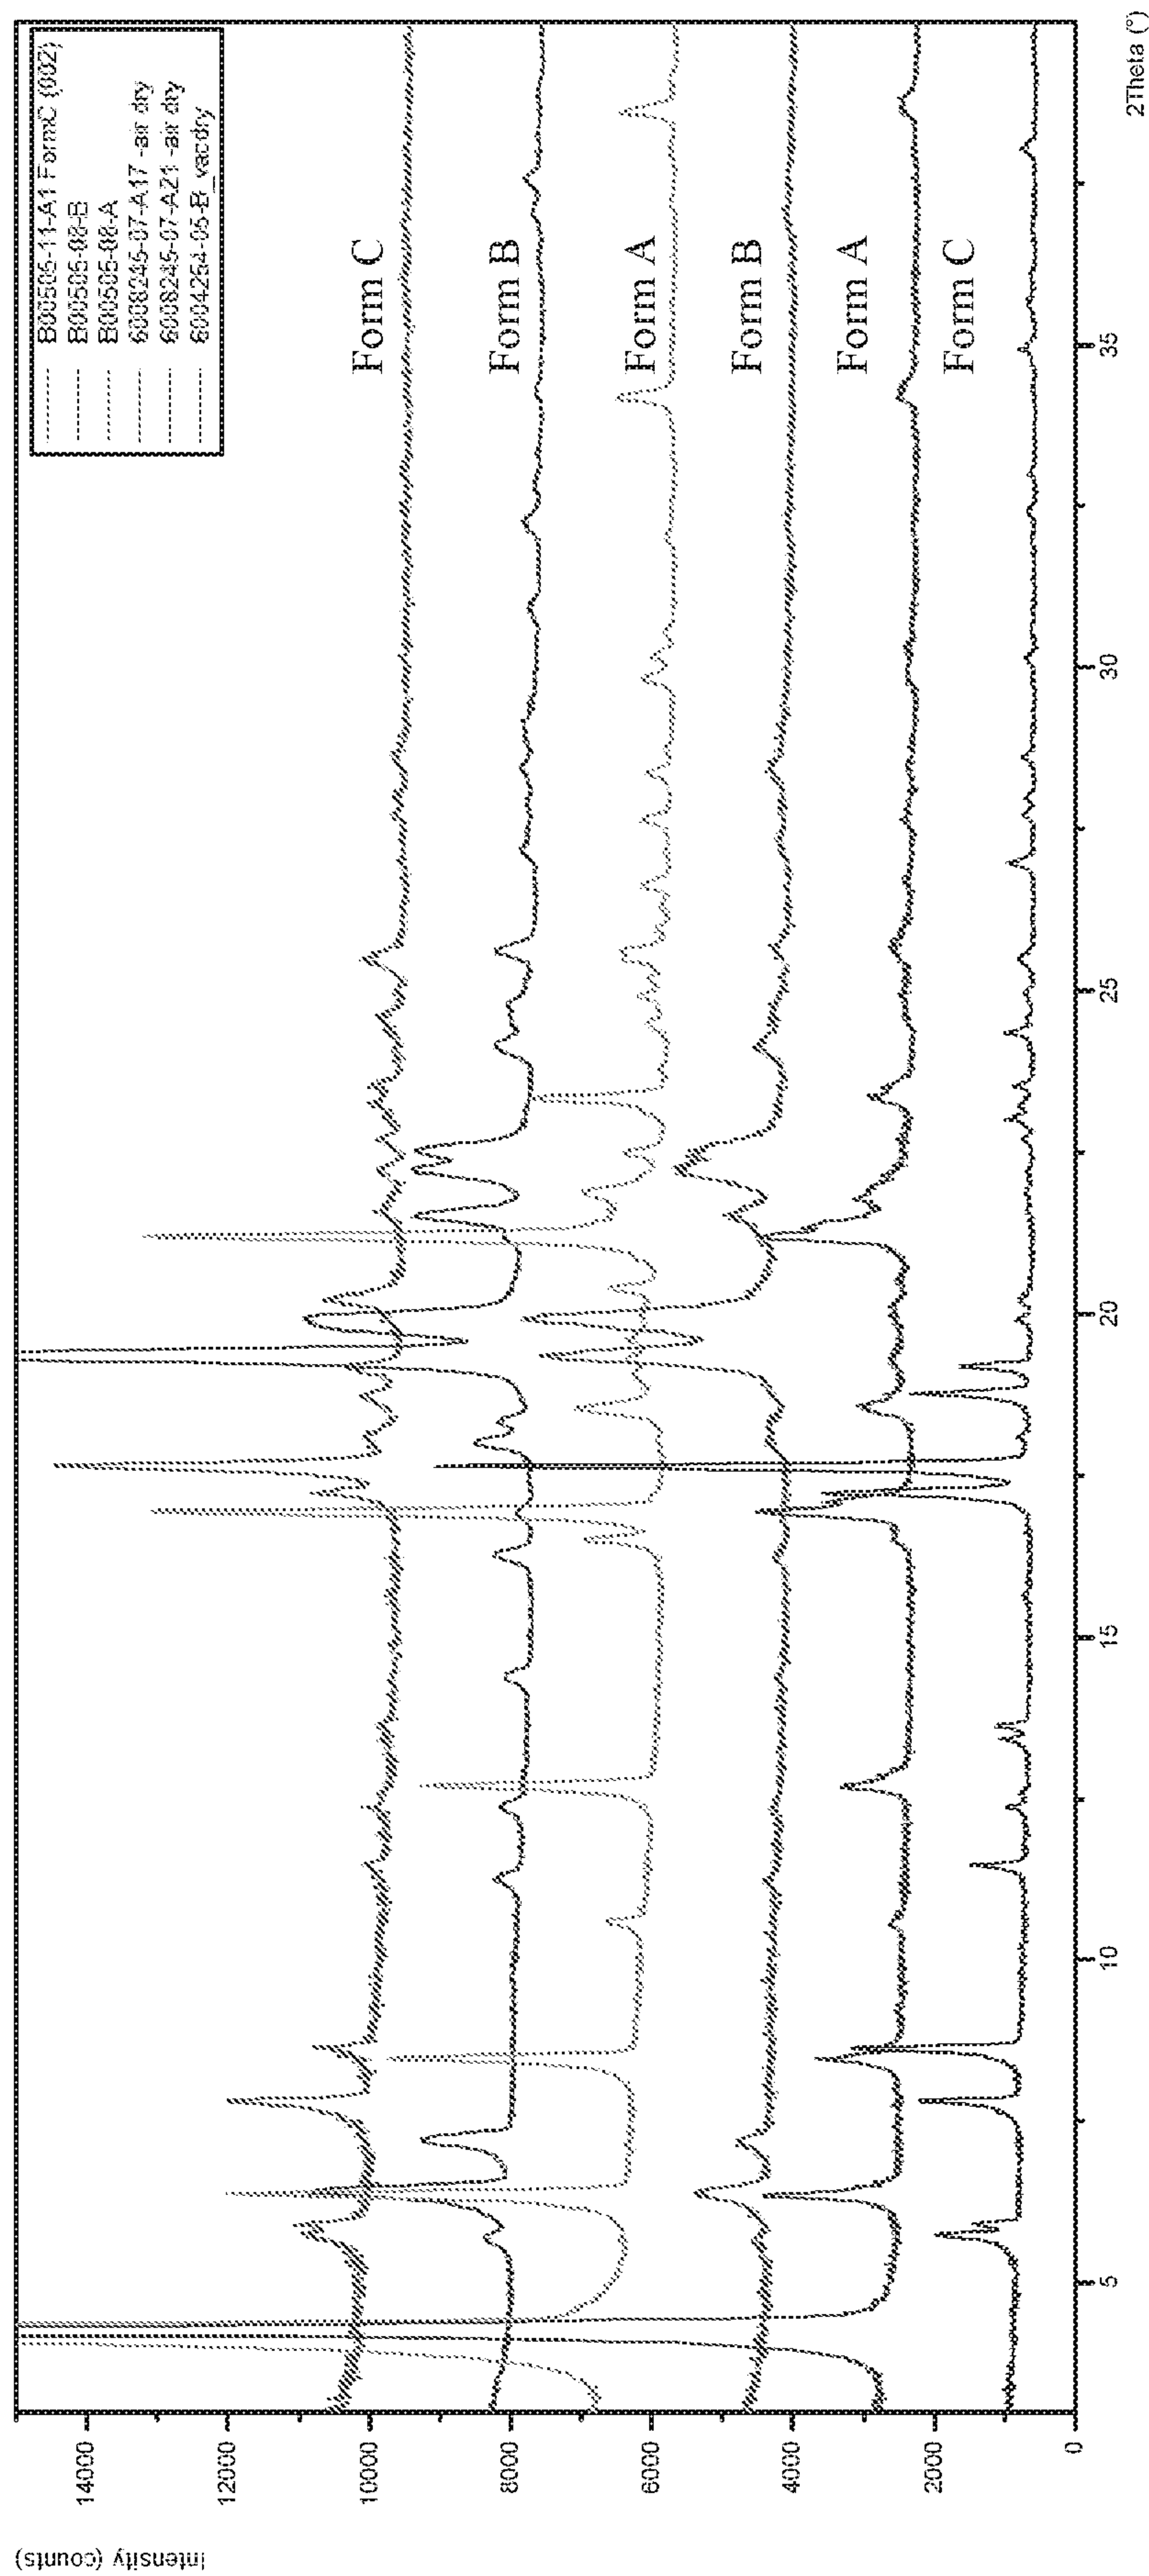


Figure 1

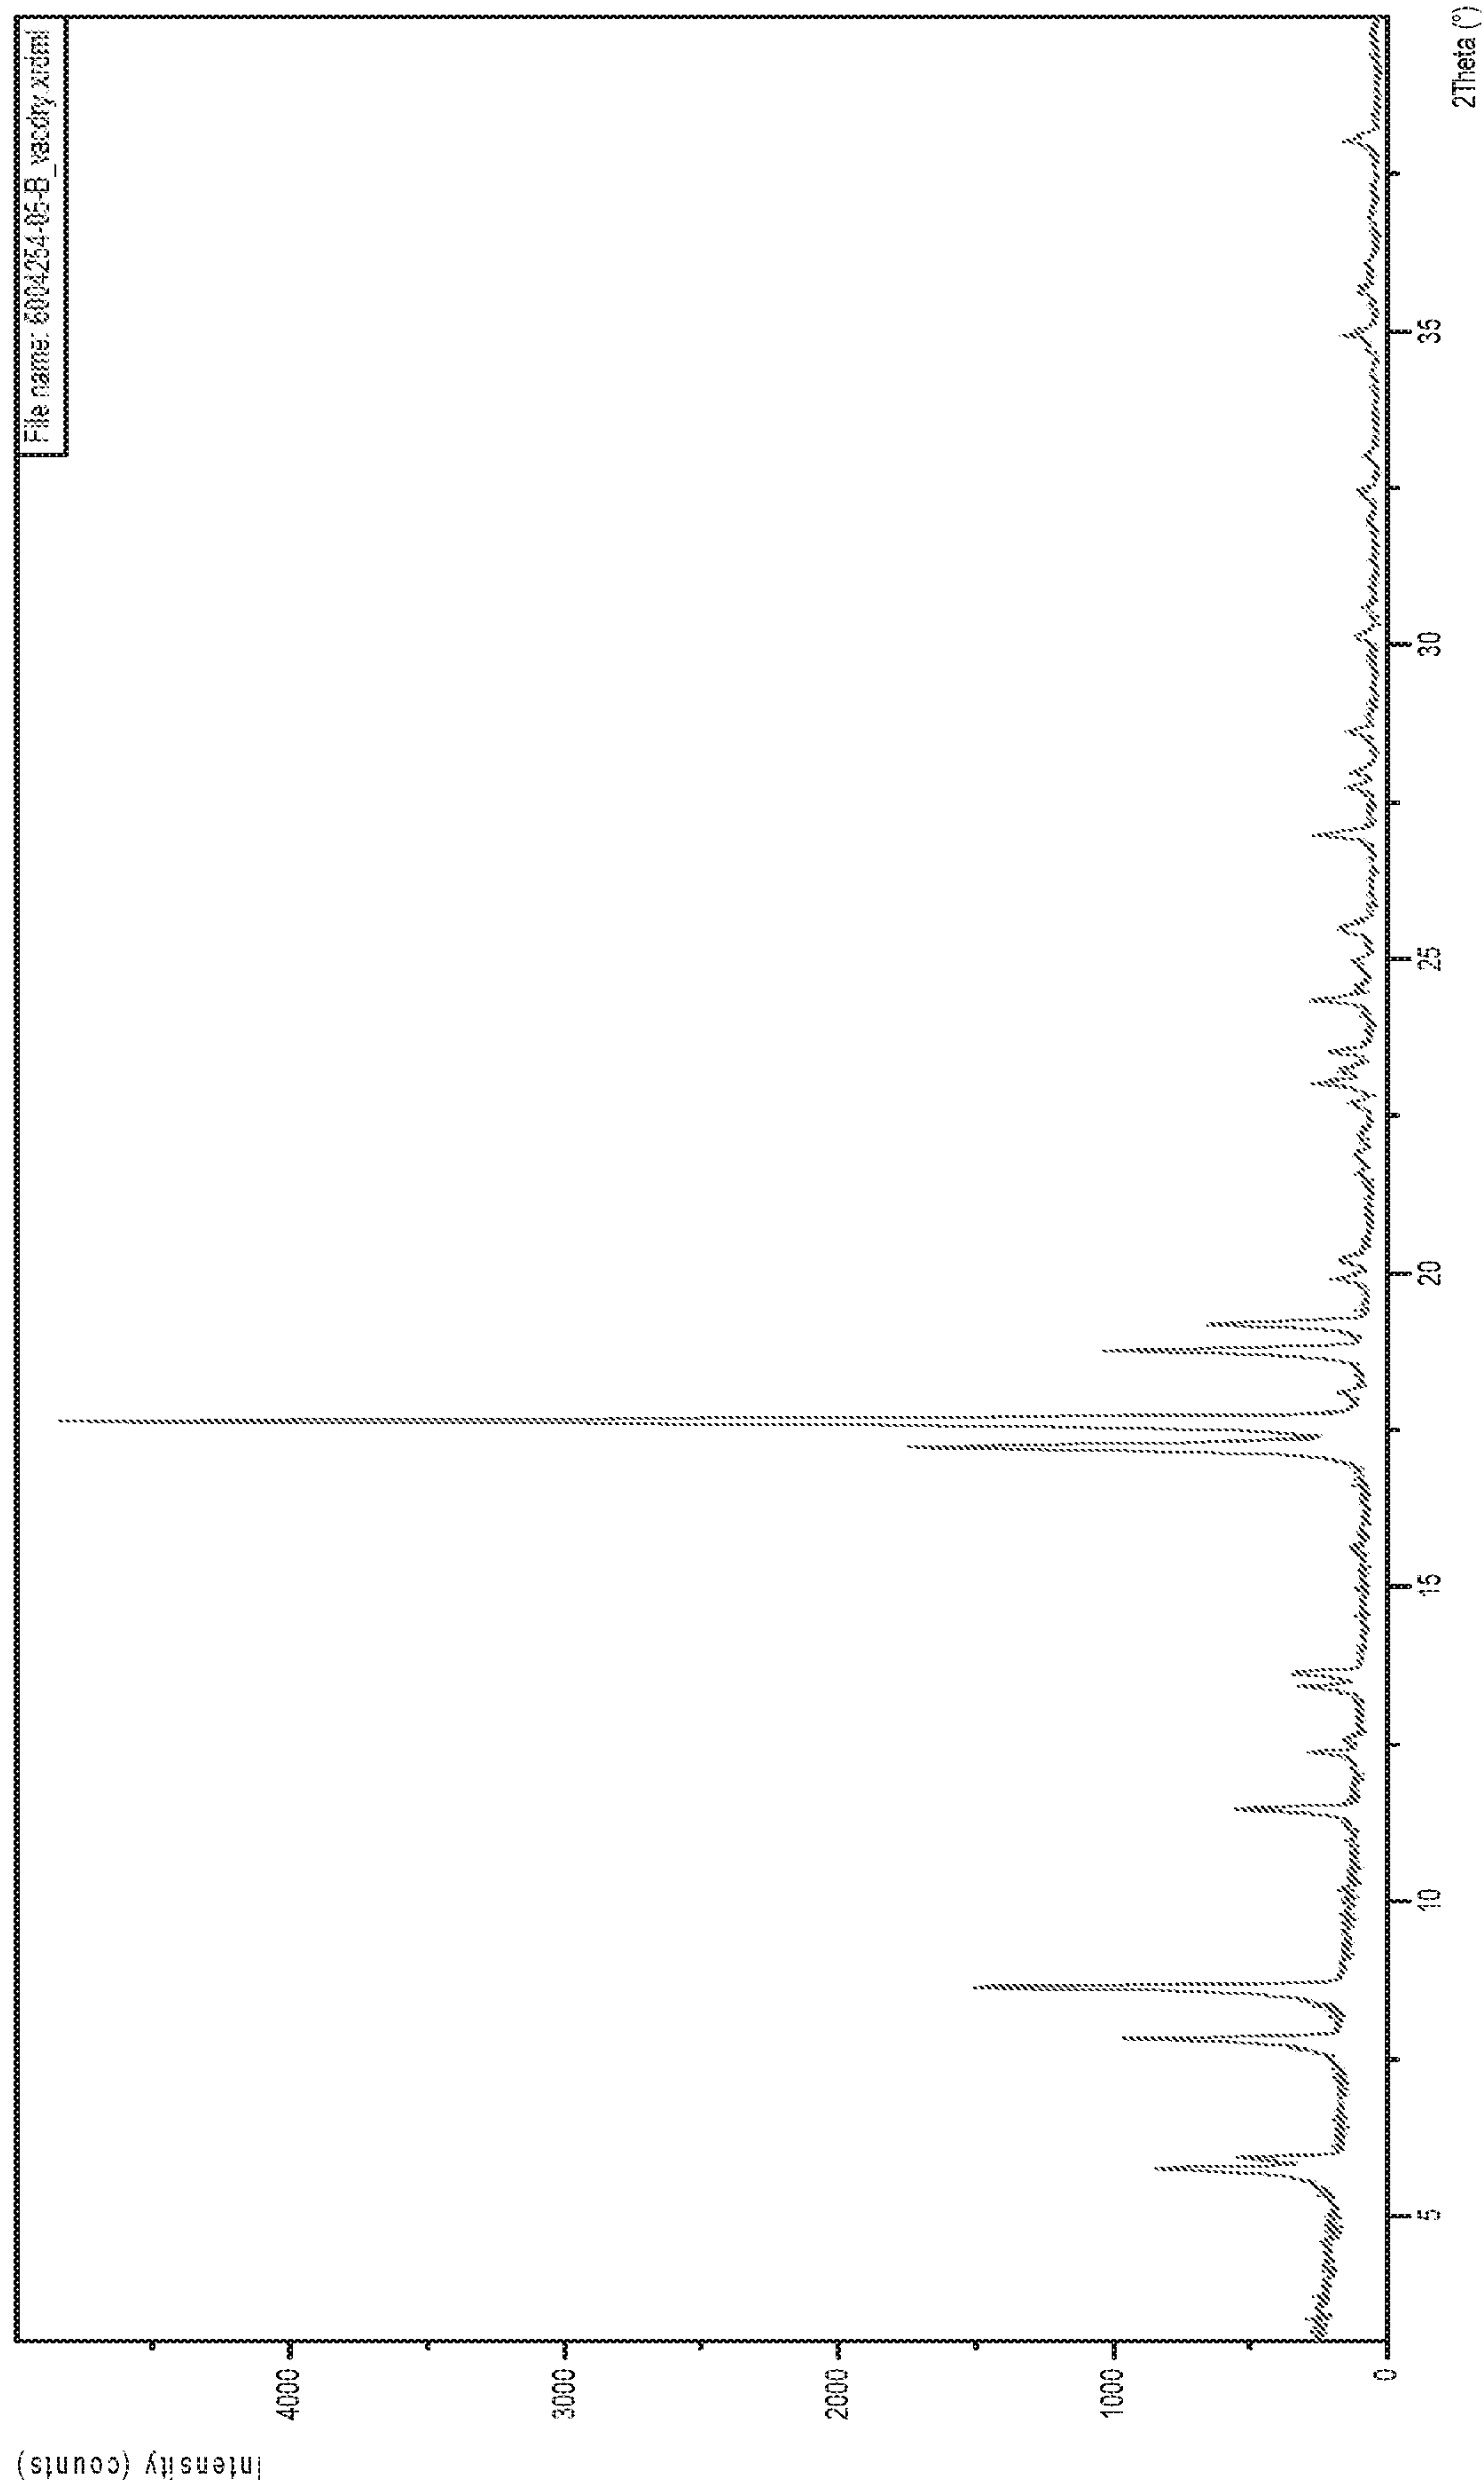


Figure 2

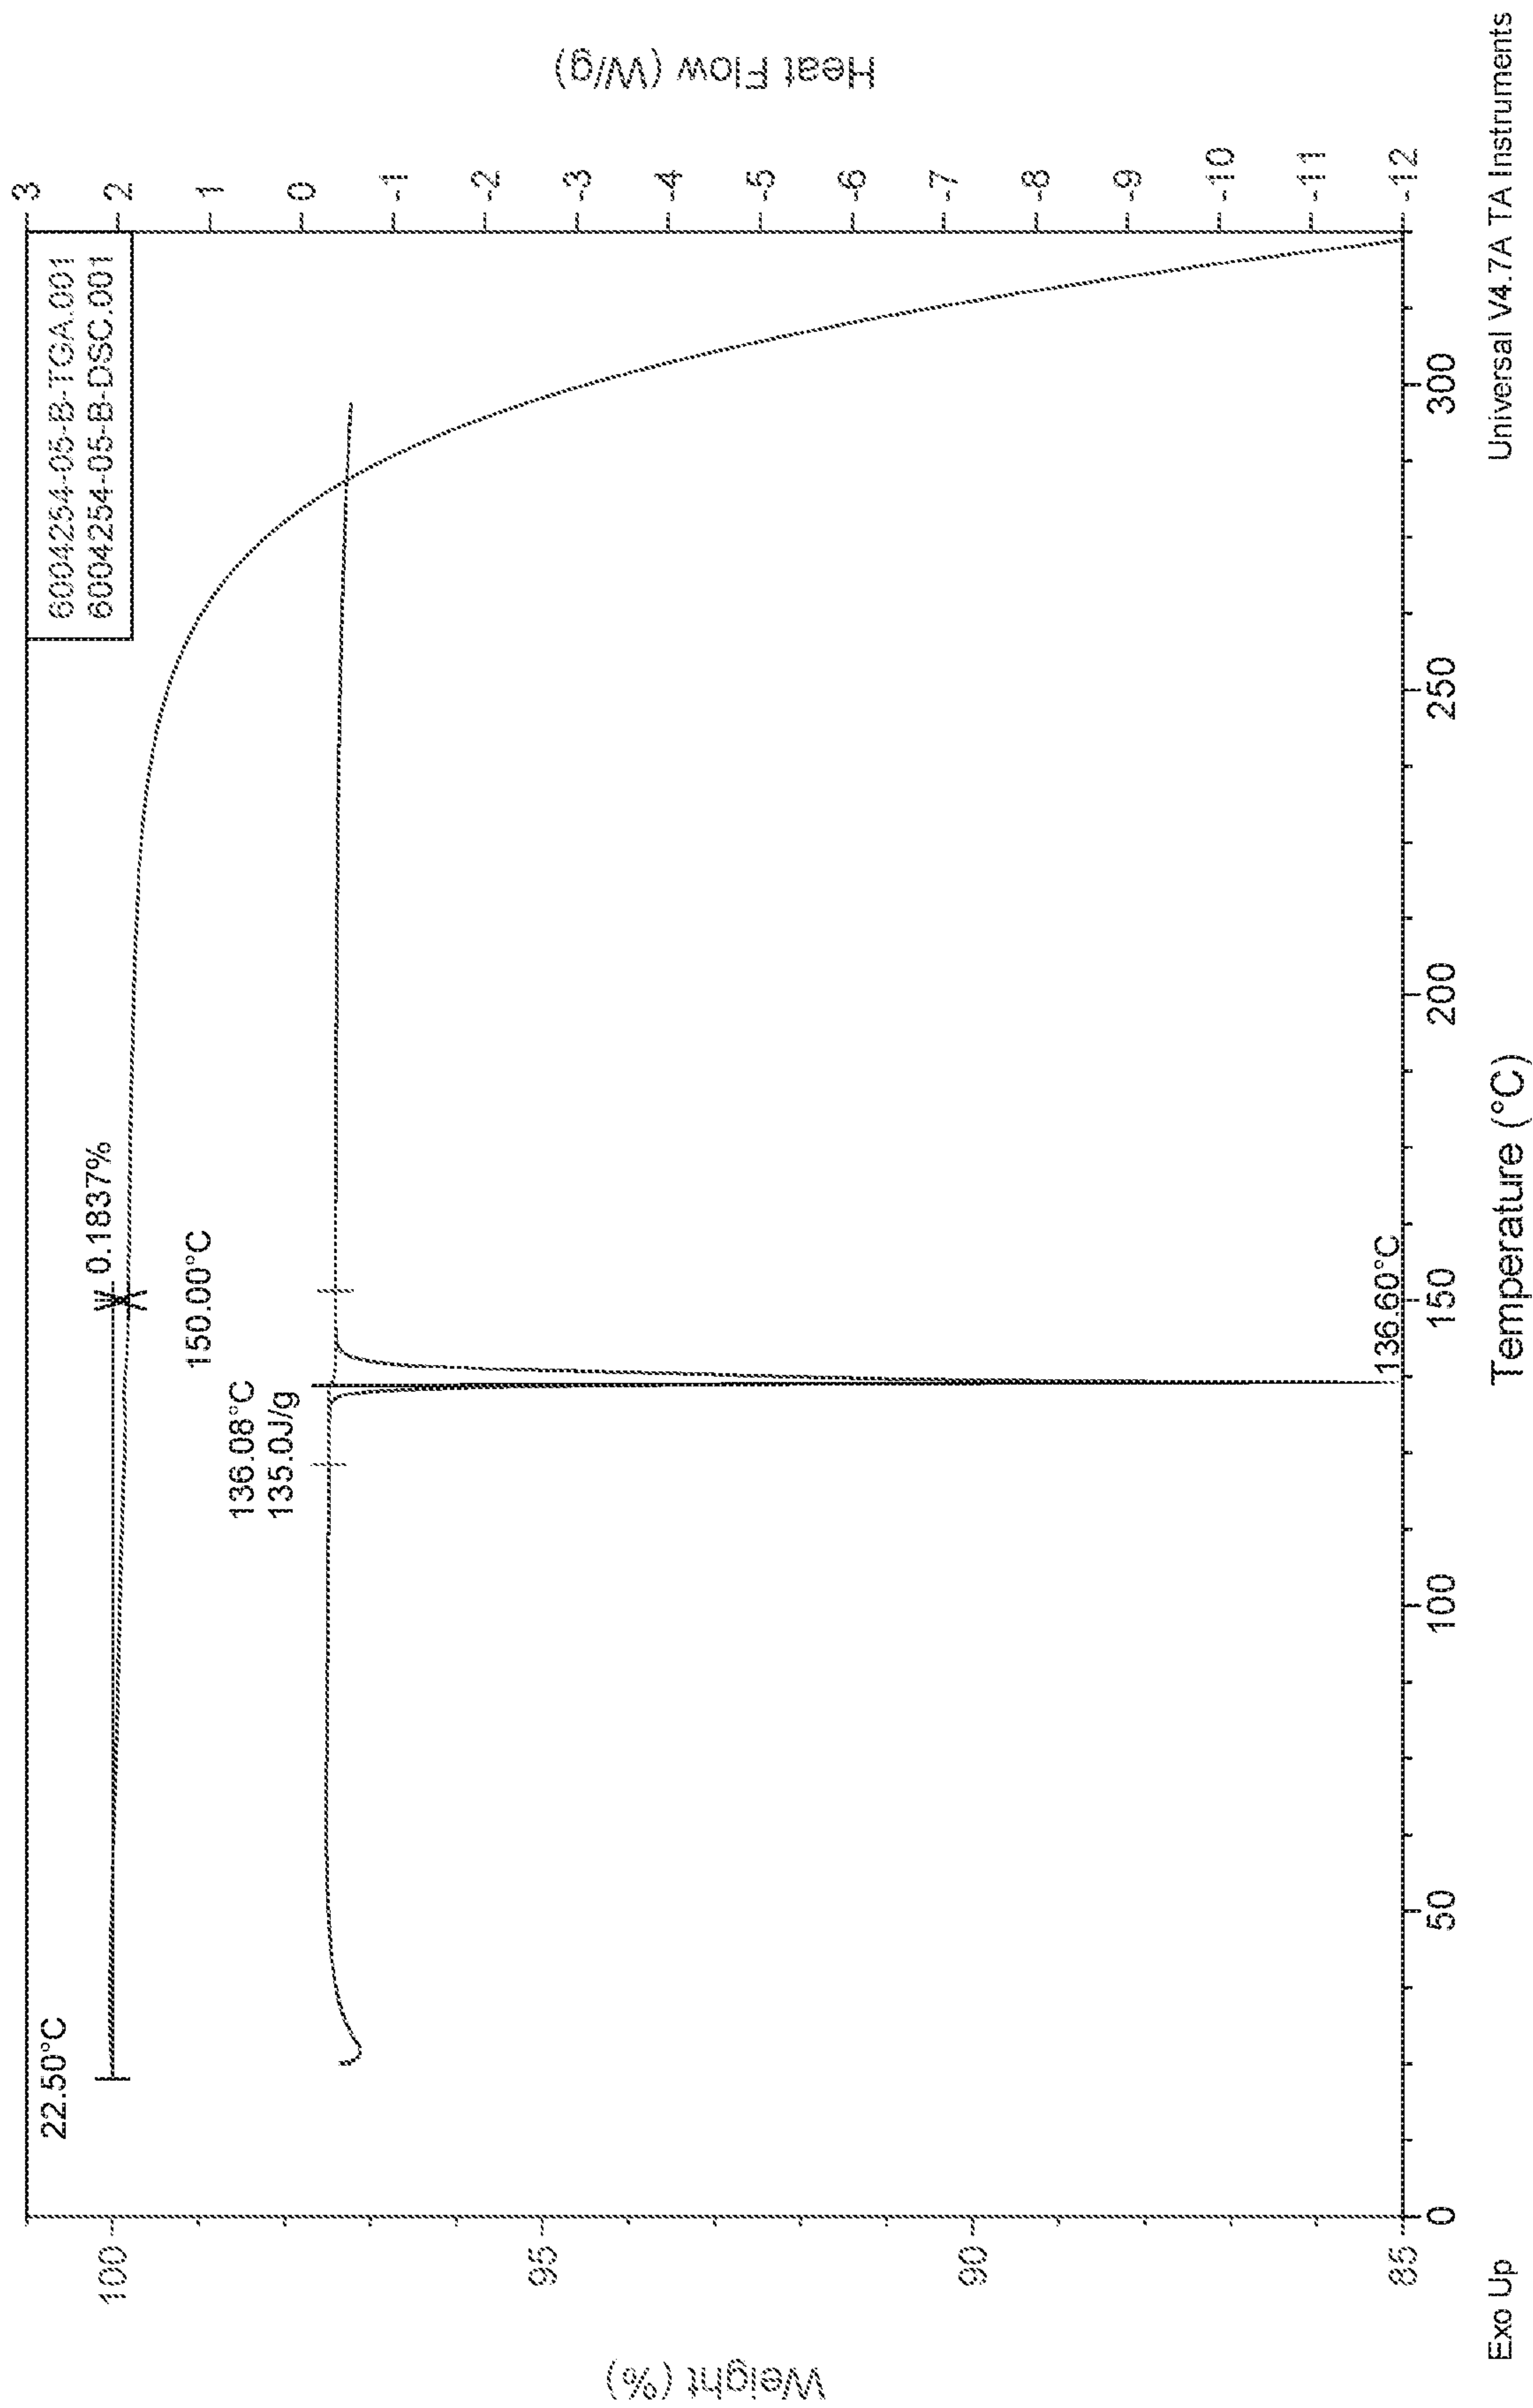


Figure 3

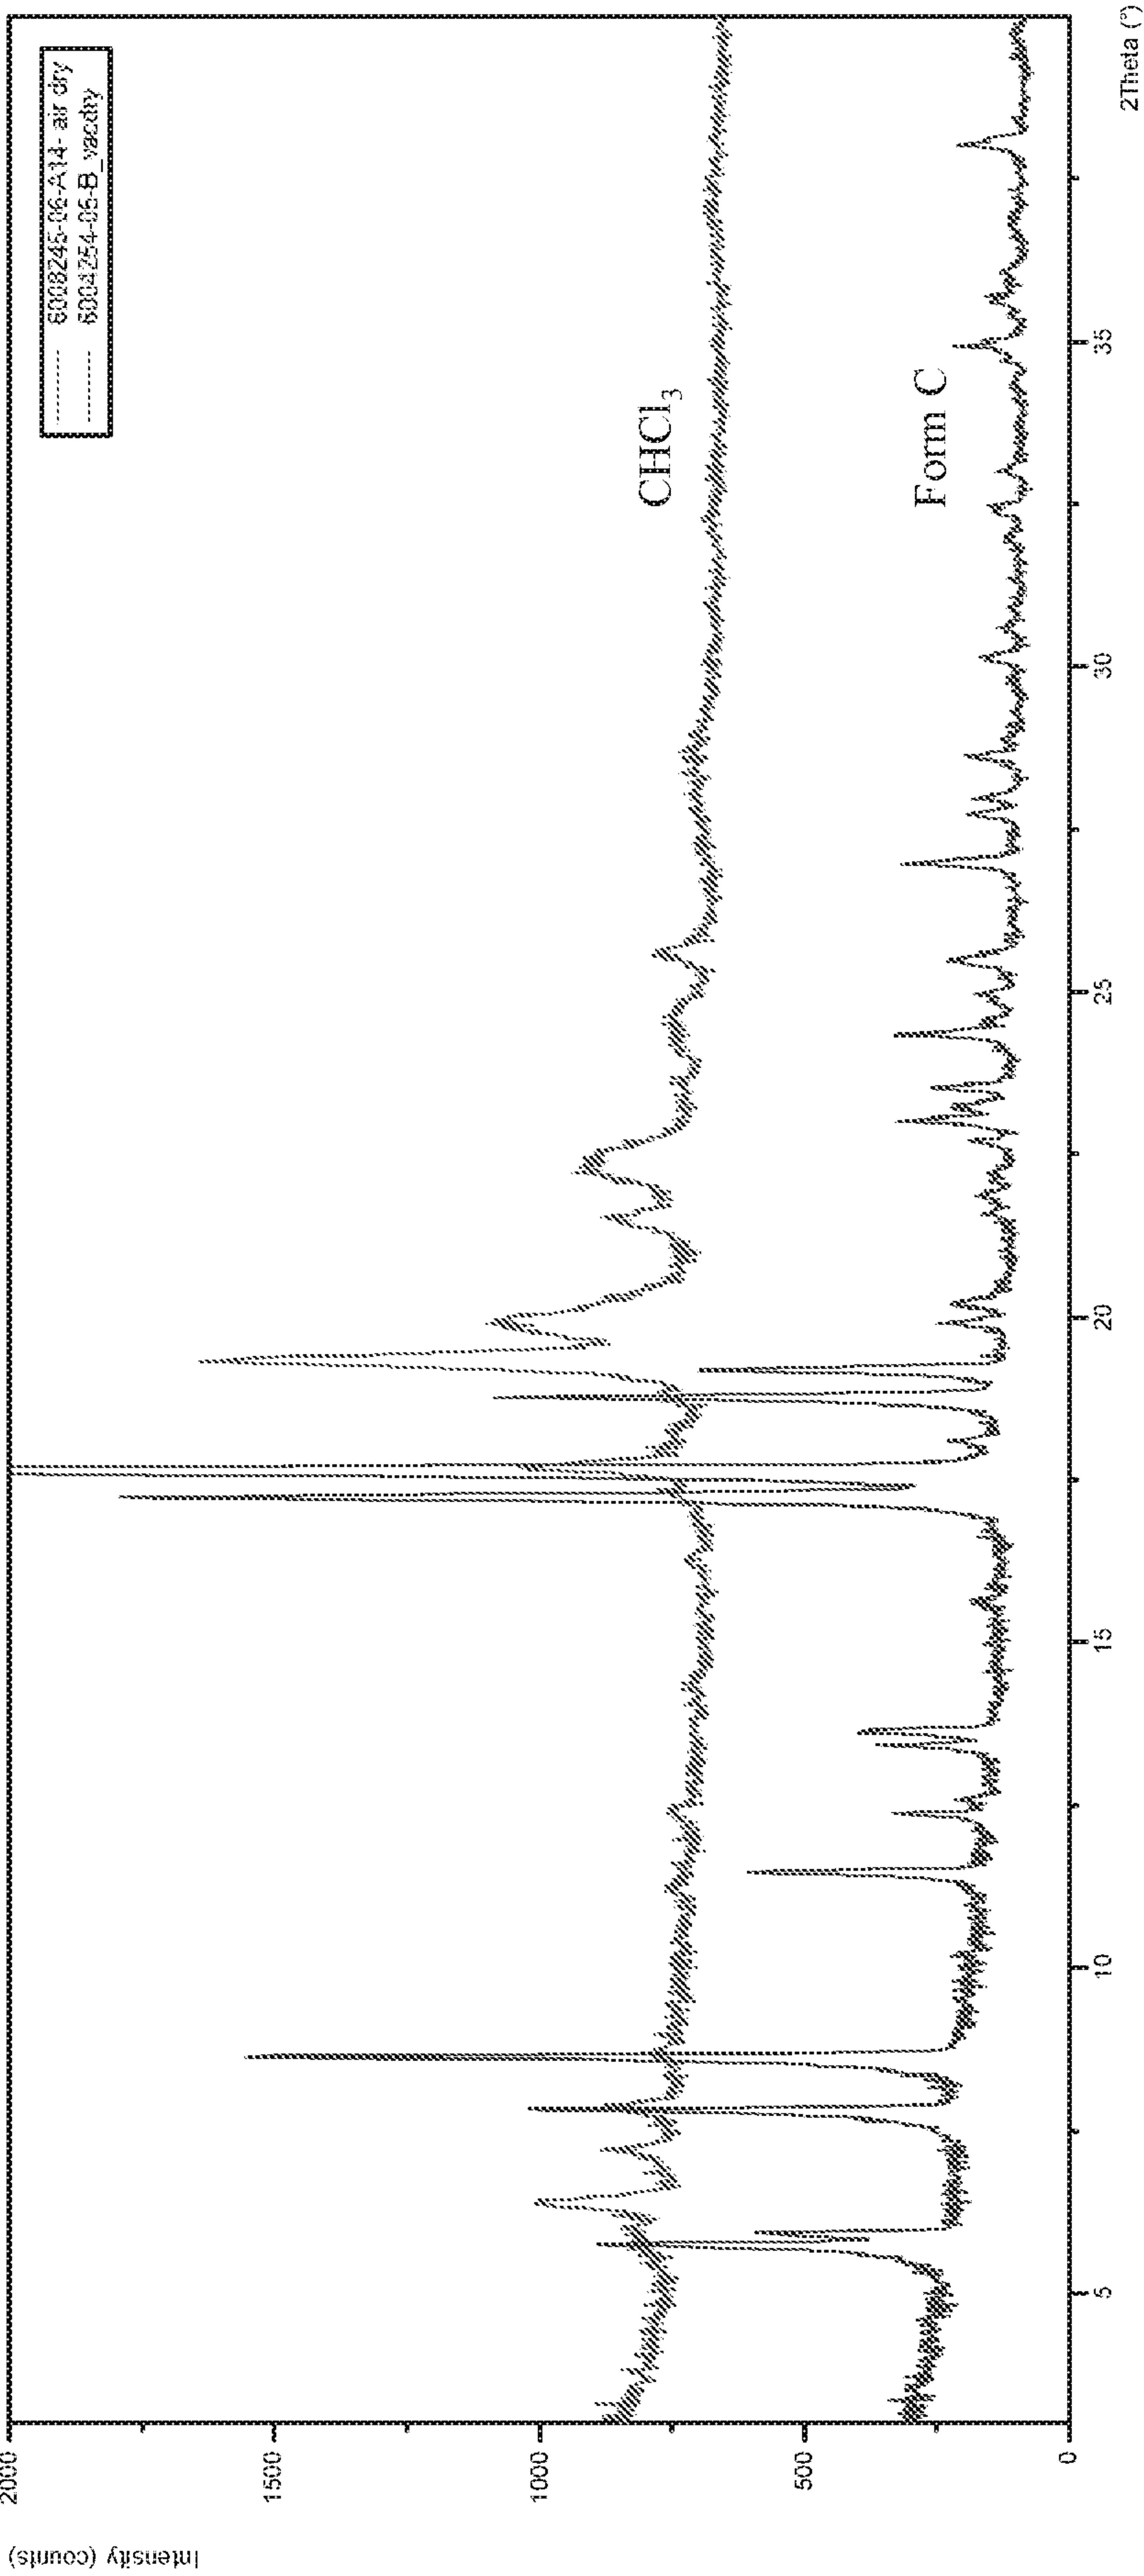


Figure 4

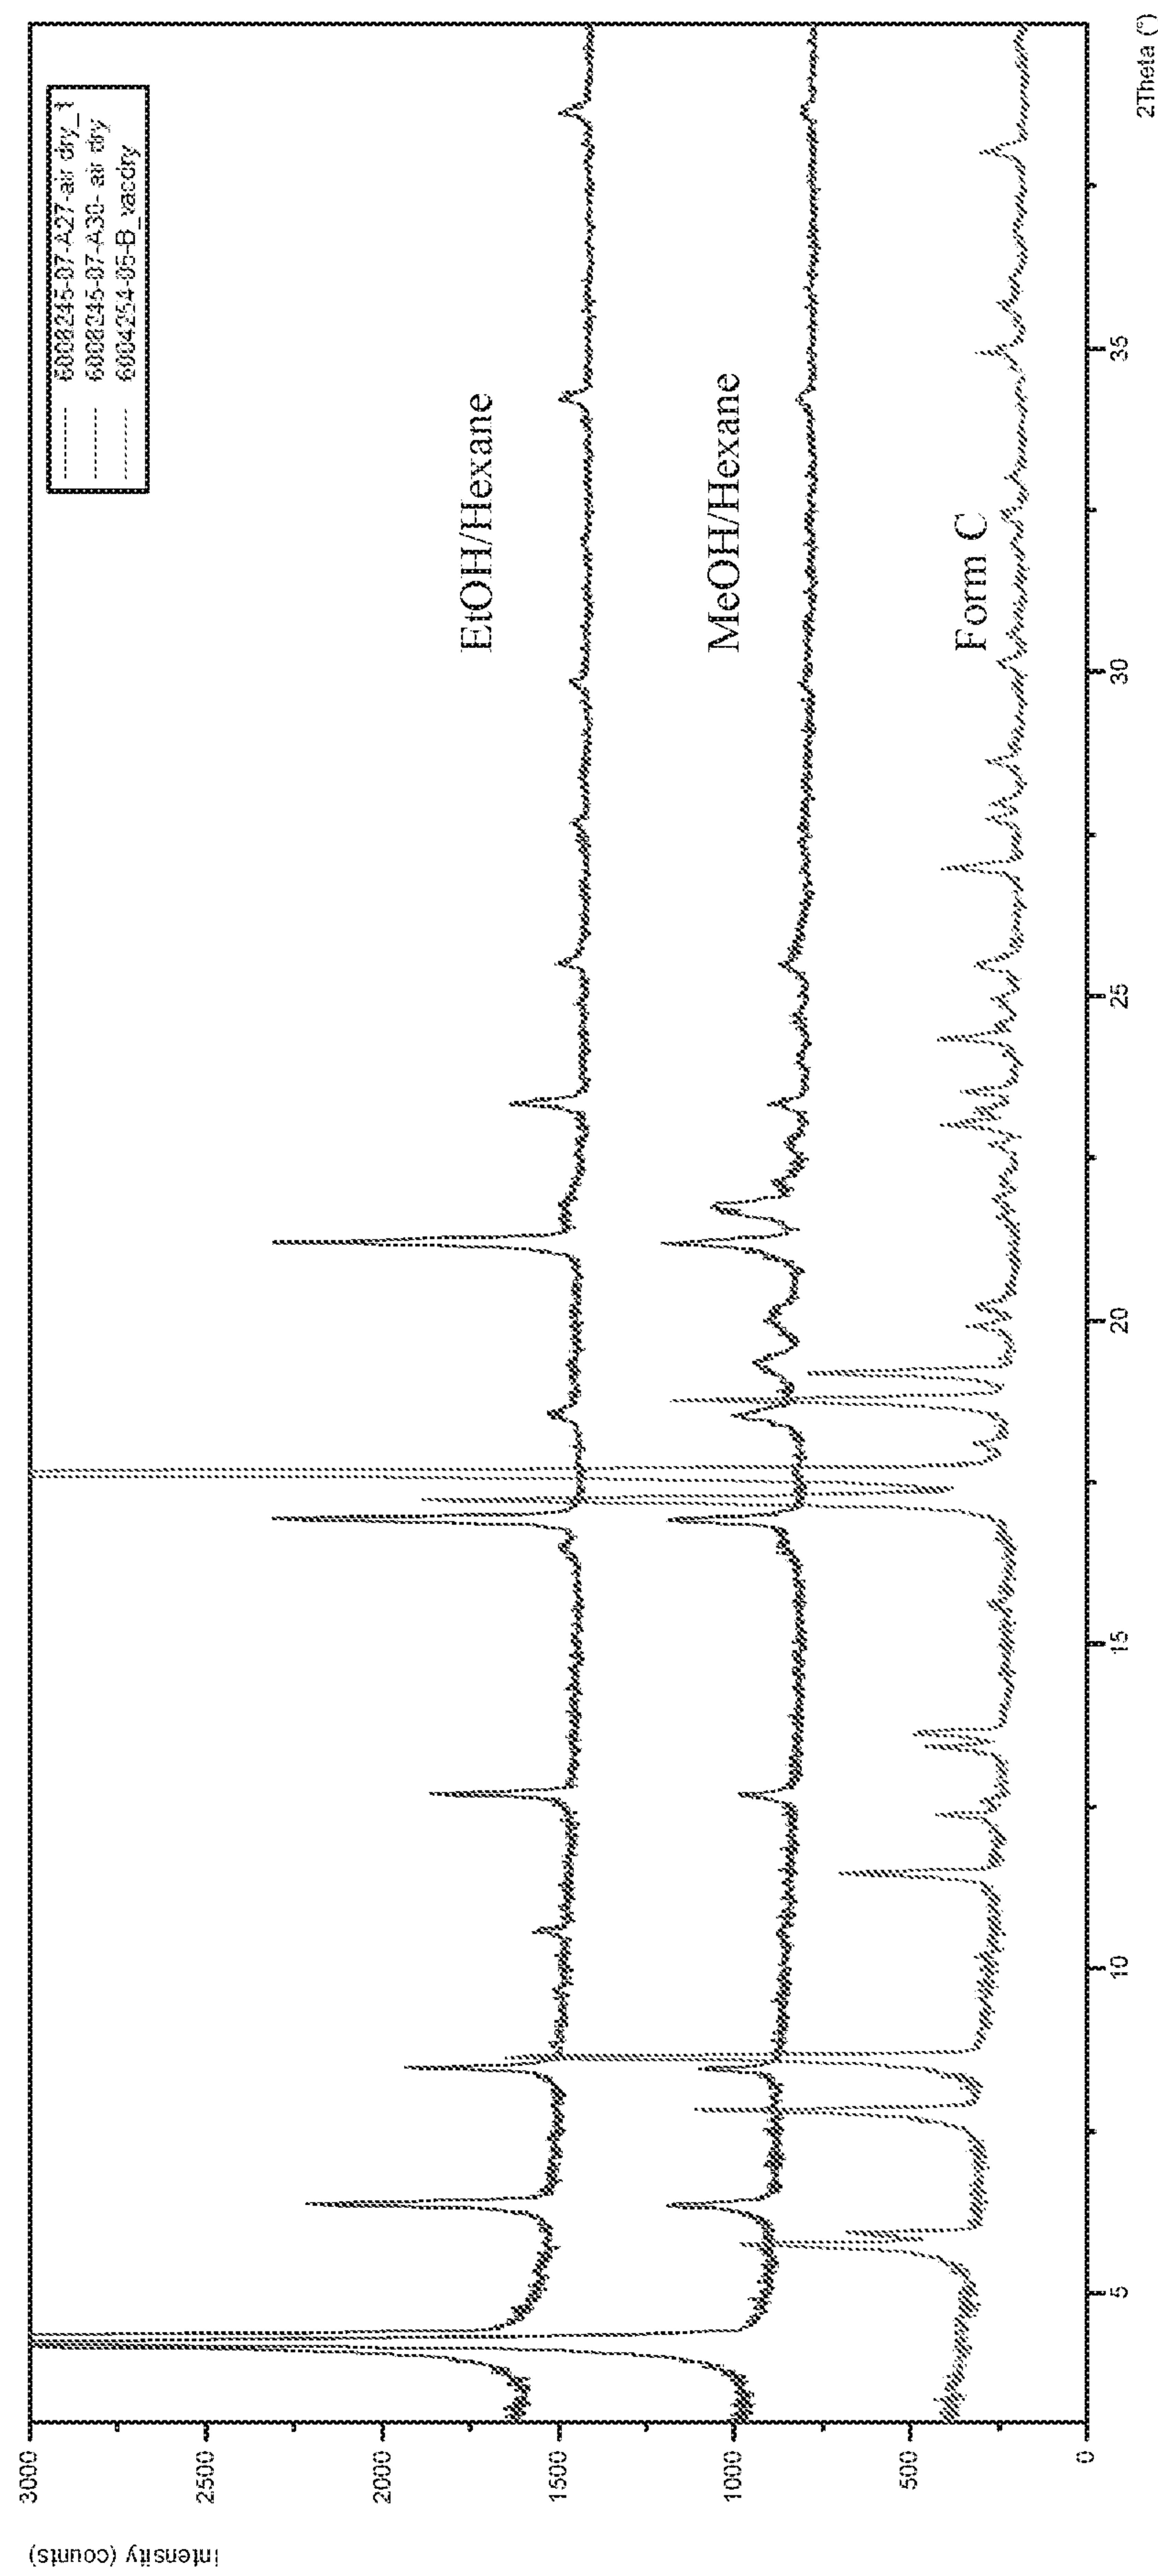


Figure 5

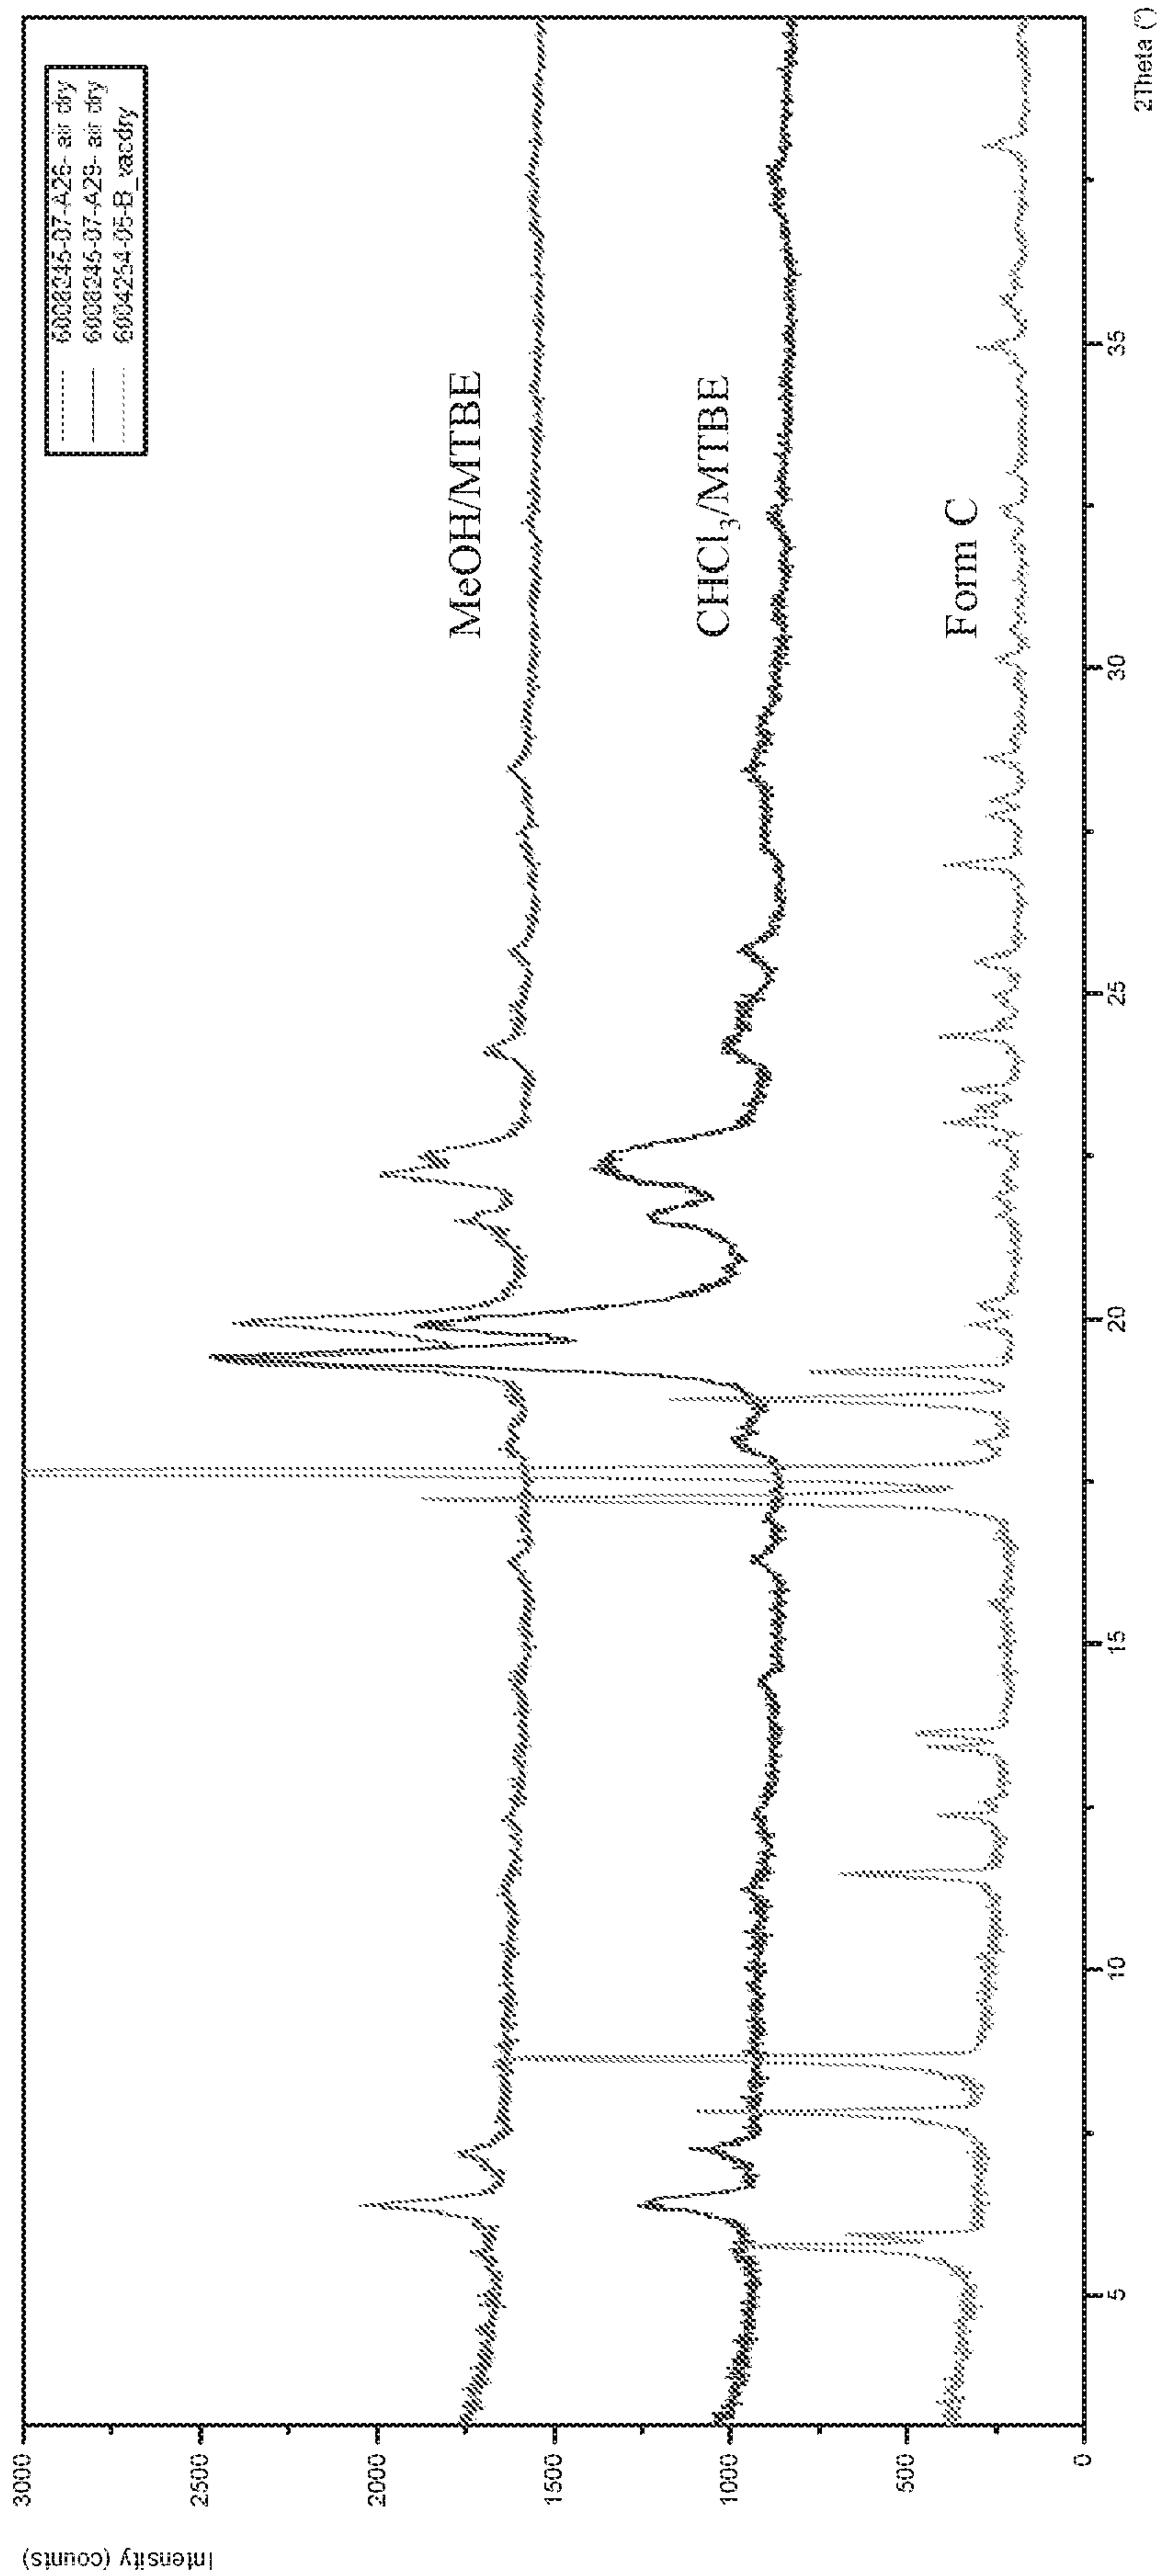


Figure 6

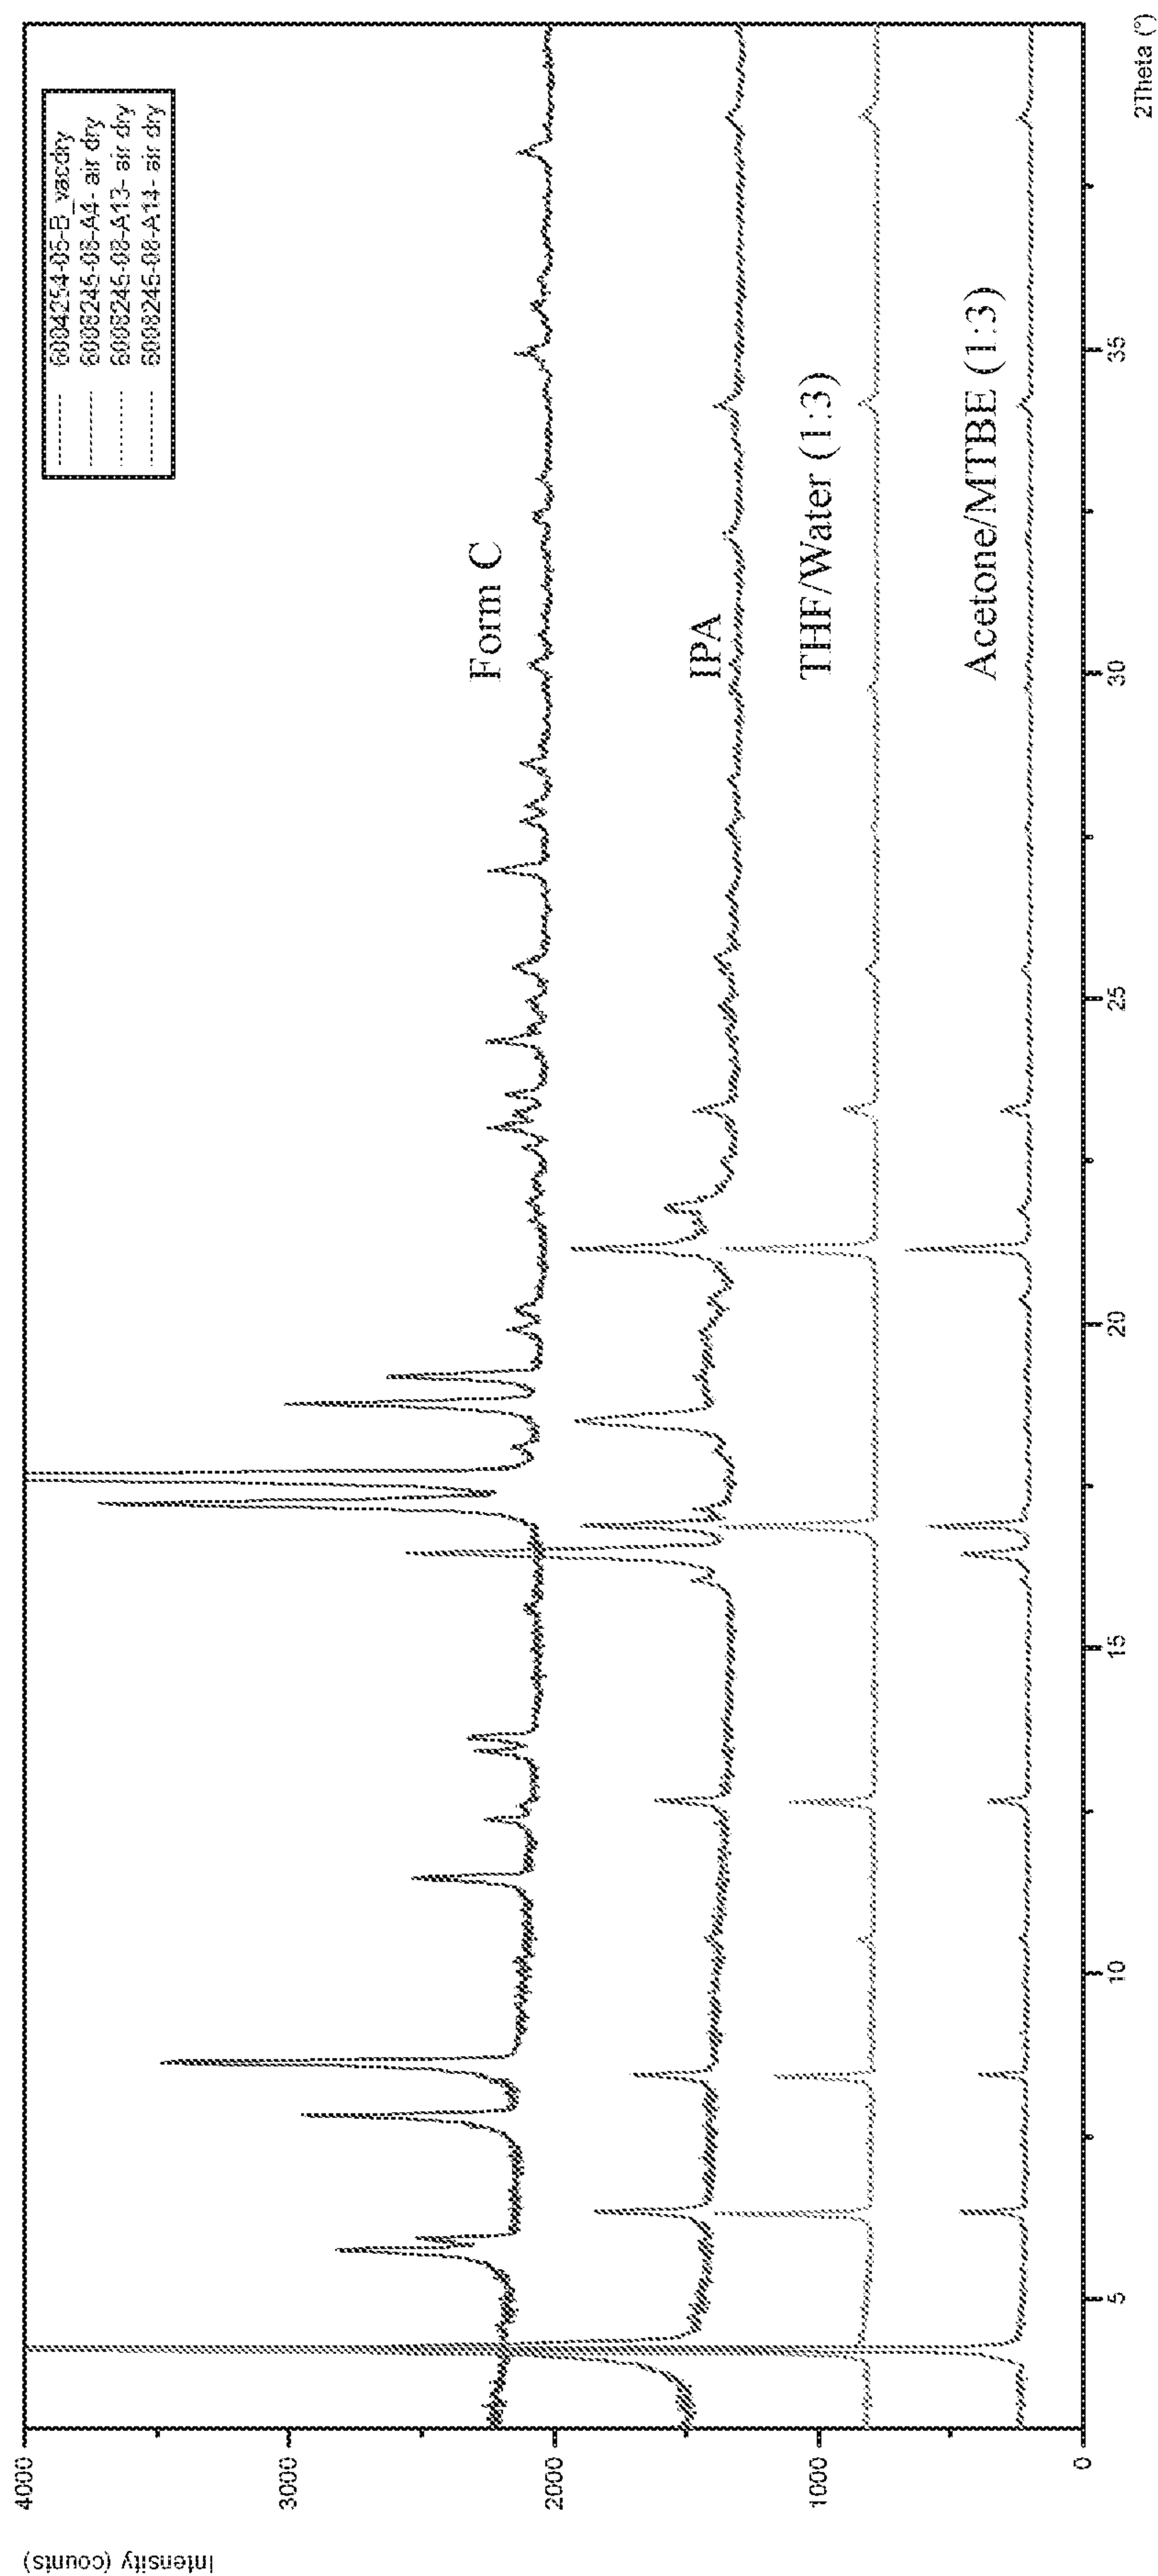


Figure 7

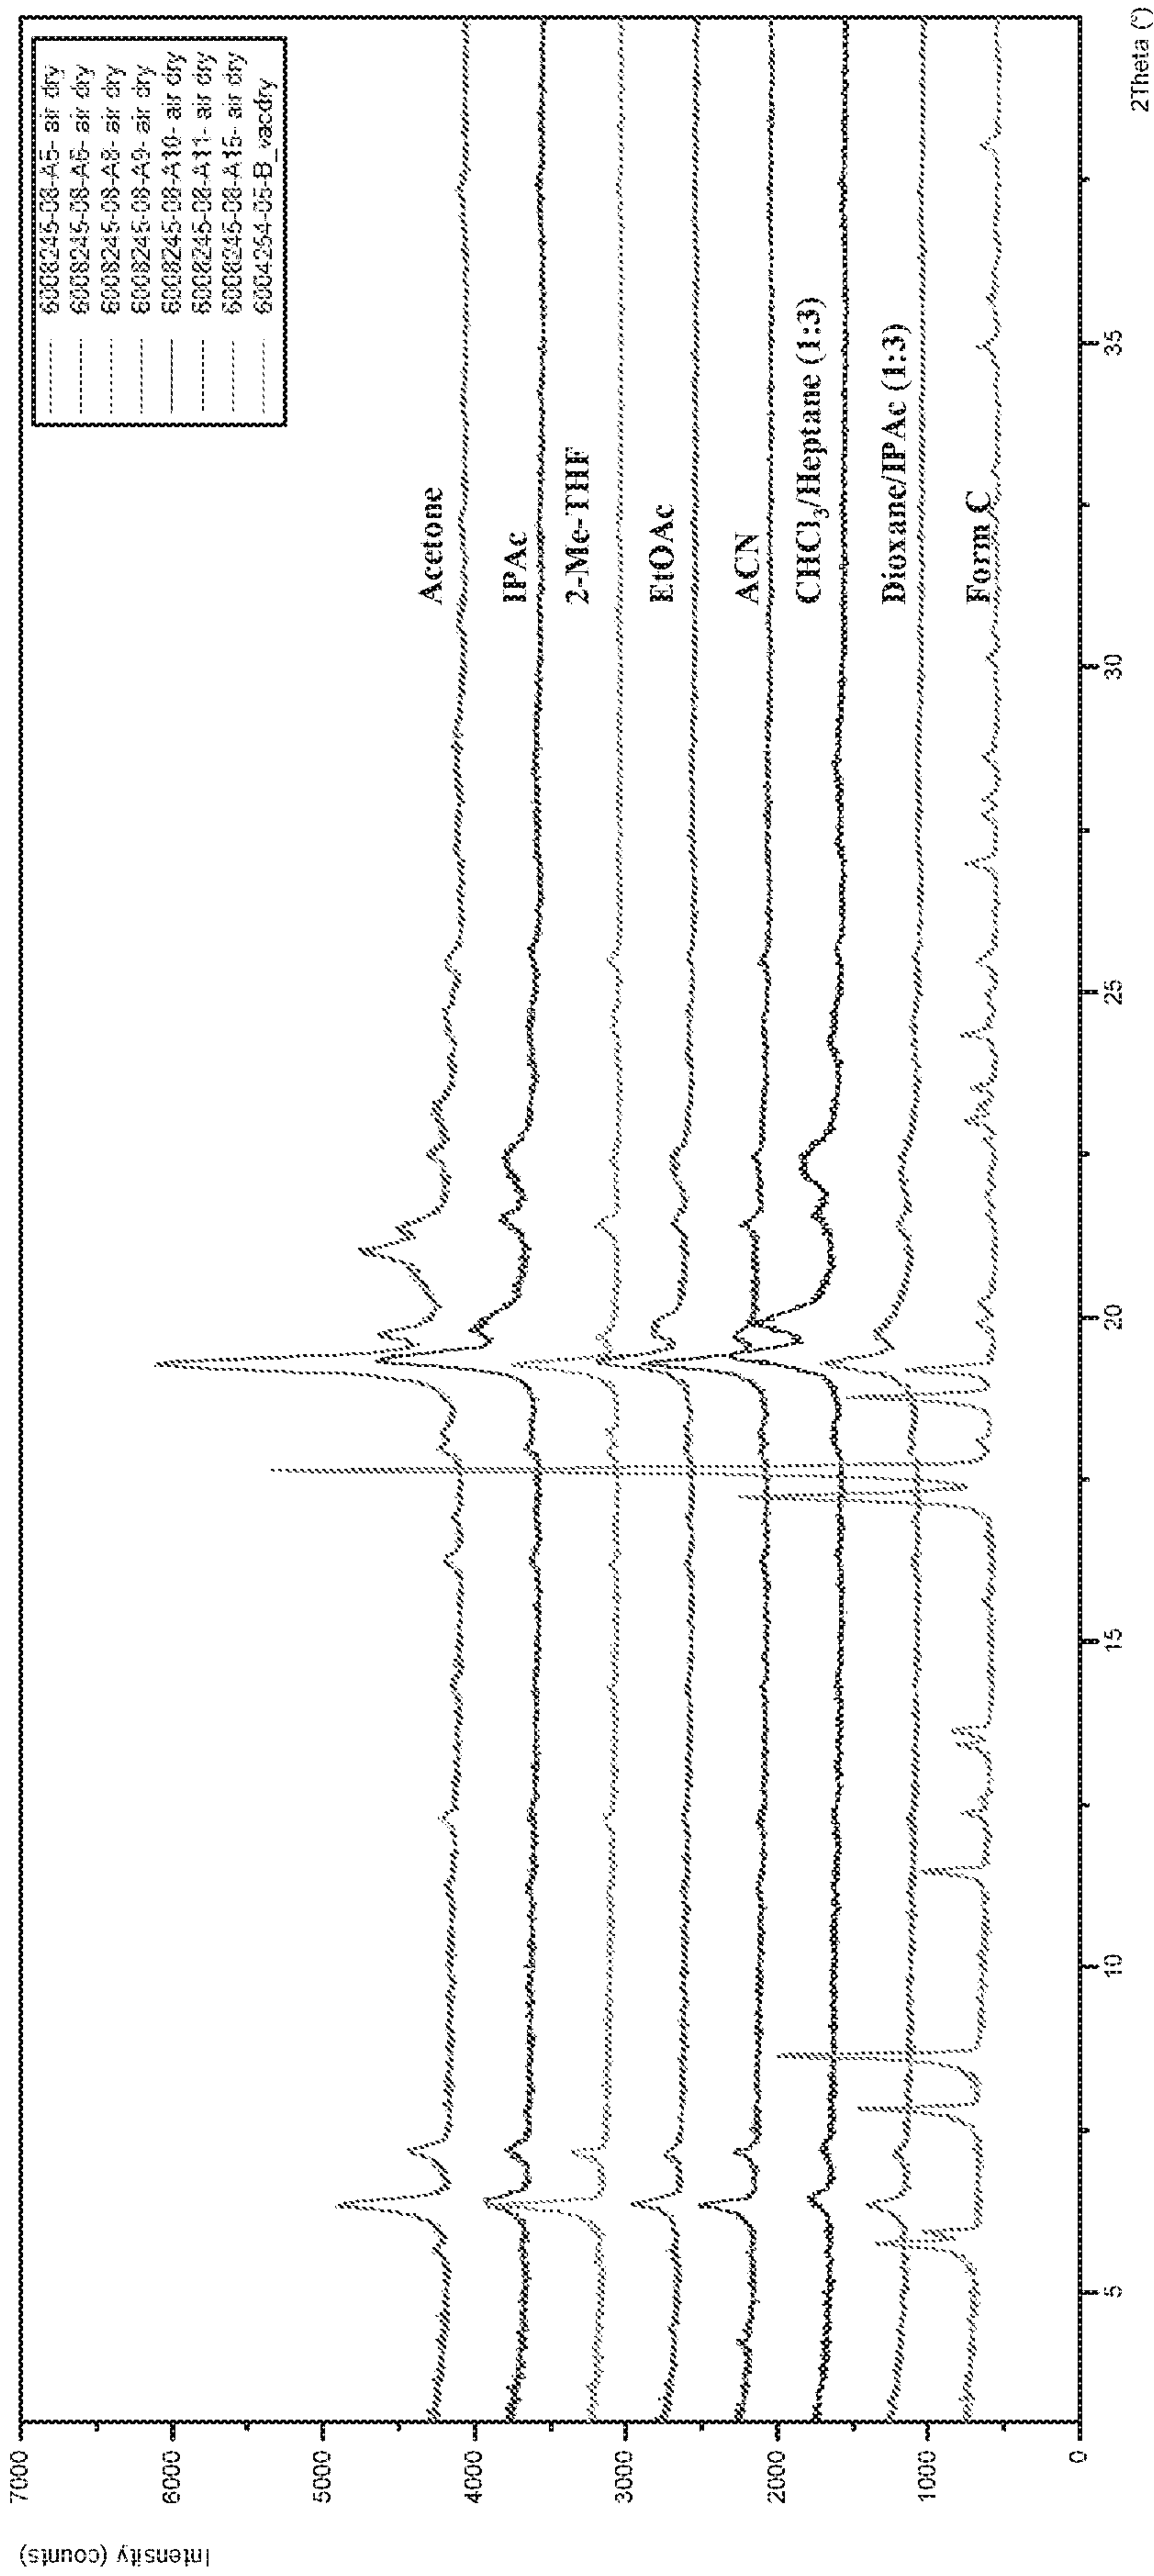


Figure 8

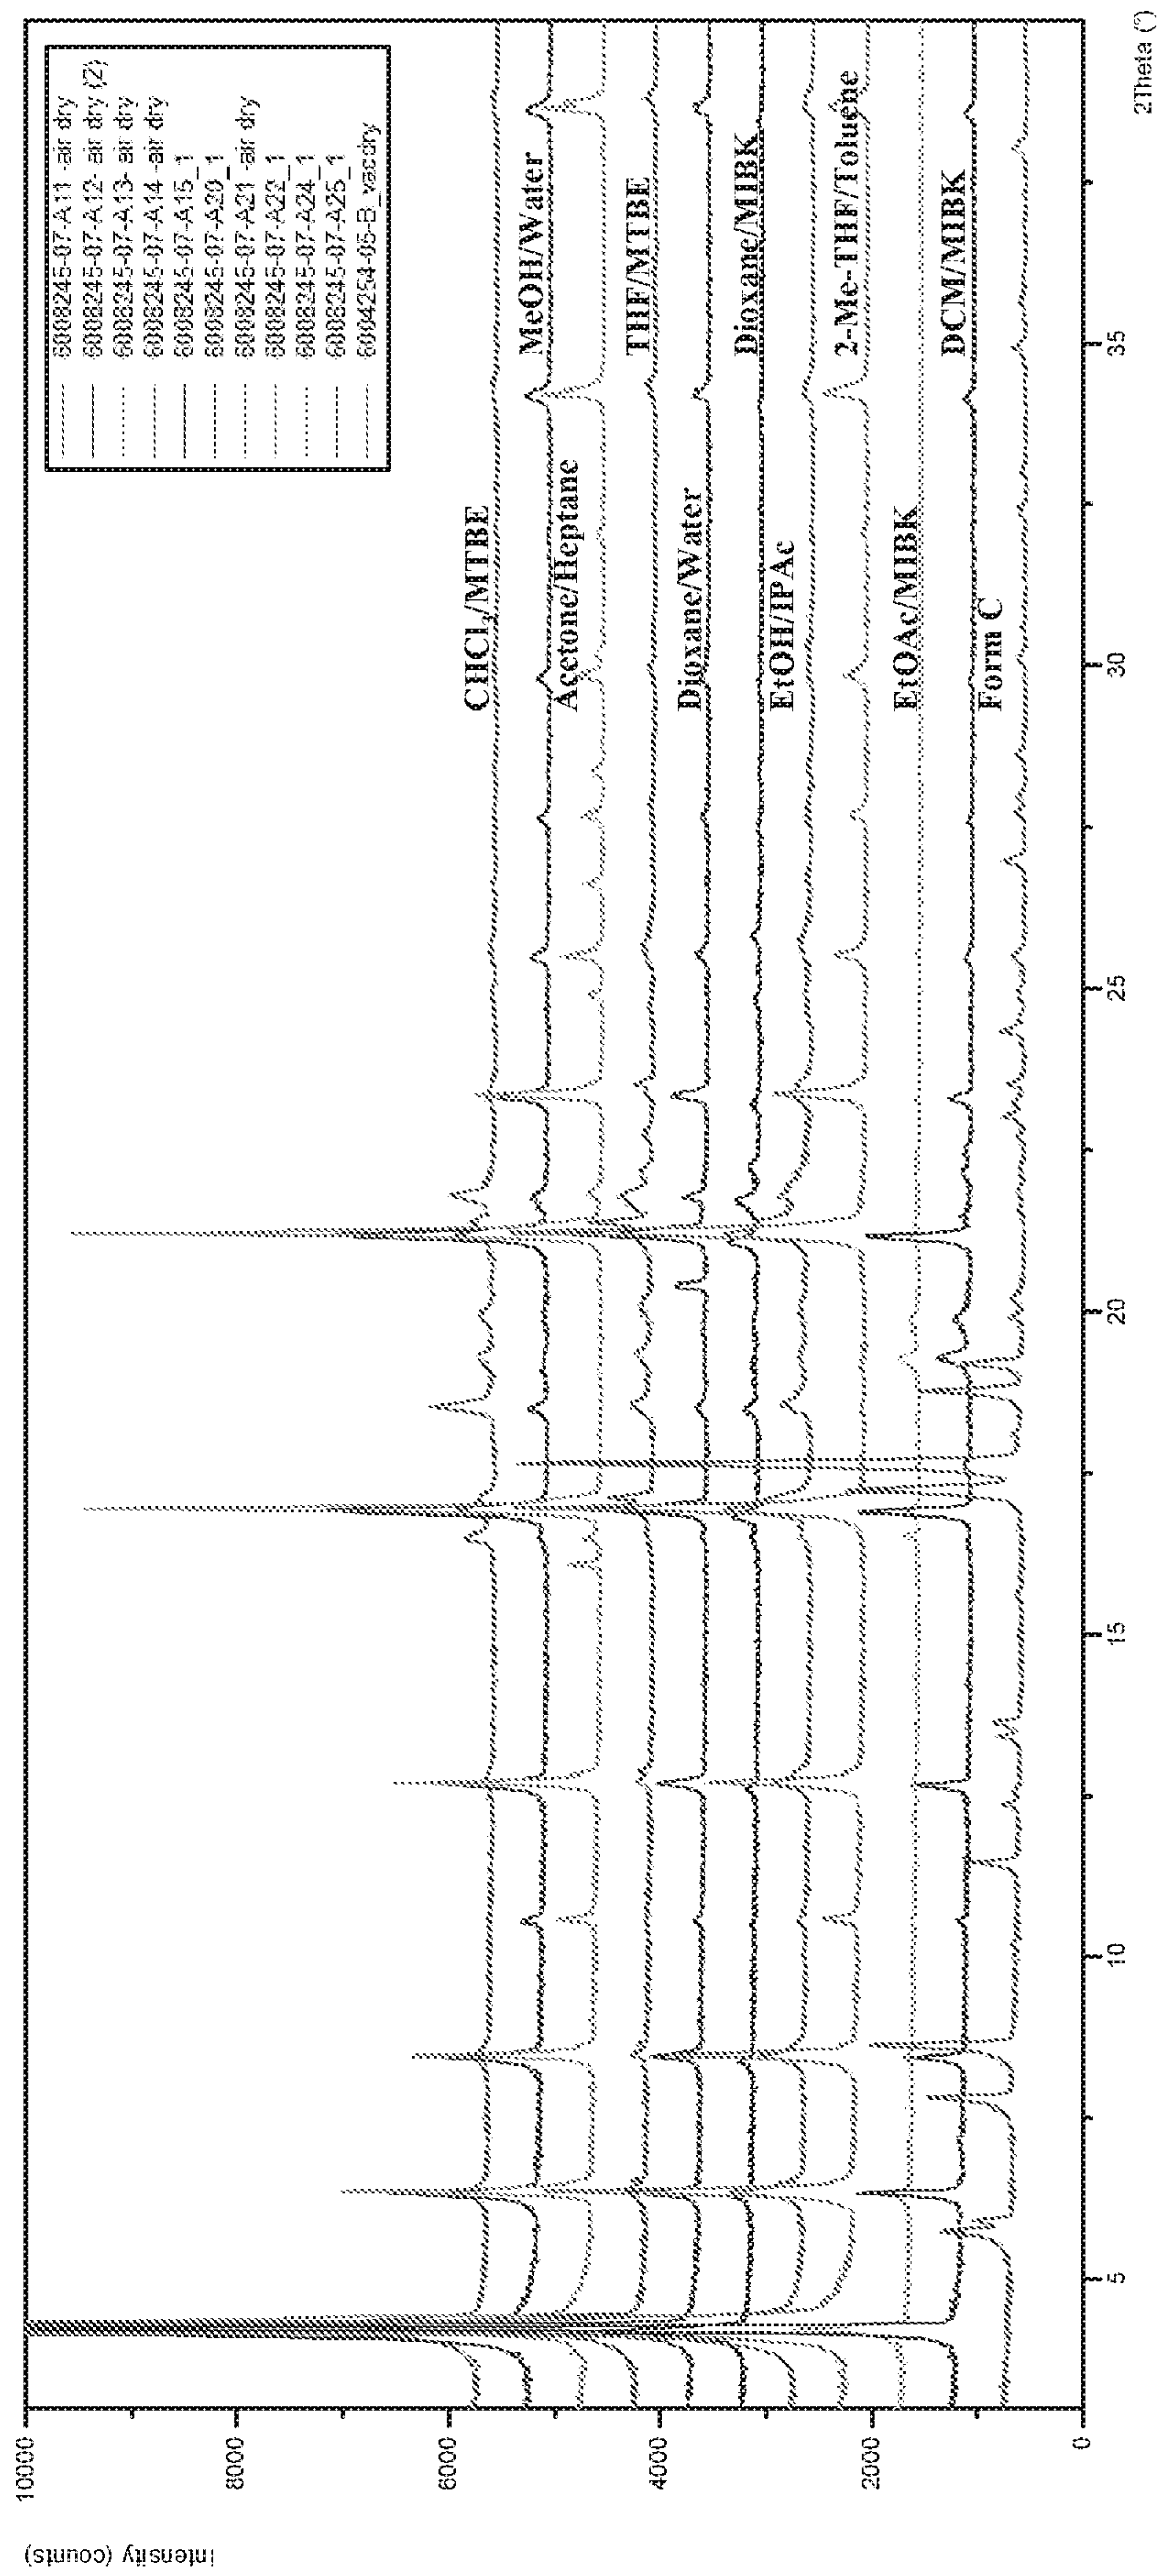


Figure 9

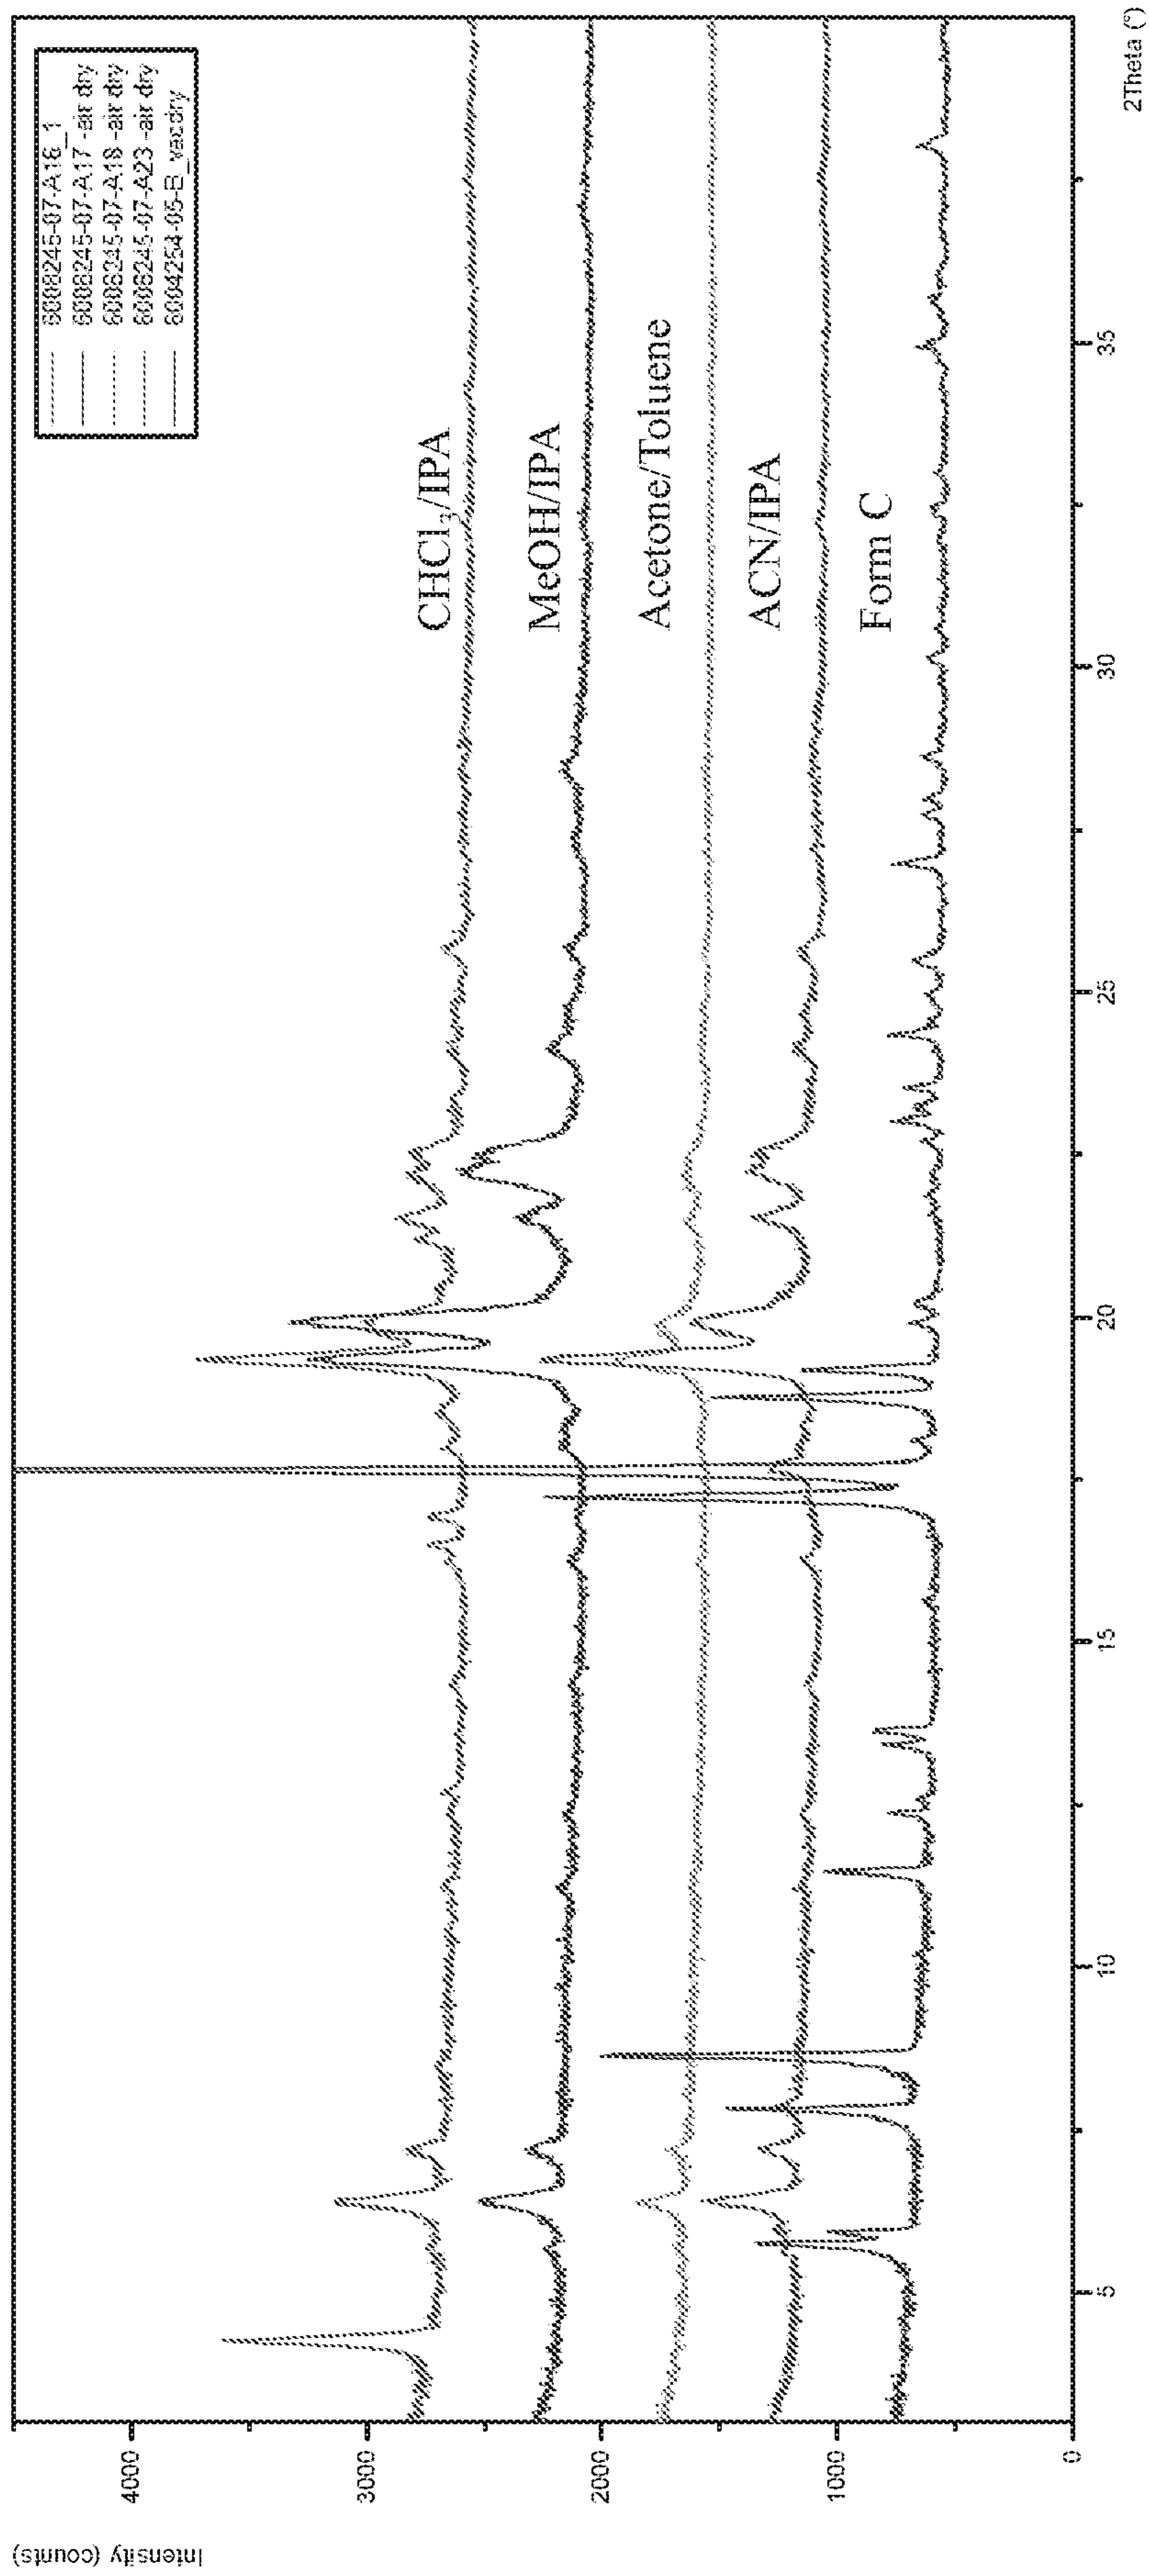


Figure 10

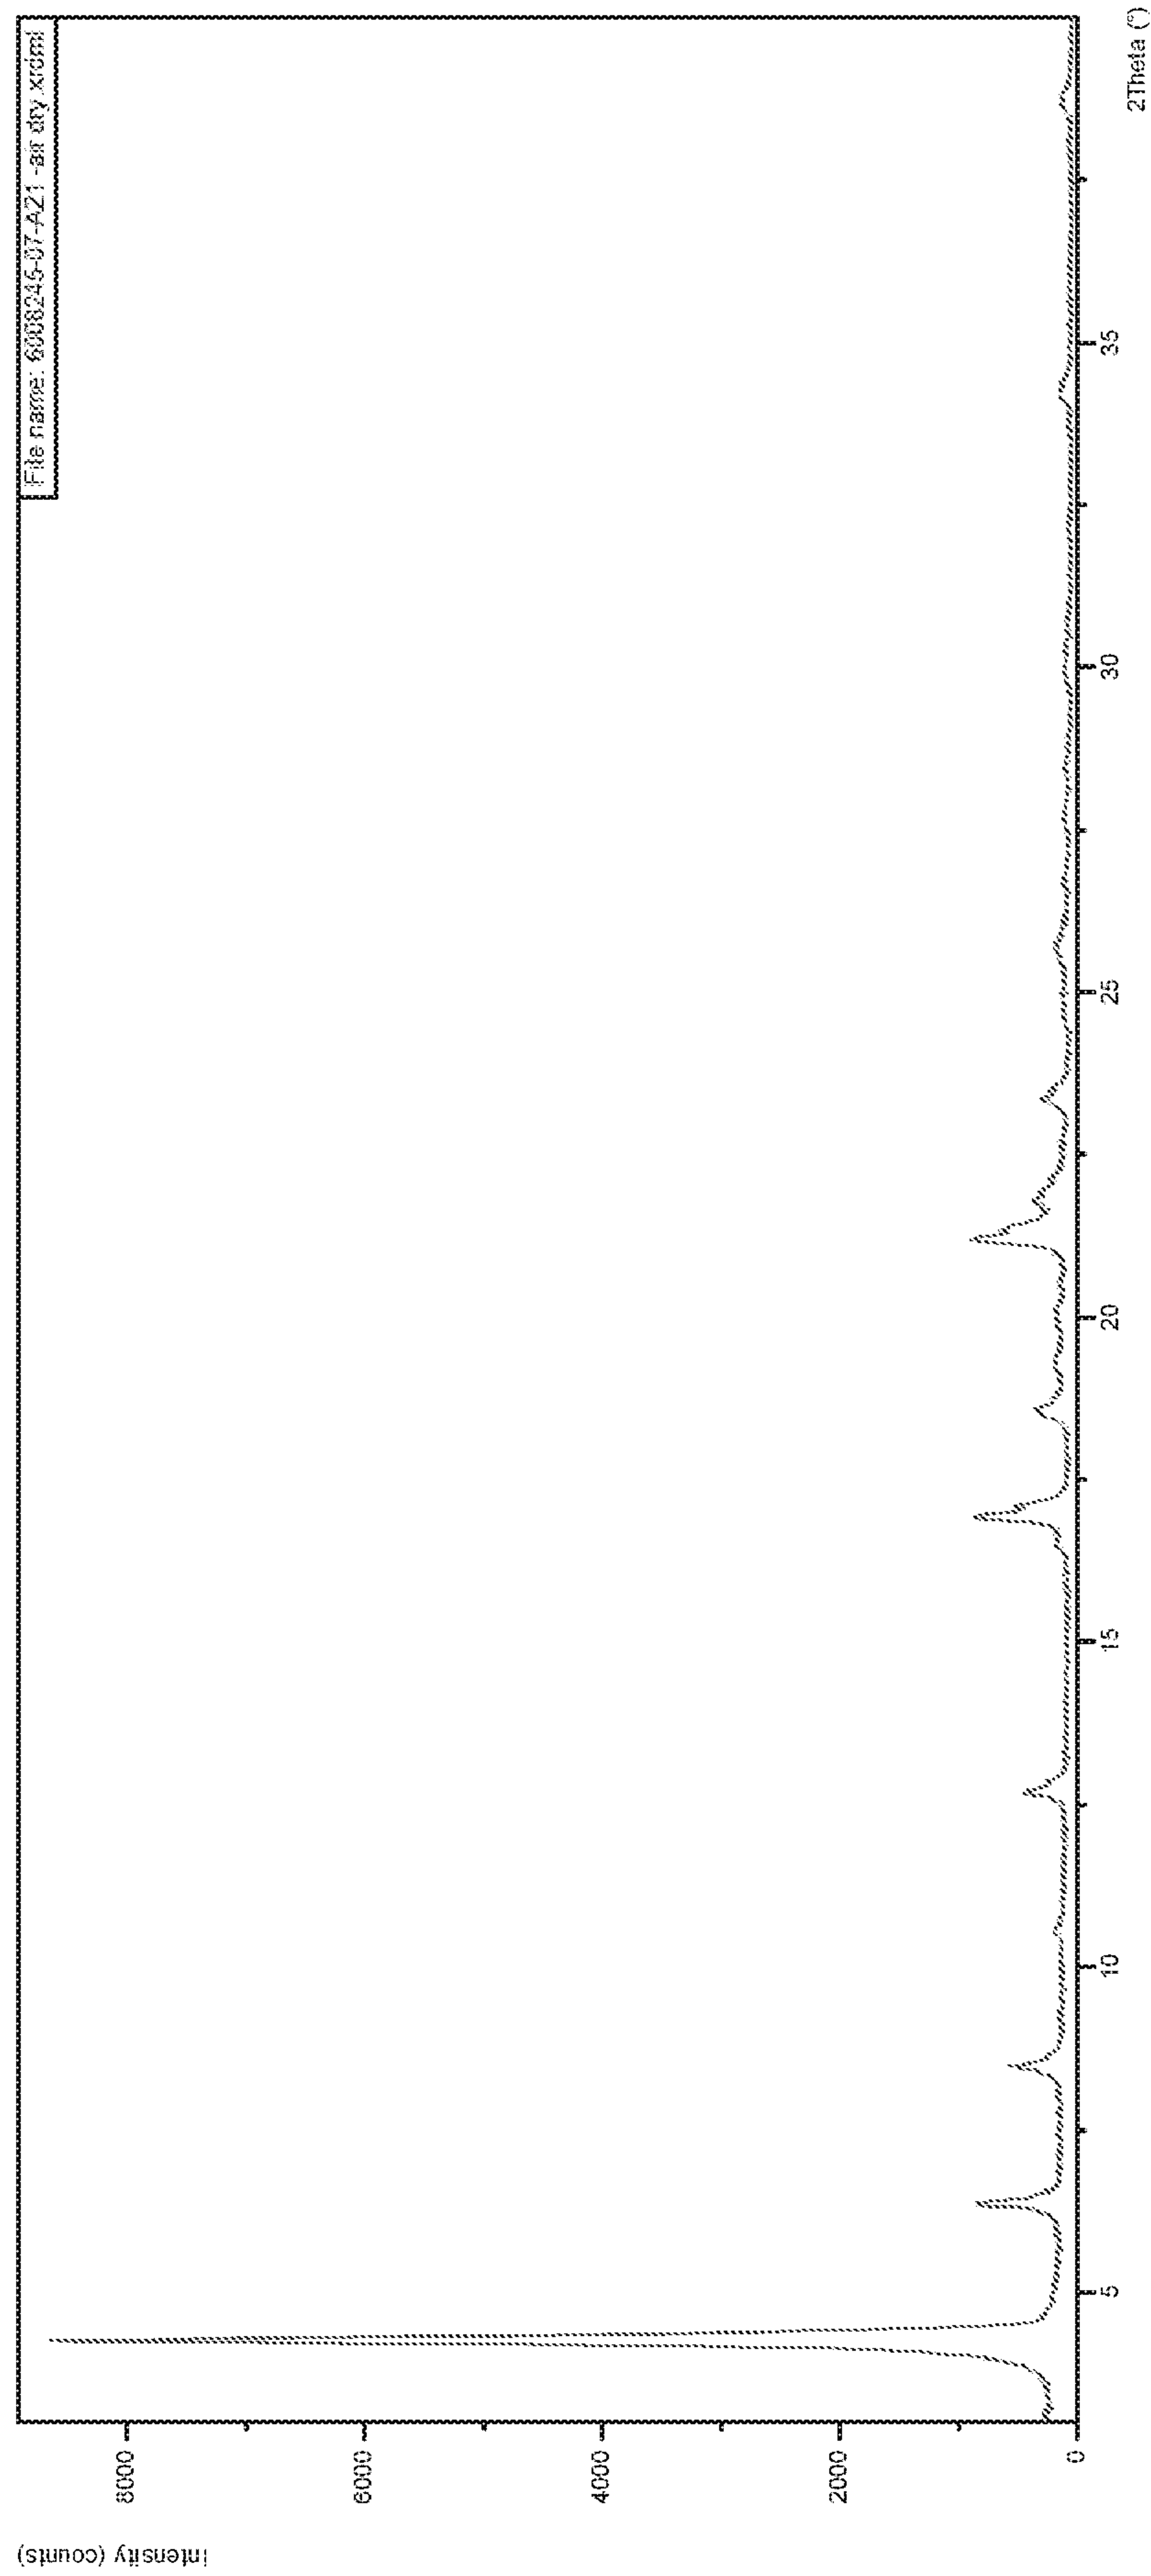


Figure 11

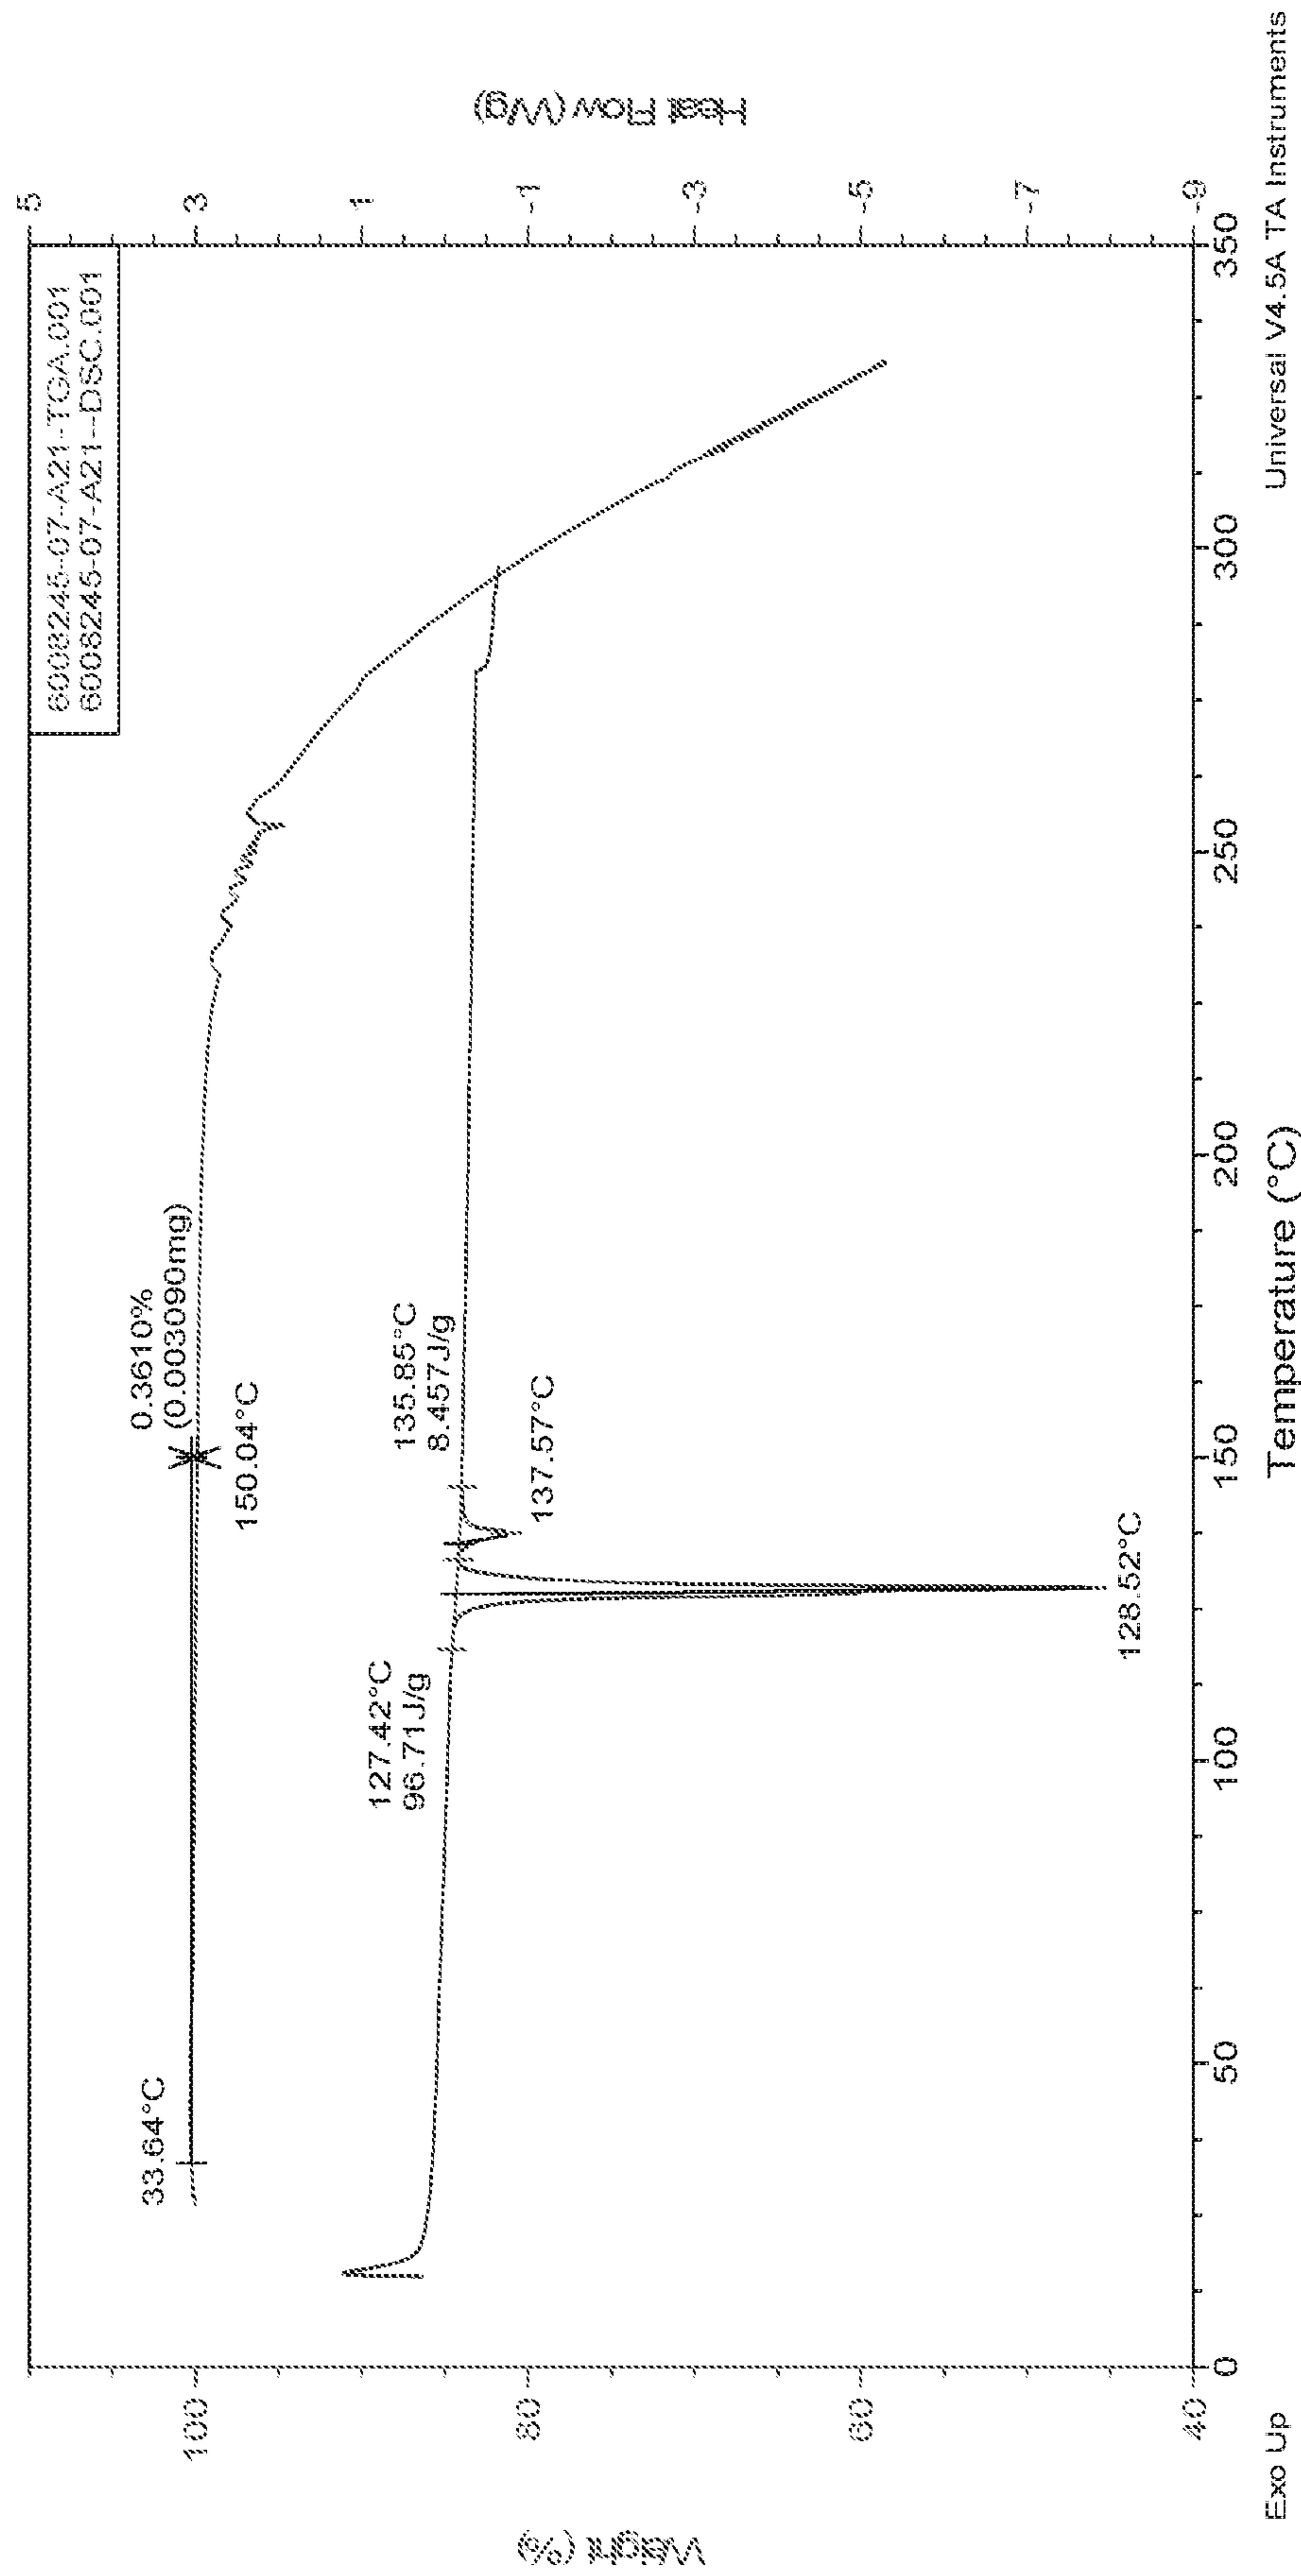


Figure 12

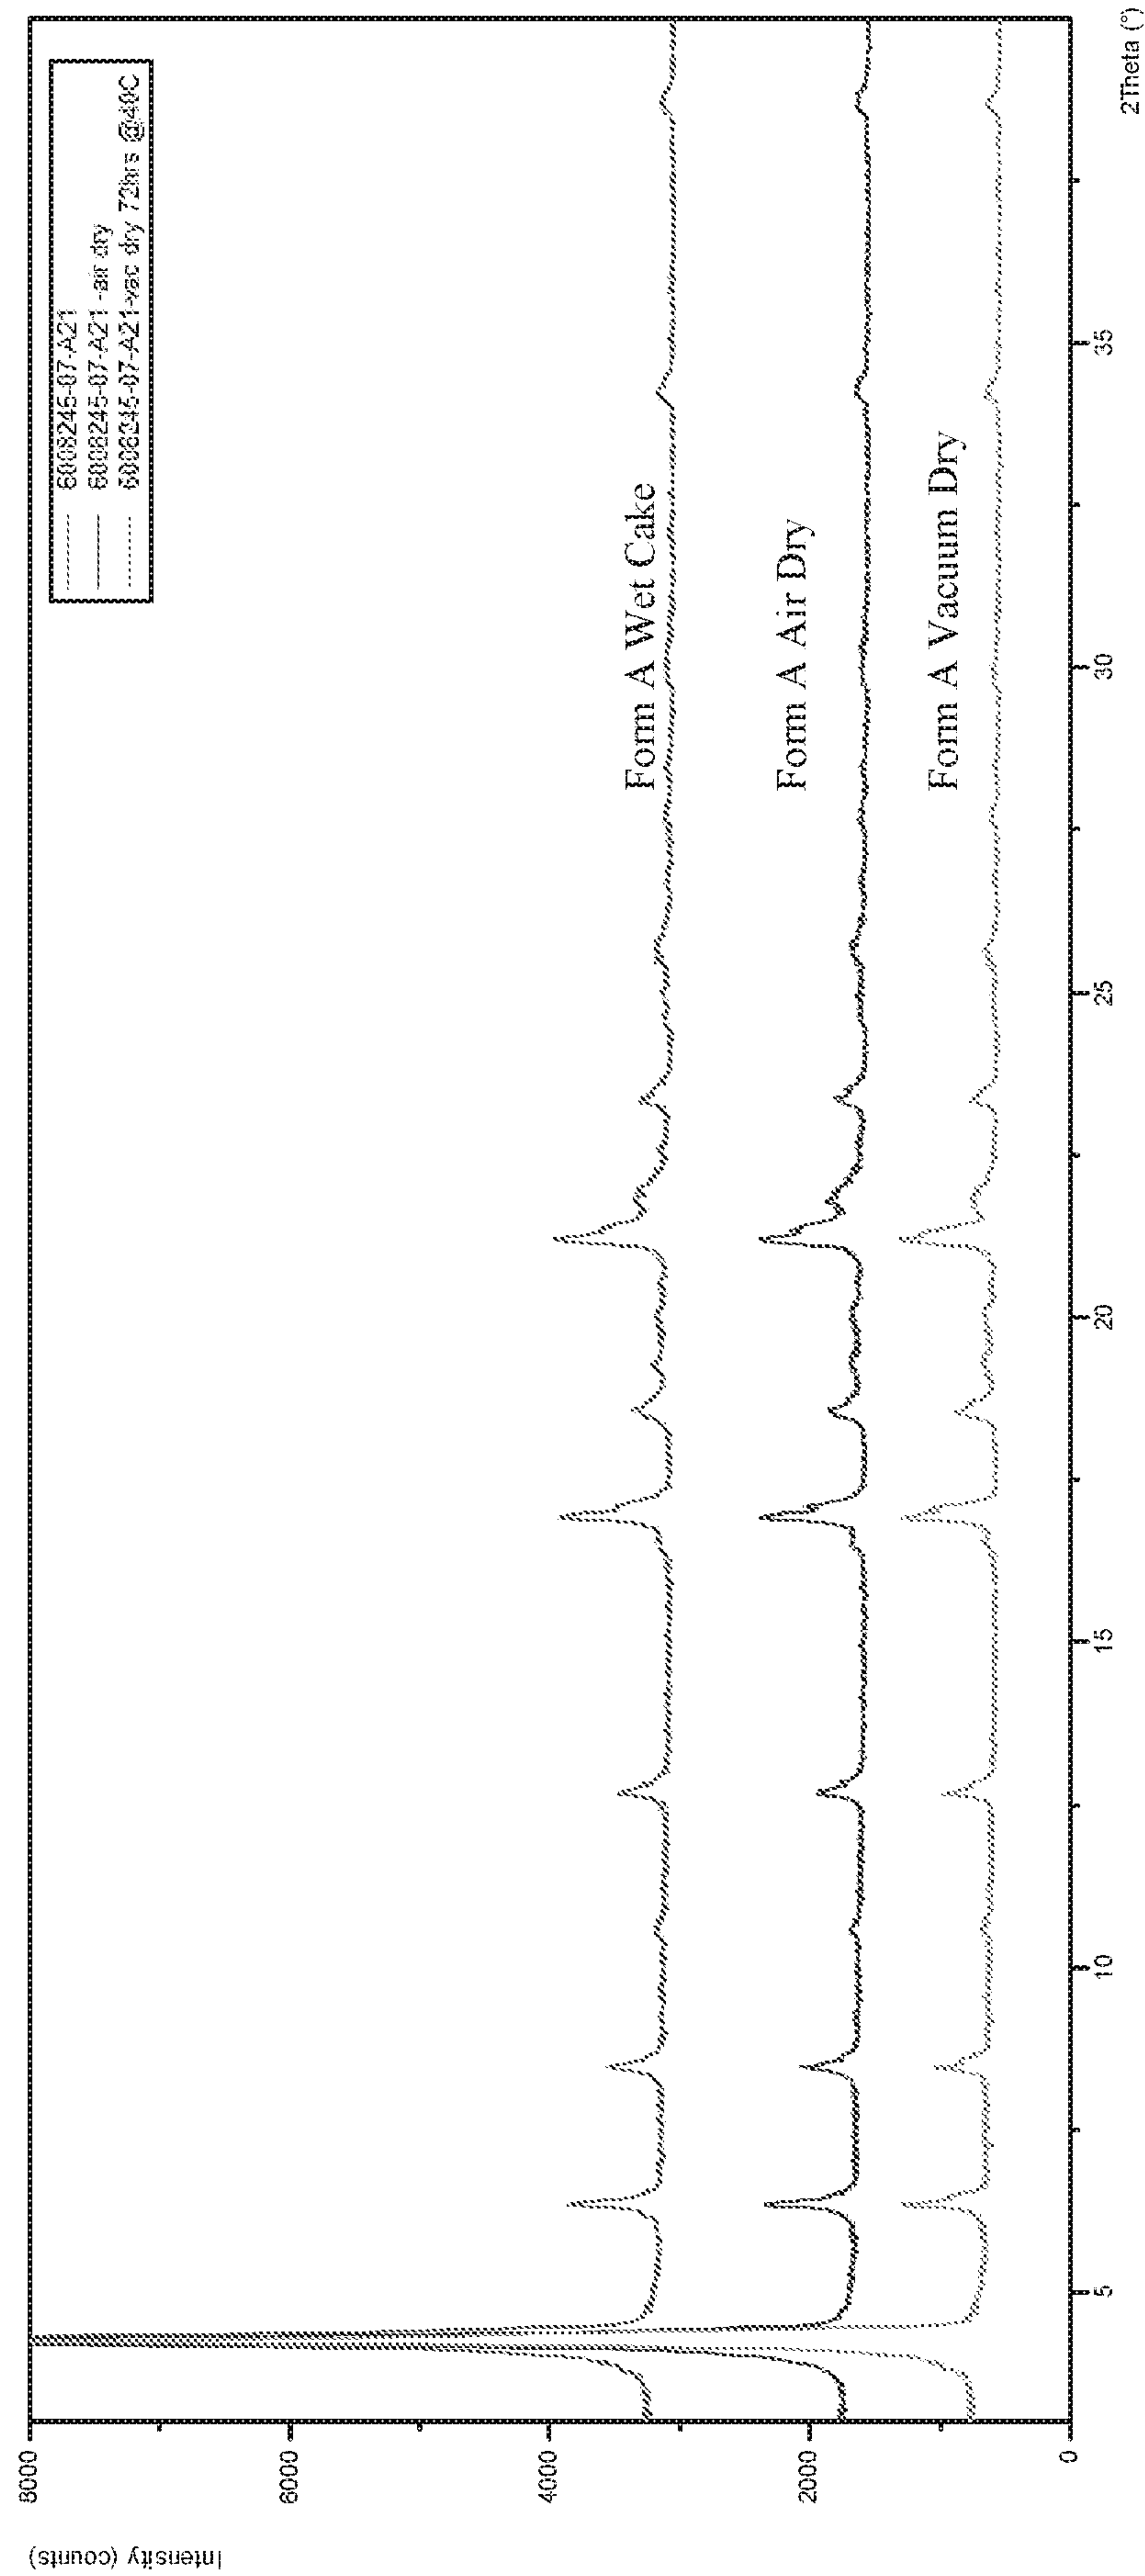


Figure 13

Sample: 6008245-07-A21-vac dry-DSC
Size: 1.9720 mg
Method: Ramp

DSC

File: C:\6008245-07-A21-vac dry-DSC.001
Operator: tb
Run Date: 29-Jul-2016 11:45
Instrument: DSC Q2000 V24.11 Build 124

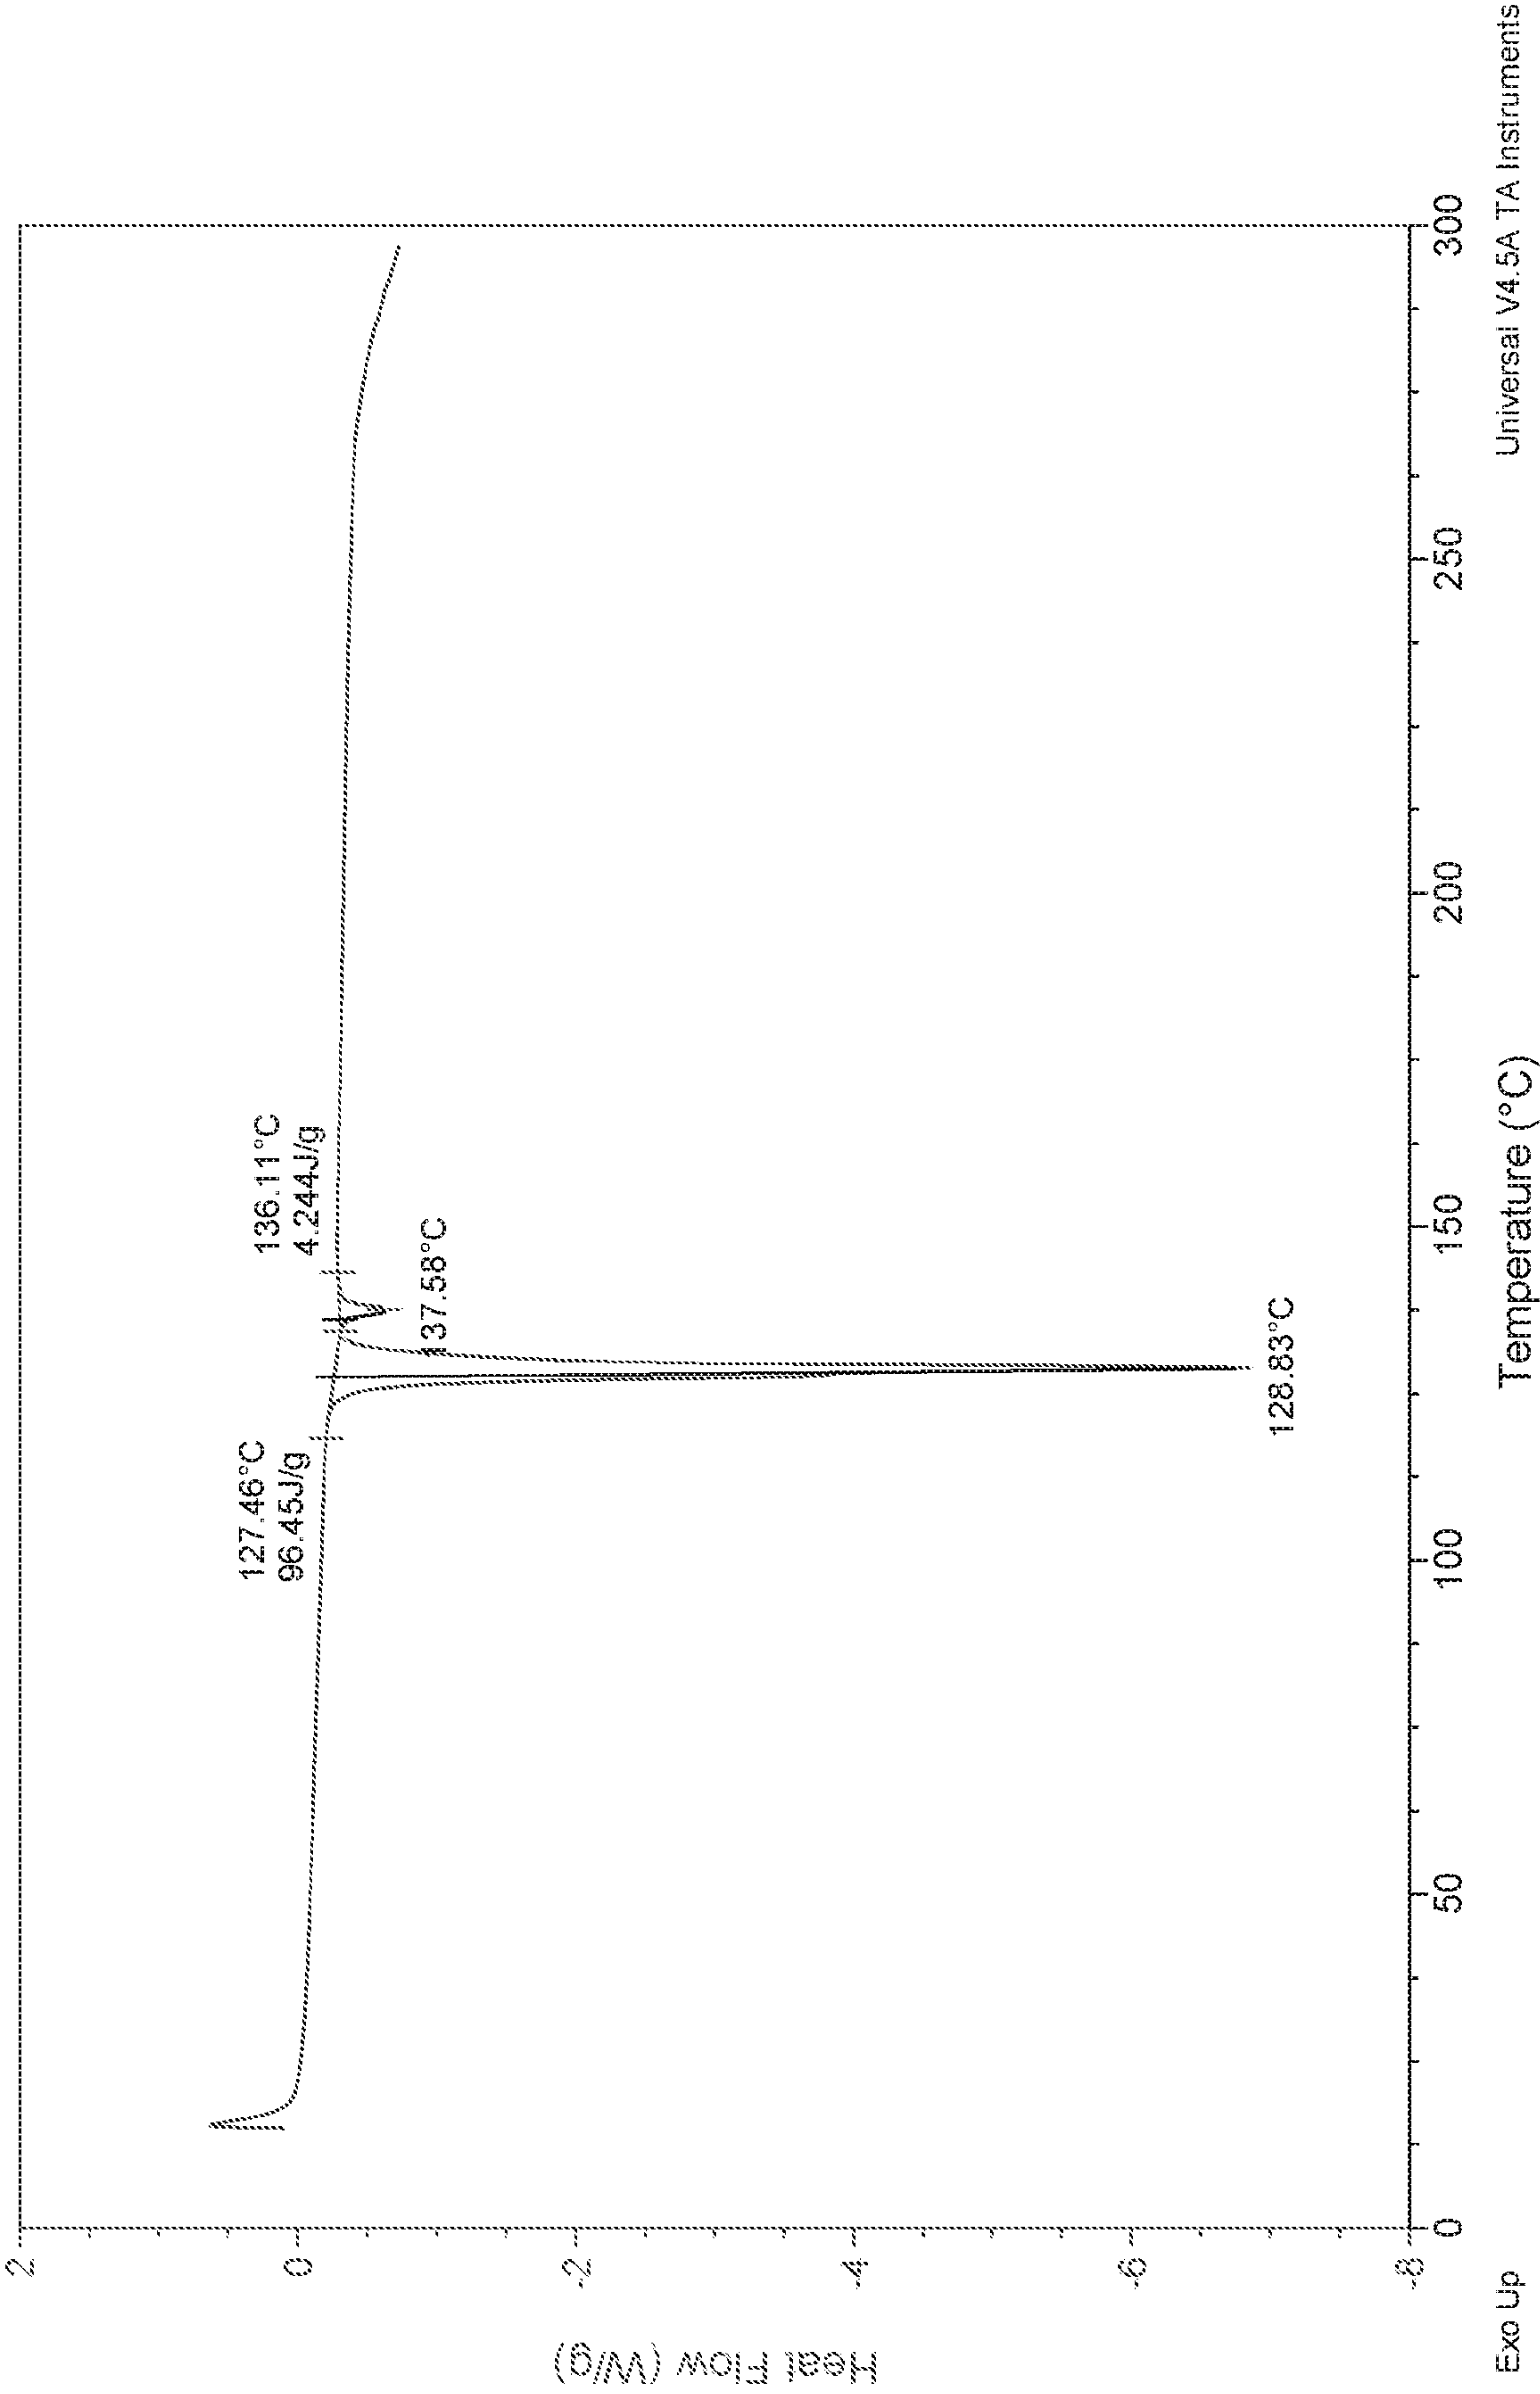


Figure 14

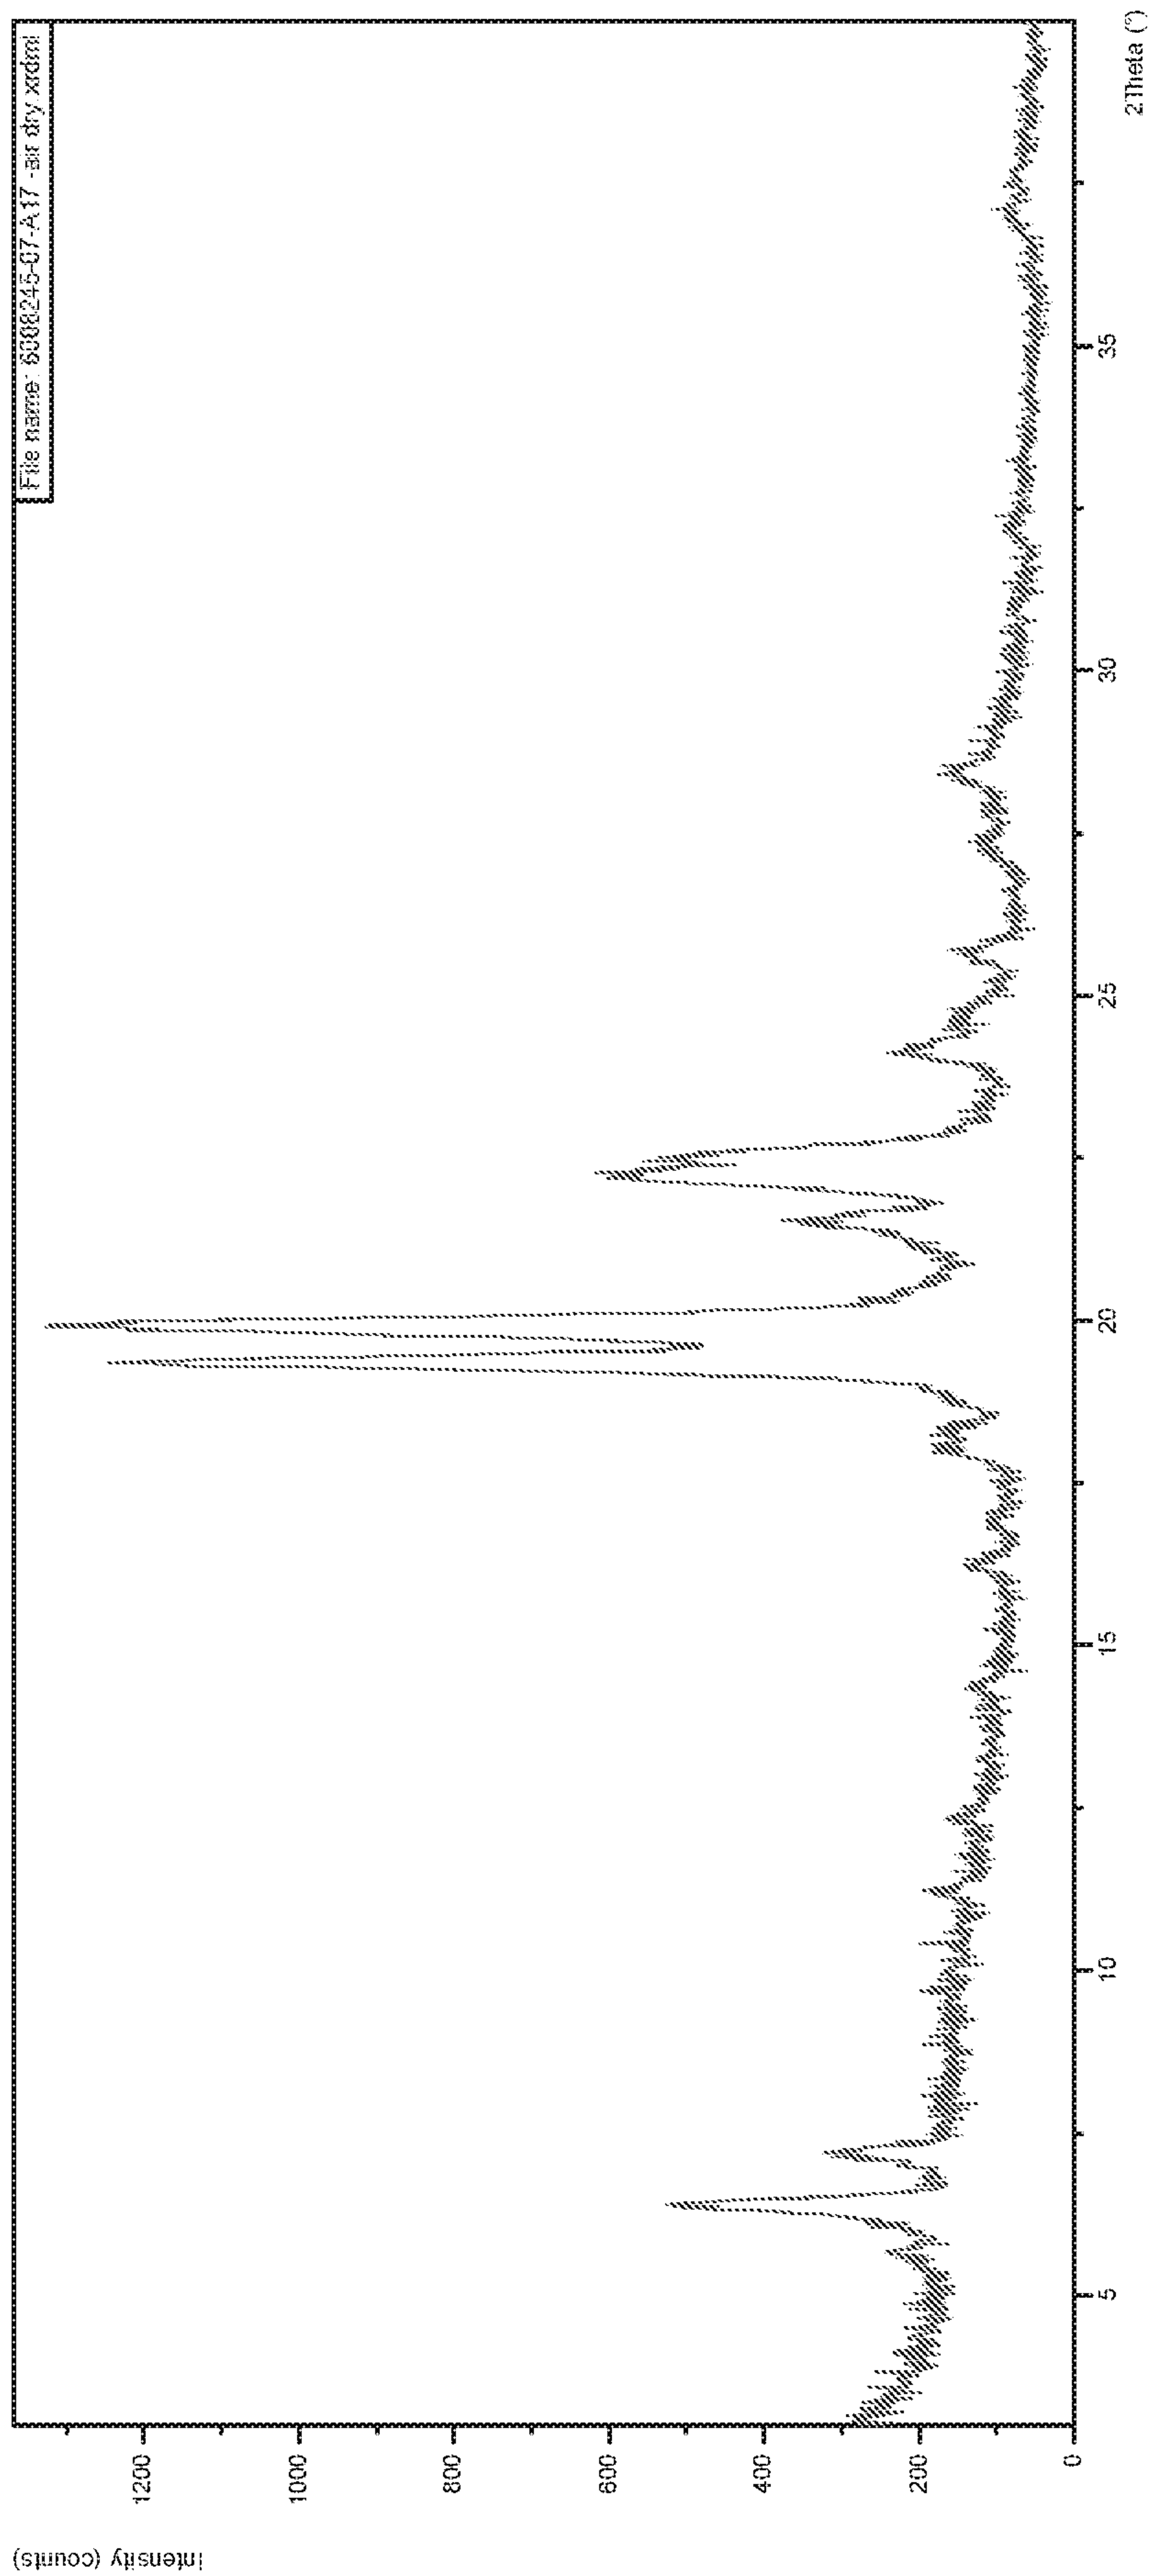


Figure 15

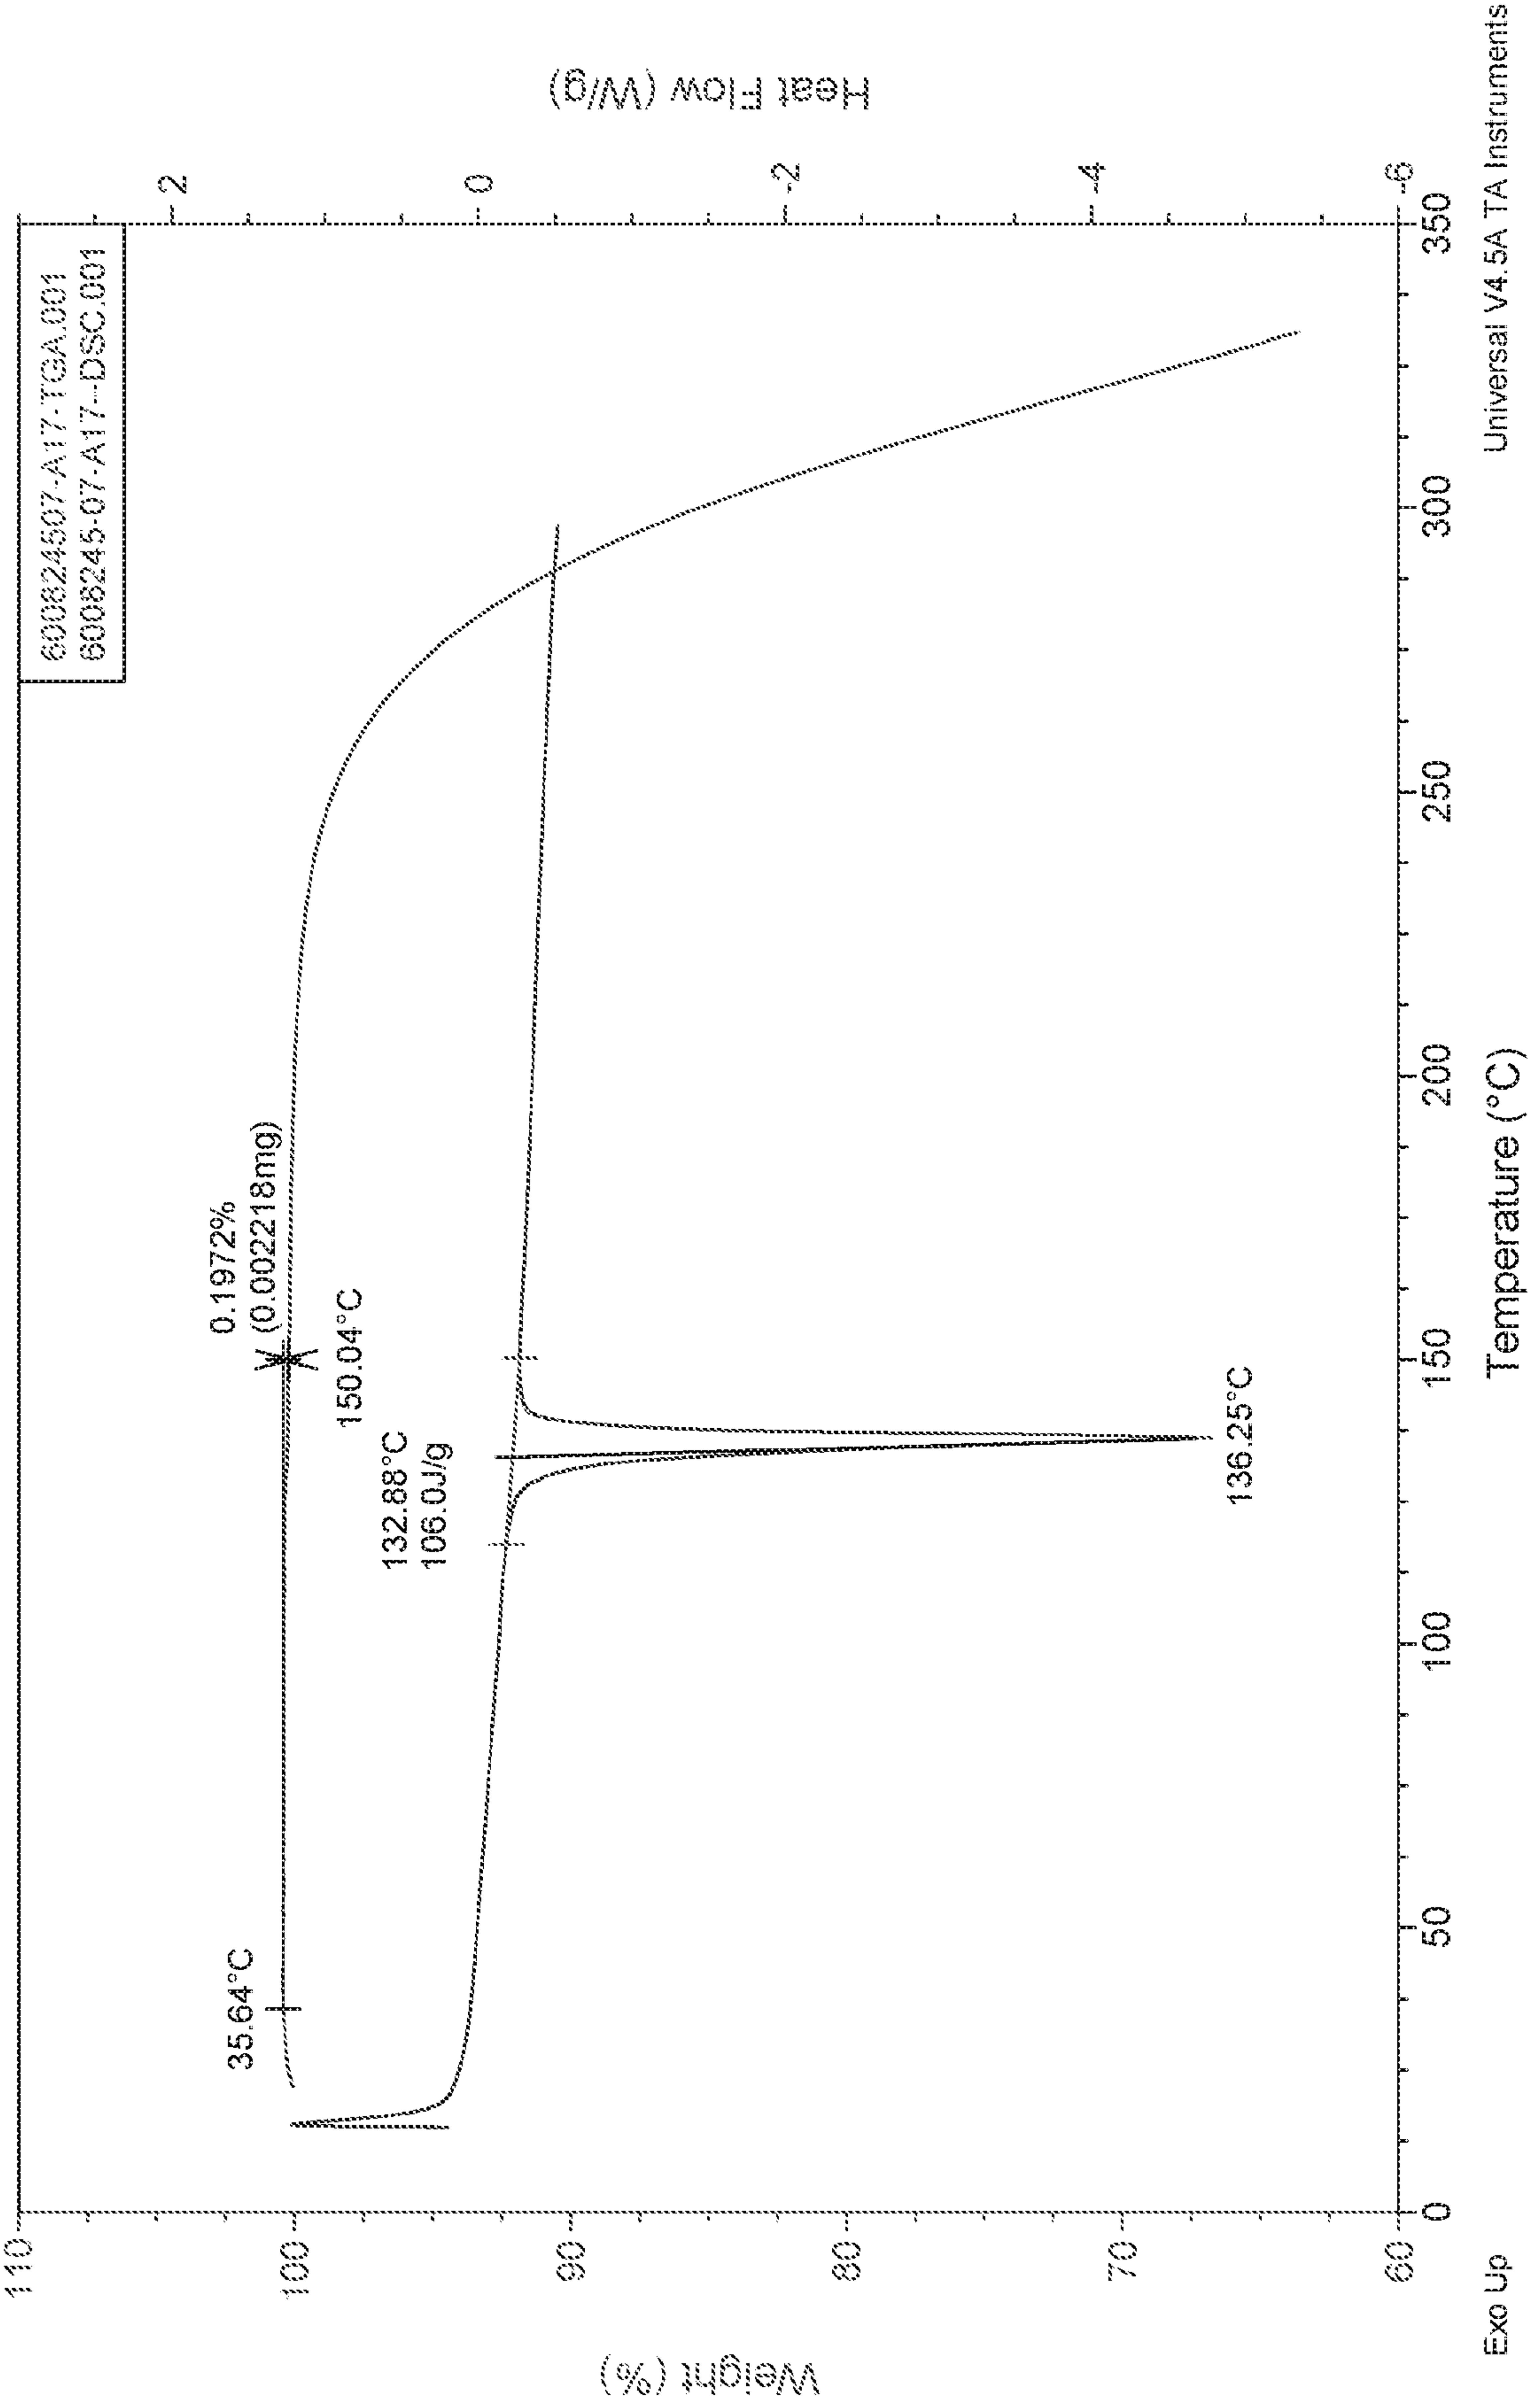


Figure 16

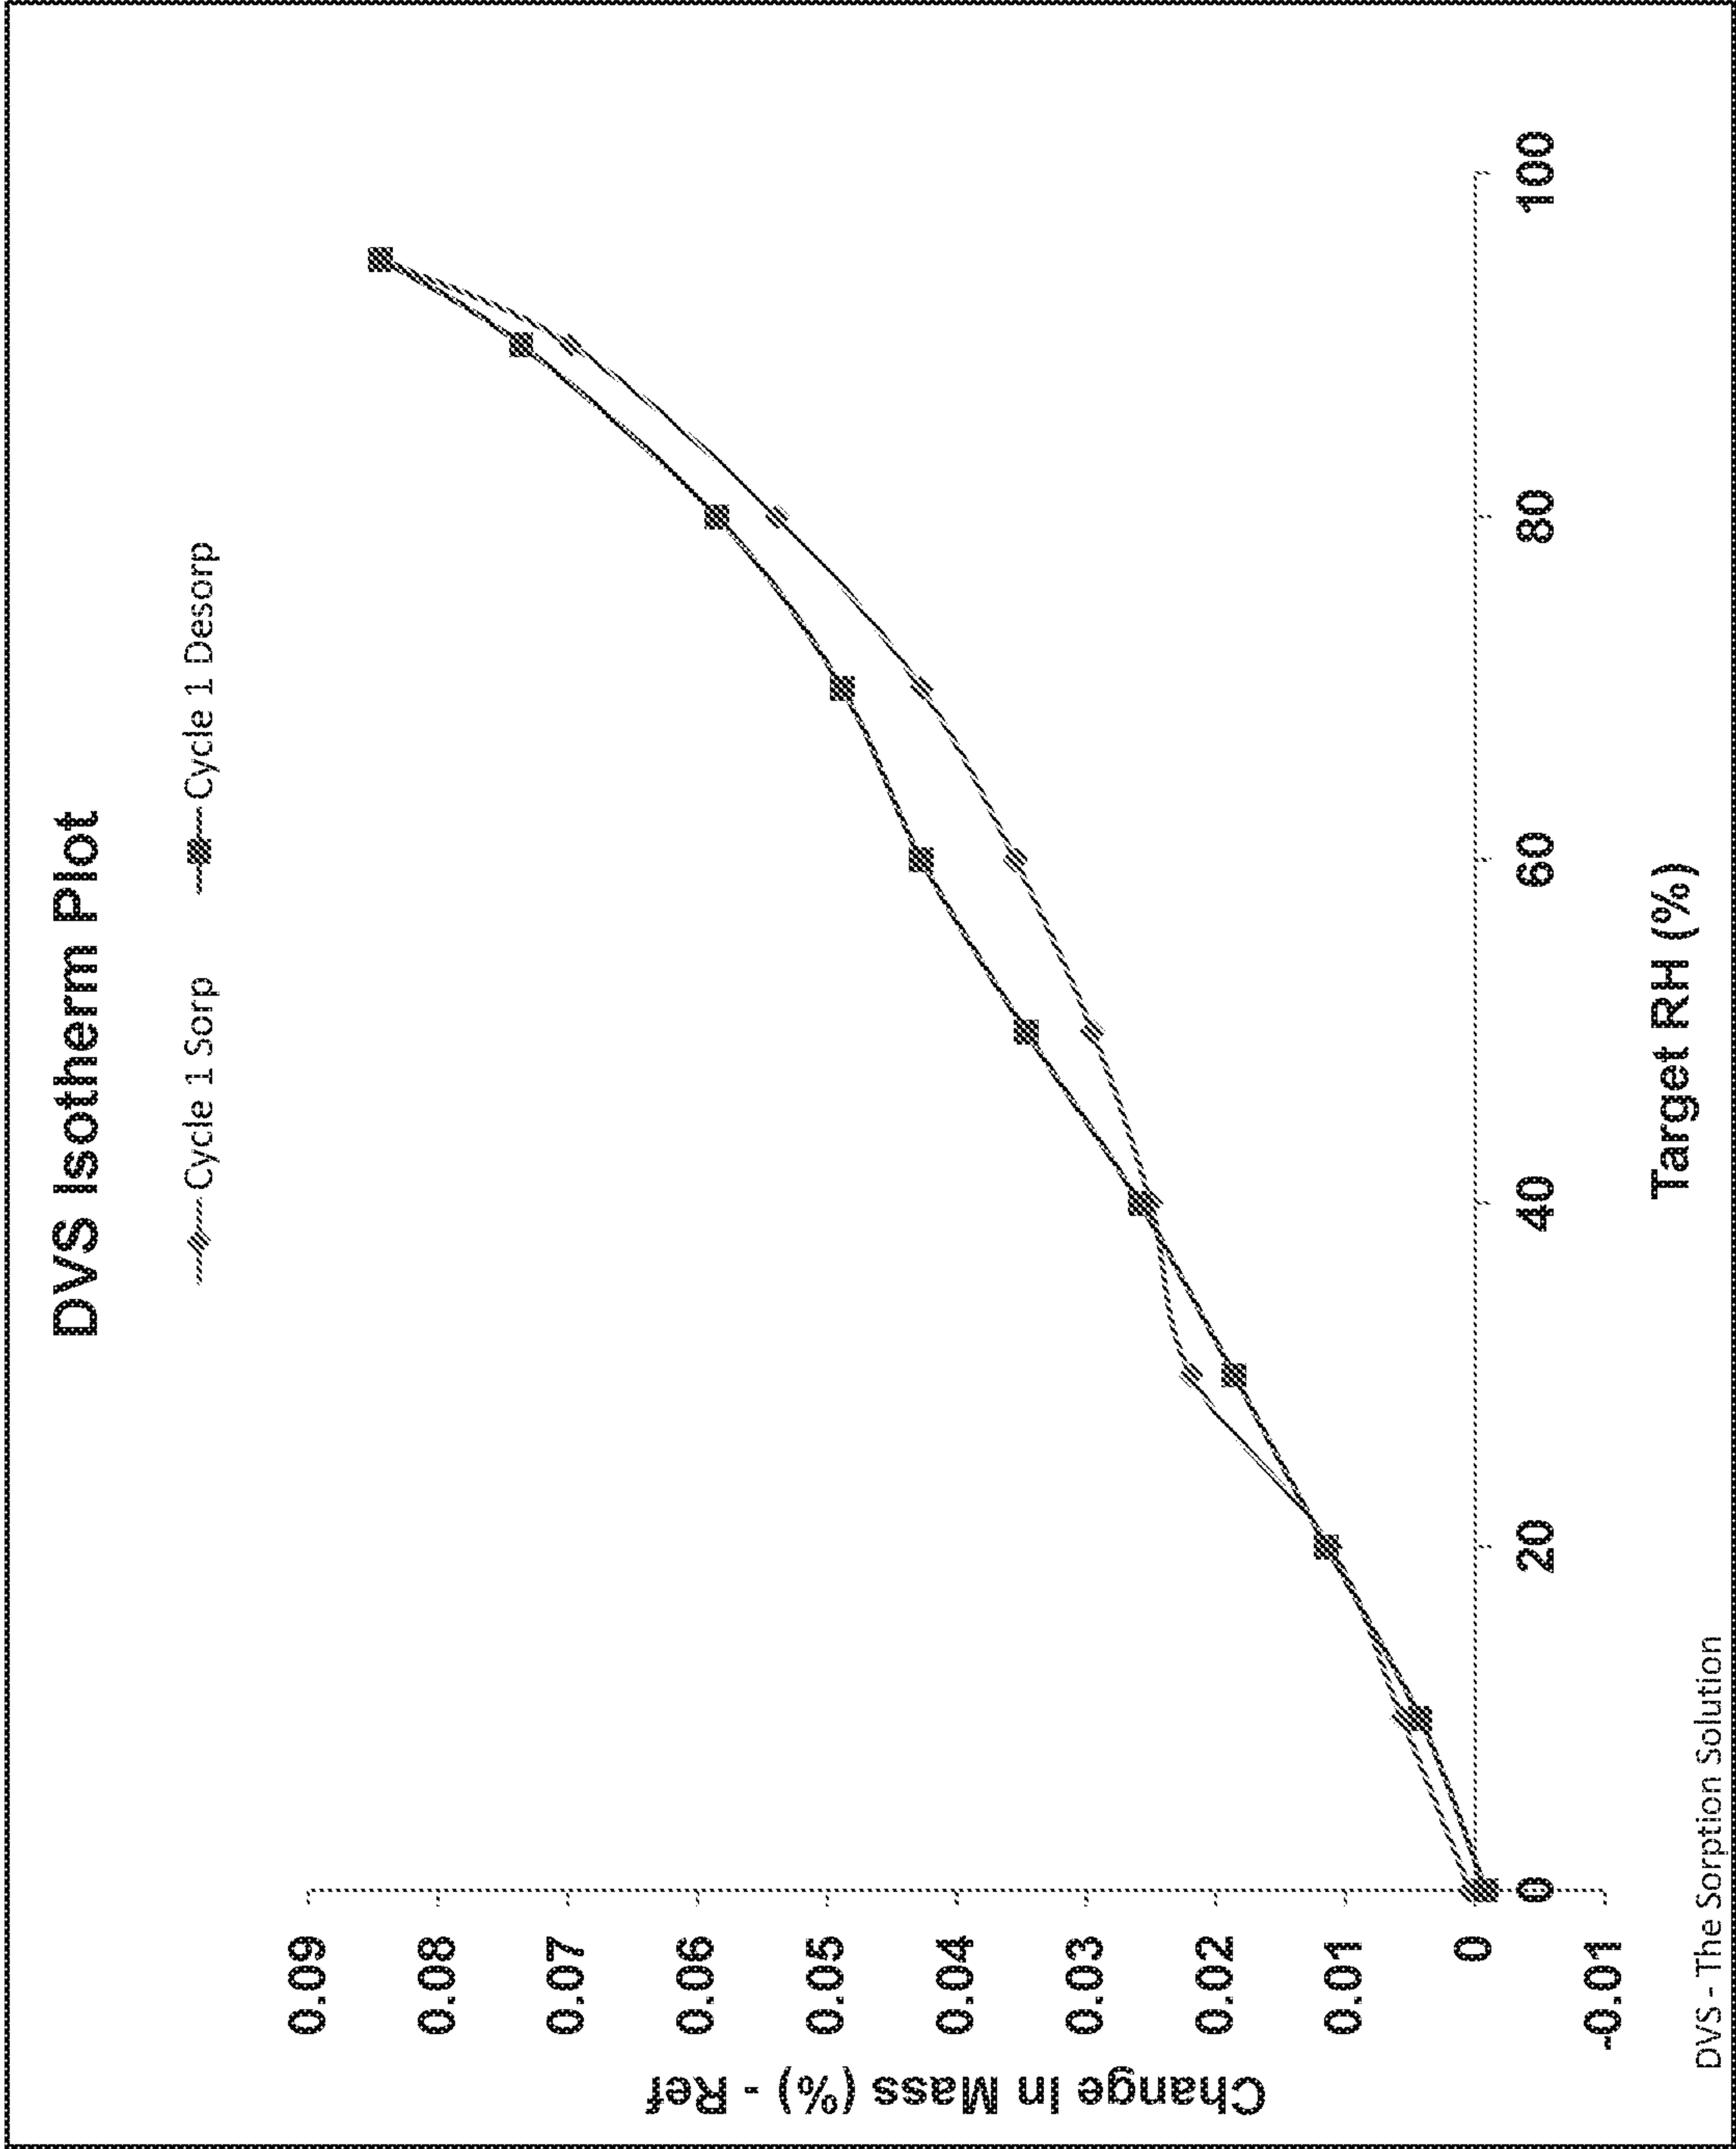


Figure 17

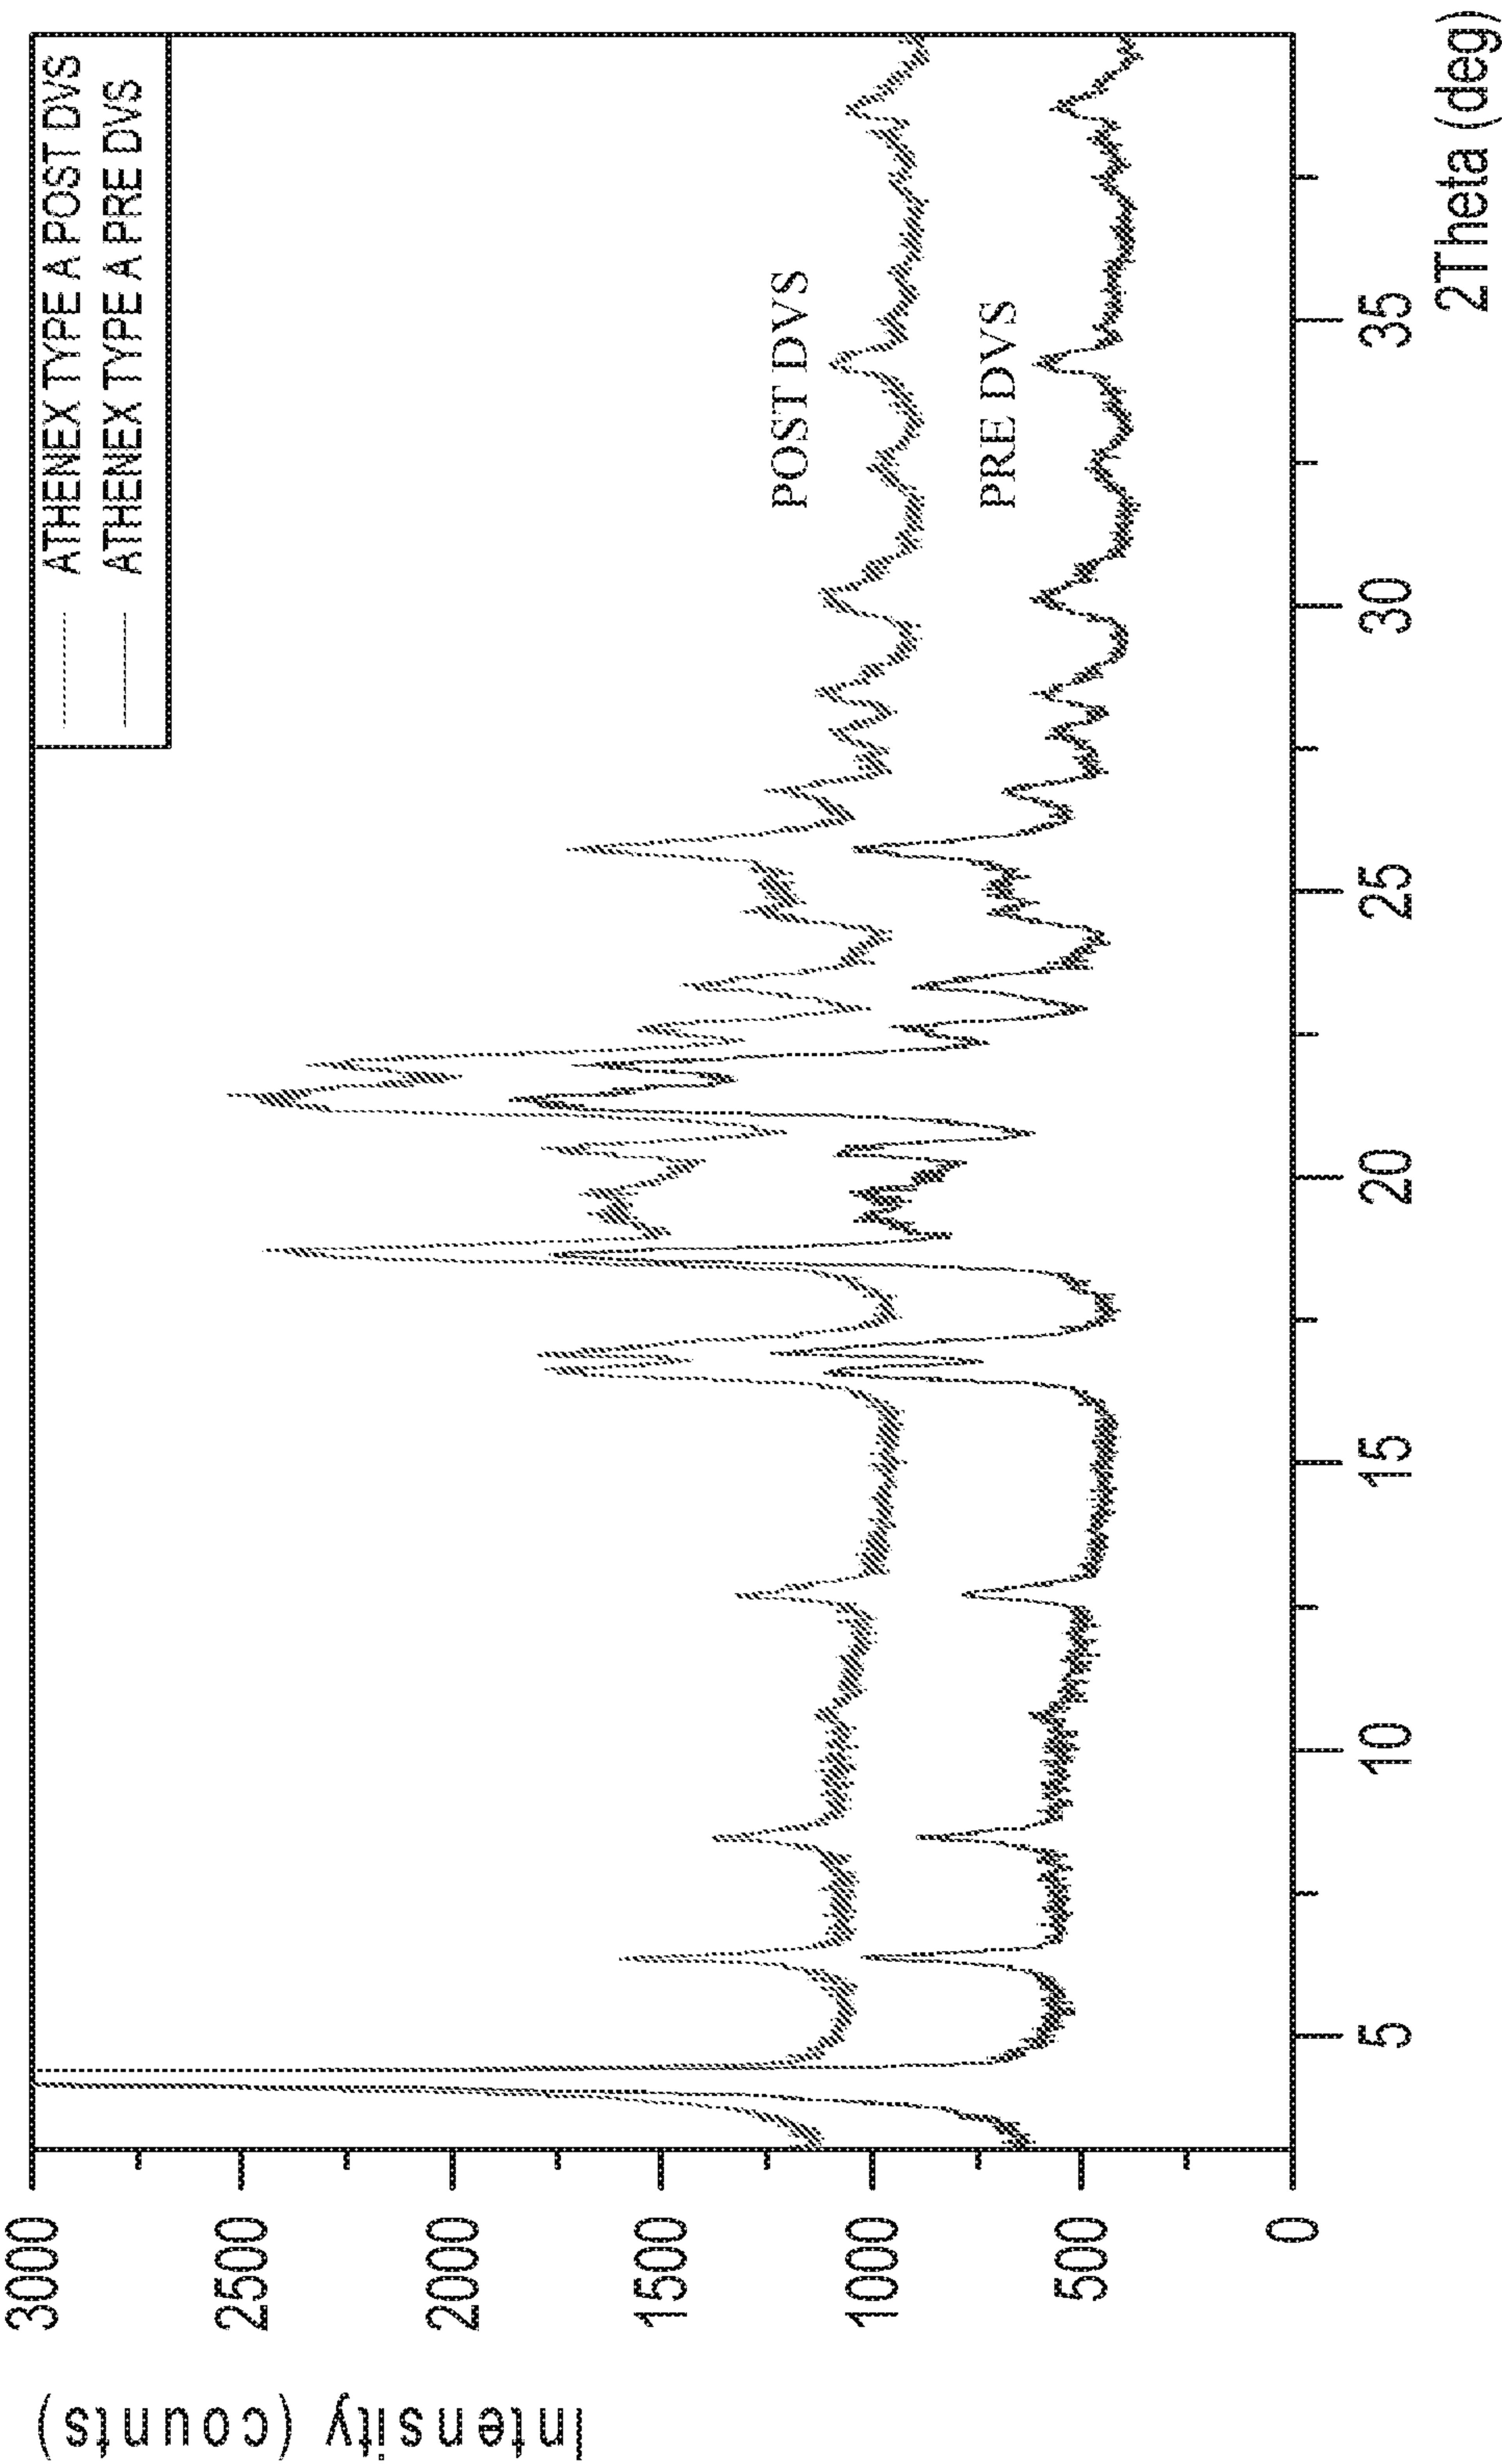


Figure 18

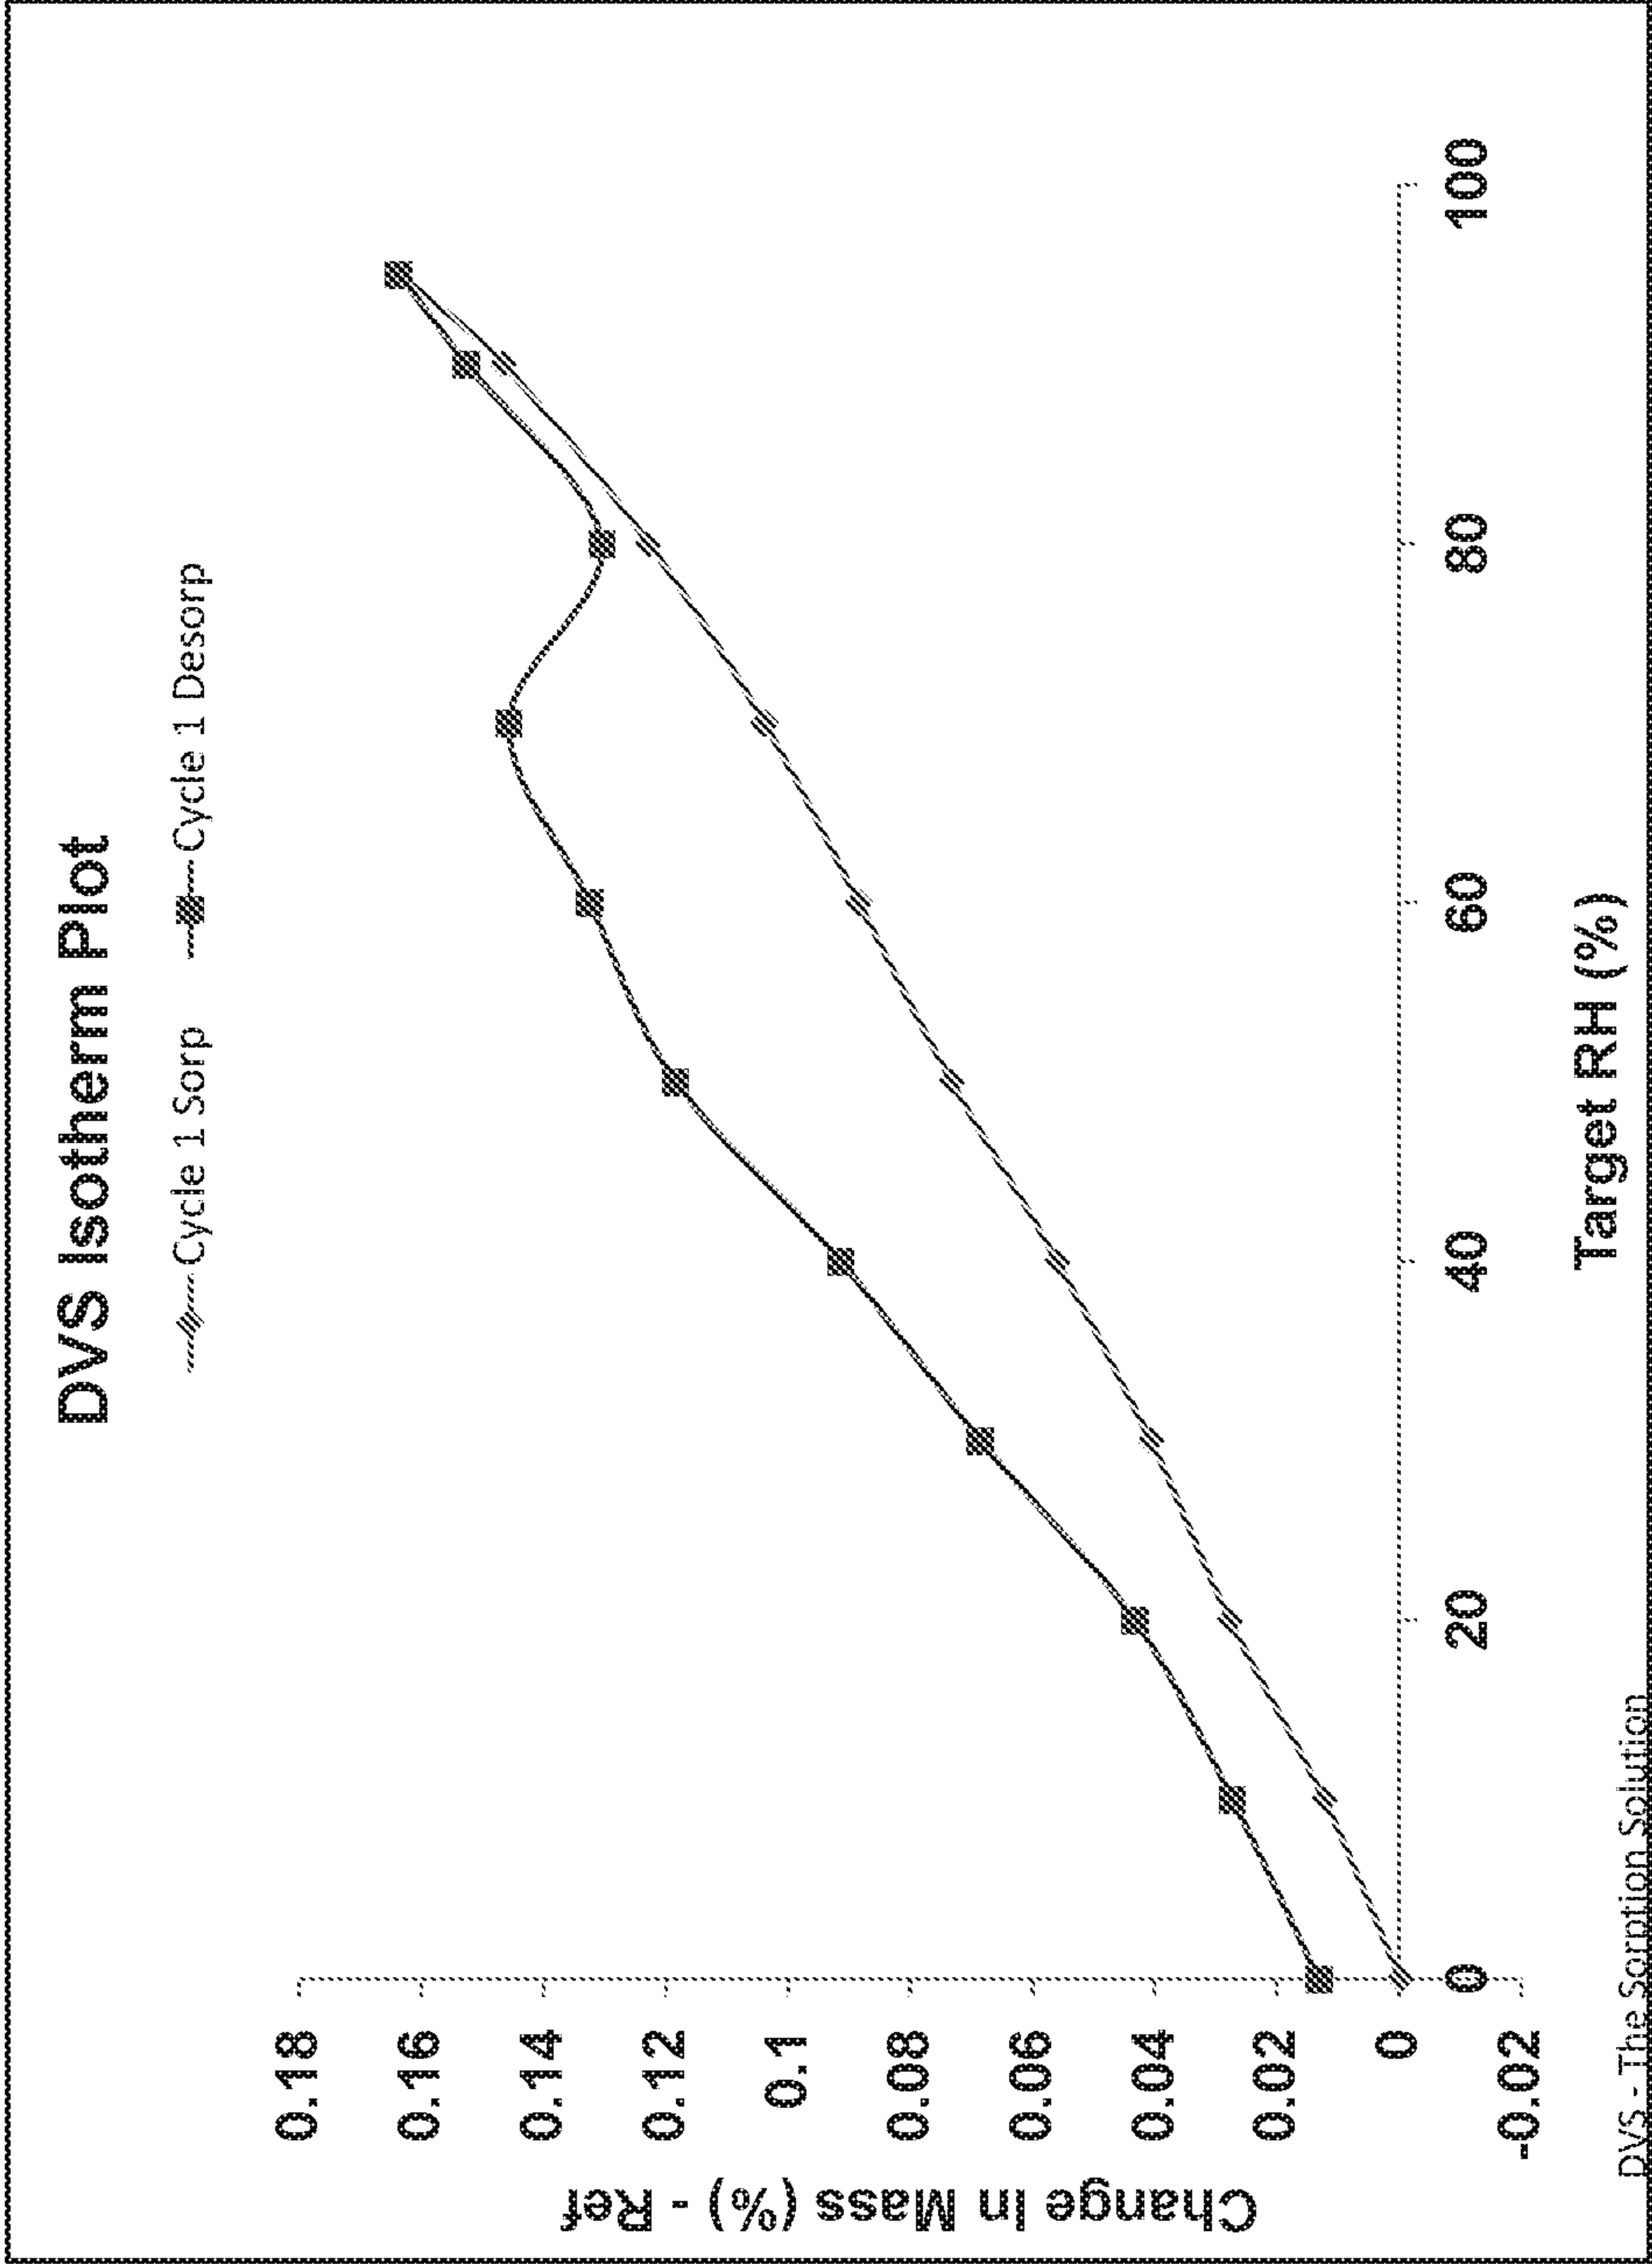


Figure 19

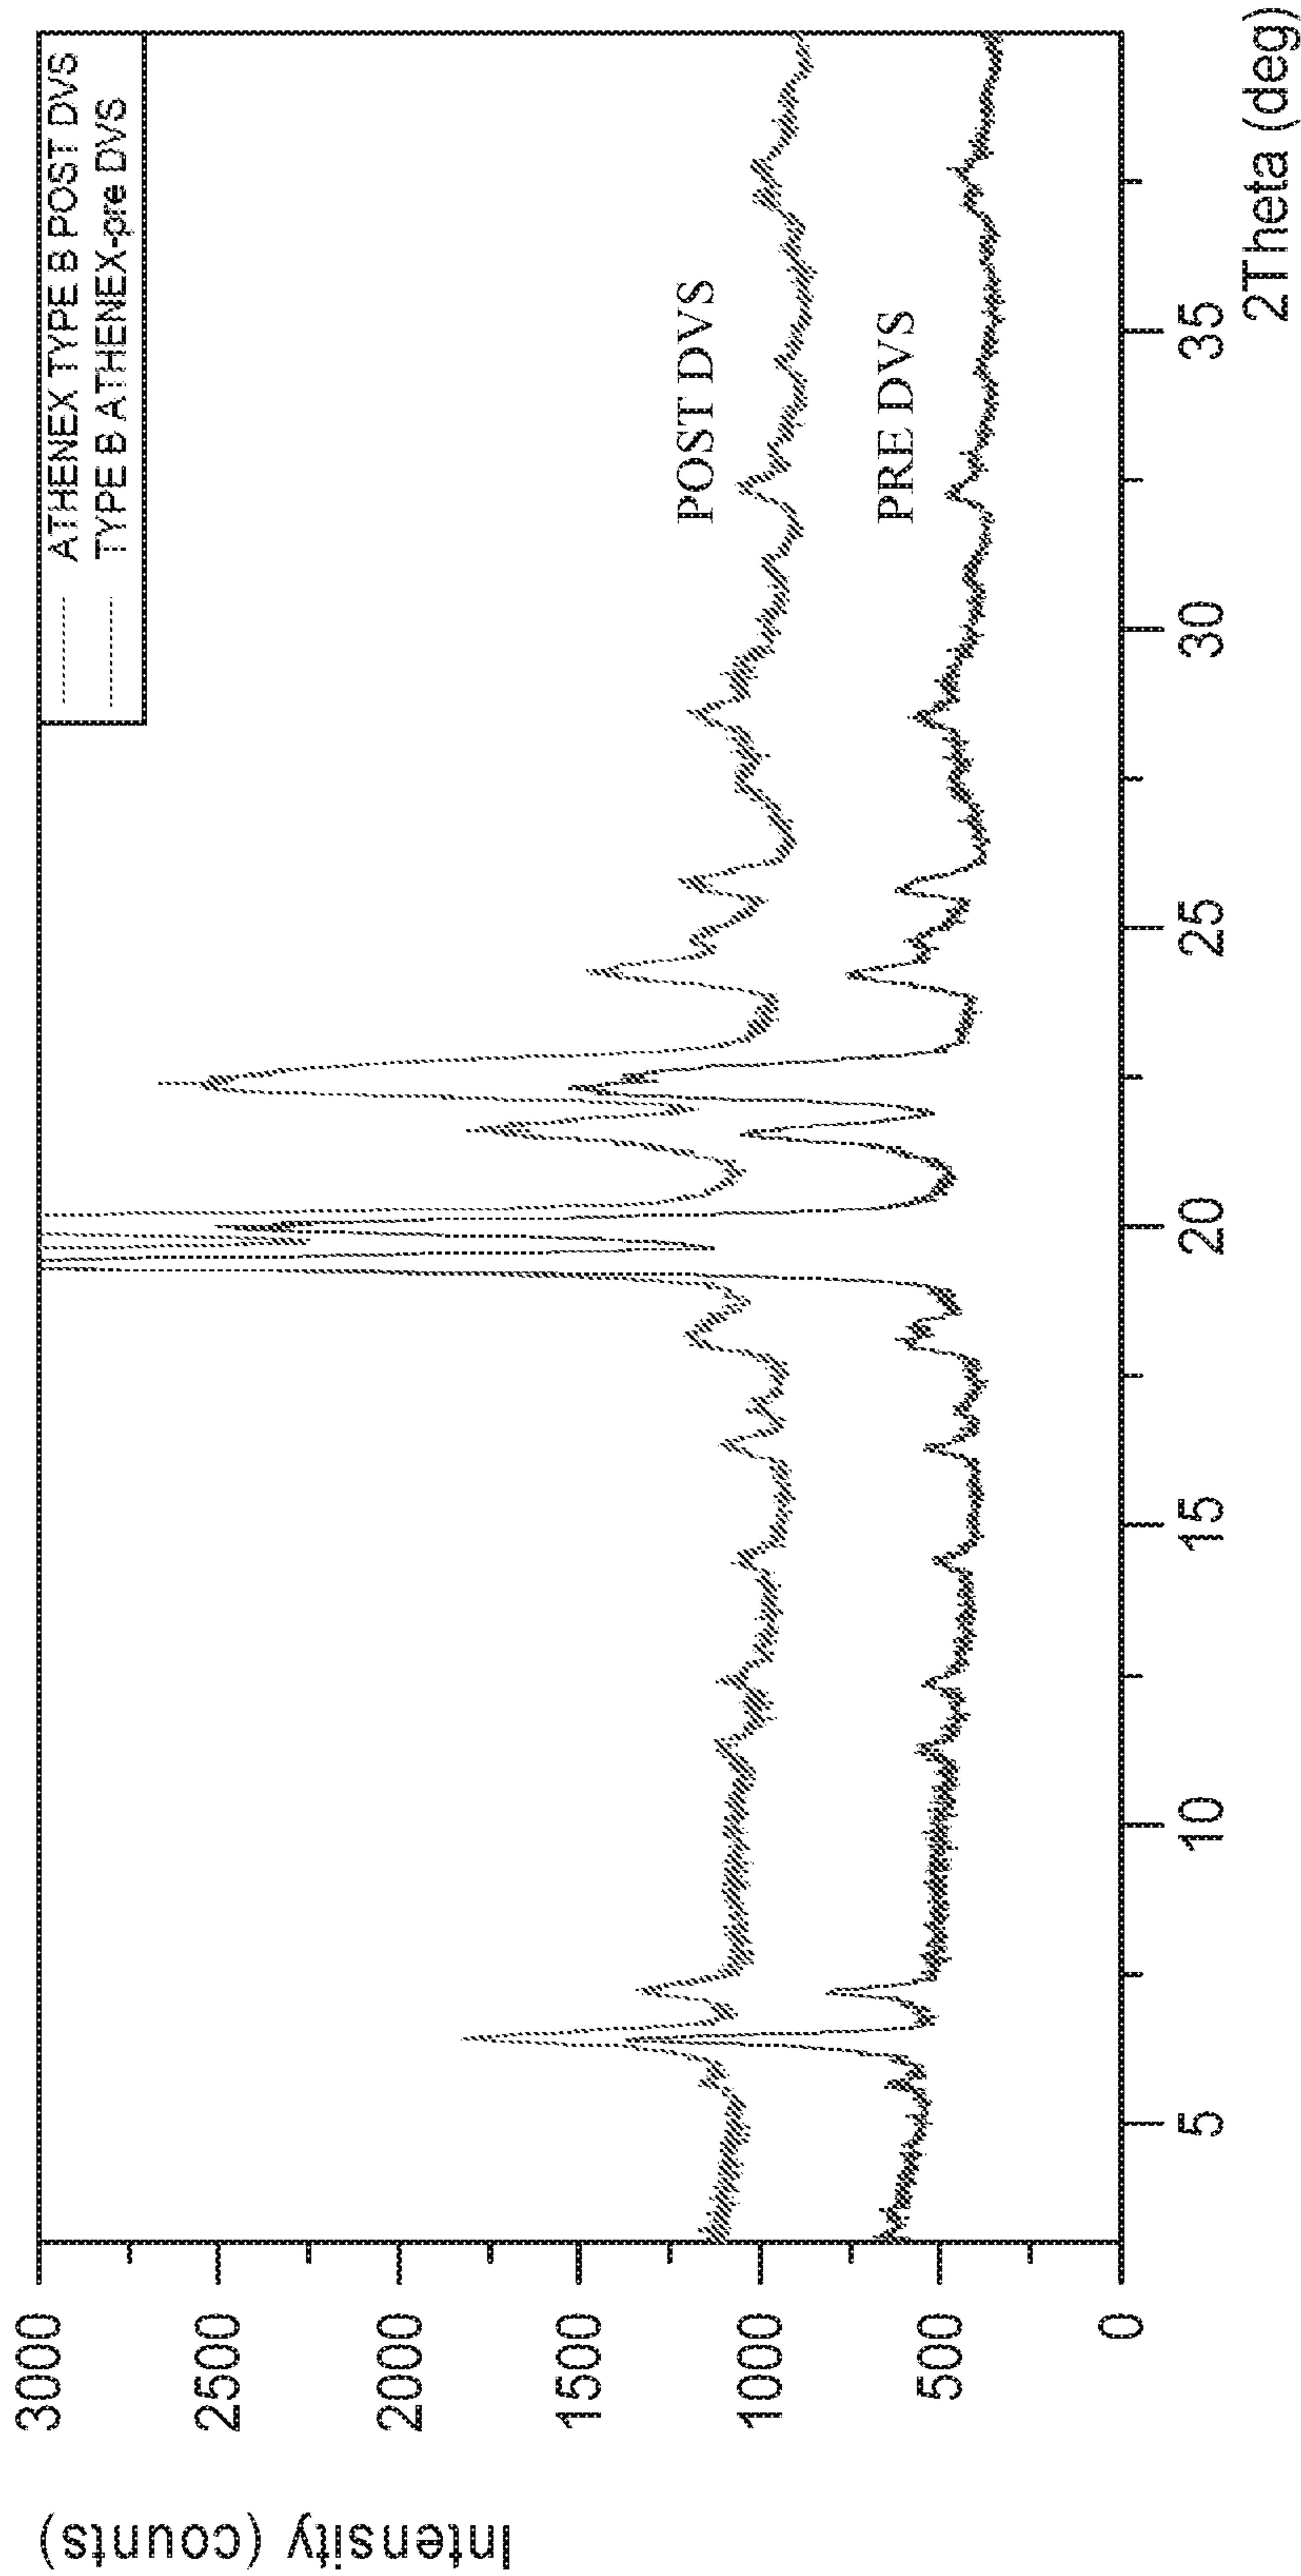


Figure 20

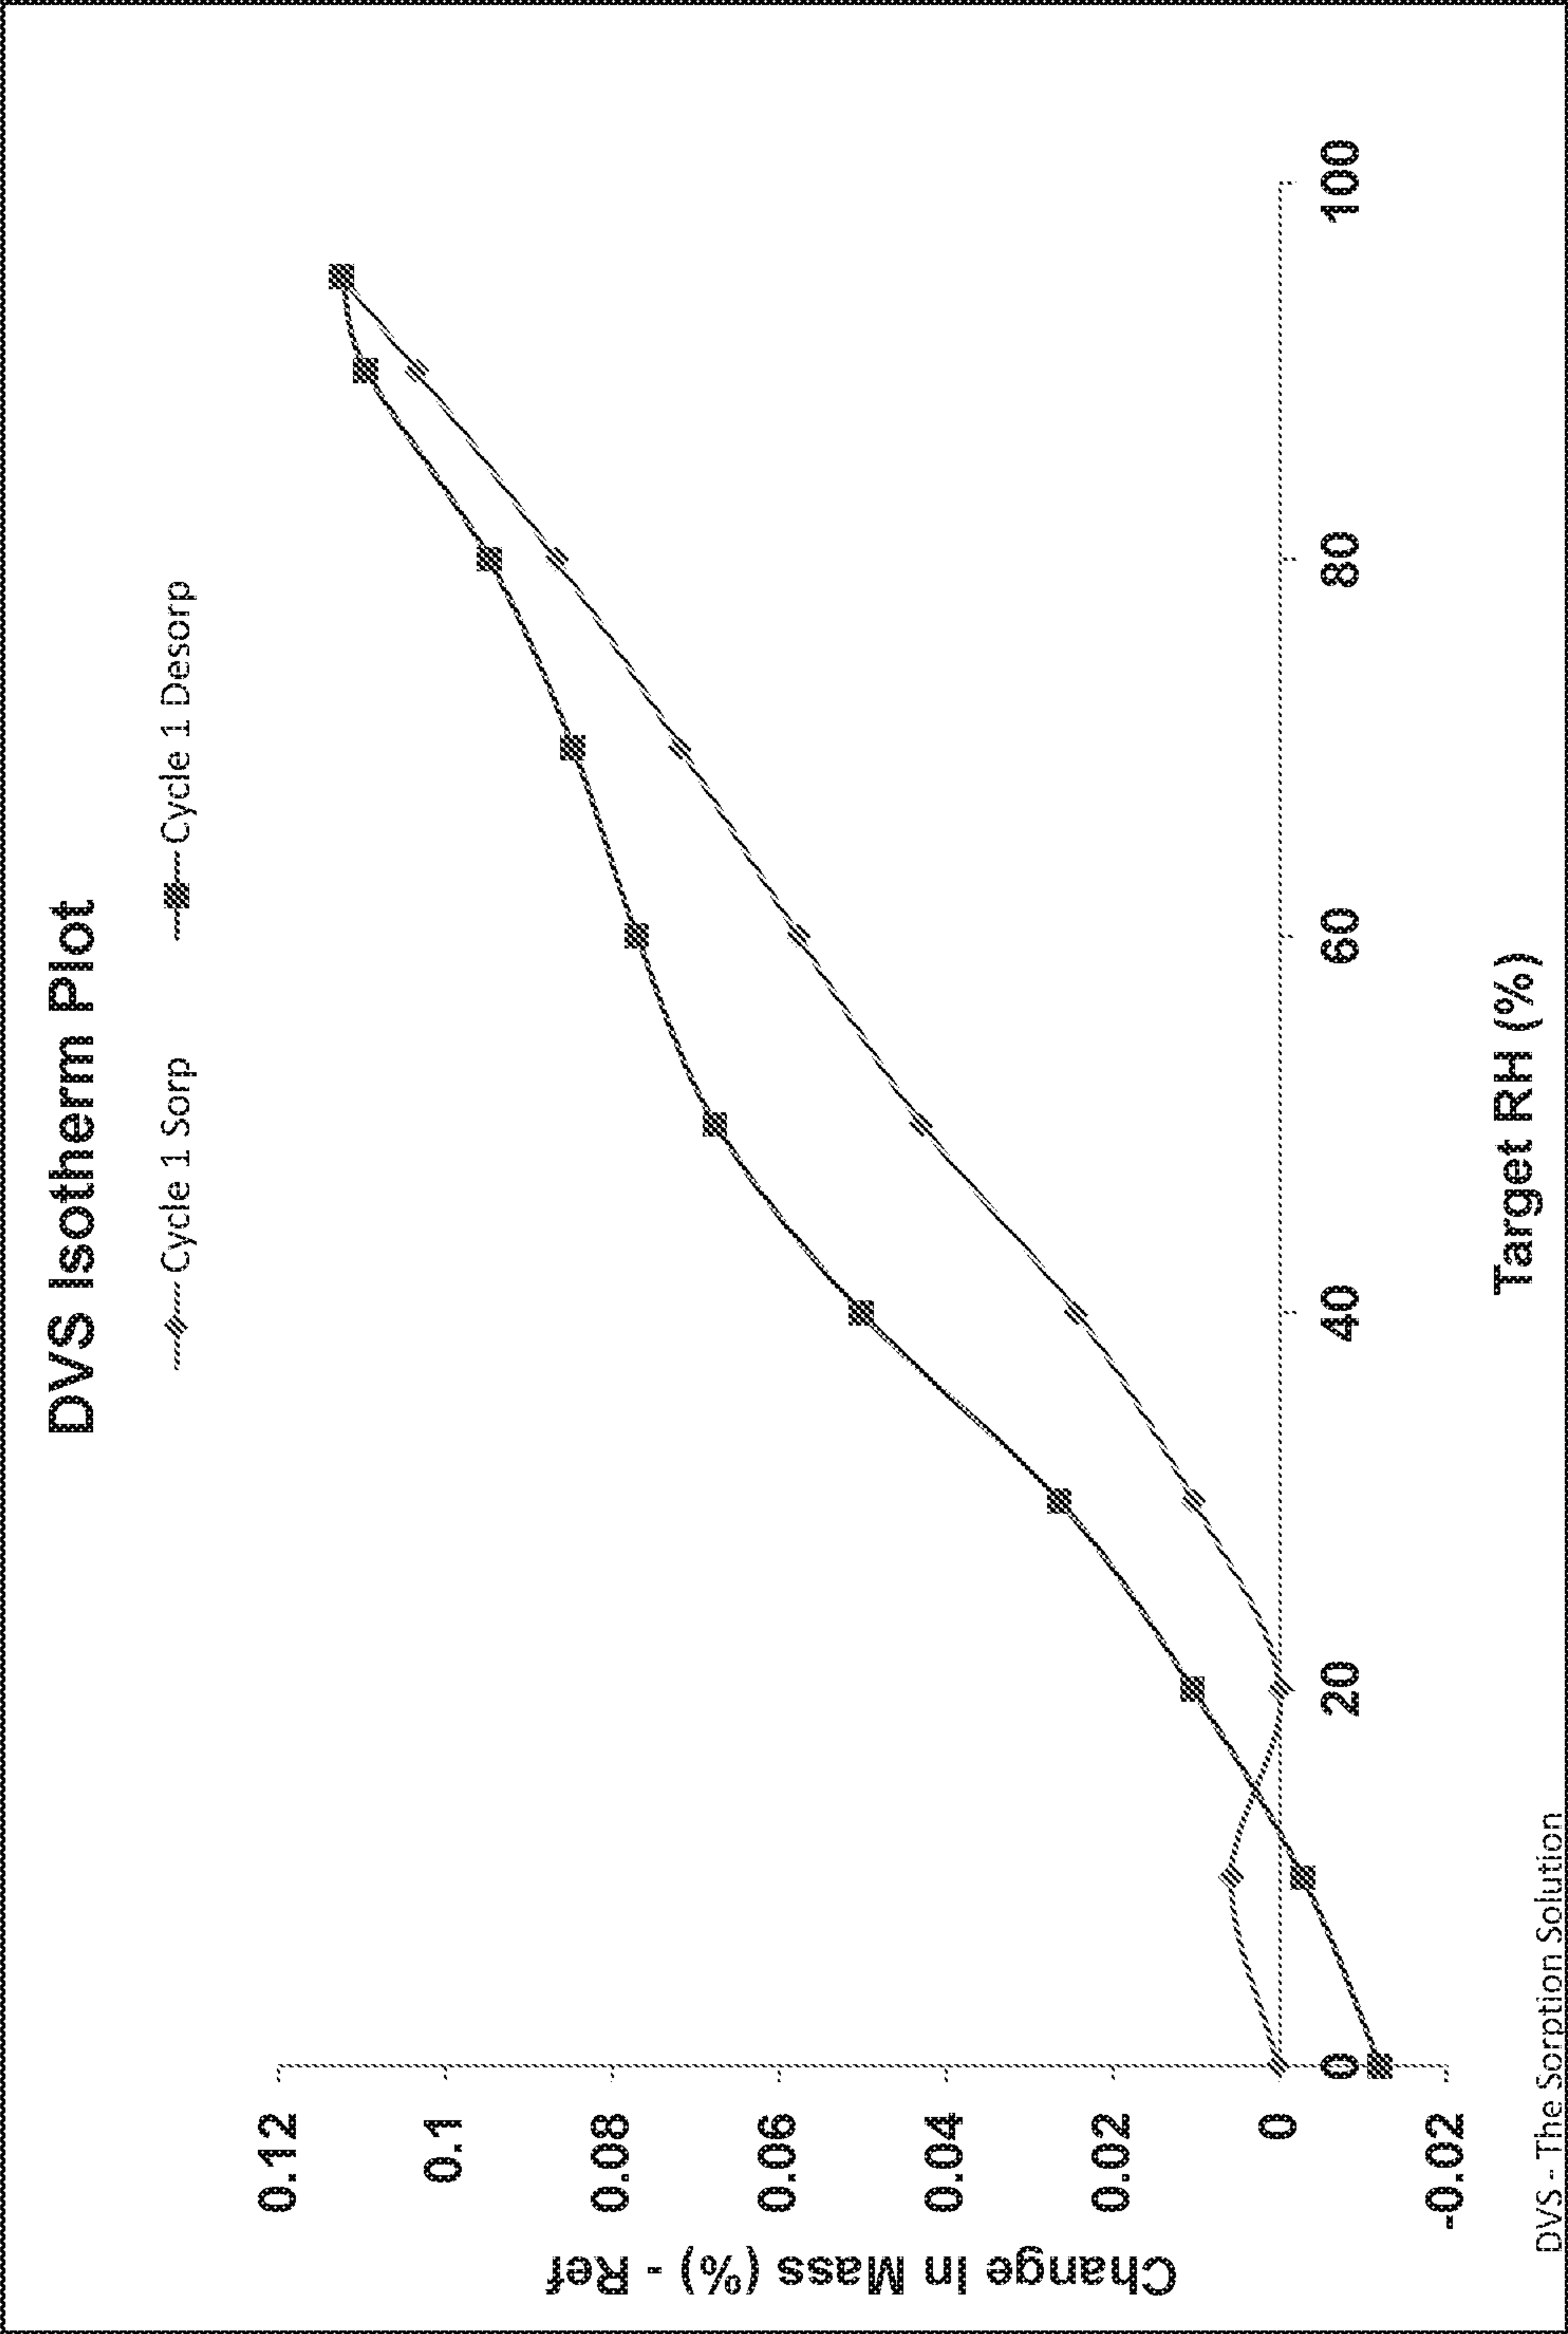


Figure 21

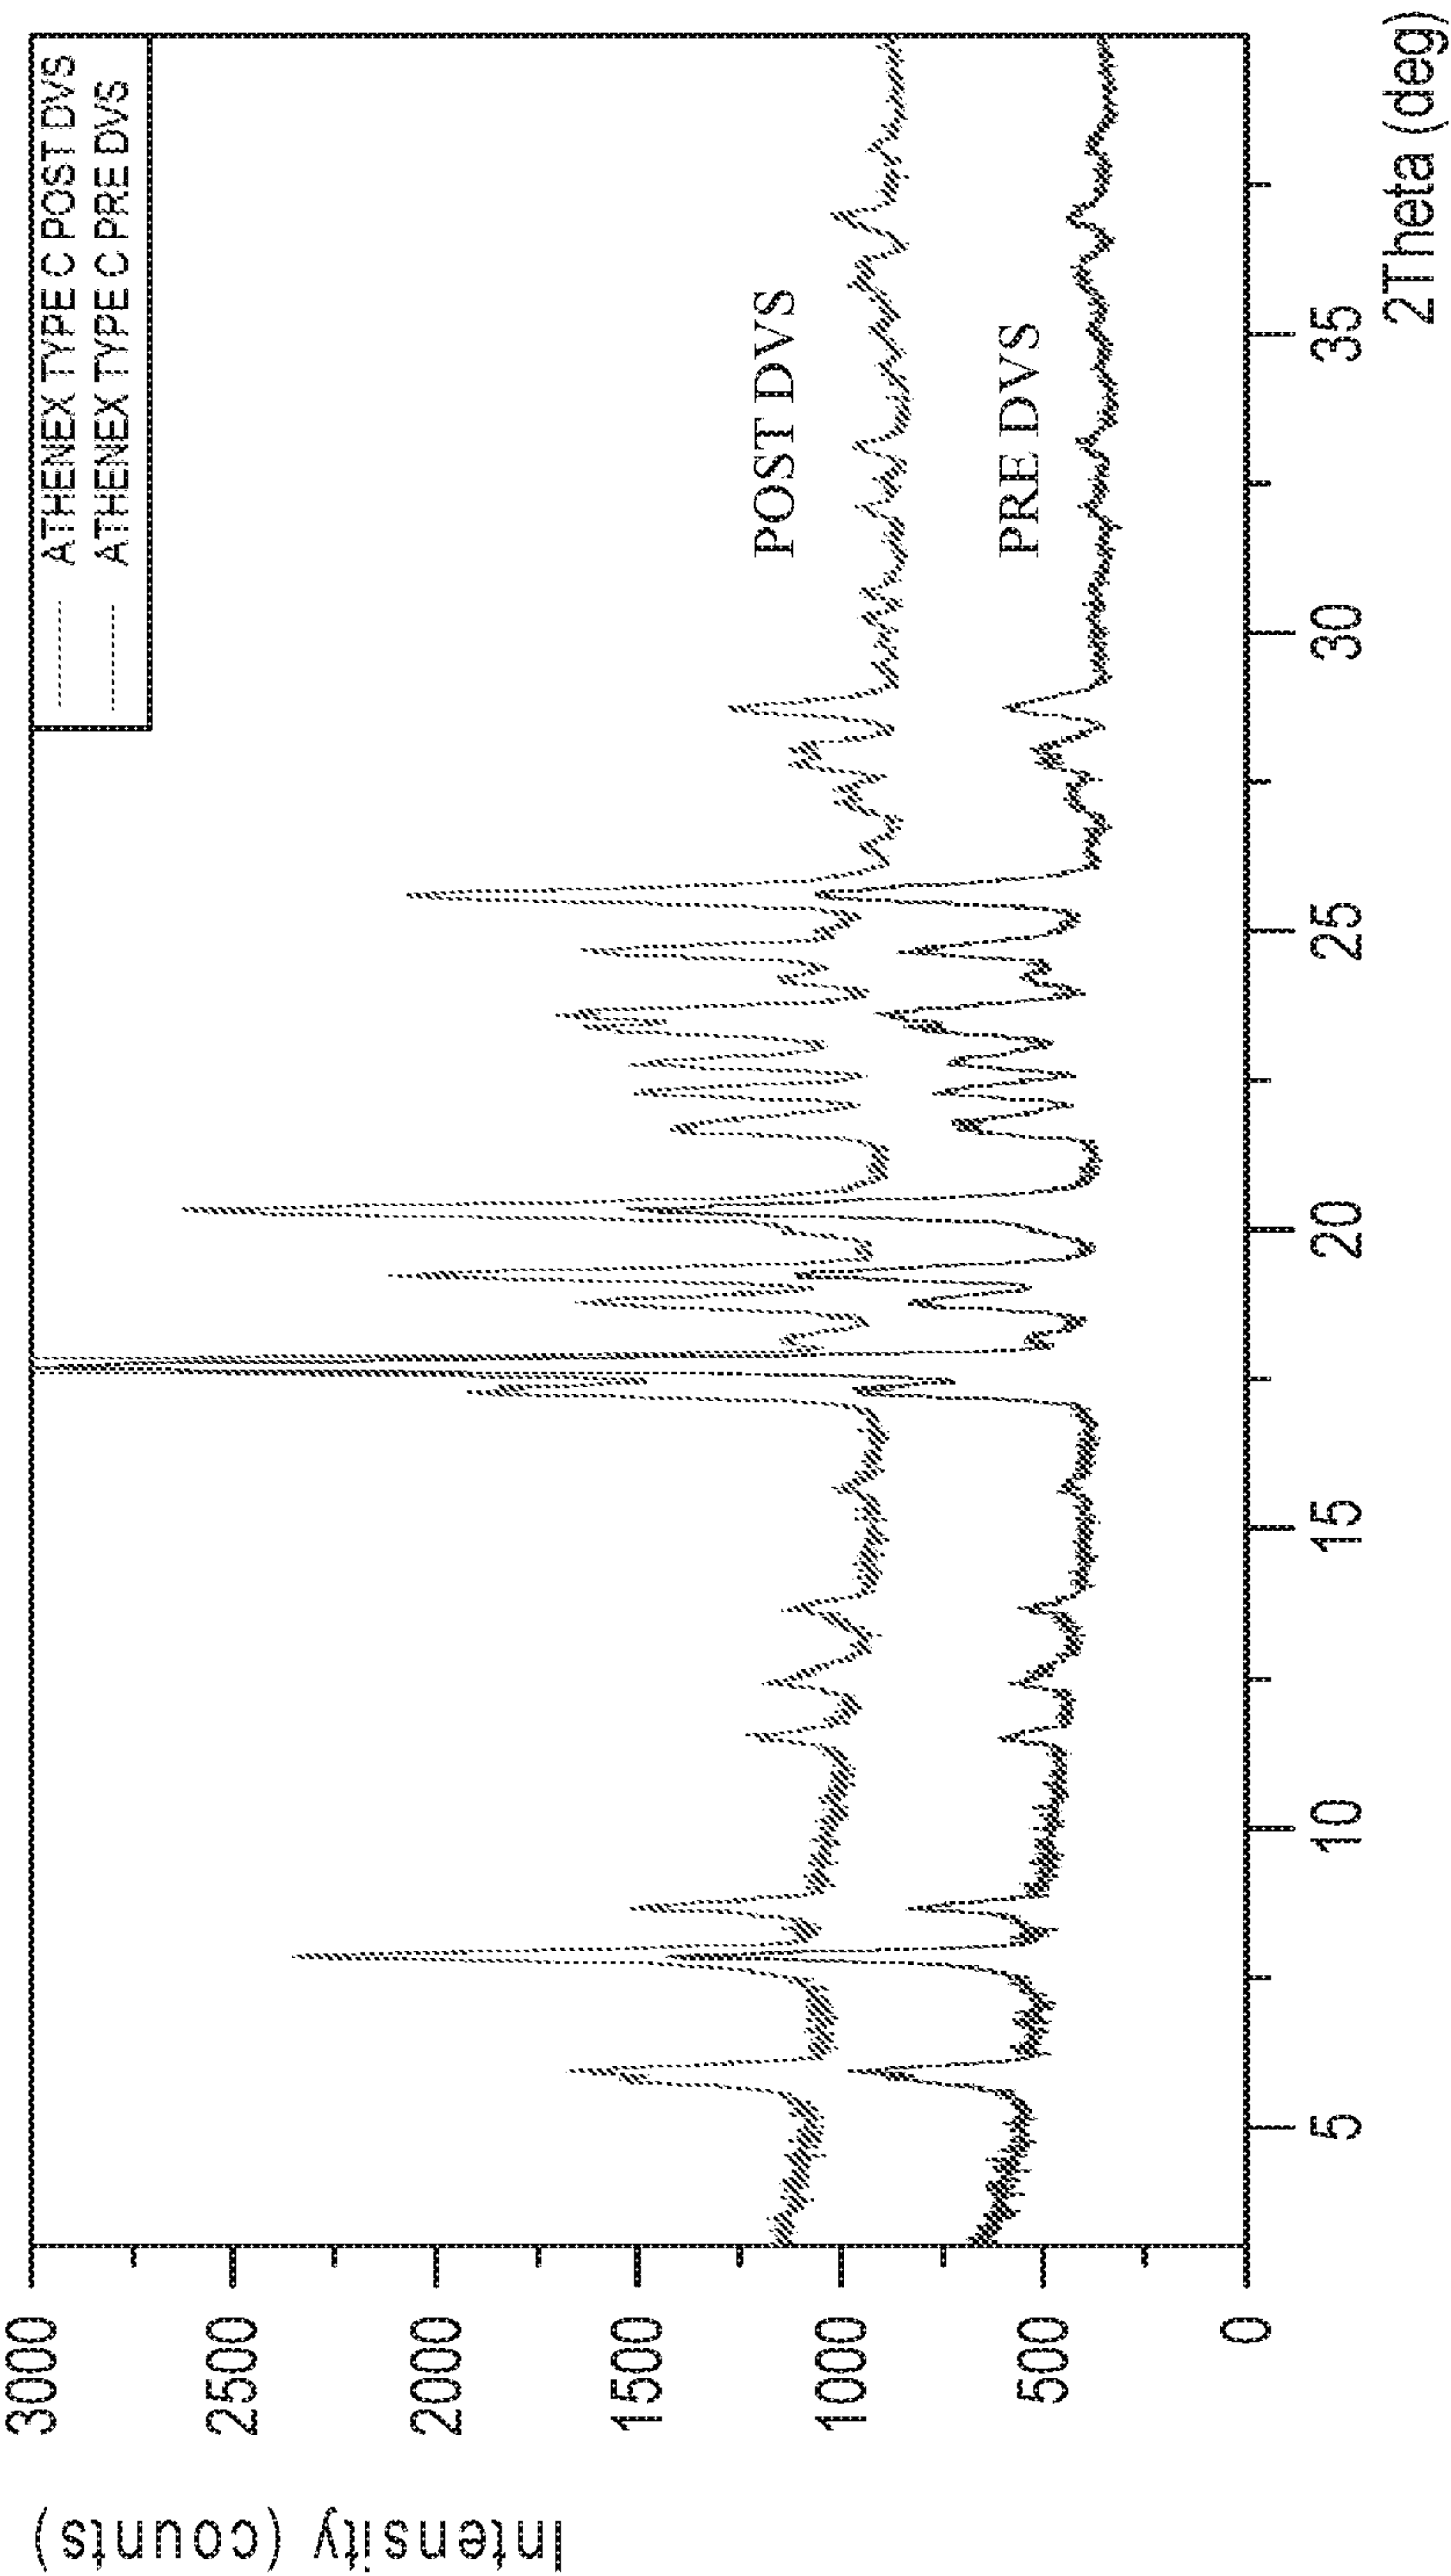


Figure 22

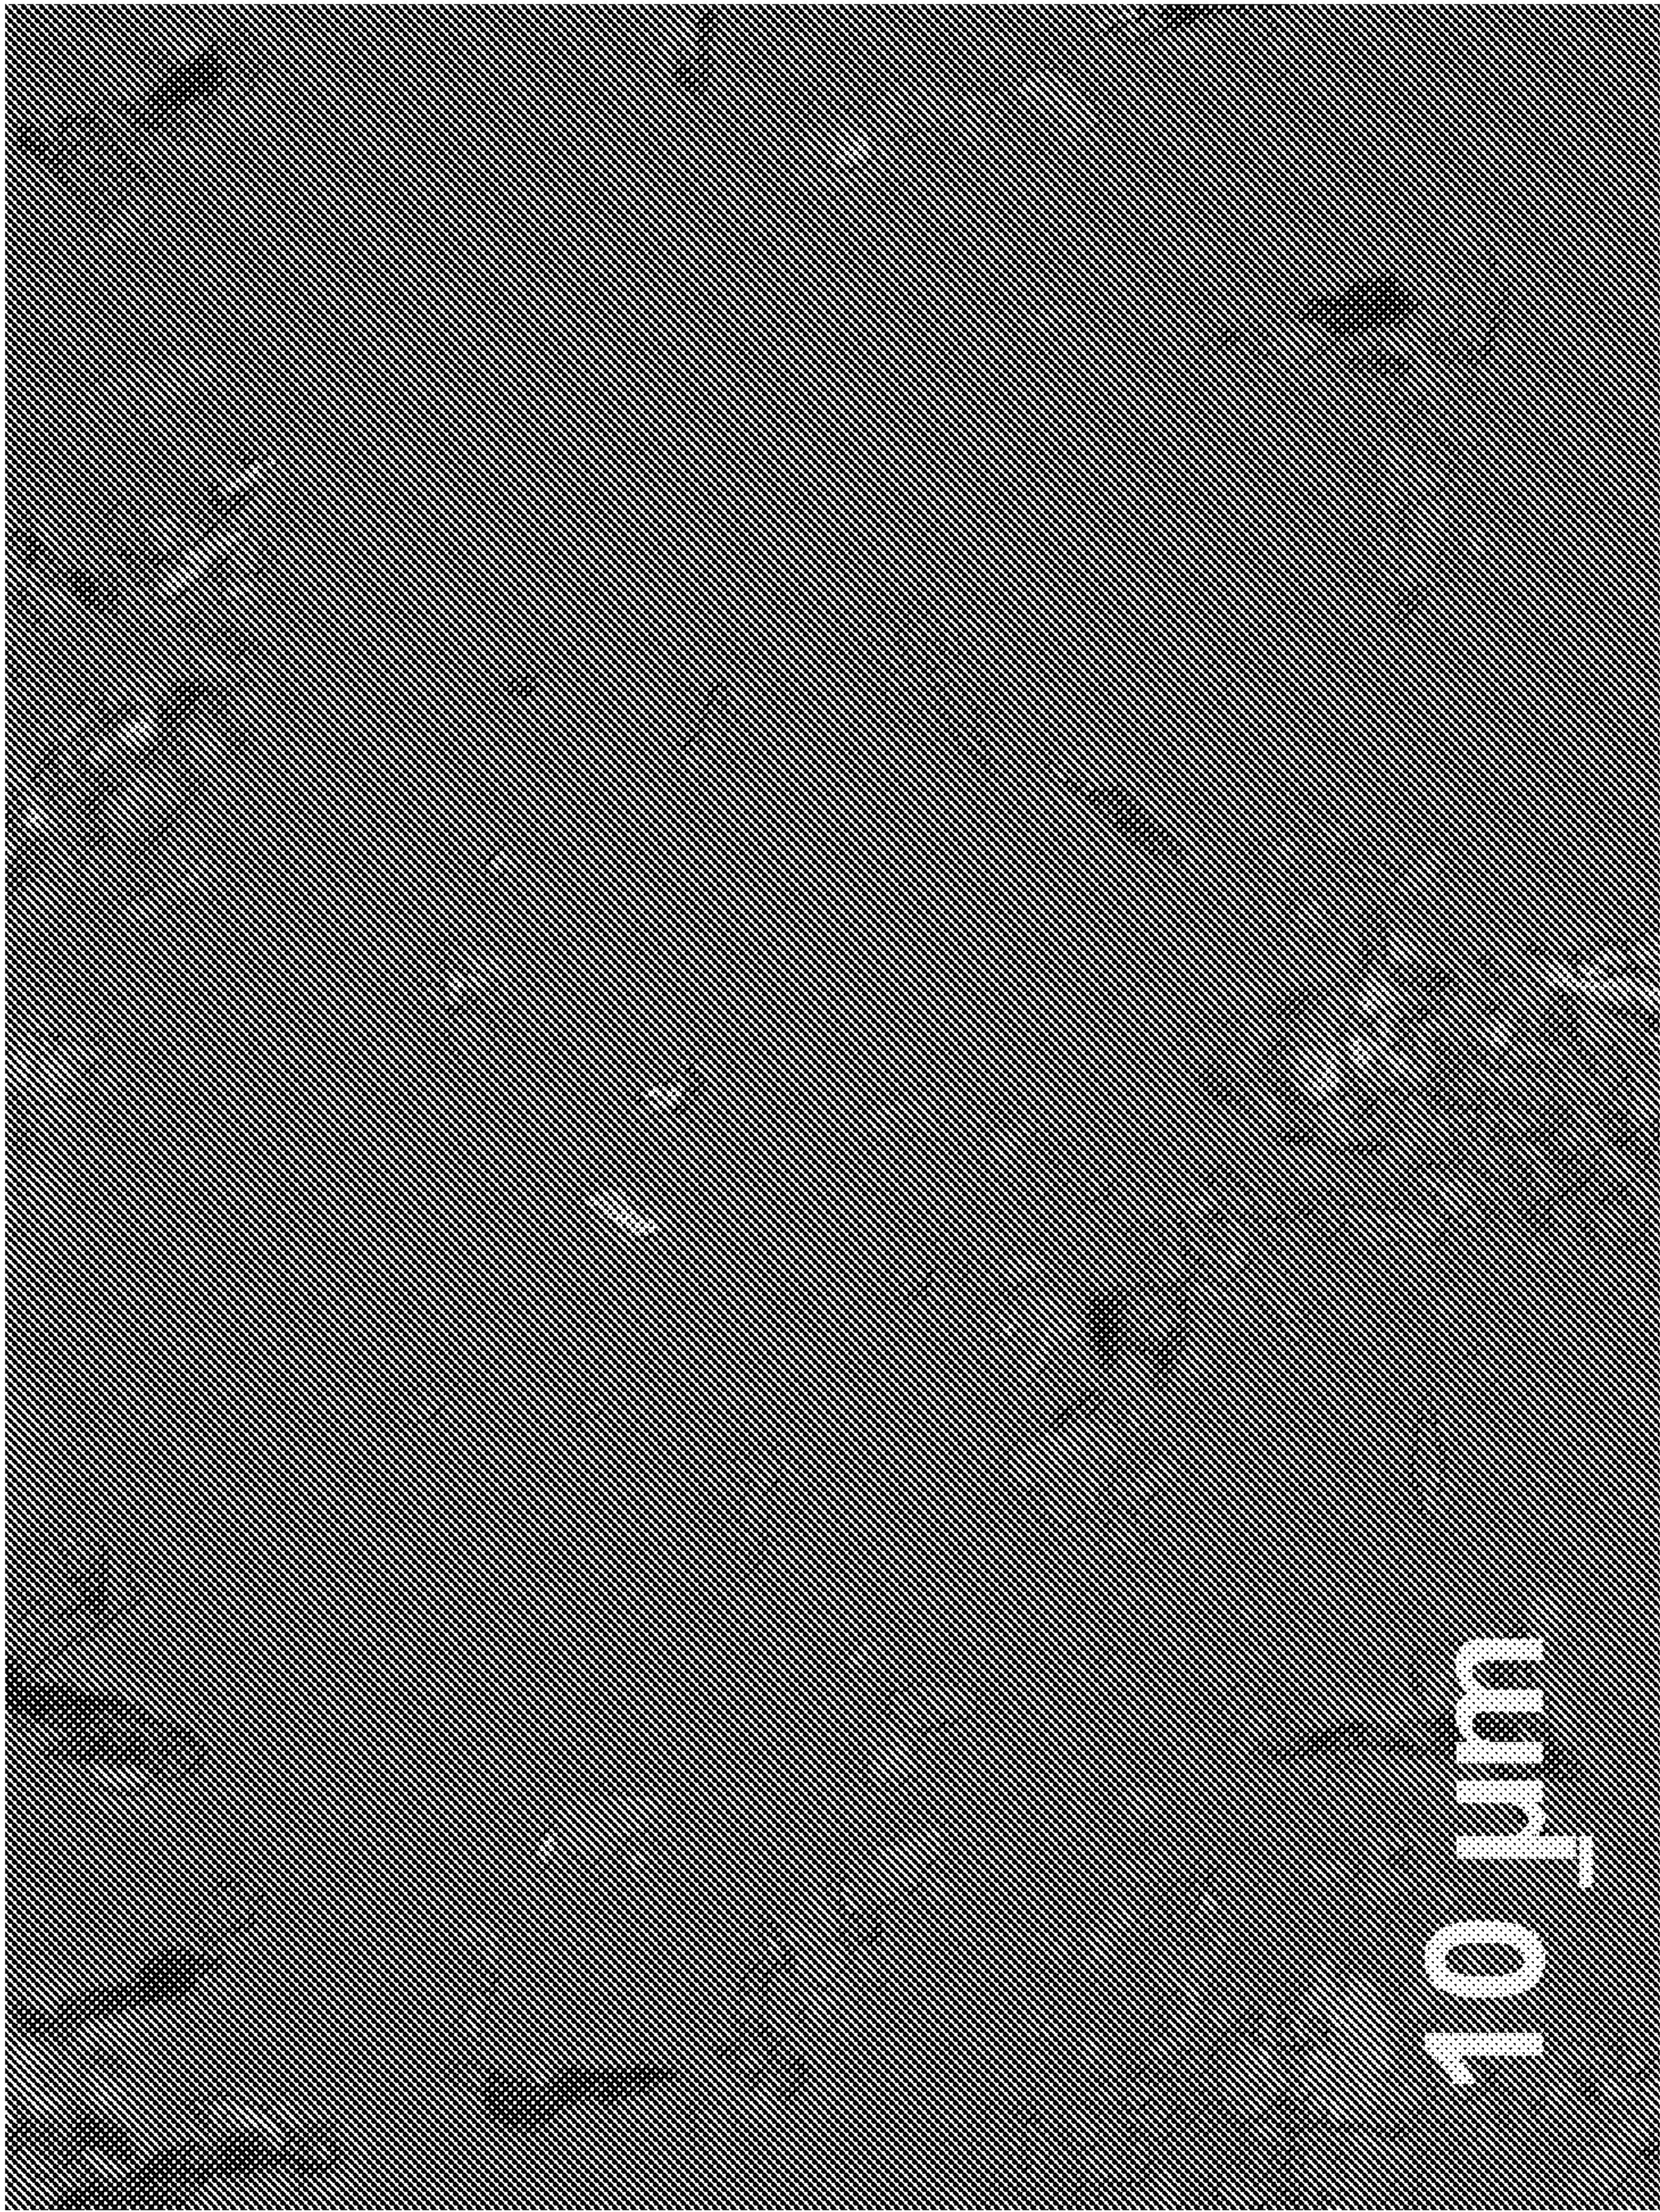


Figure 23

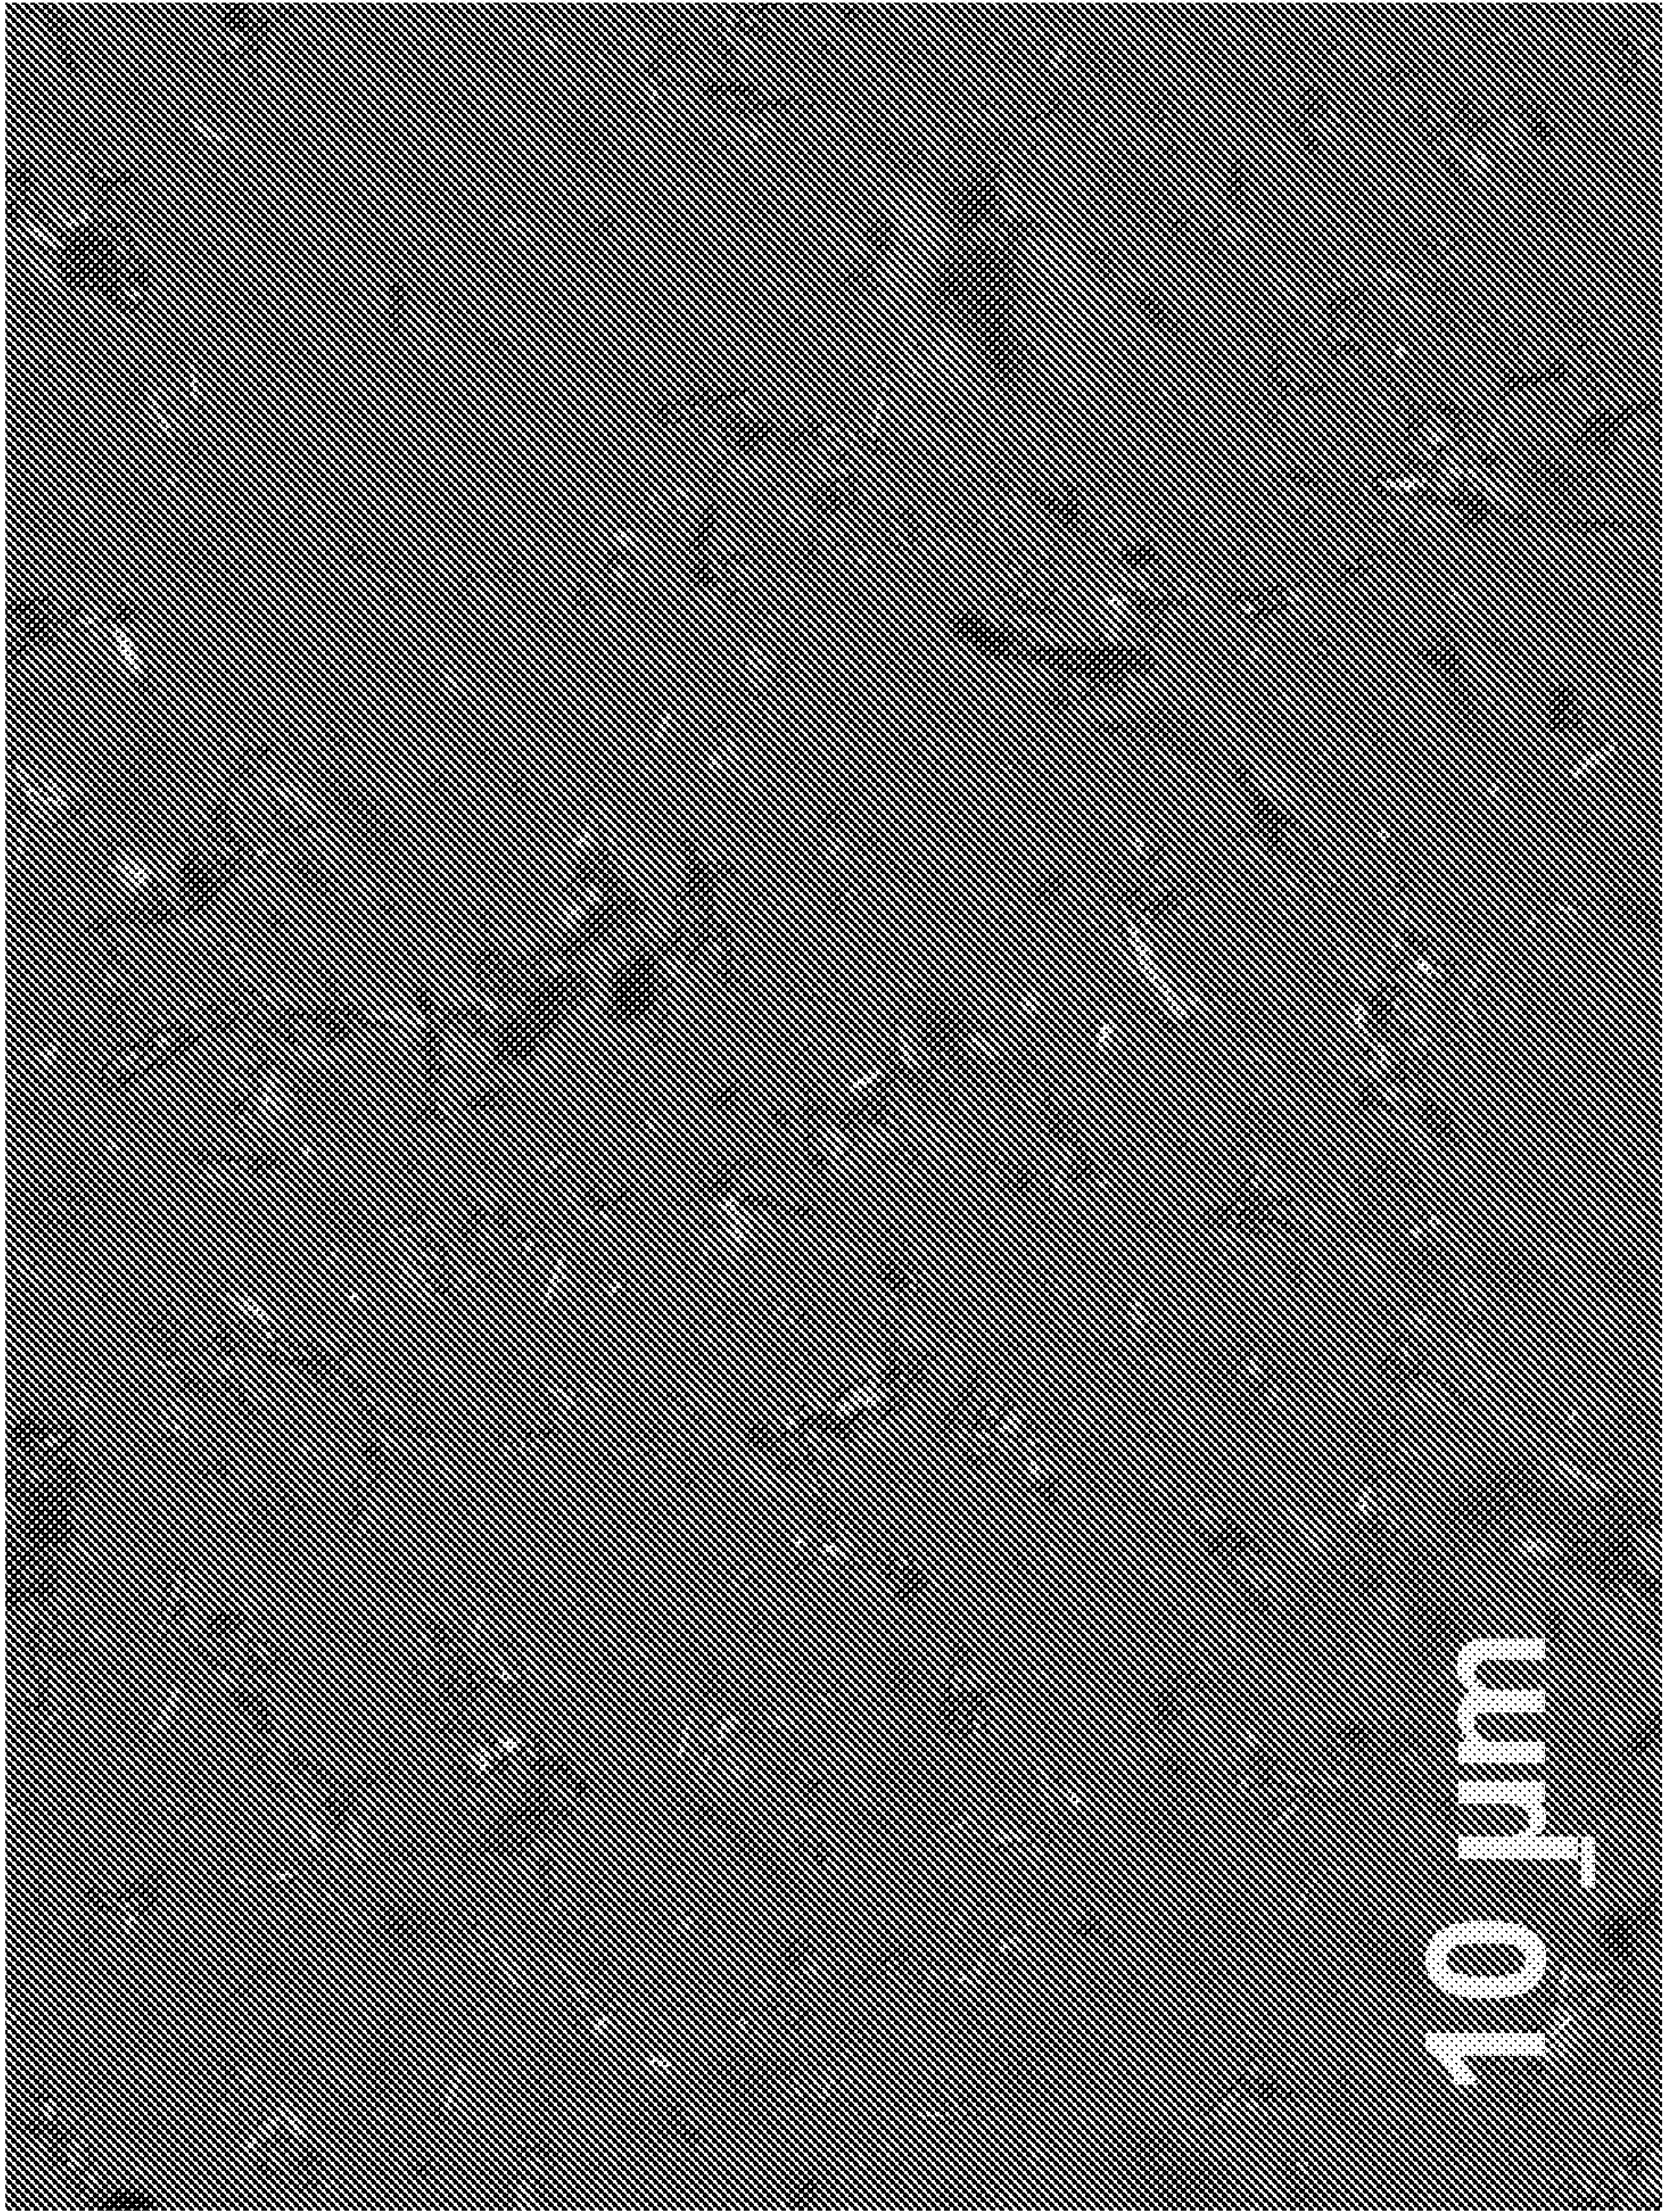


Figure 24

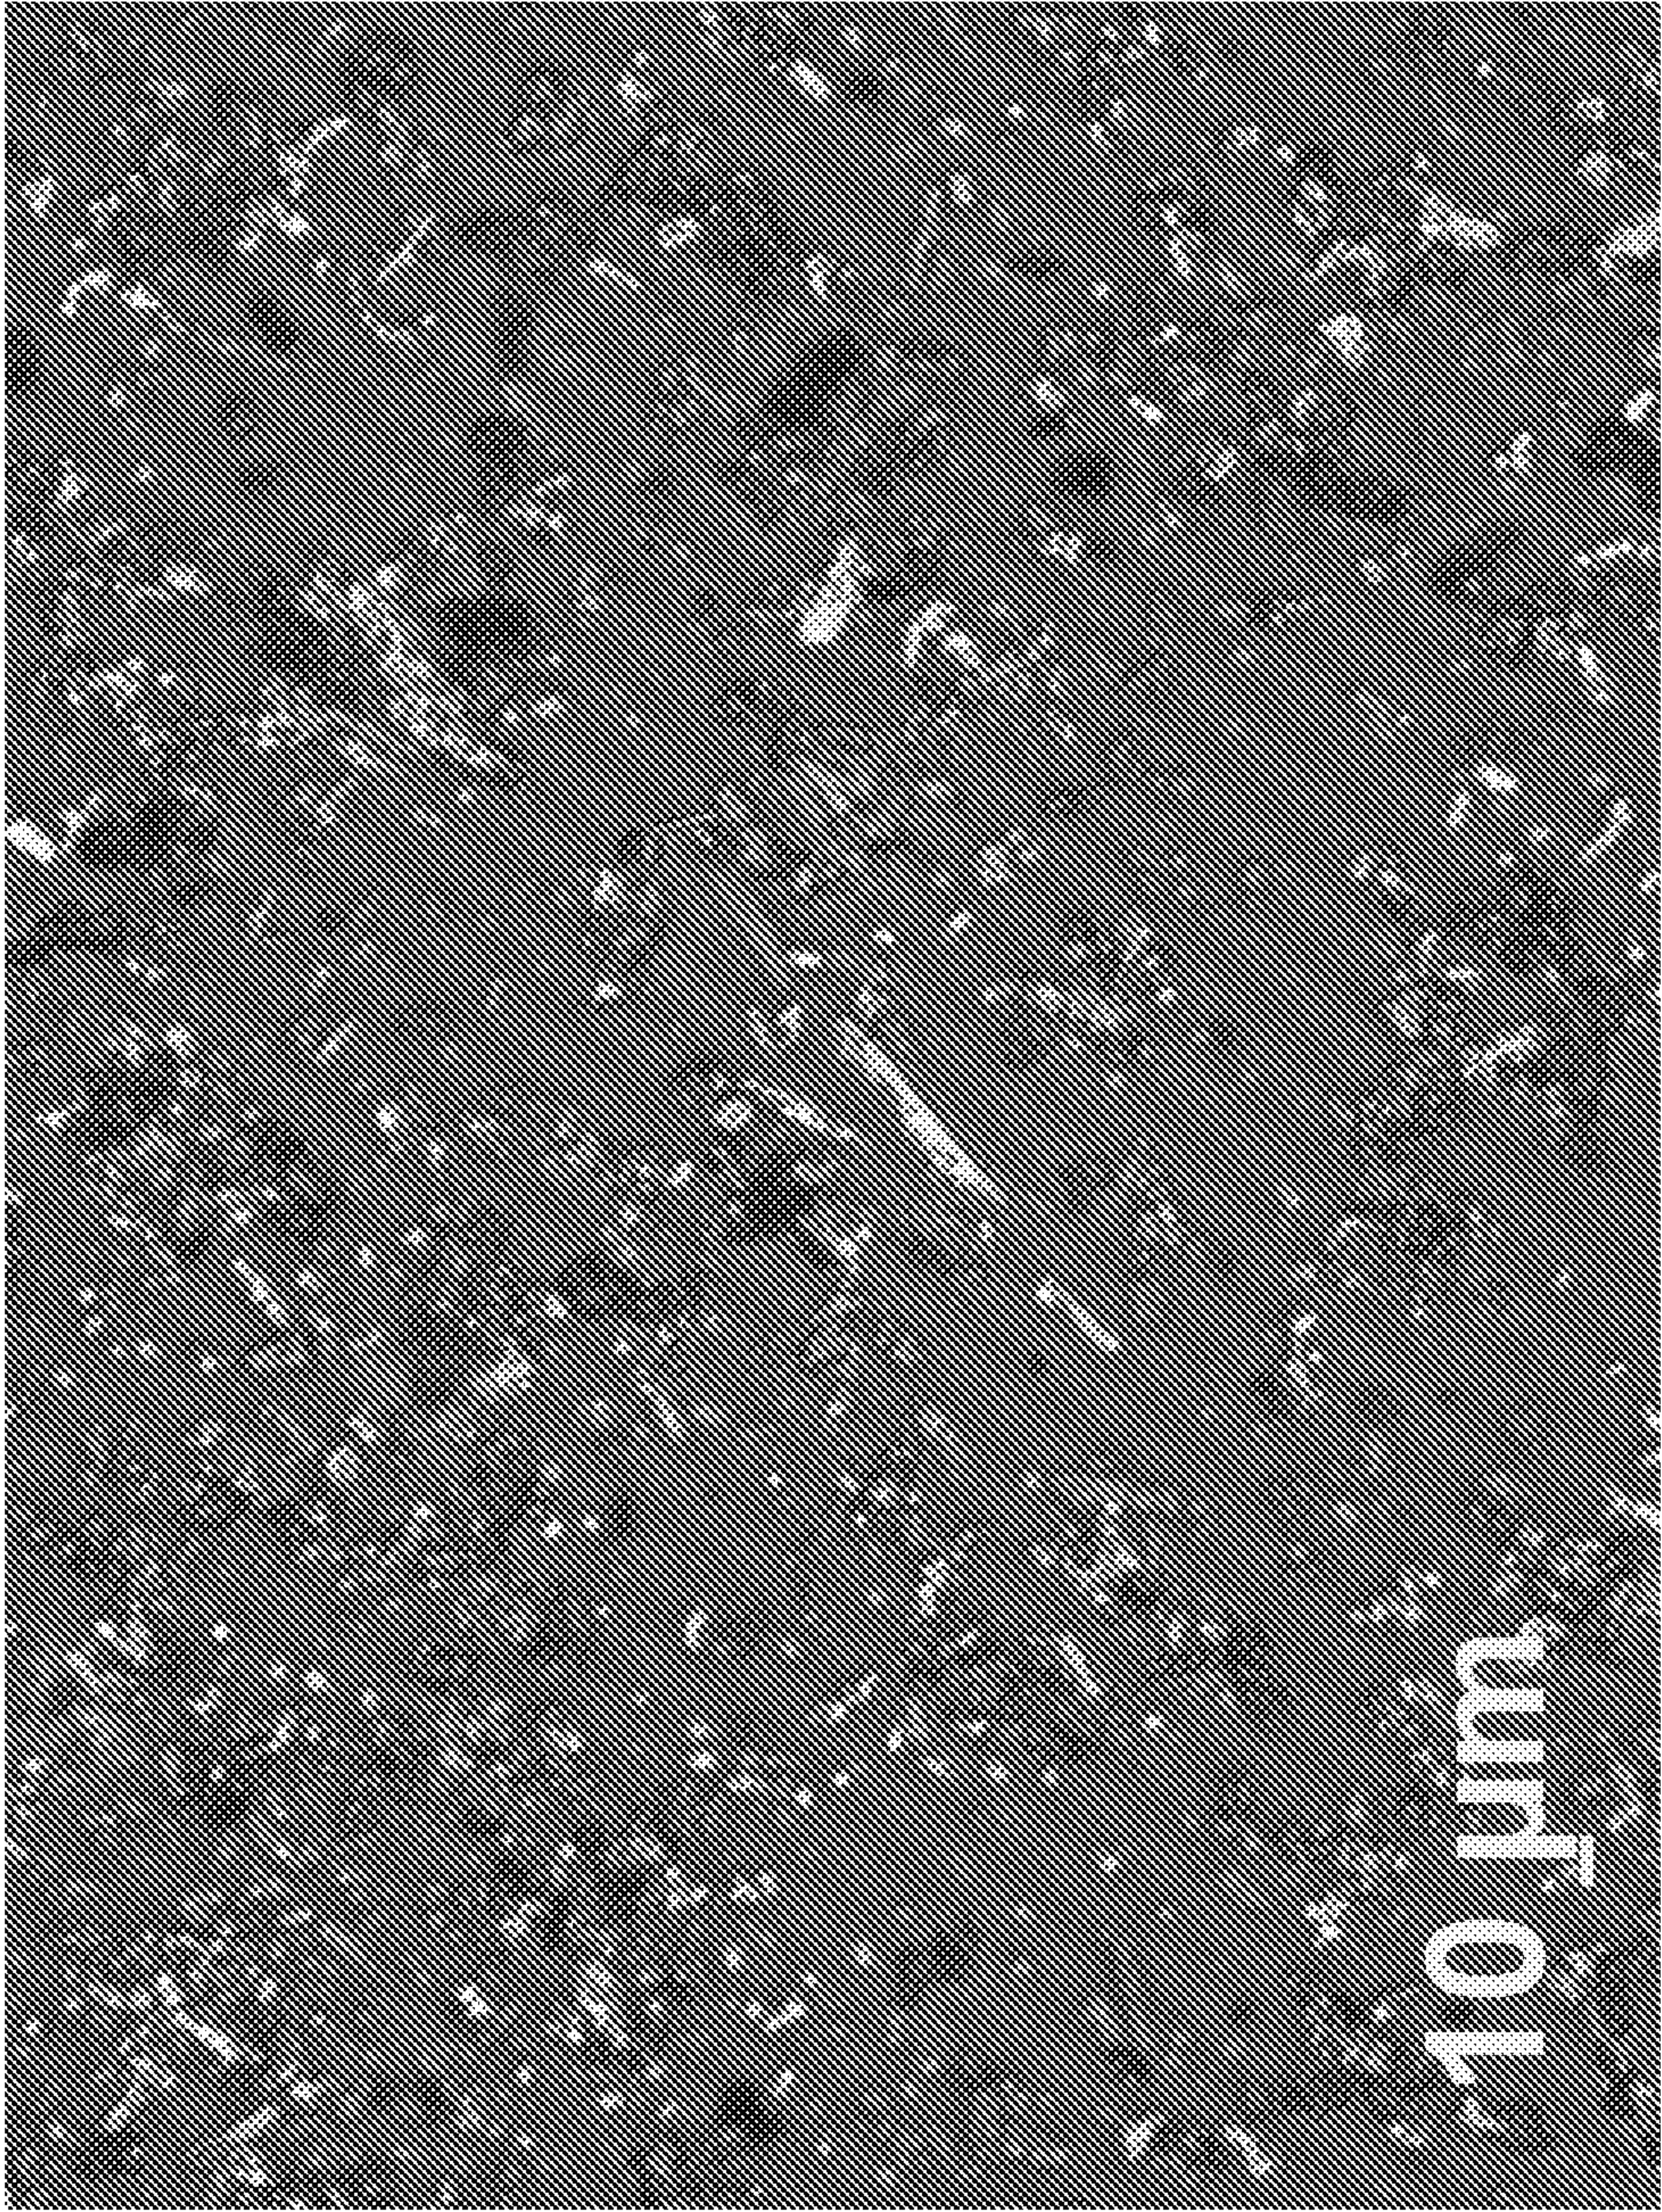


Figure 25

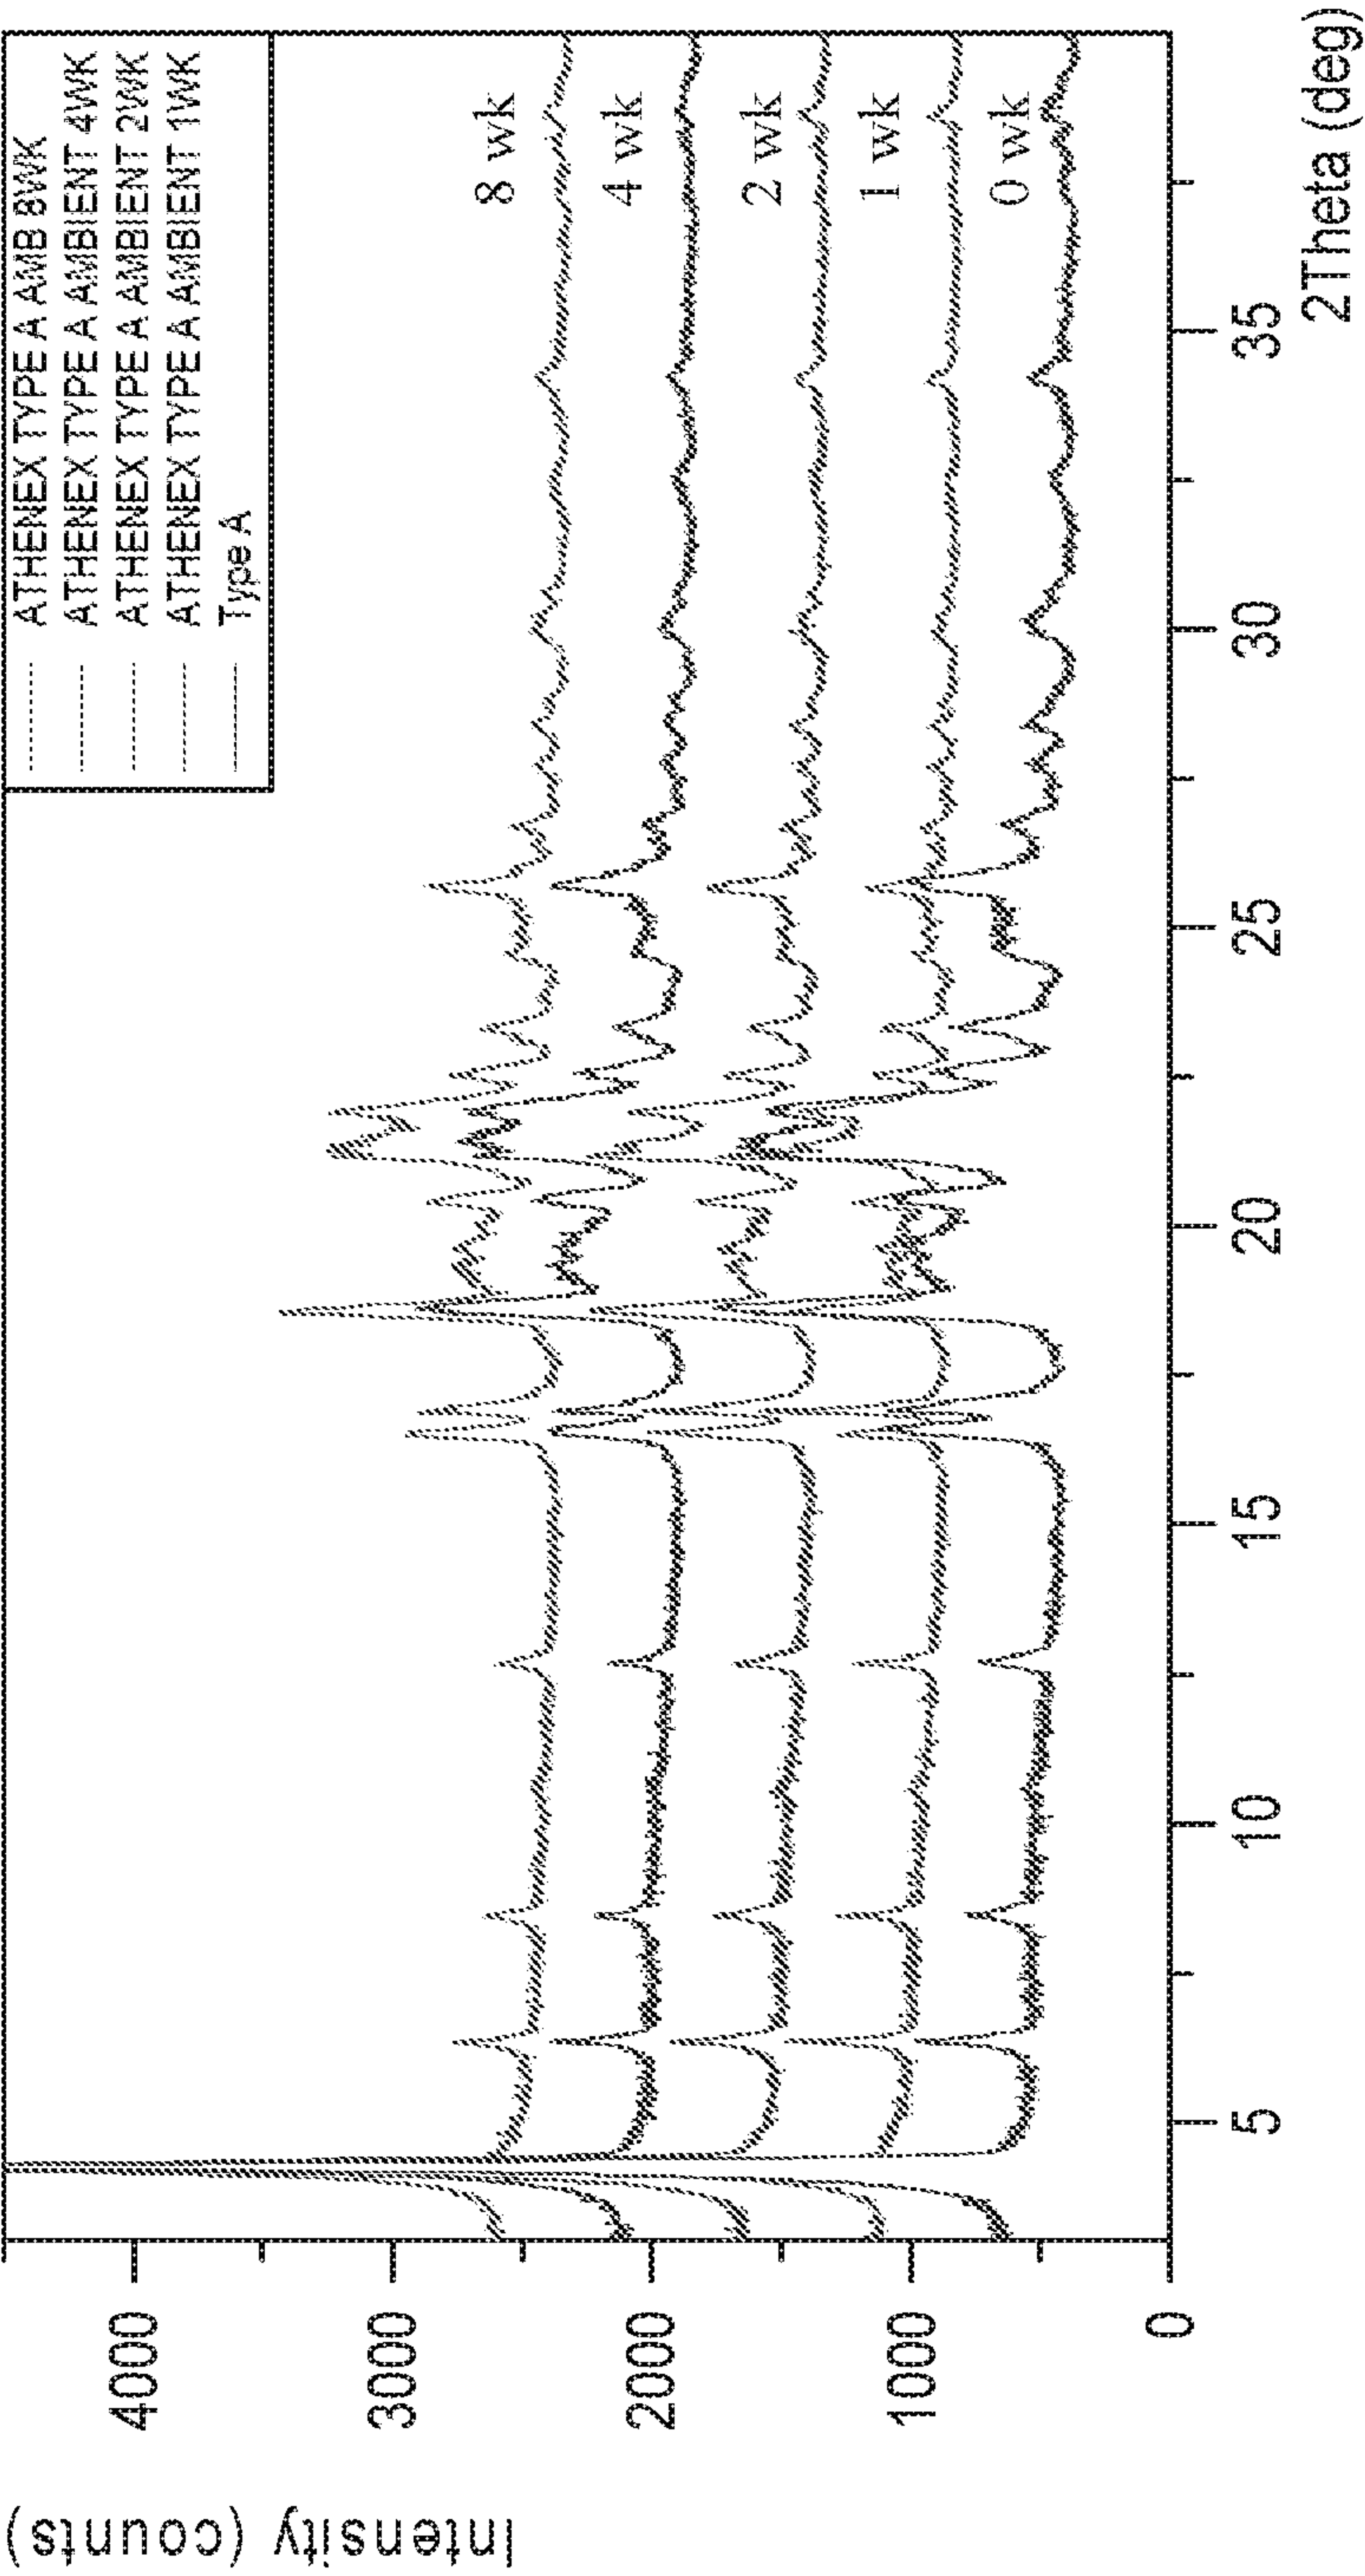


Figure 26

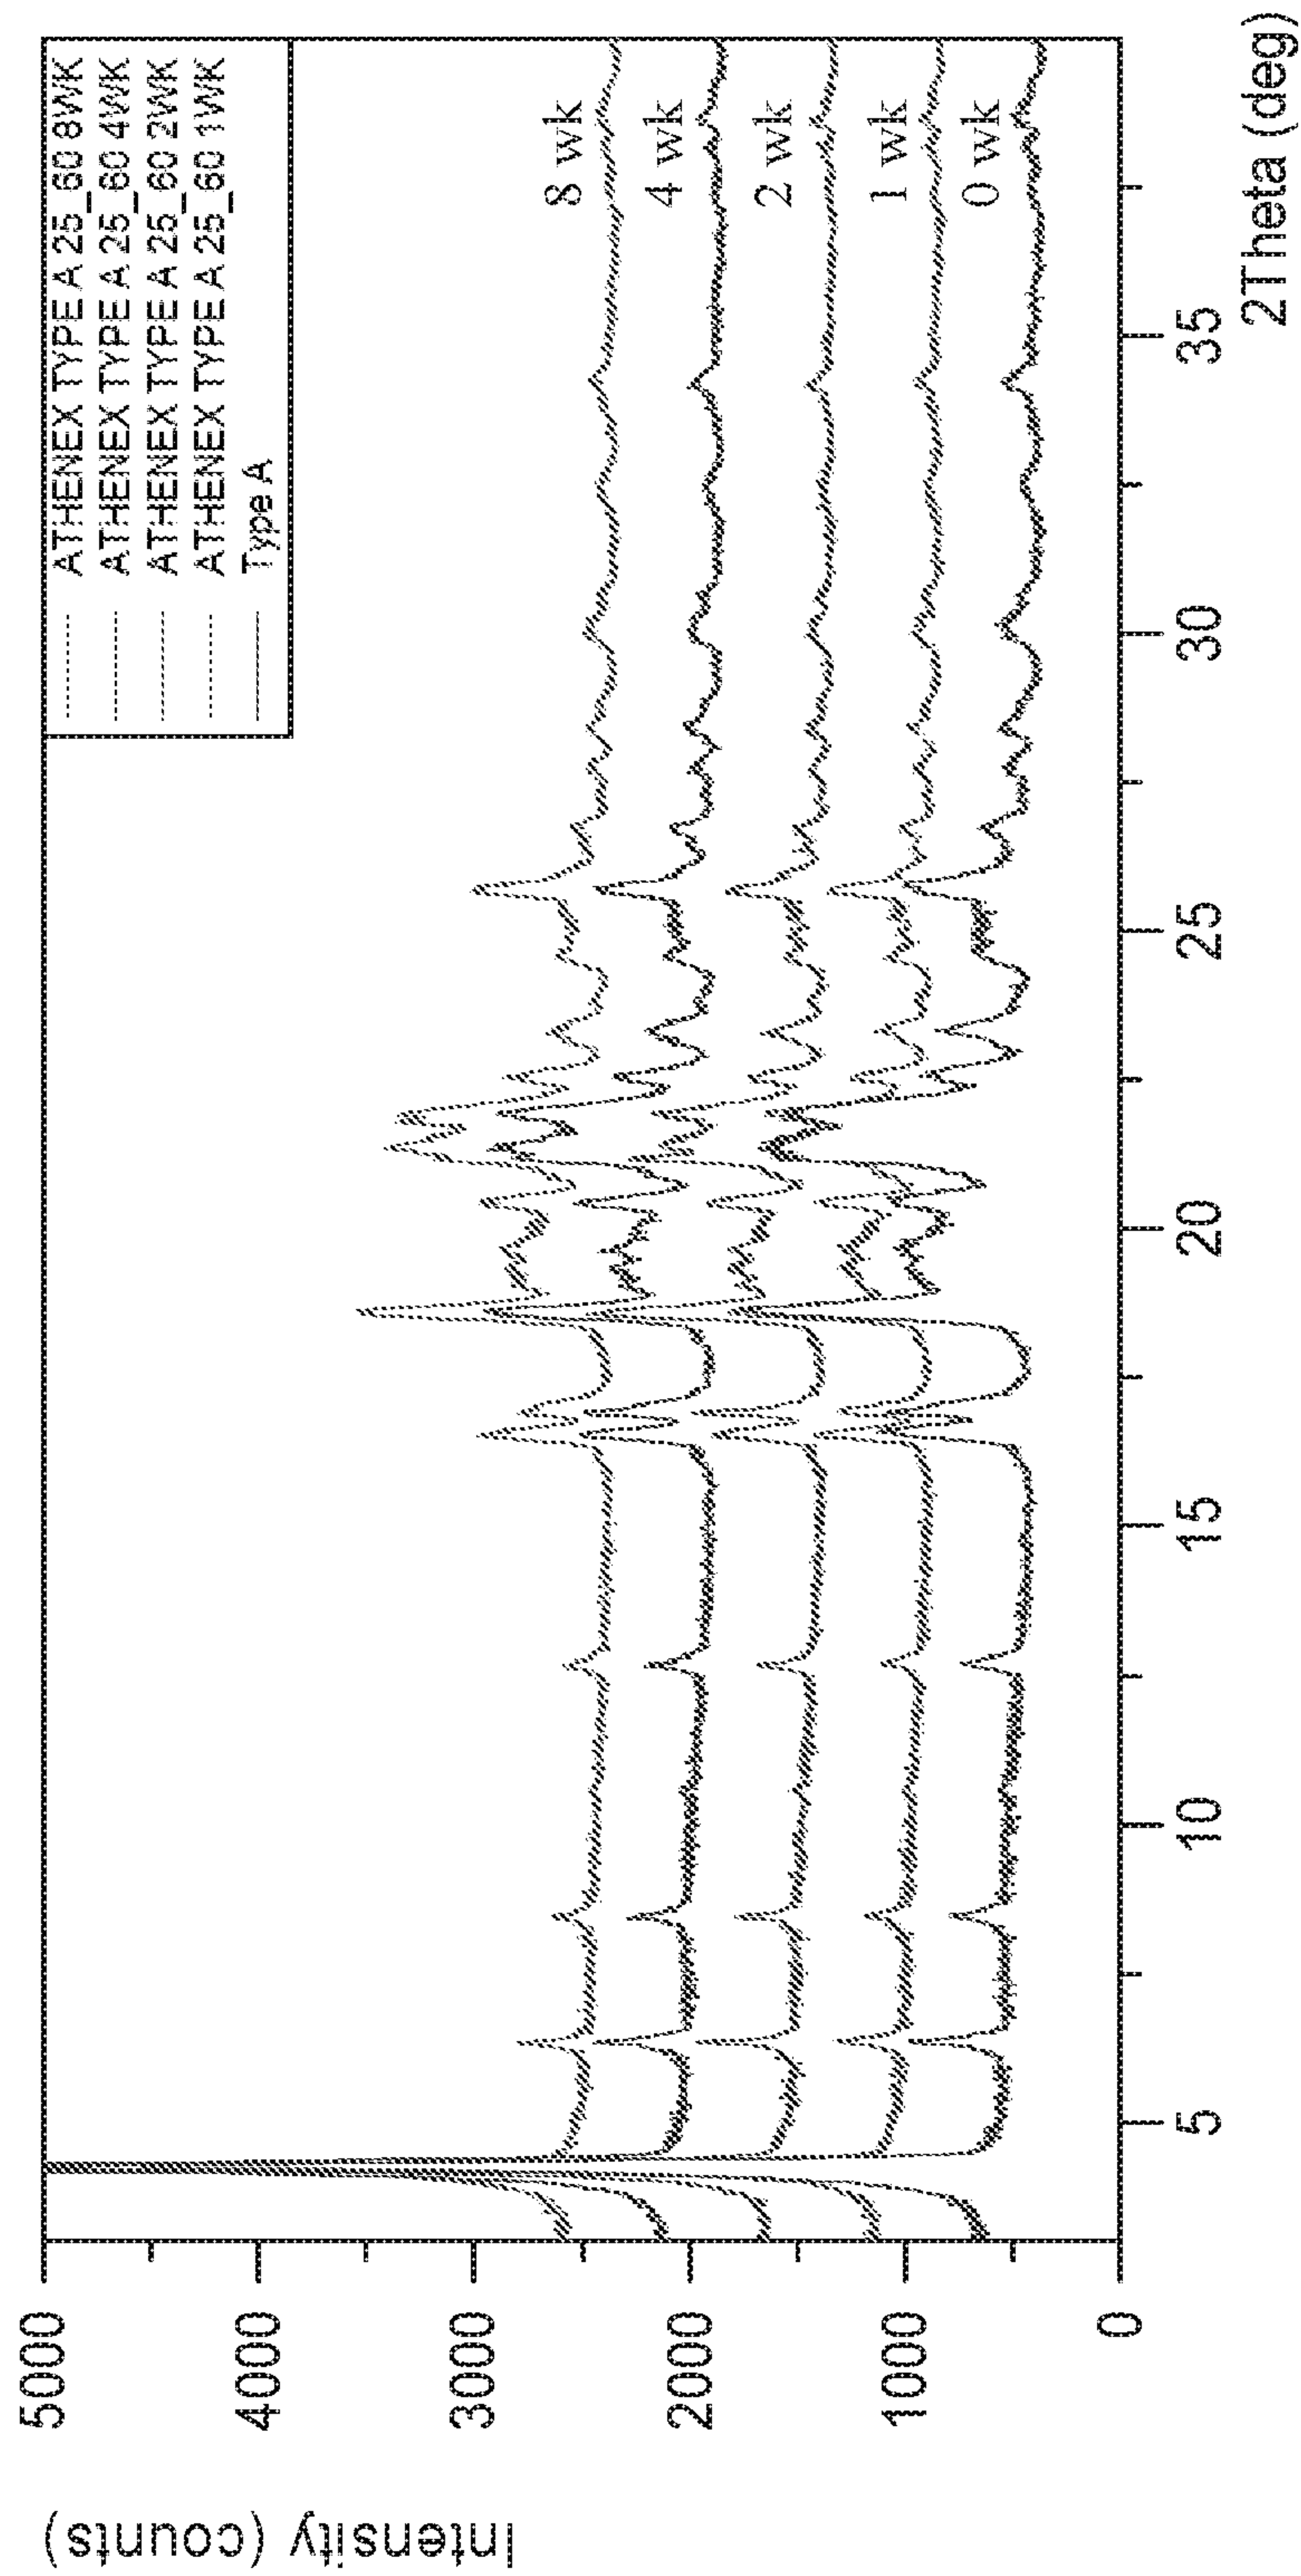


Figure 27

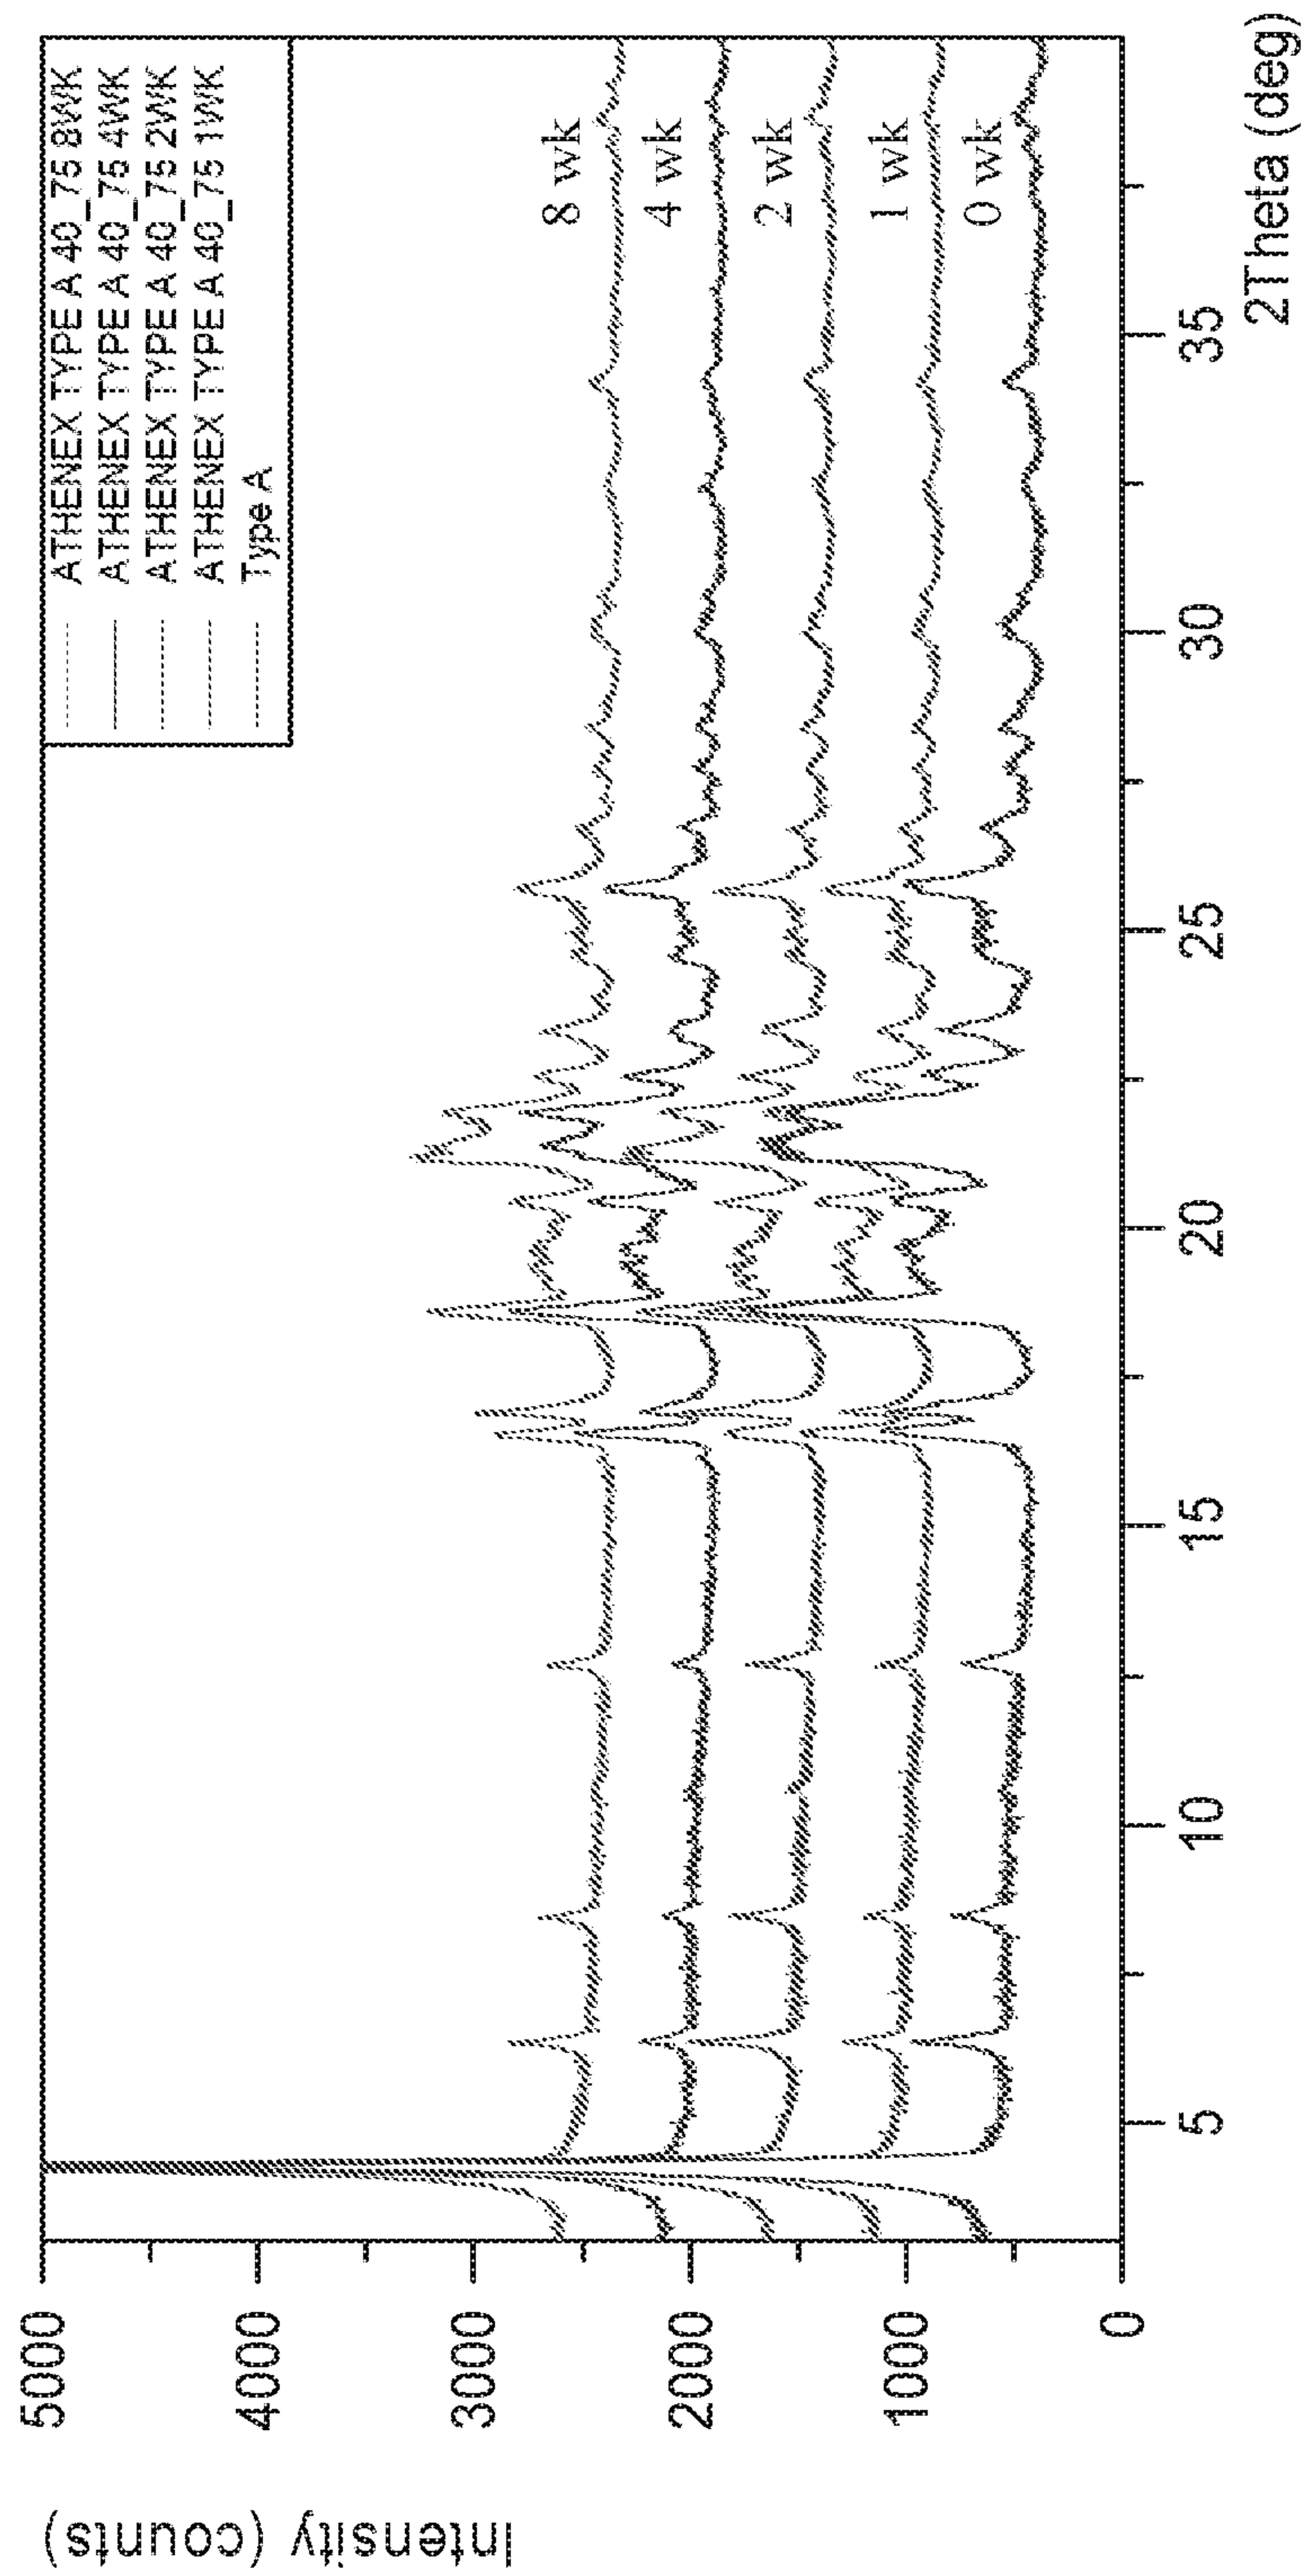


Figure 28

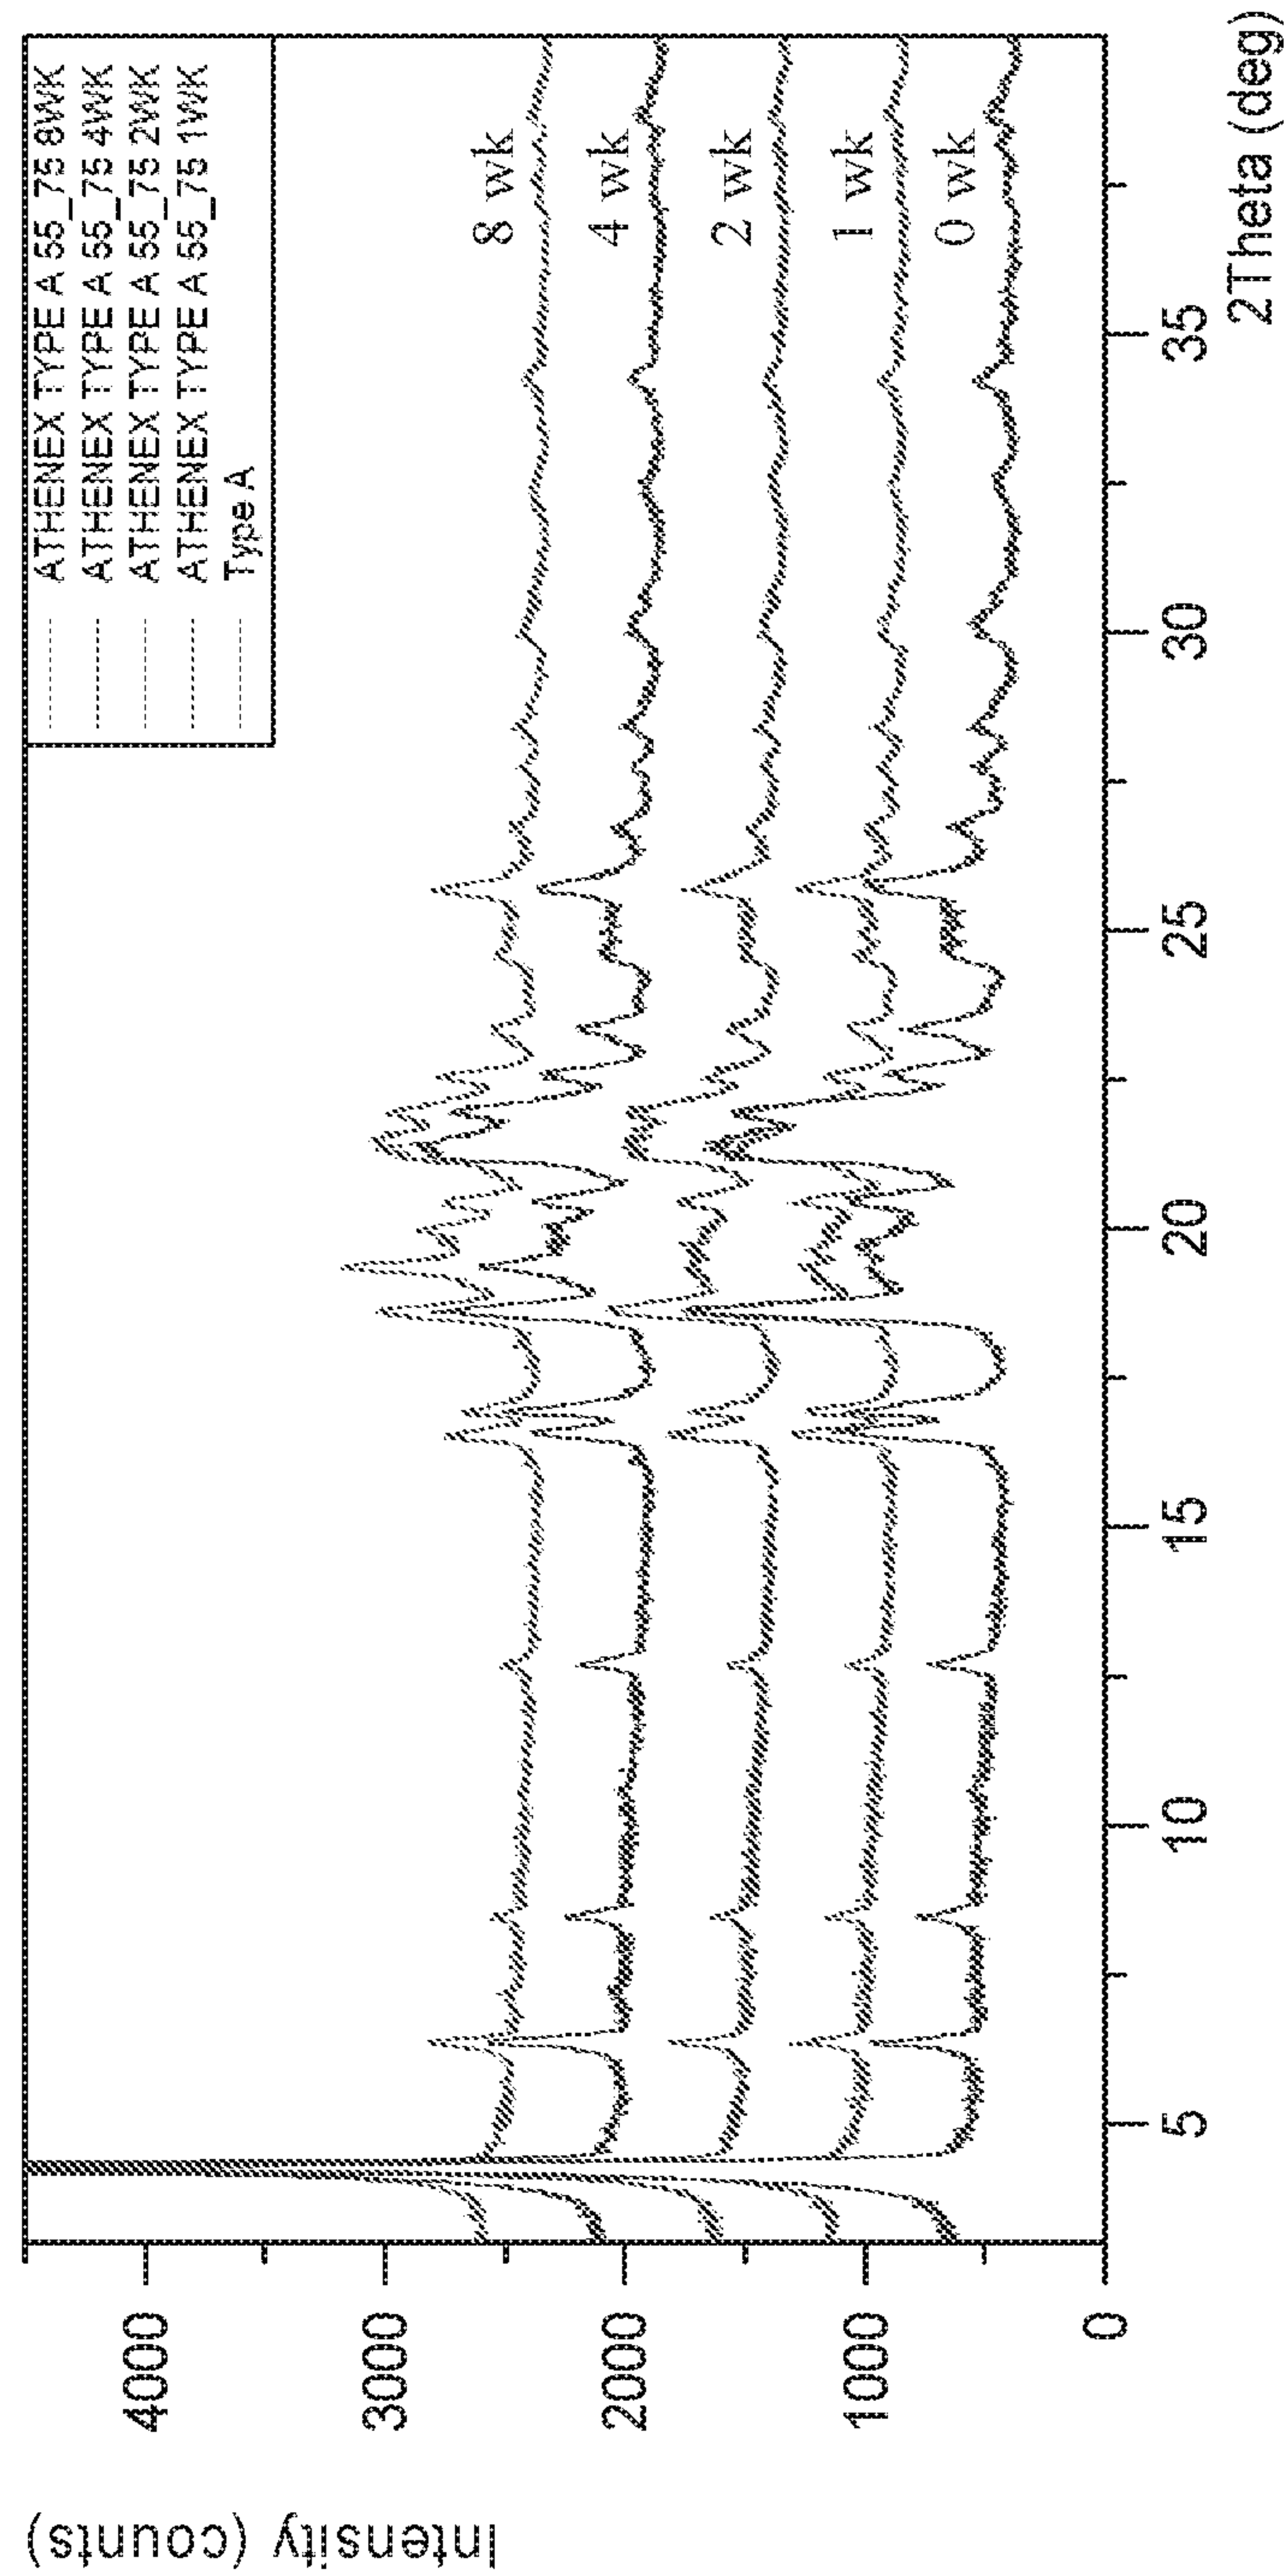


Figure 29

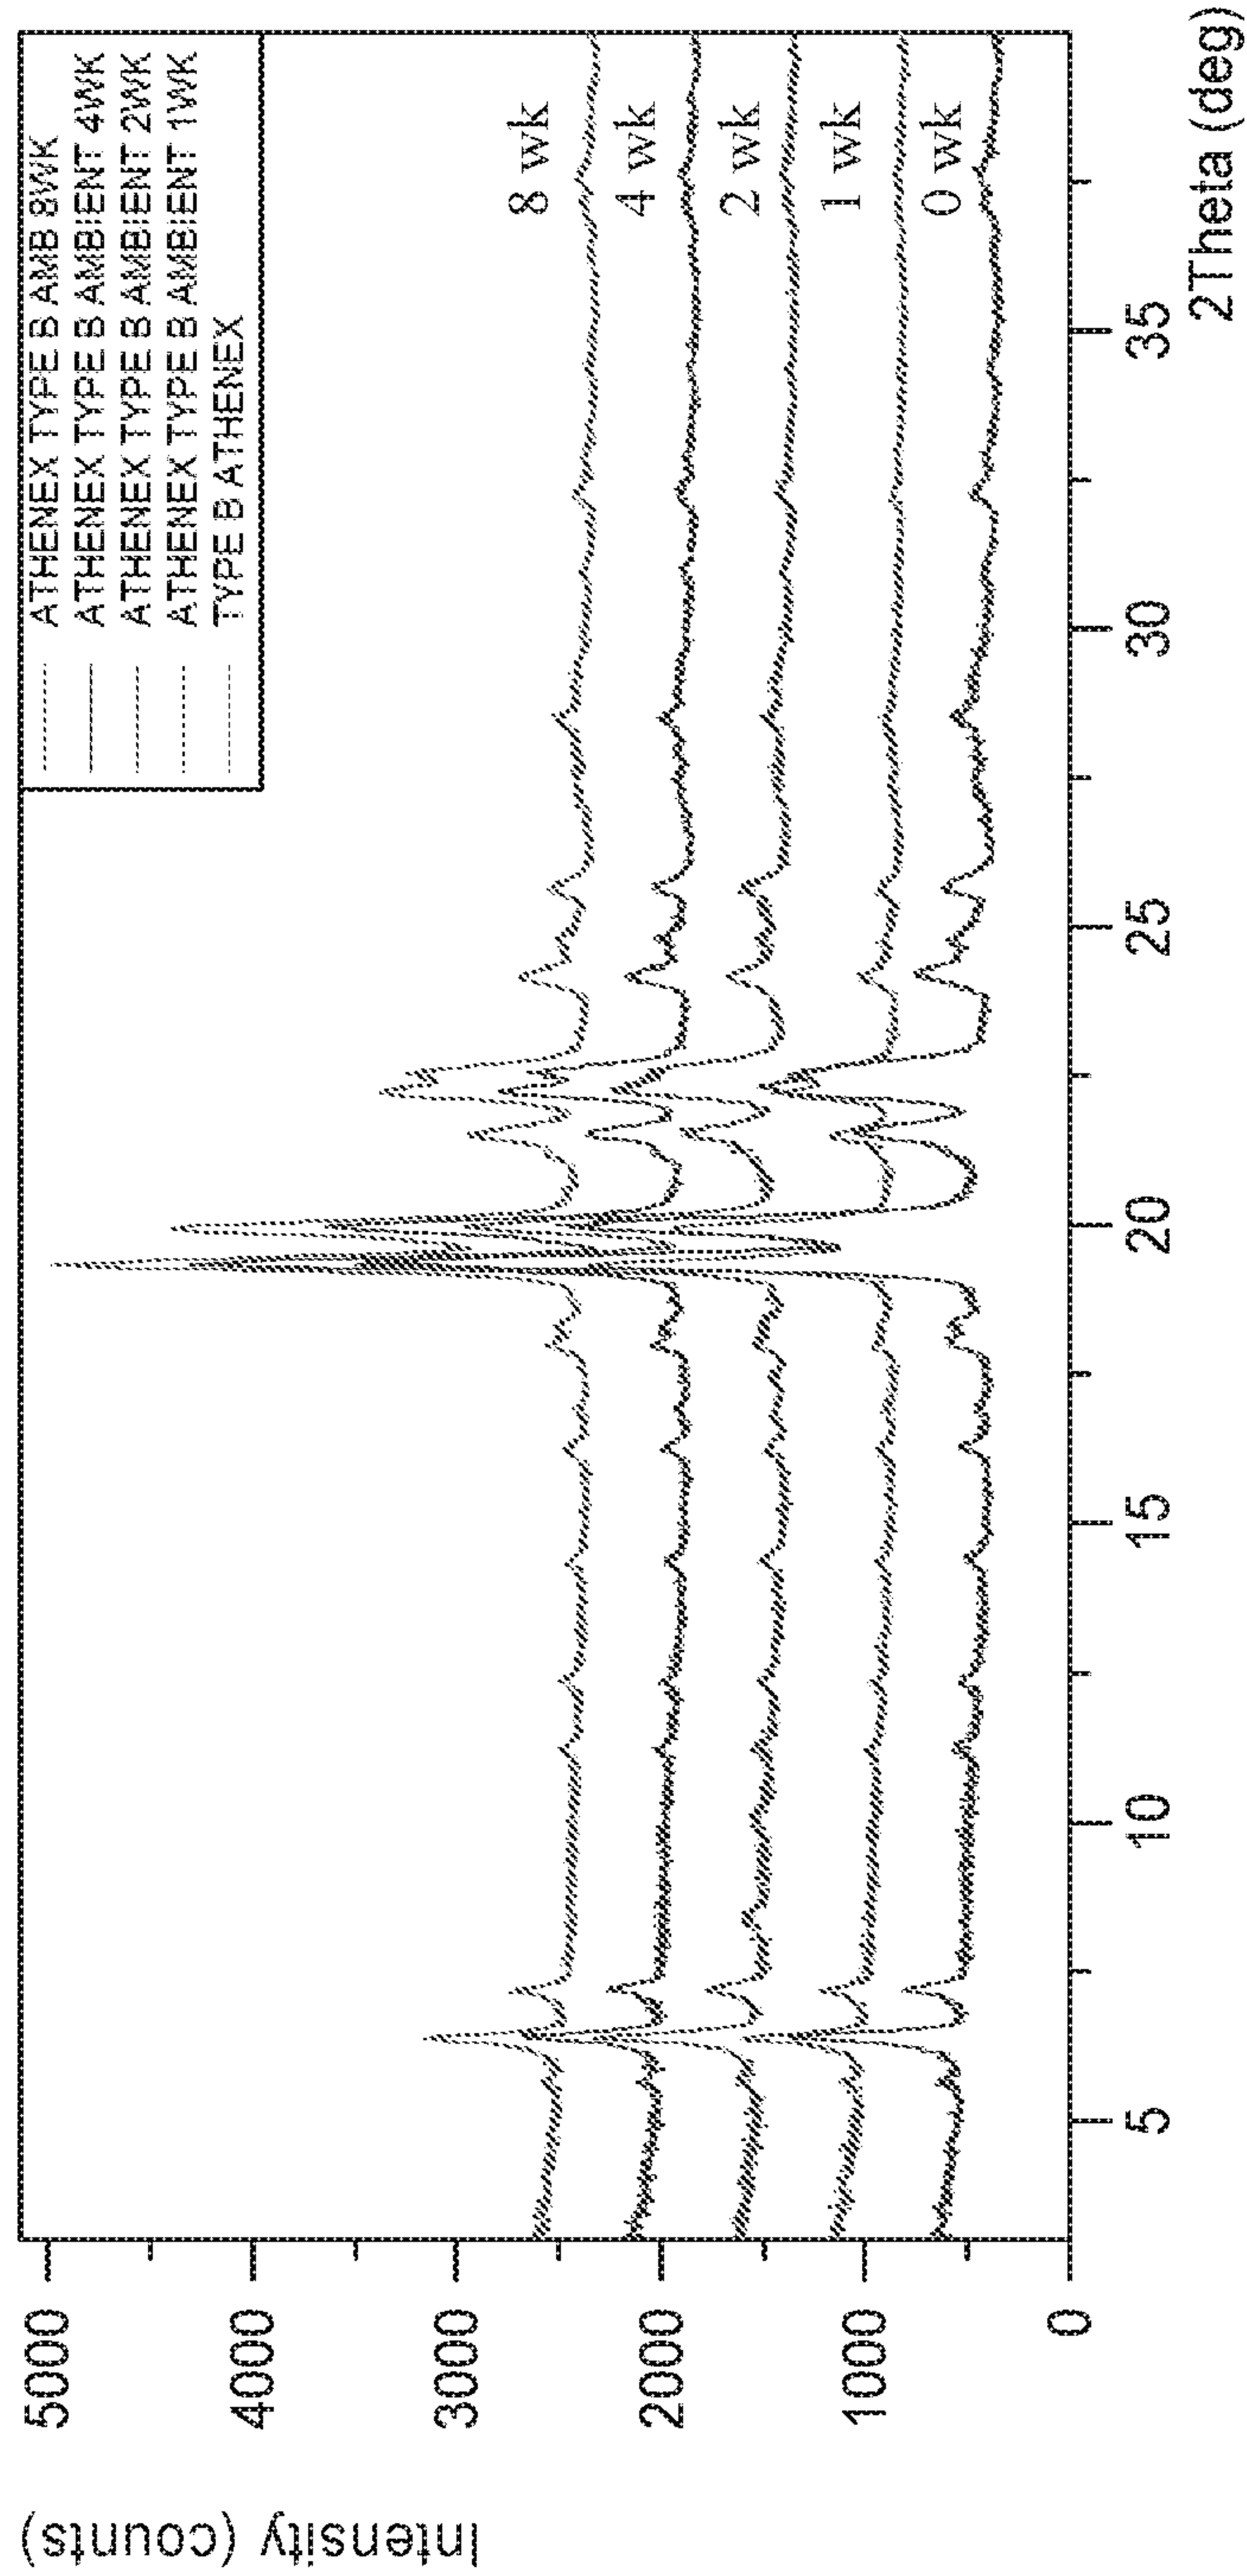


Figure 30

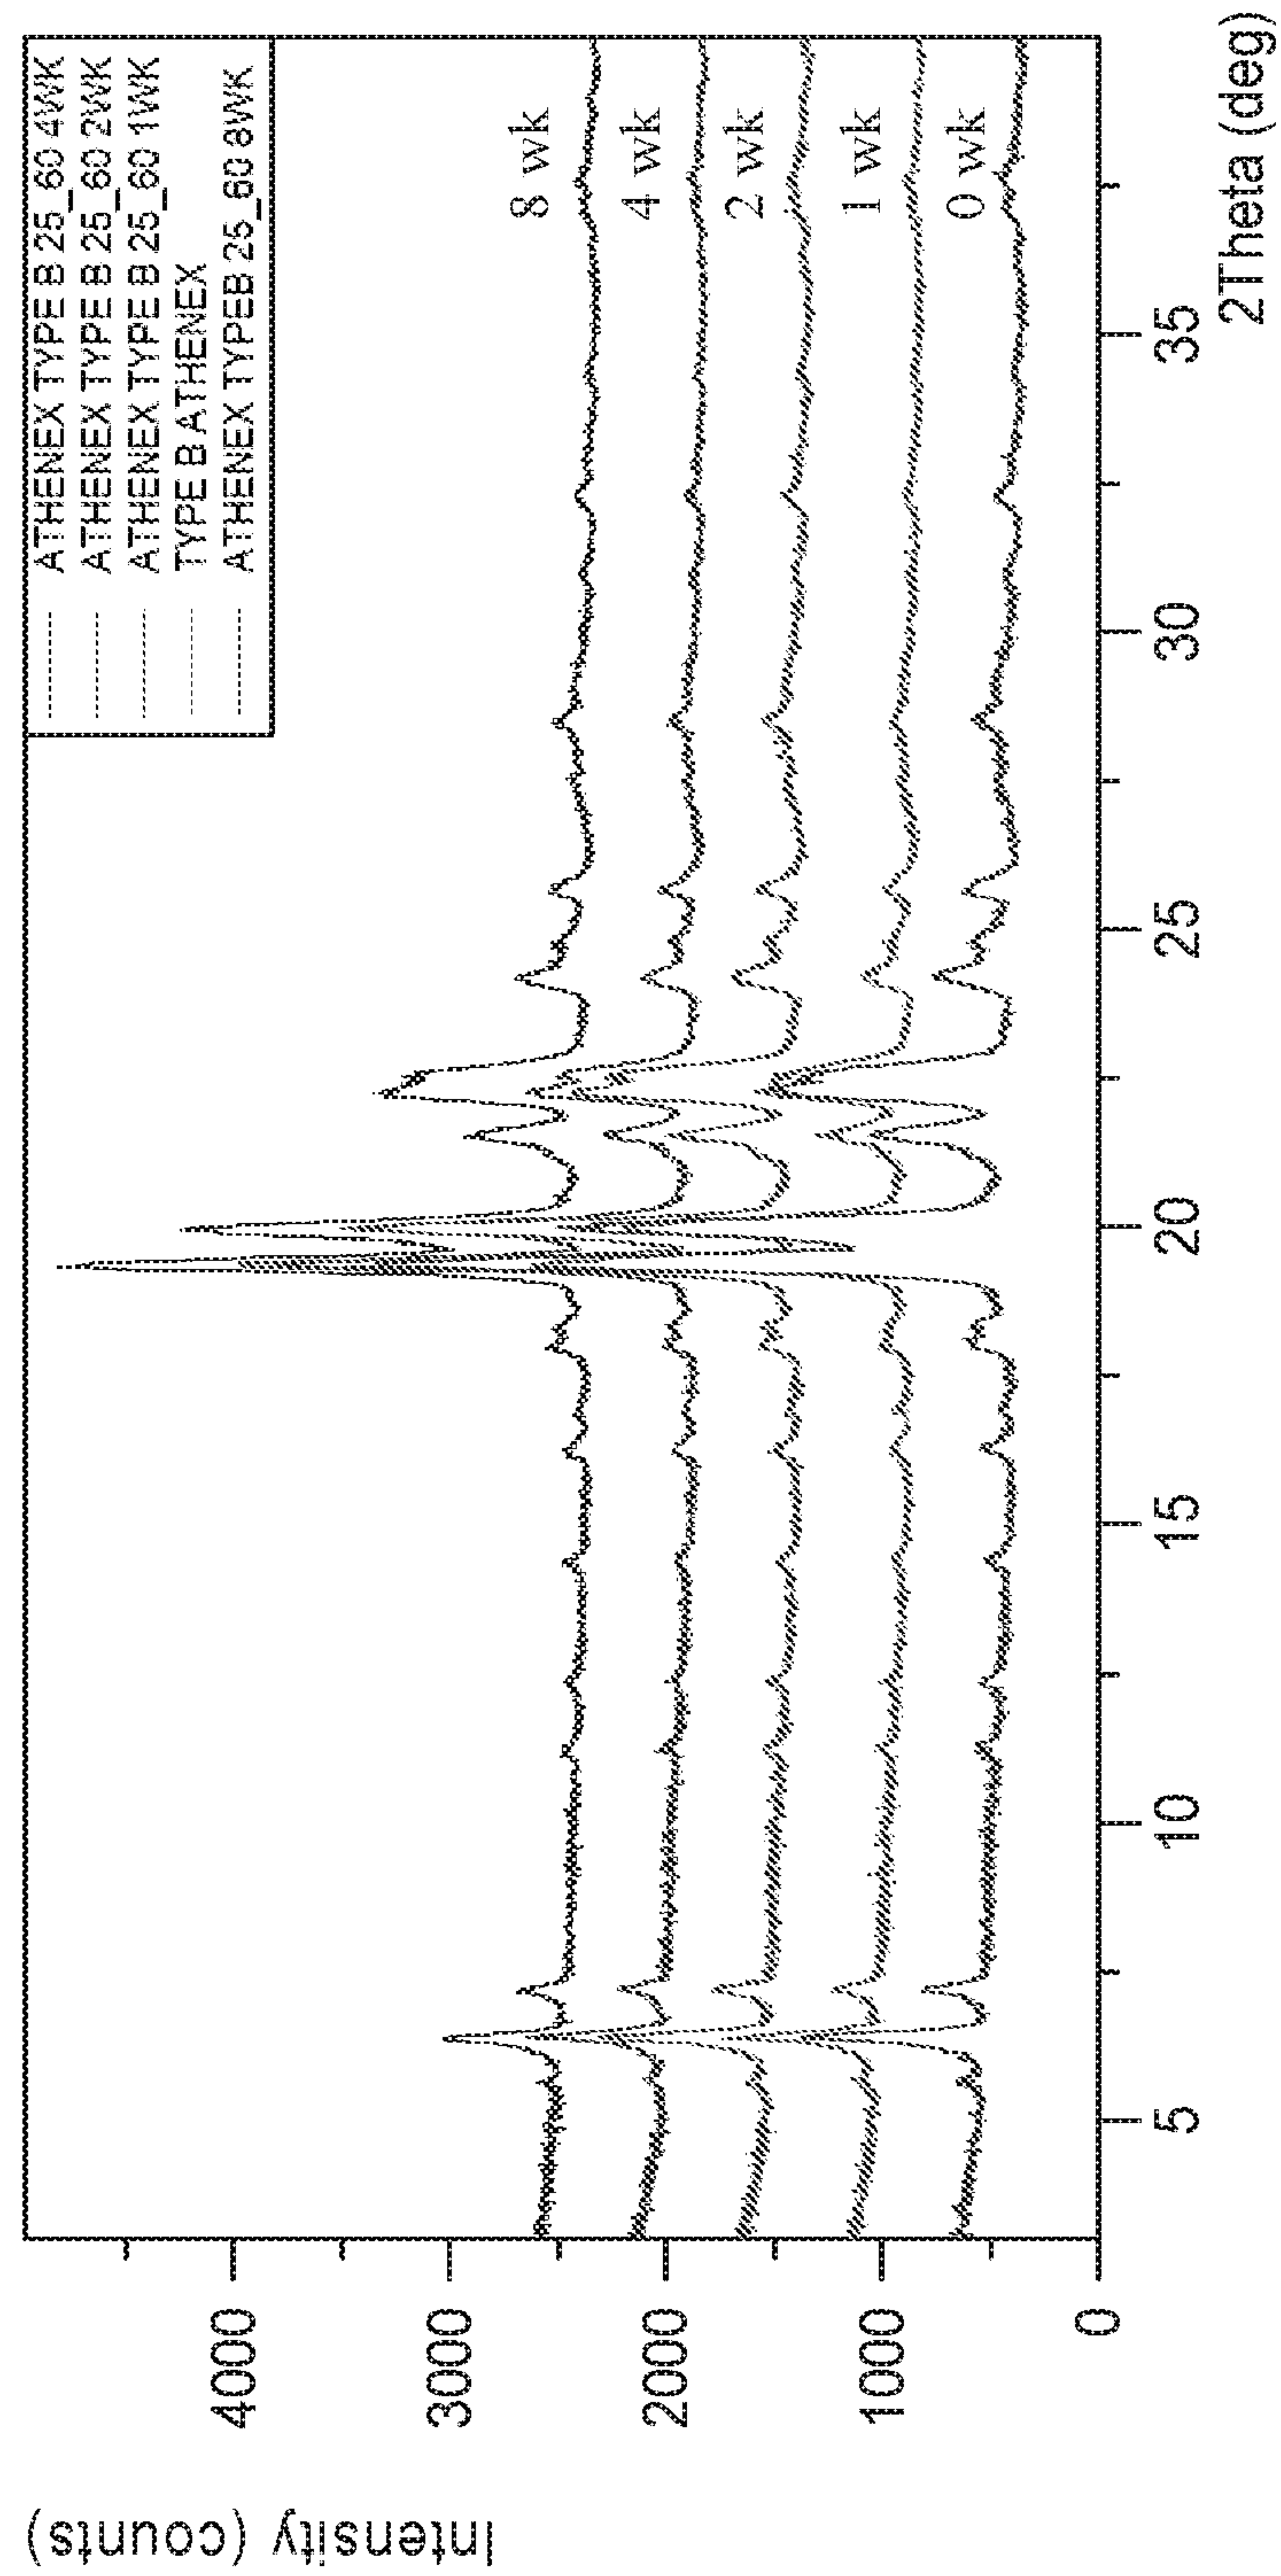


Figure 31

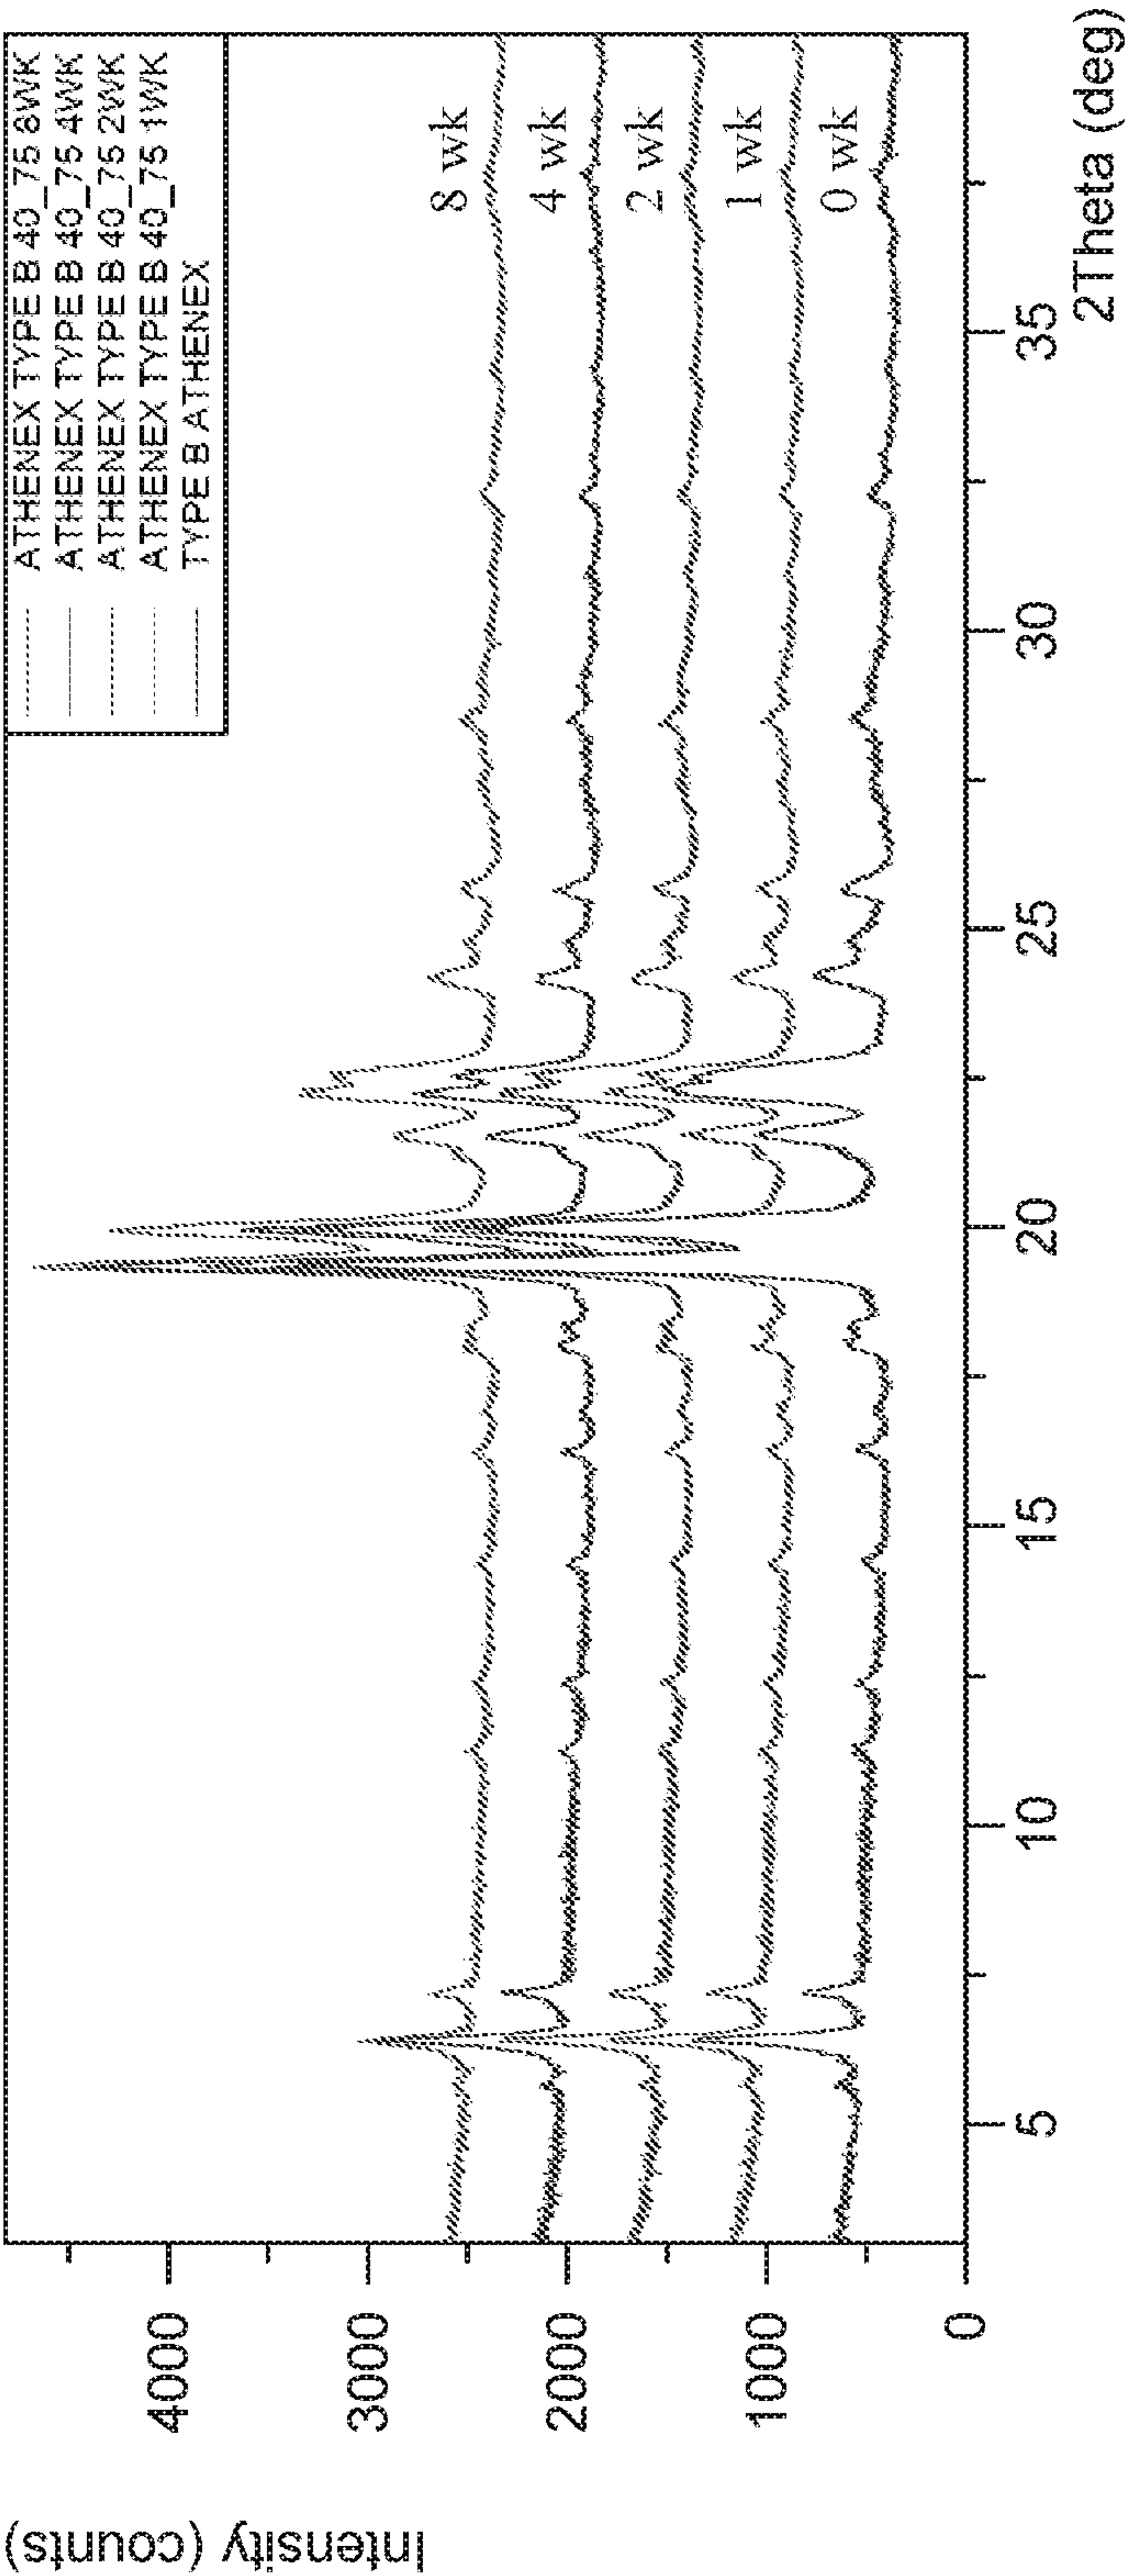


Figure 32

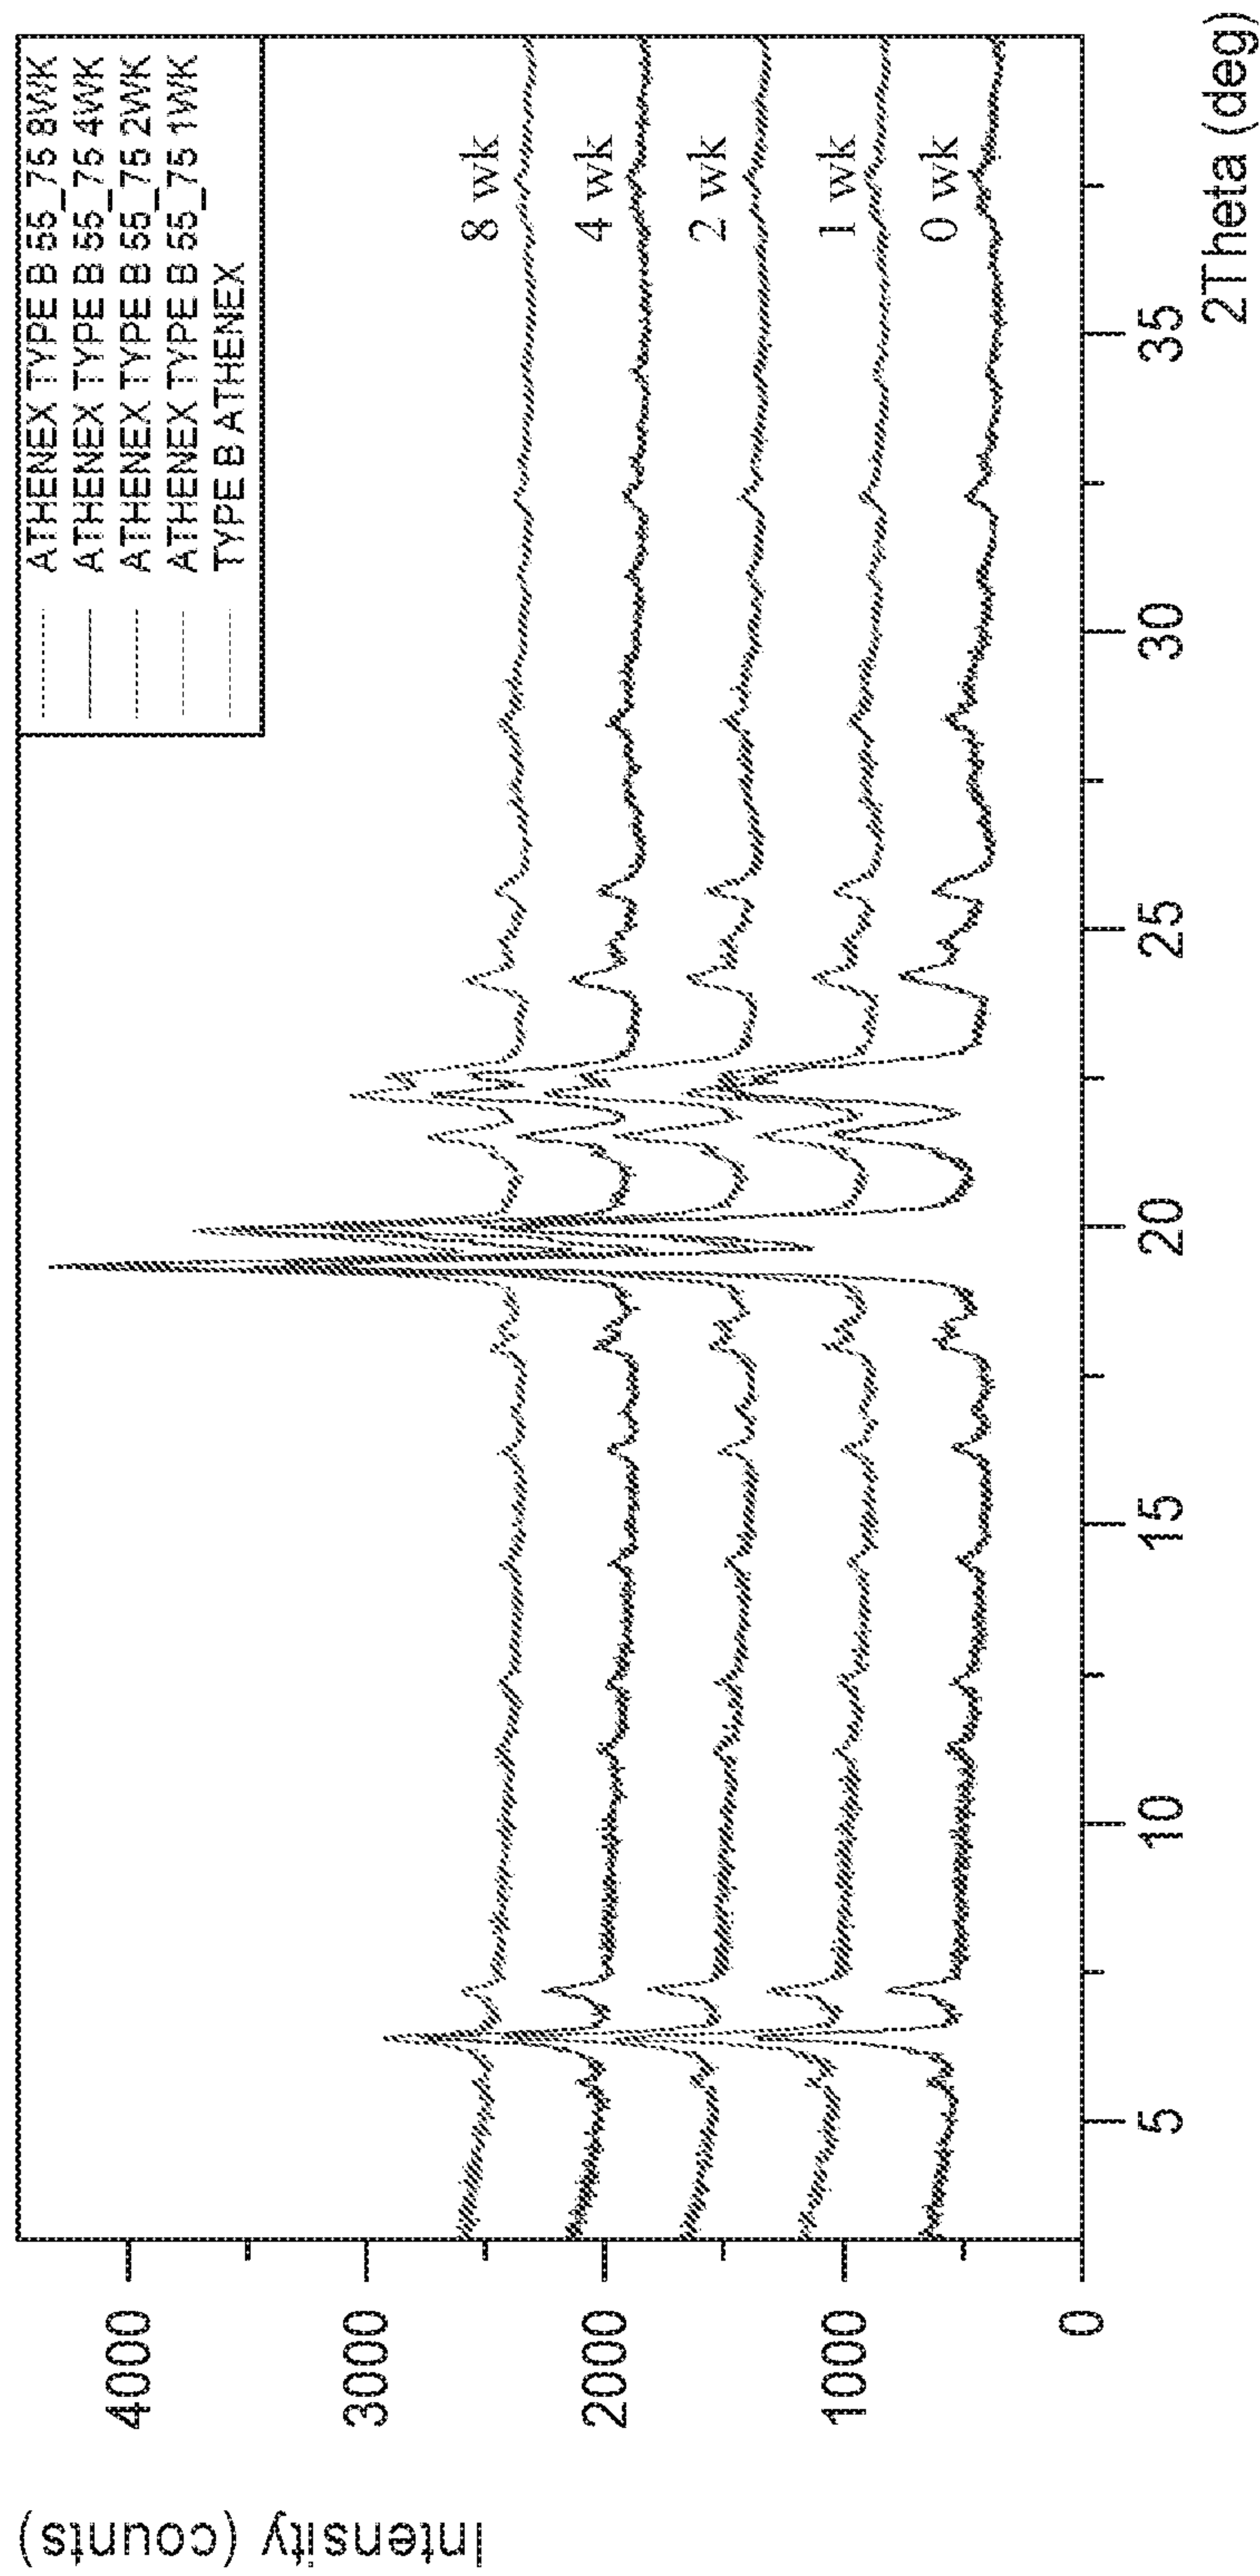


Figure 33

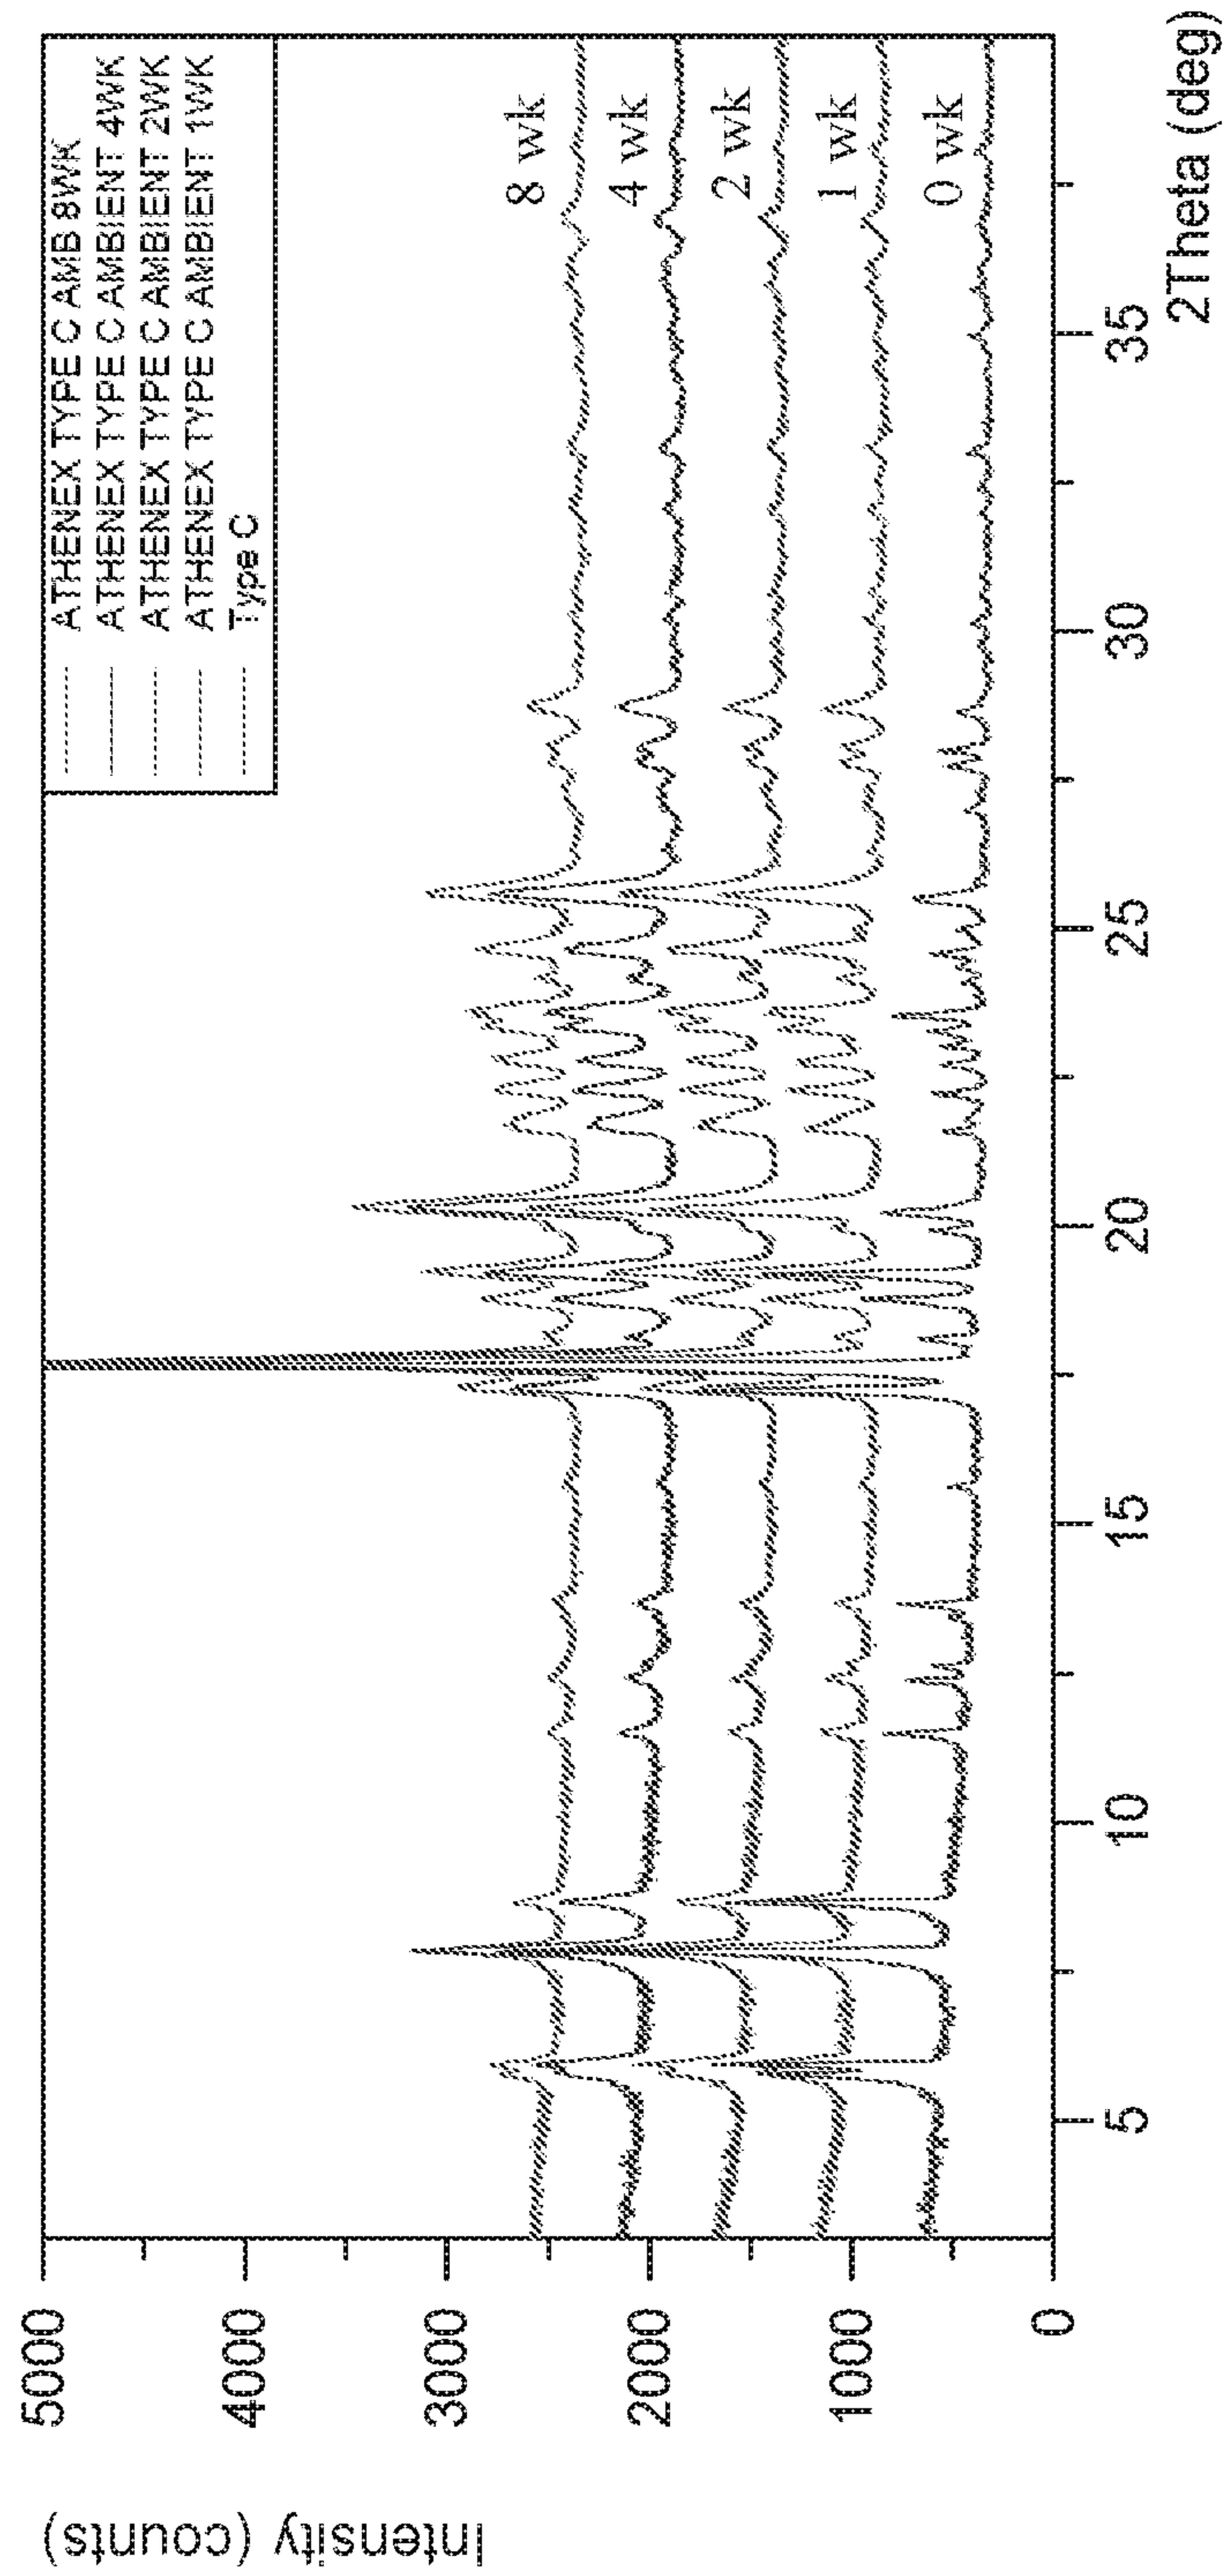


Figure 34

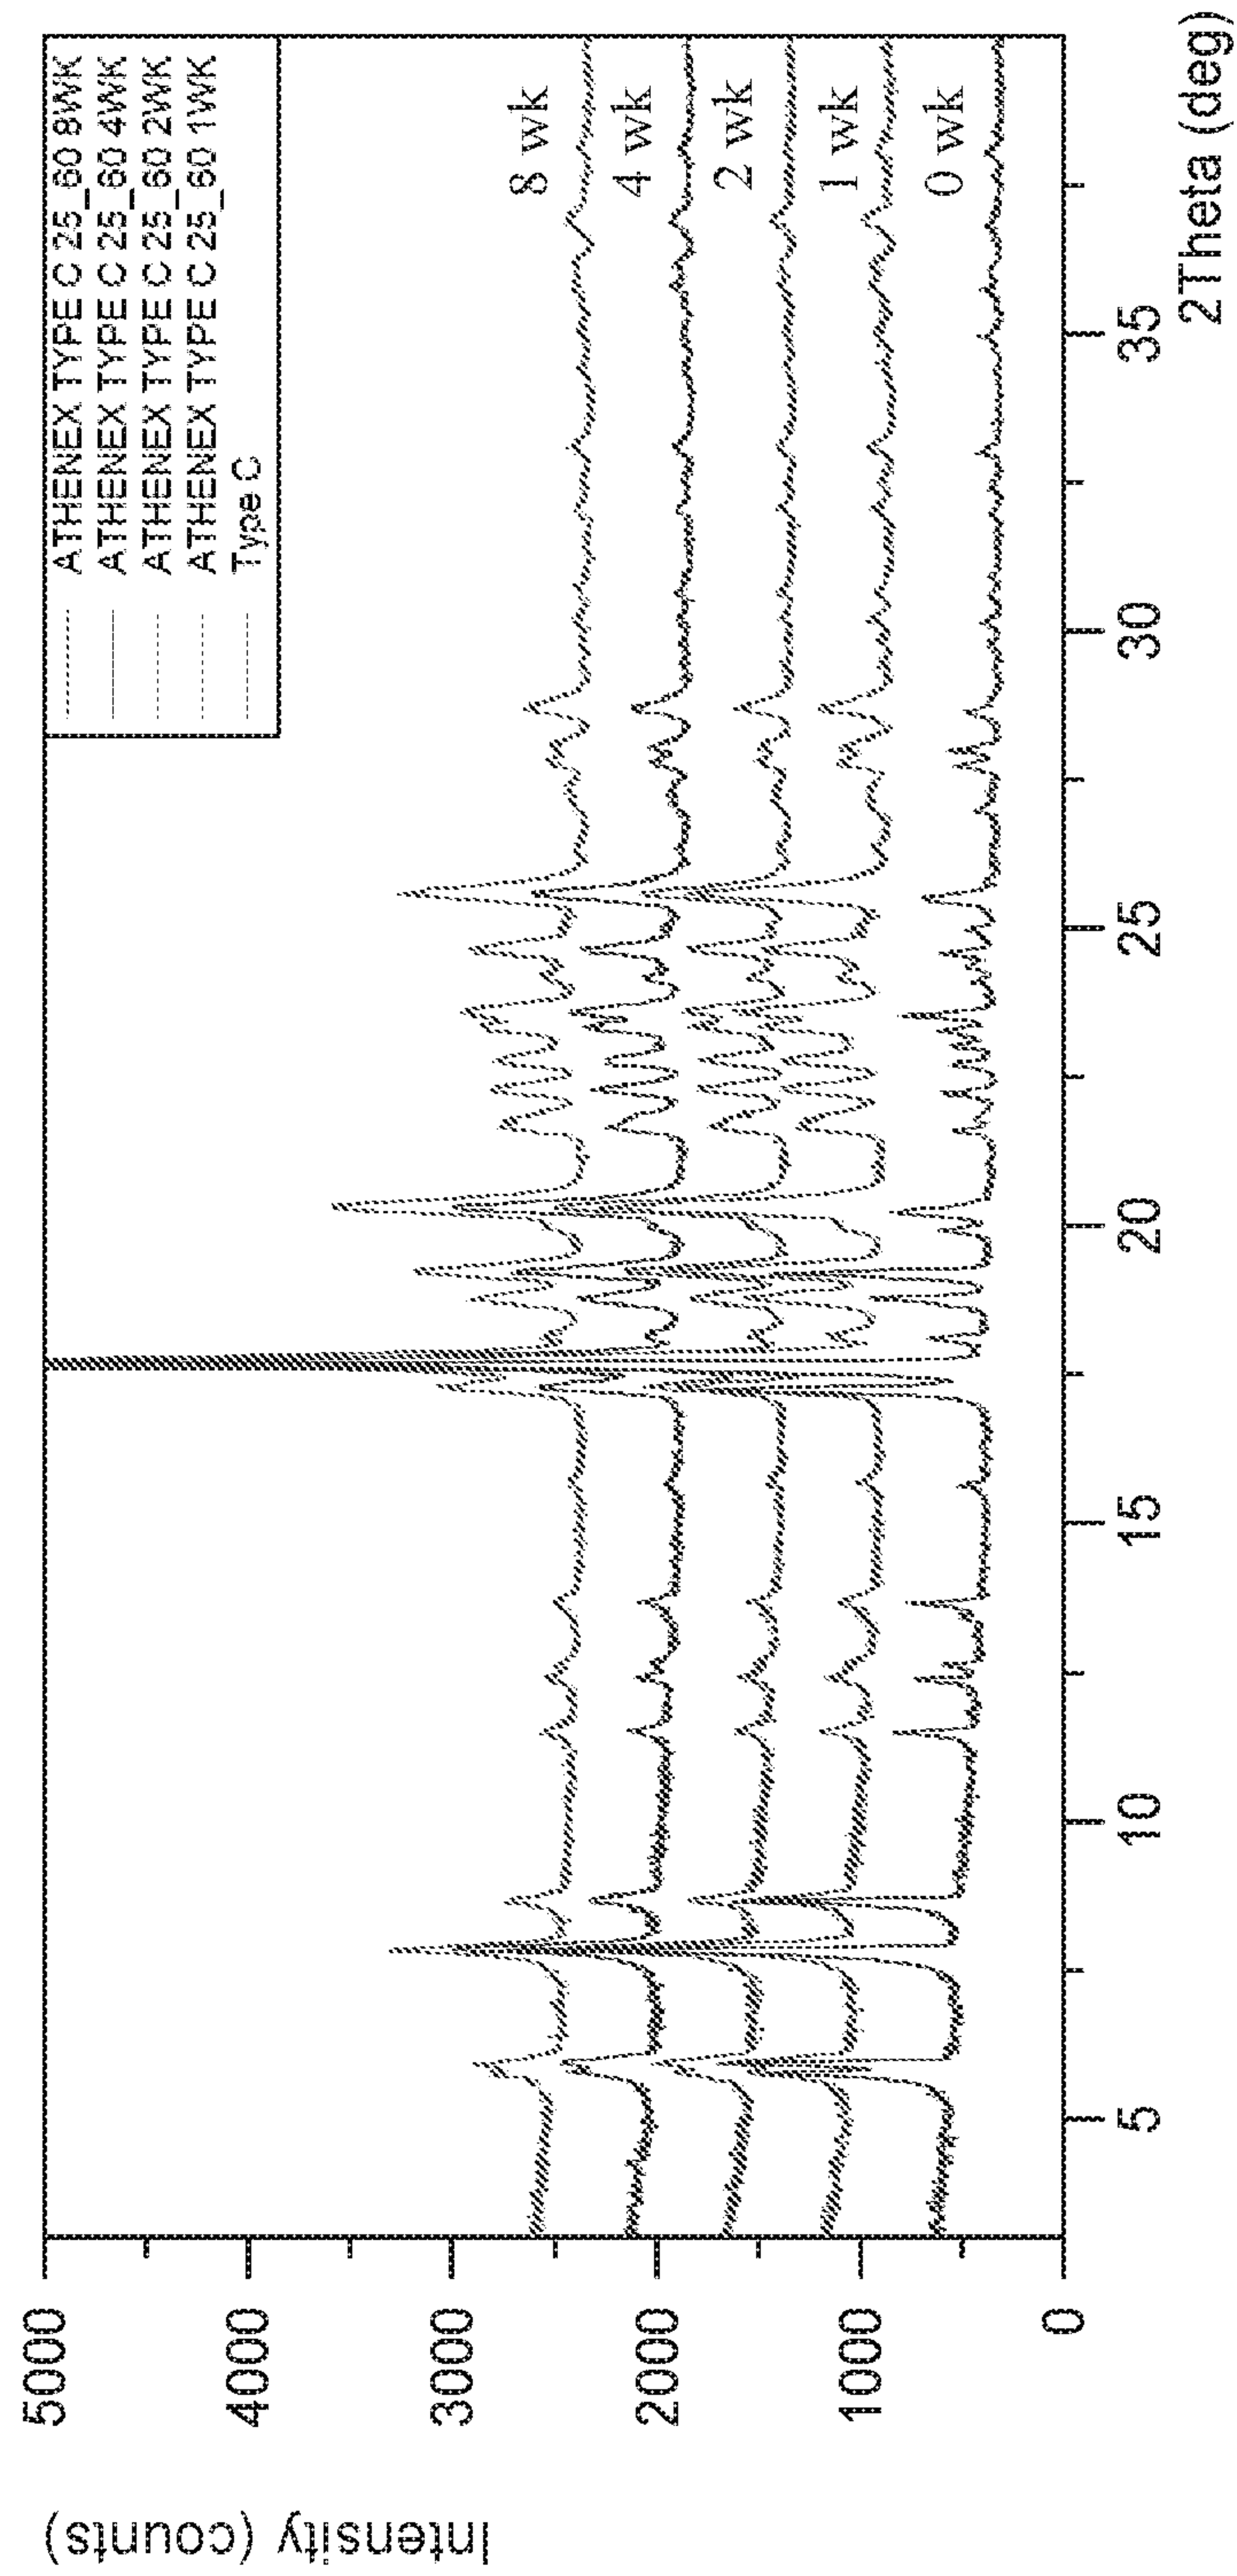


Figure 35

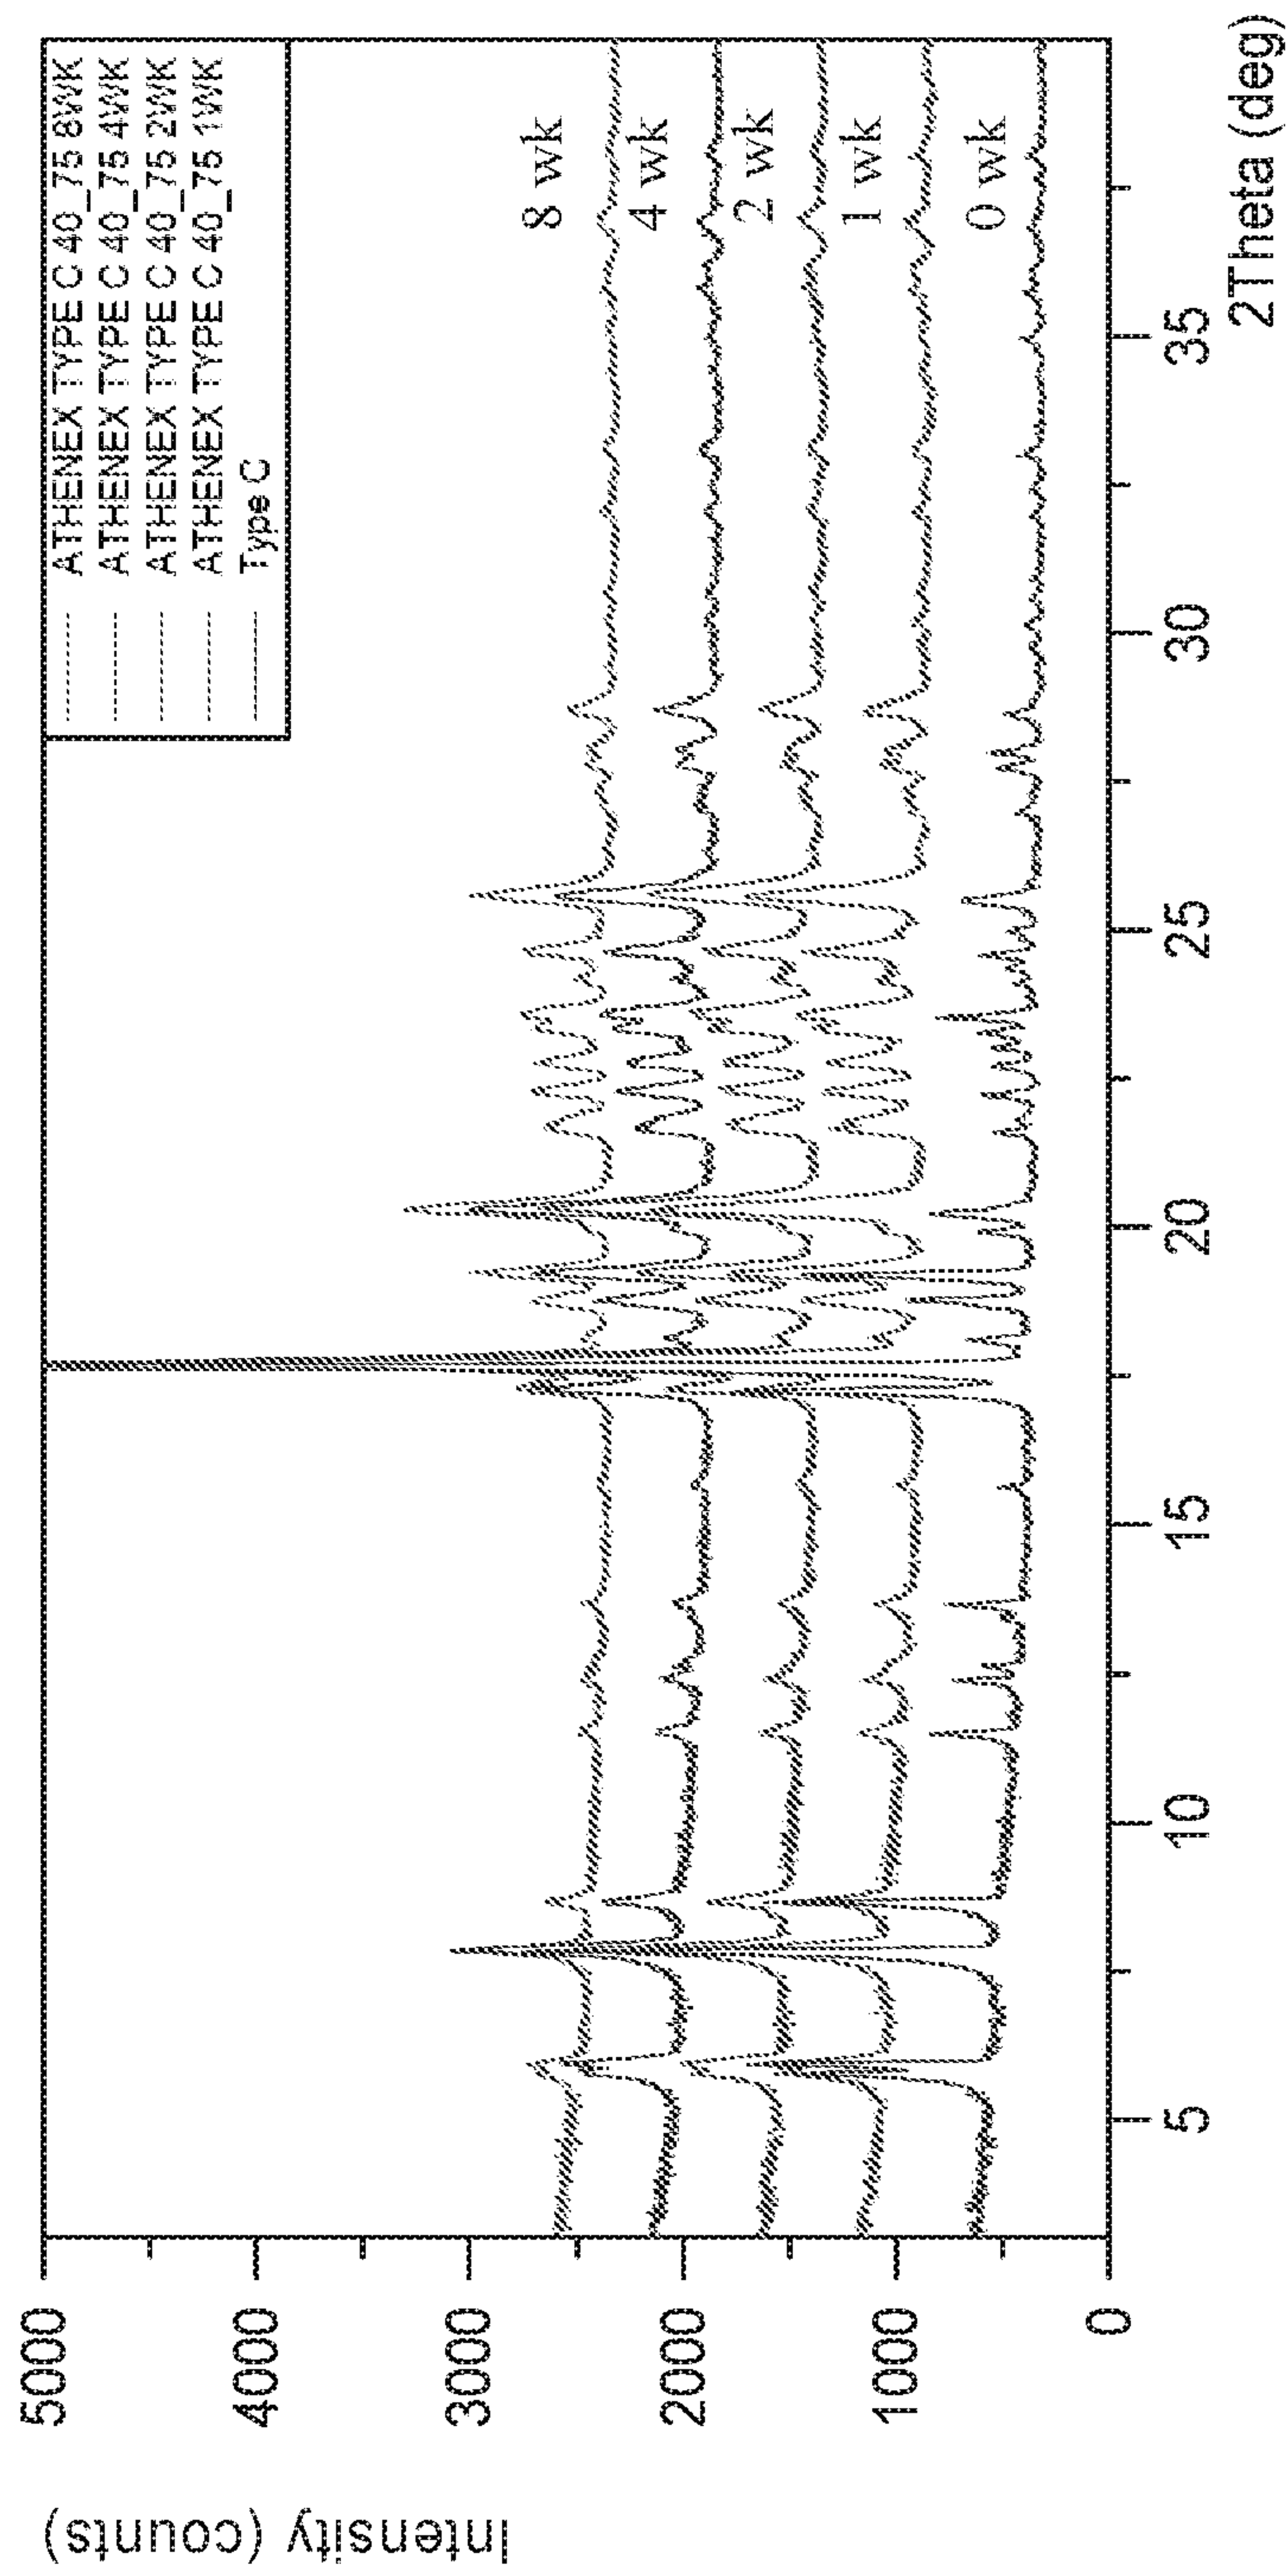


Figure 36

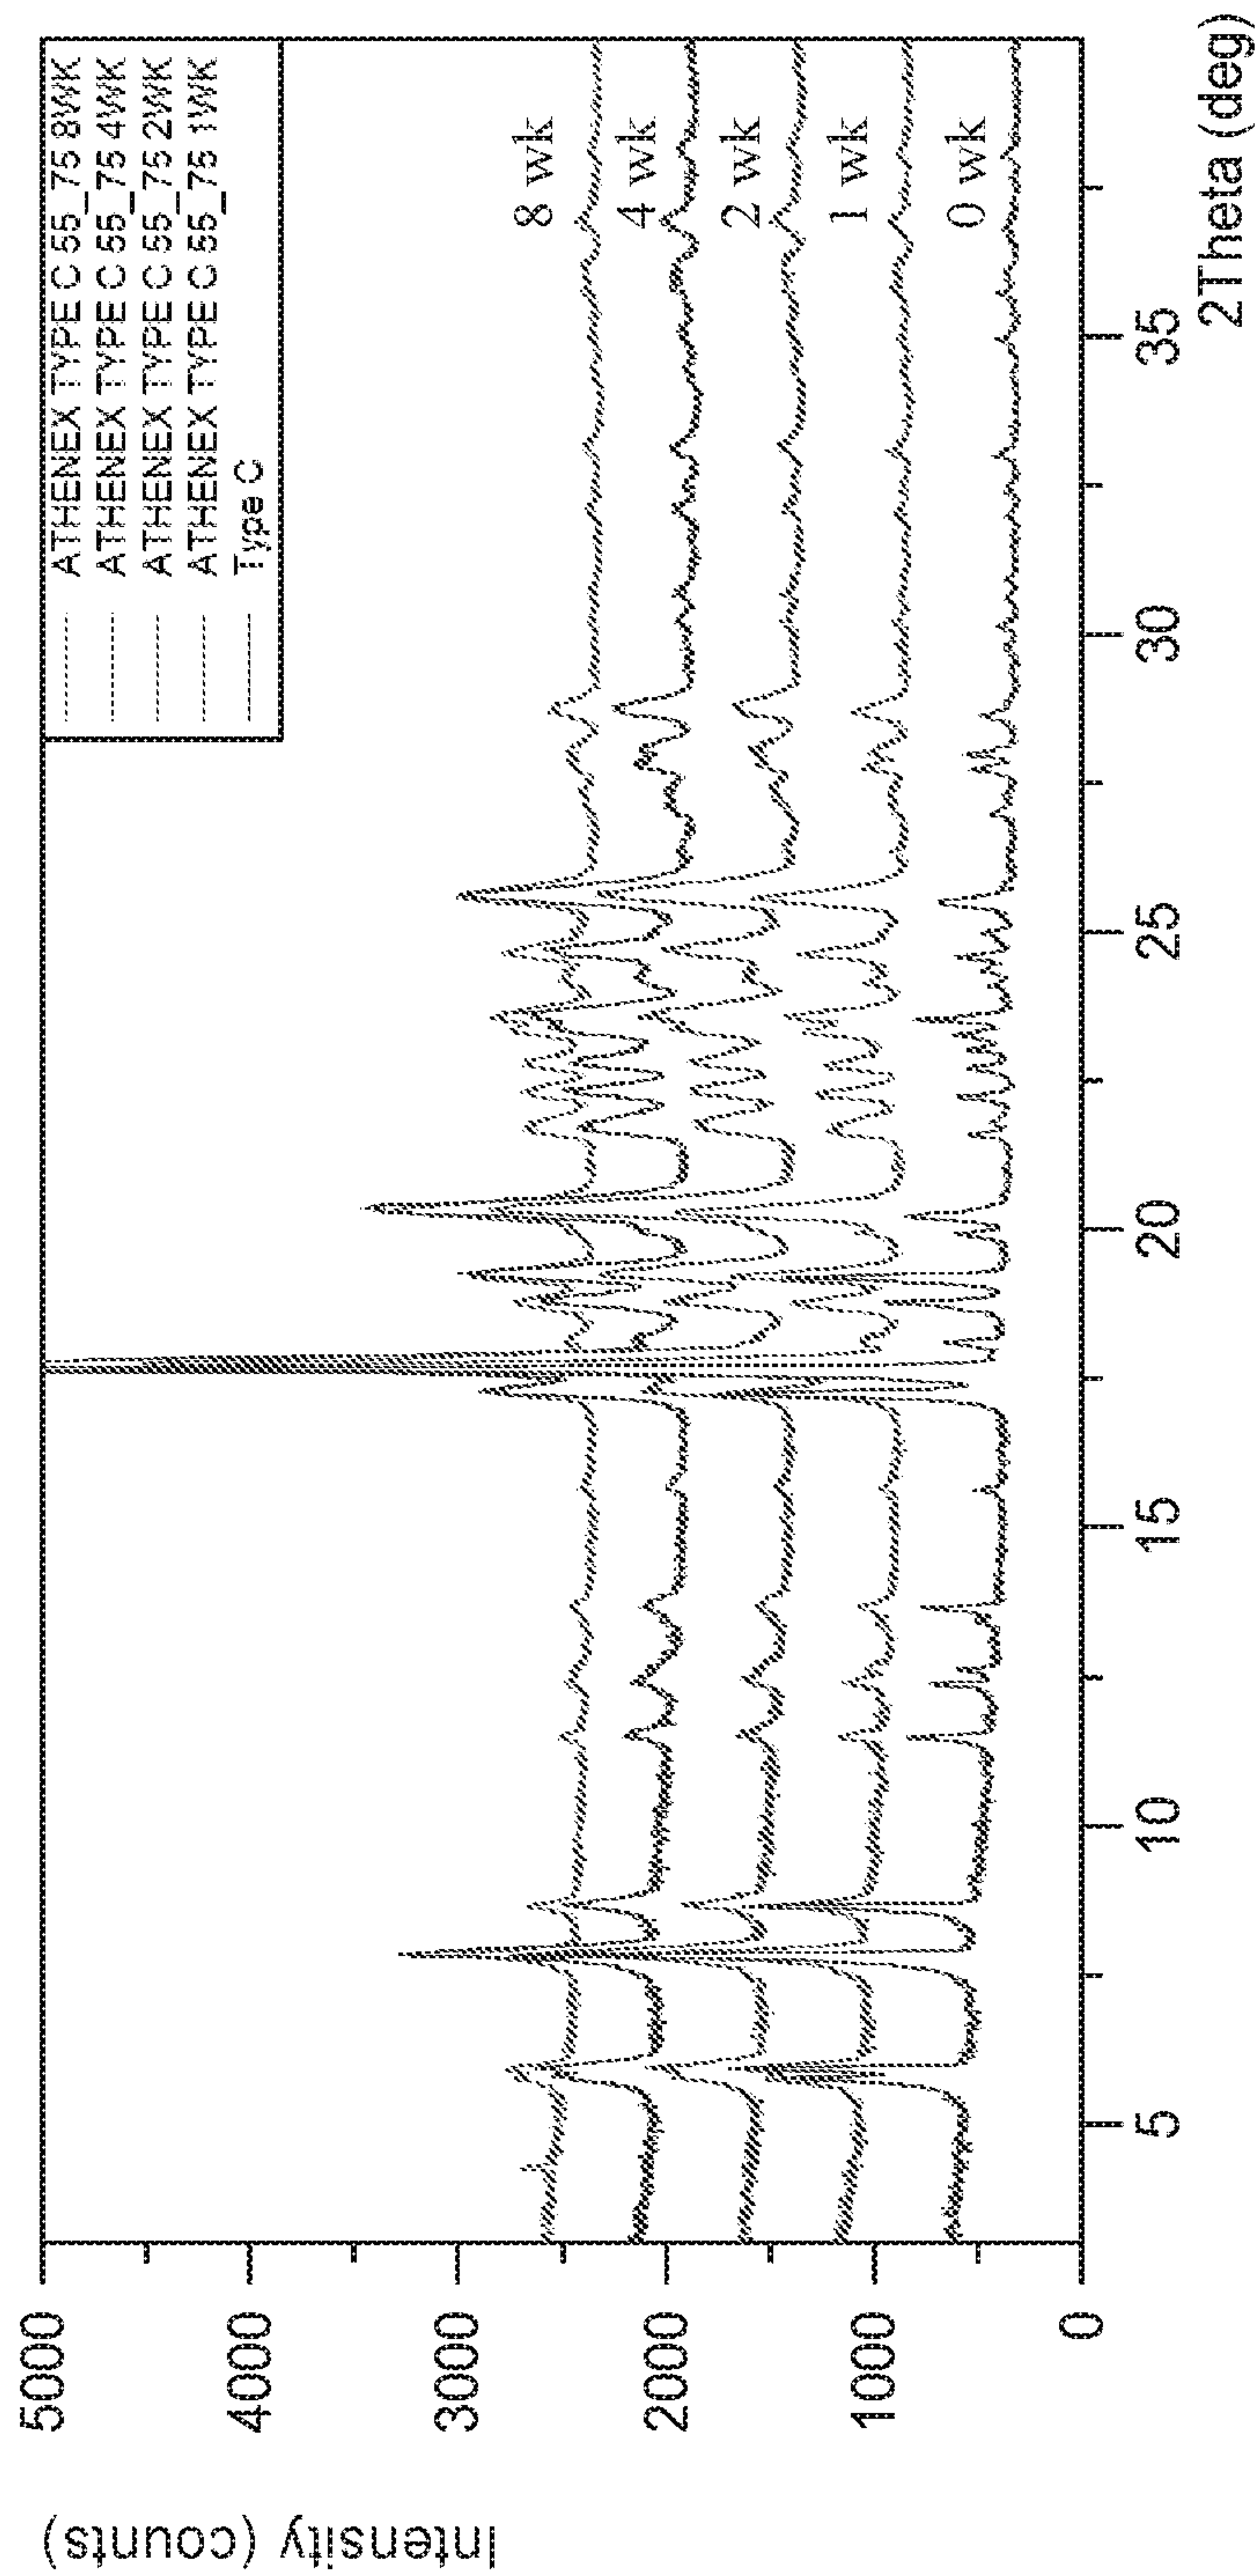


Figure 37