

FIG.1

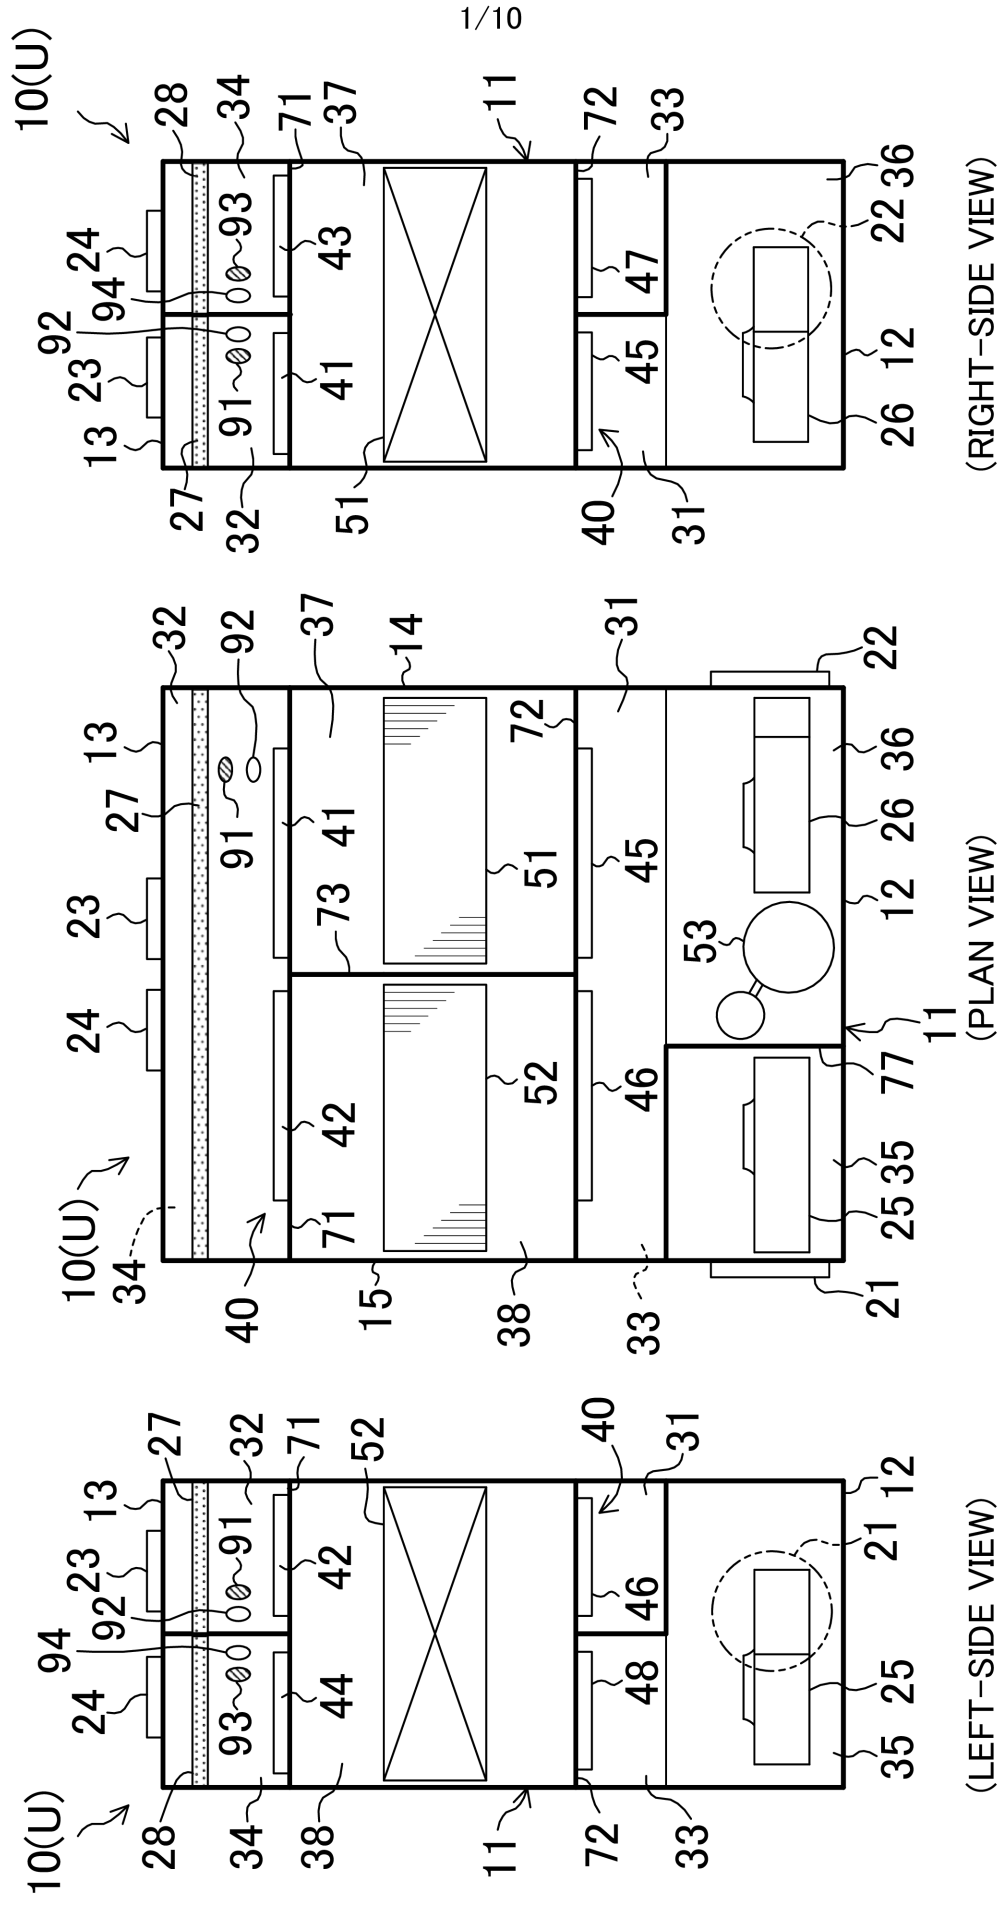


FIG.2A

FIRST ACTION

10

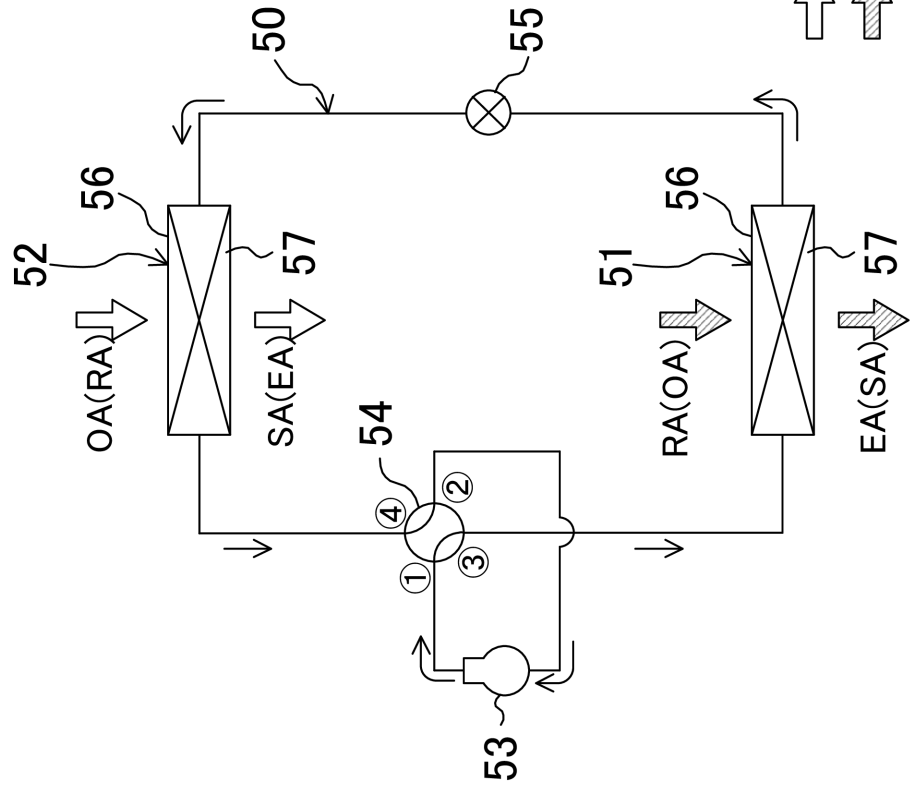


FIG.2B

SECOND ACTION

10

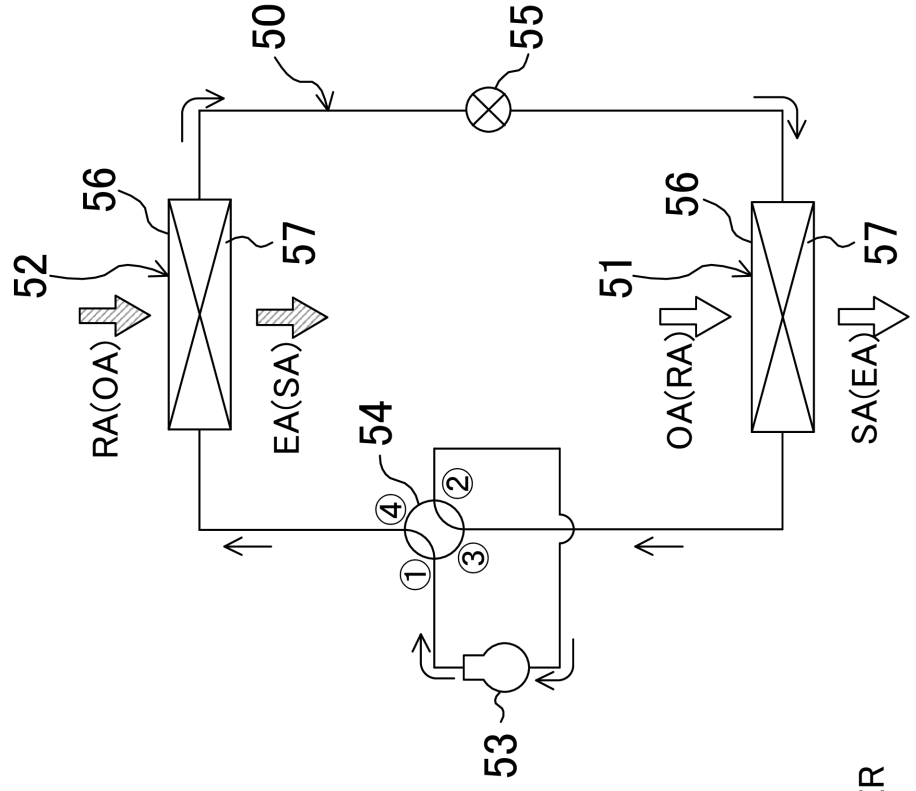


FIG.3

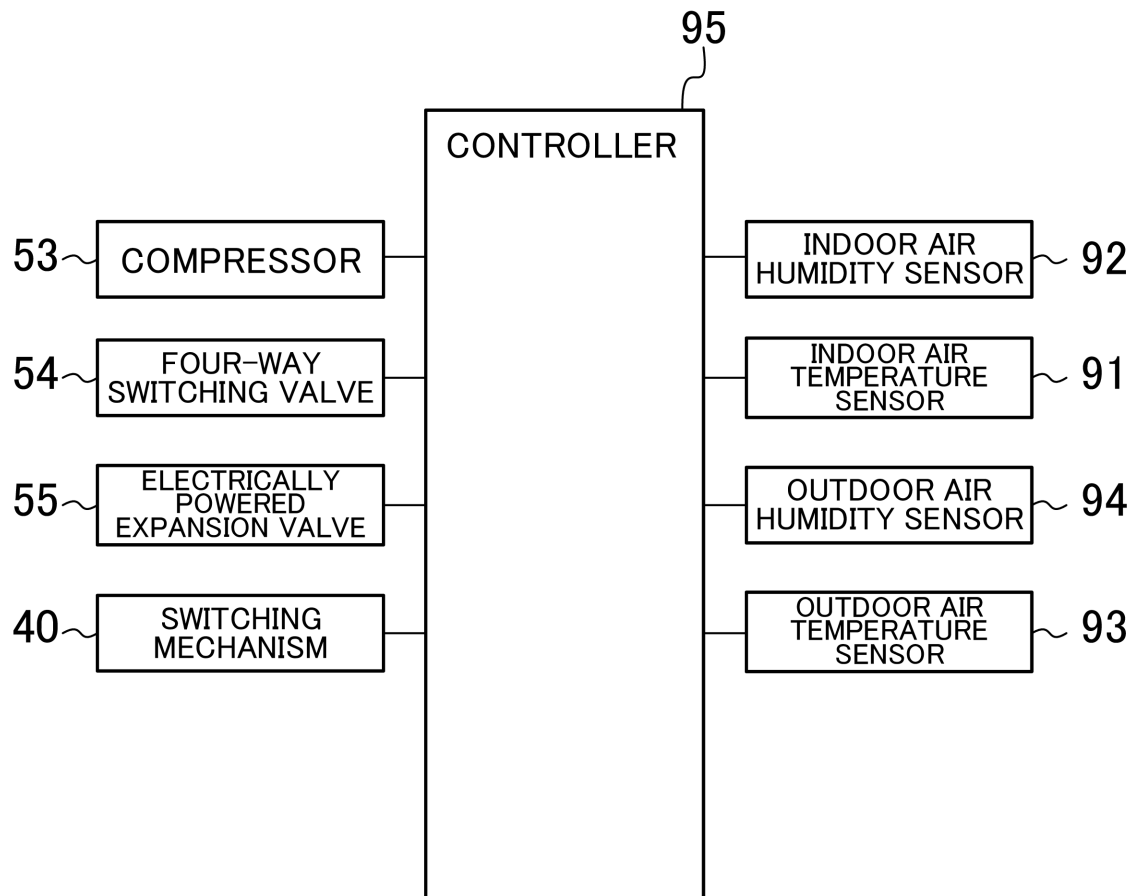


FIG.4

 FIRST AIR (OUTDOOR AIR)
 SECOND AIR (ROOM AIR)


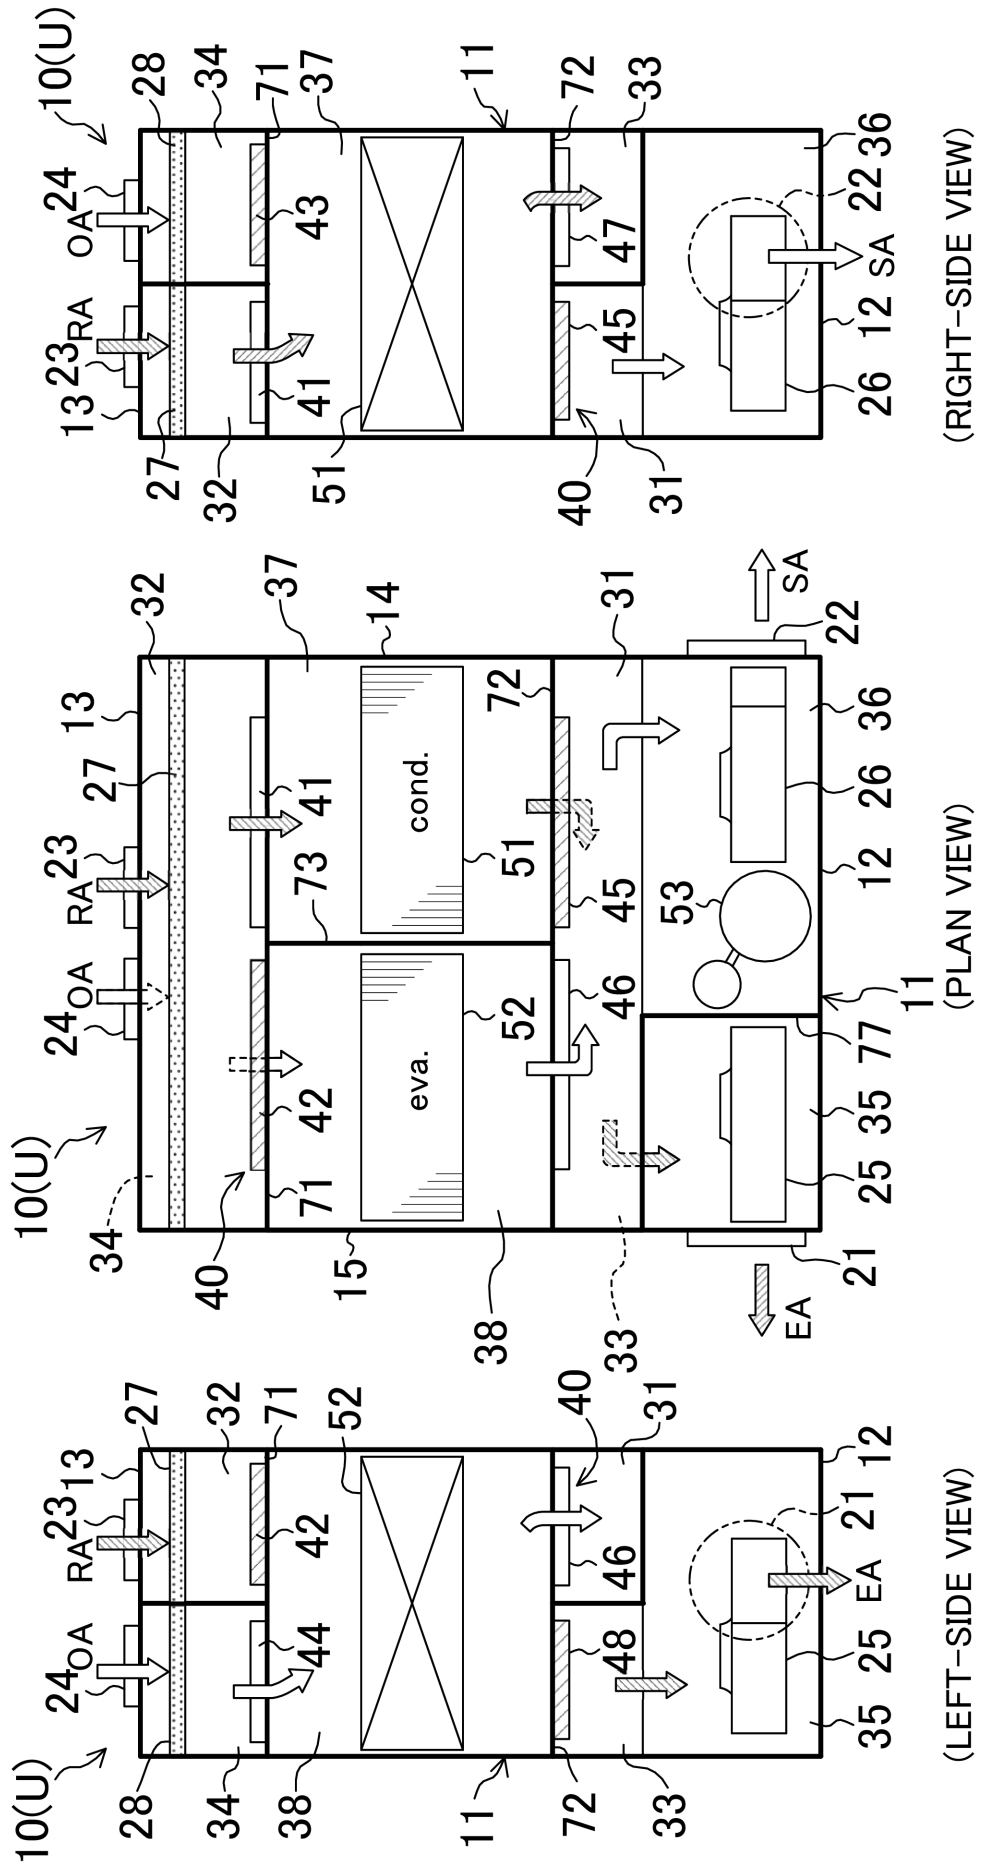


FIG. 5

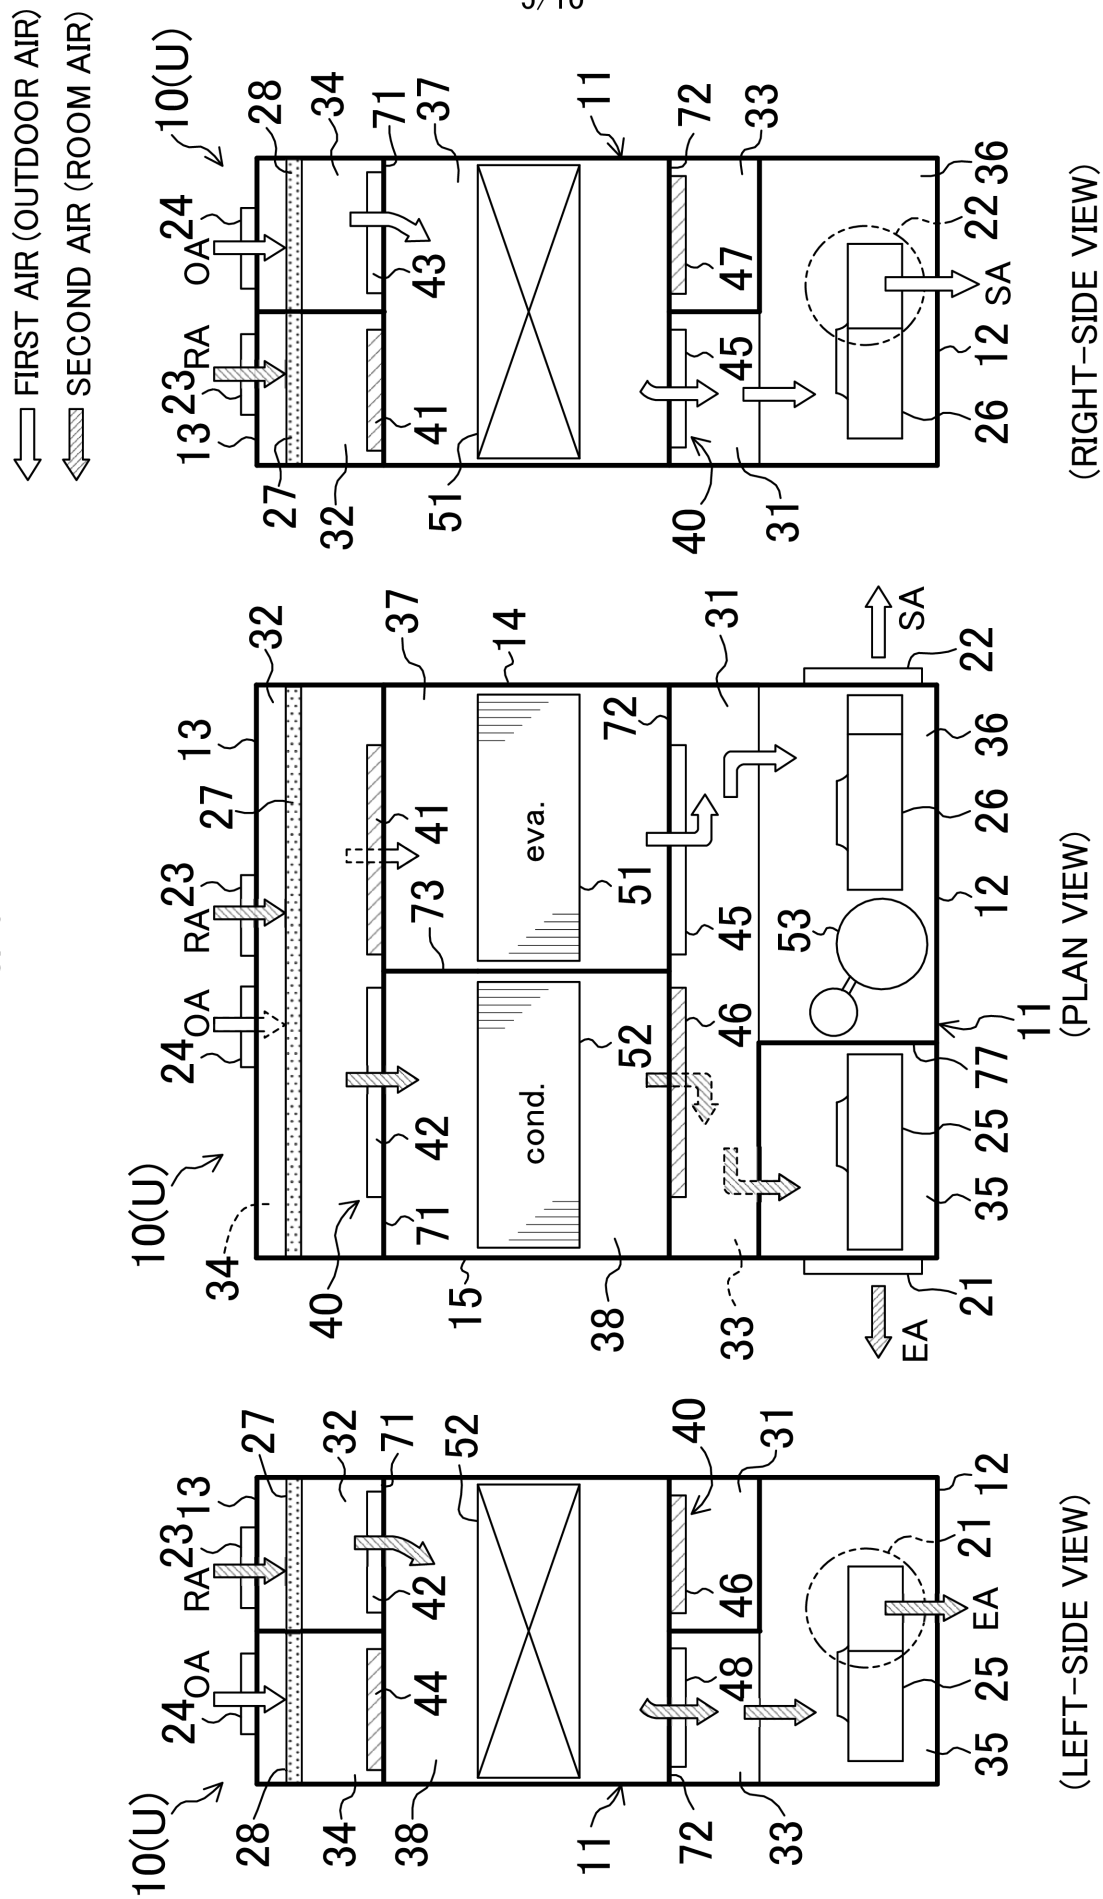

 FIRST AIR (ROOM AIR)
 SECOND AIR (OUTDOOR AIR)

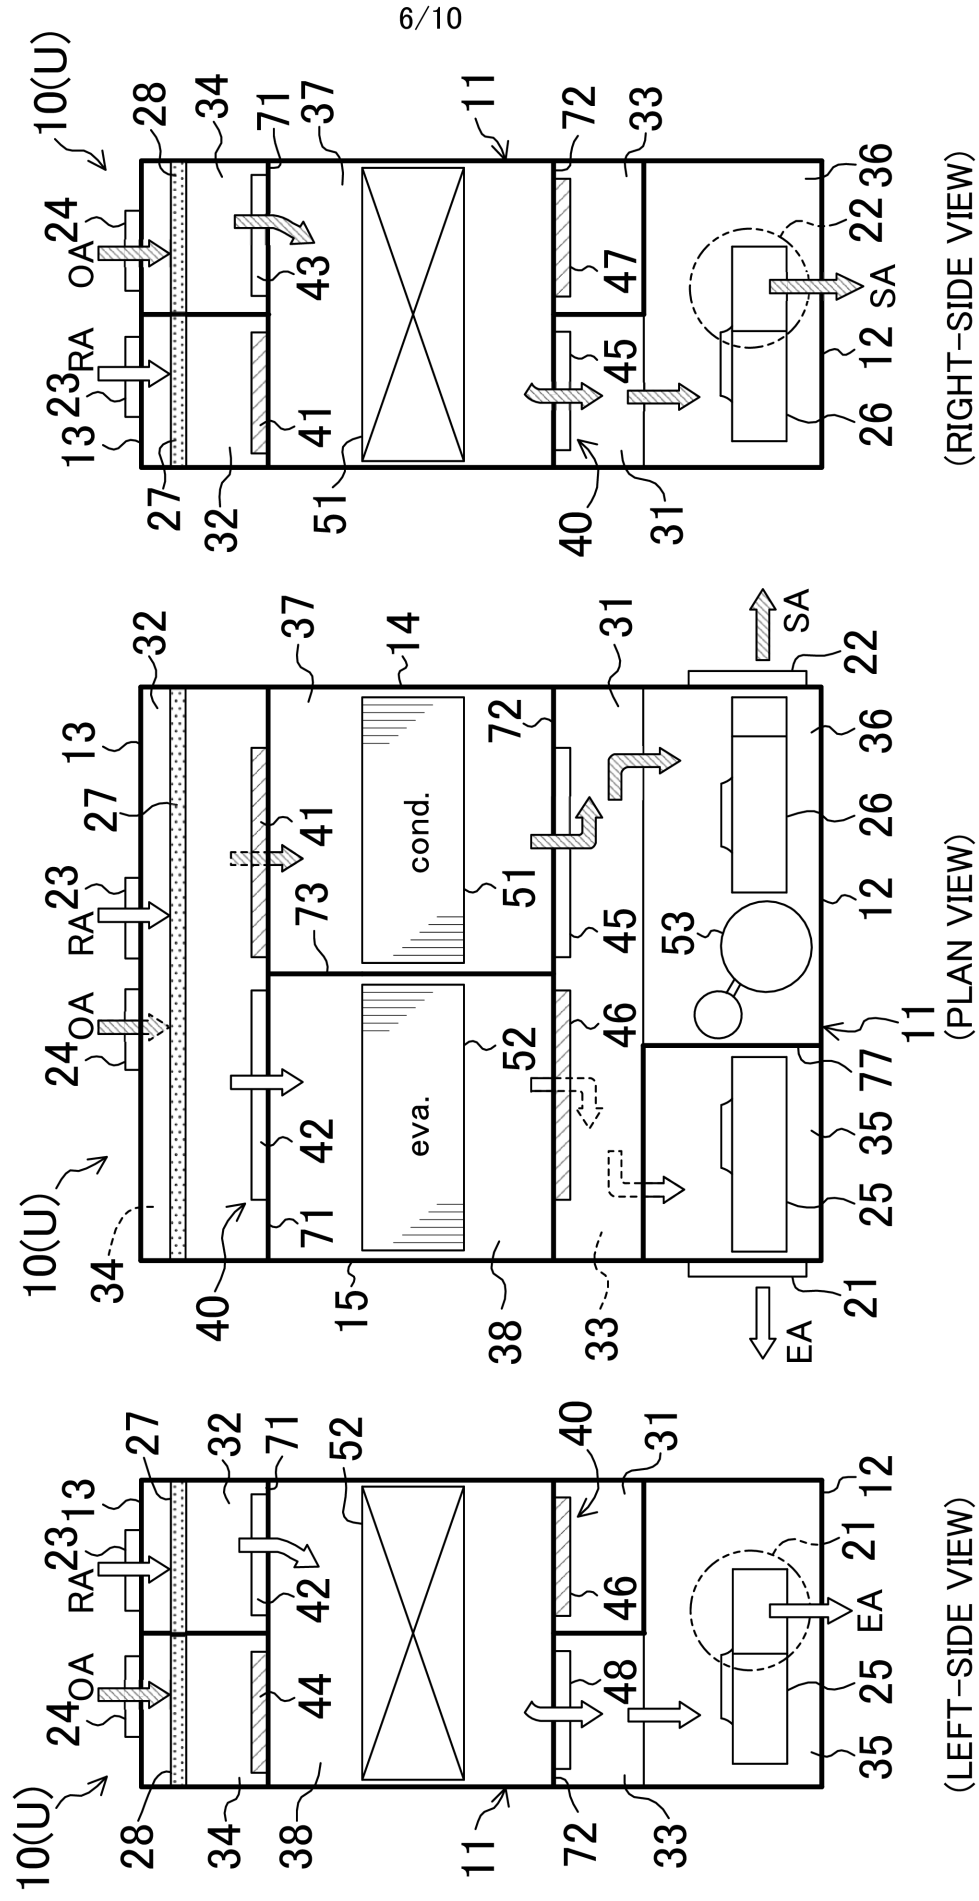


FIG. 7

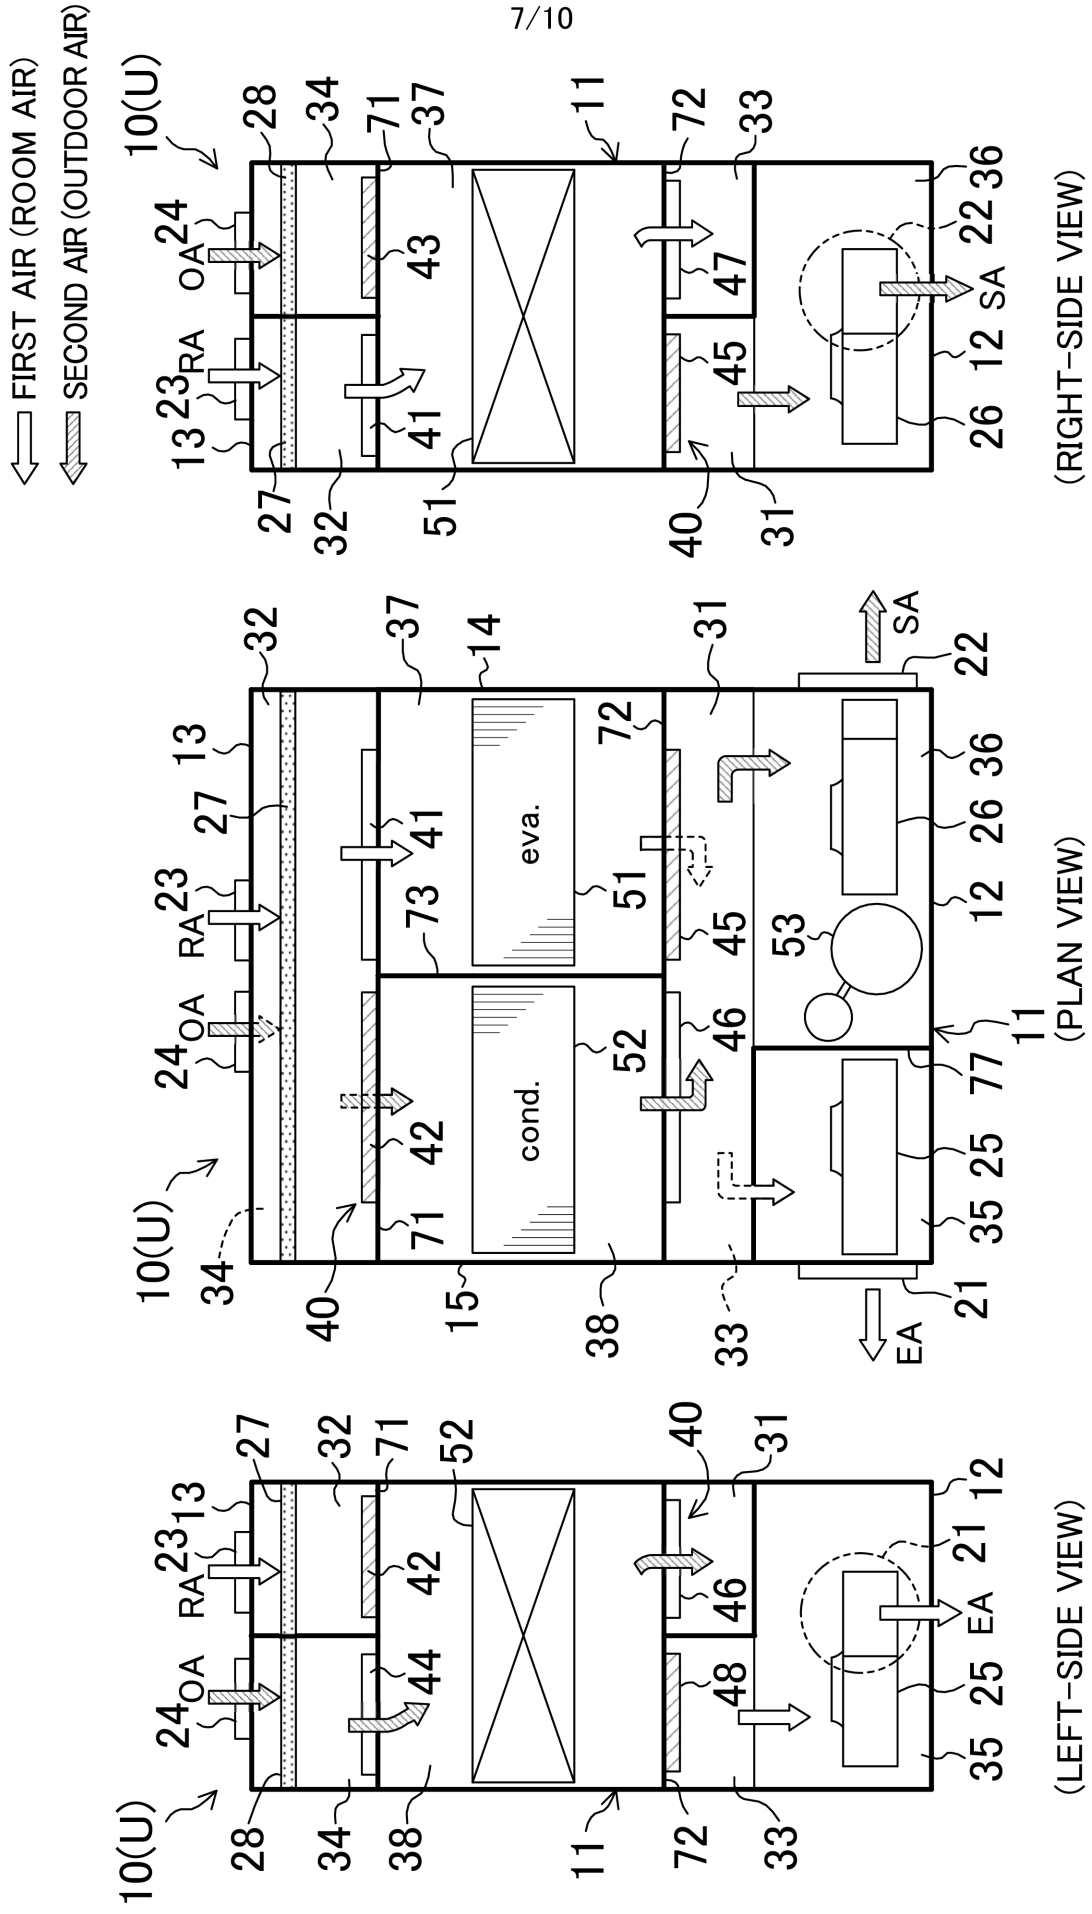


FIG.8

(DEHUMIDIFYING OPERATION)

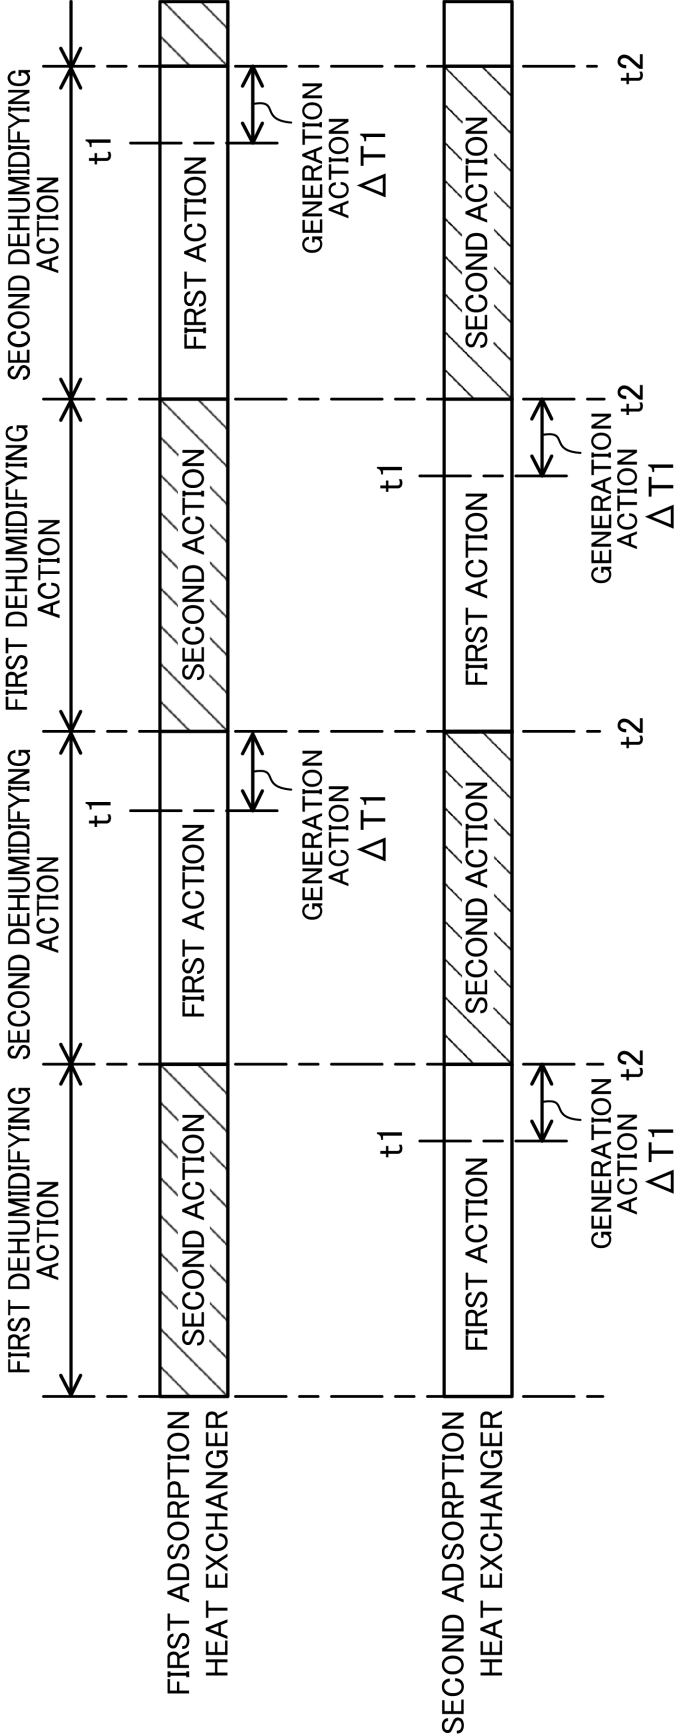


FIG.9

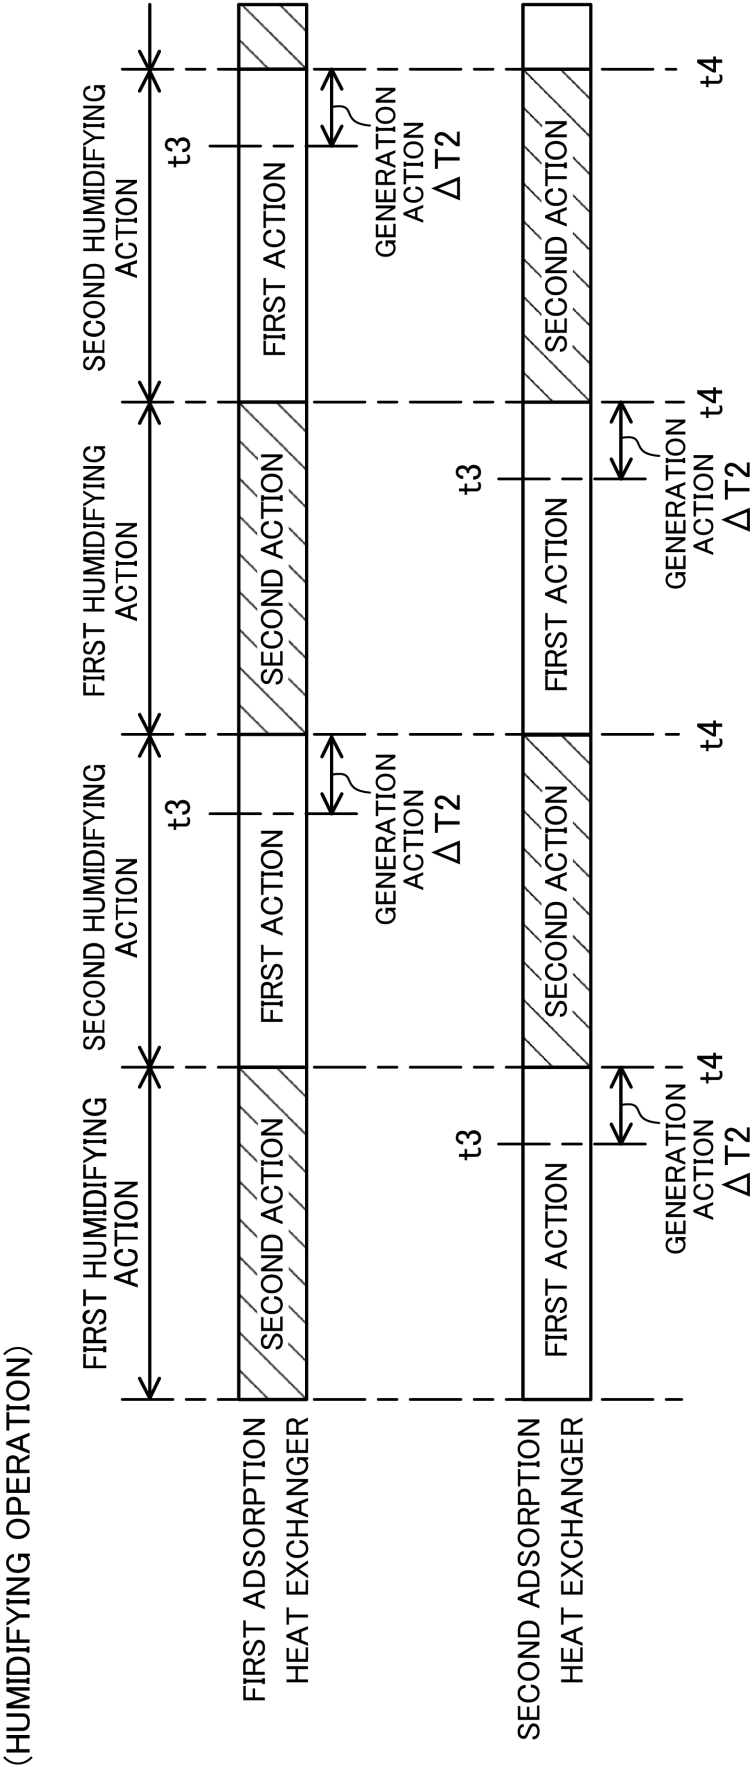


FIG.10

	CRITICAL GROWTH RANGE	OPTIMAL GROWTH RANGE
MOLD	2. 0~8. 5	4. 0~4. 5
YEAST	3. 0~	4. 0~5. 0
GENERAL BACTERIA	5. 0~5. 5	6. 0~7. 0
SPANISH INFLUENZA VIRUS	—	4. 0~5. 0