

Figure 1

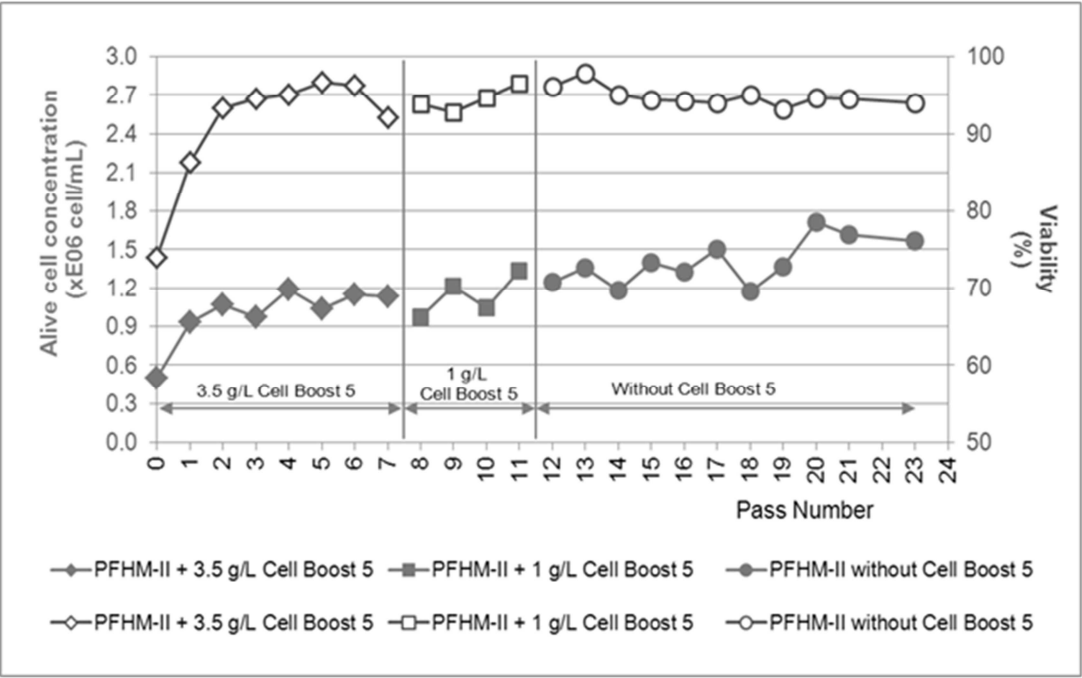


Figure 2

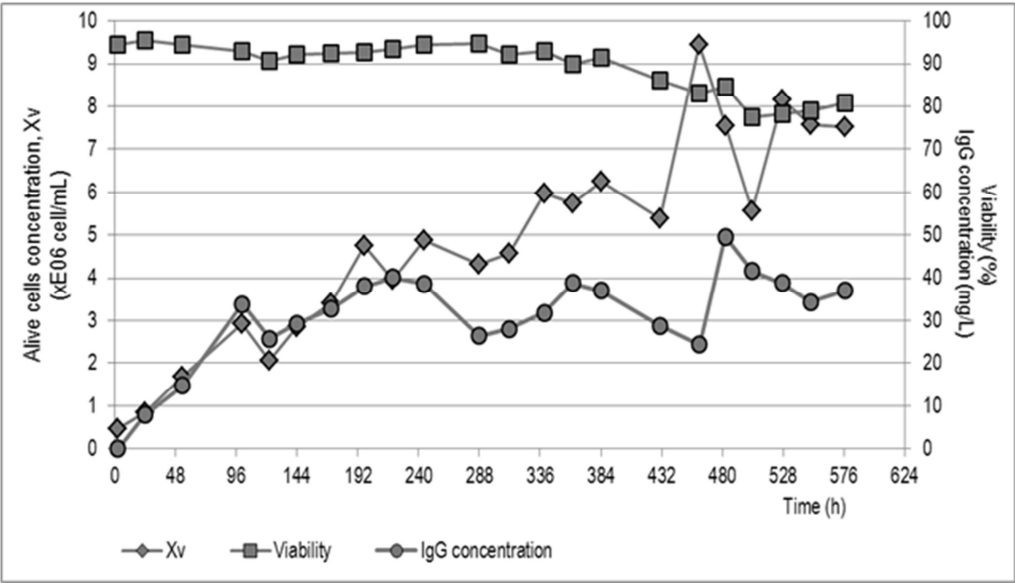


Figure 3

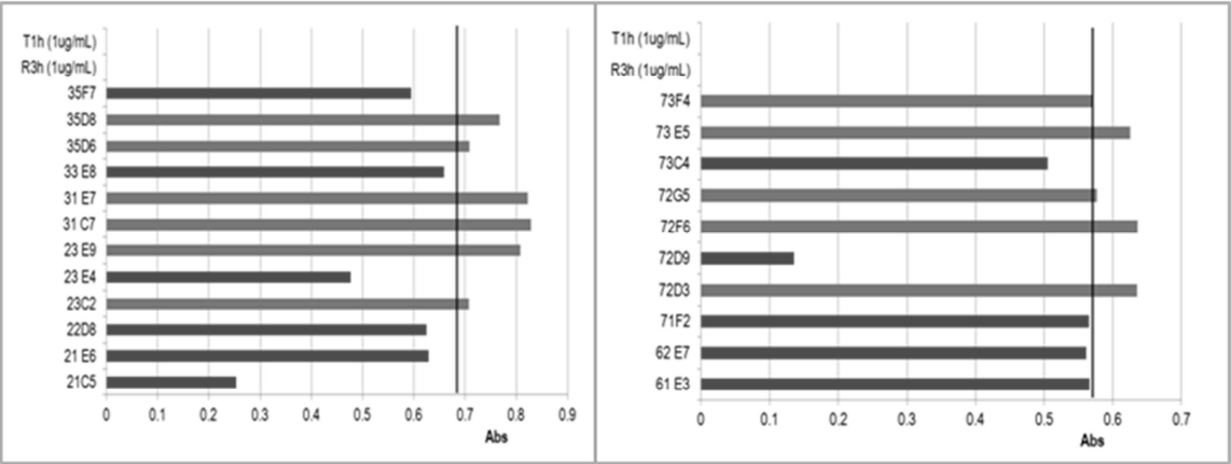


Figure 4

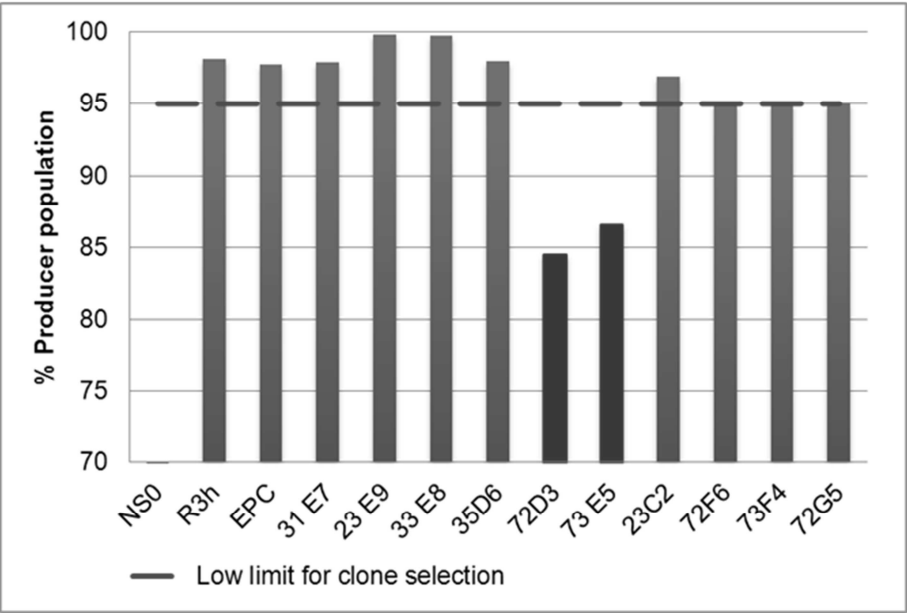


Figure 5

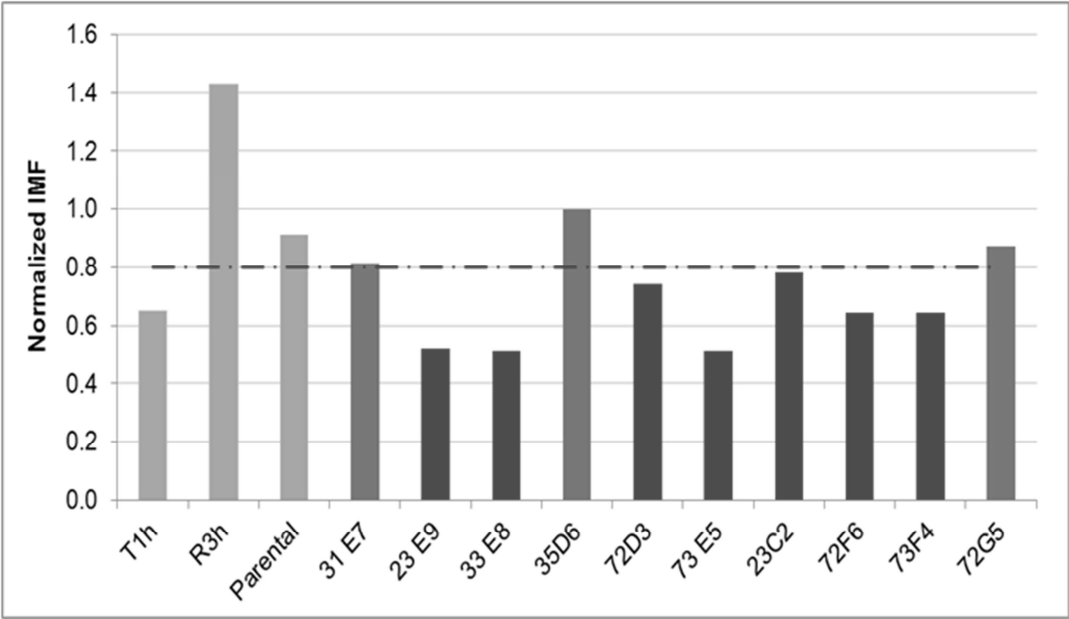


Figure 6

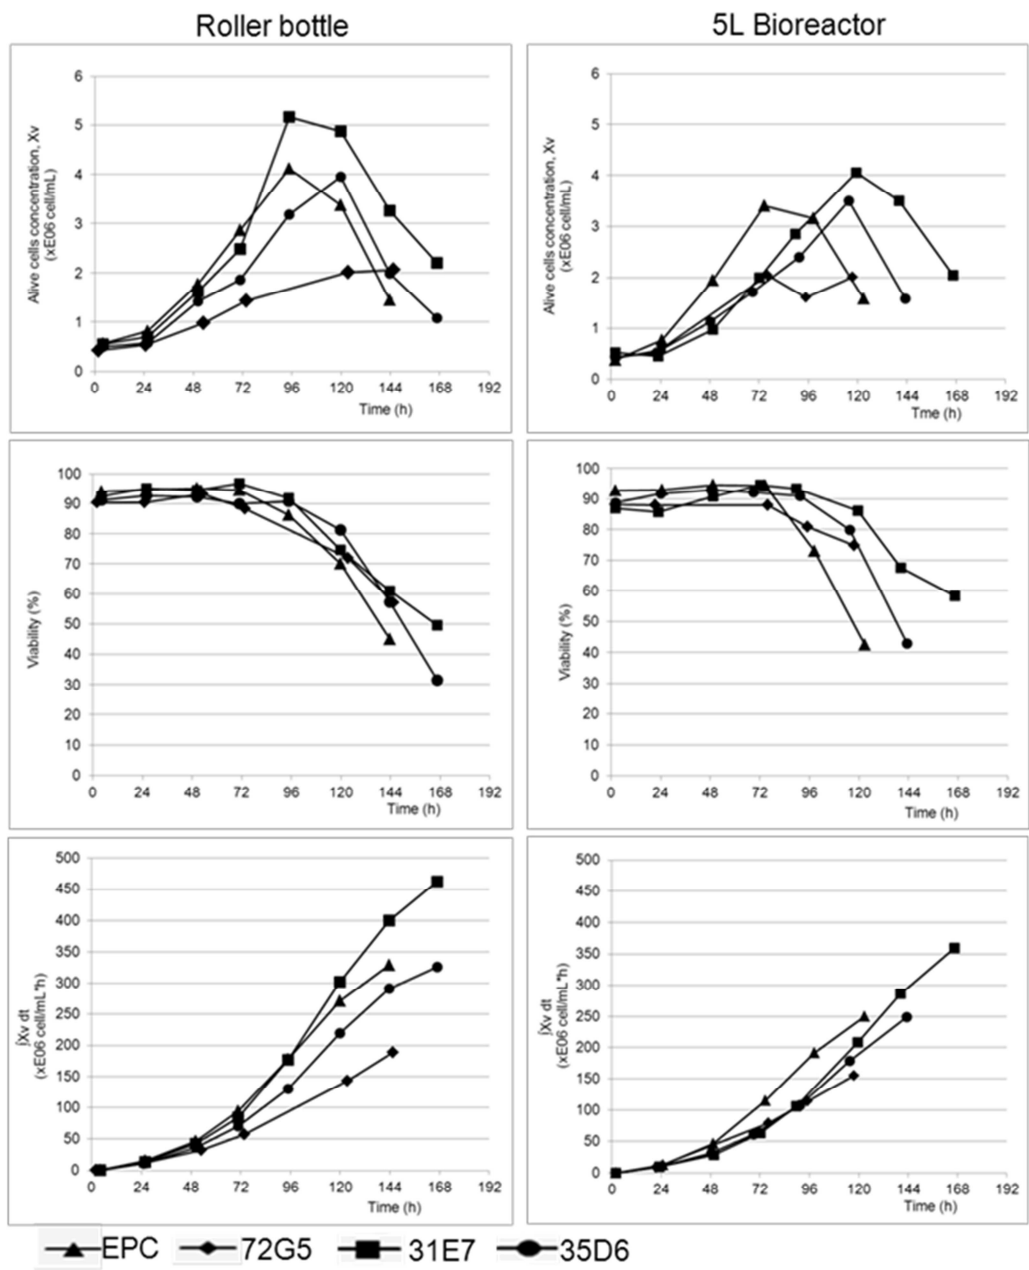


Figure 7

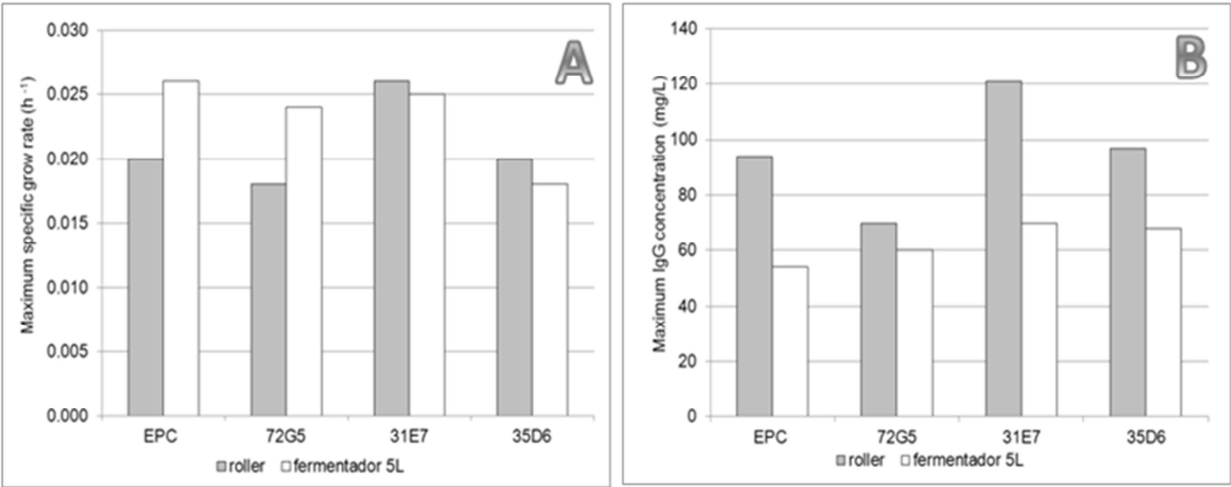


Figure 8



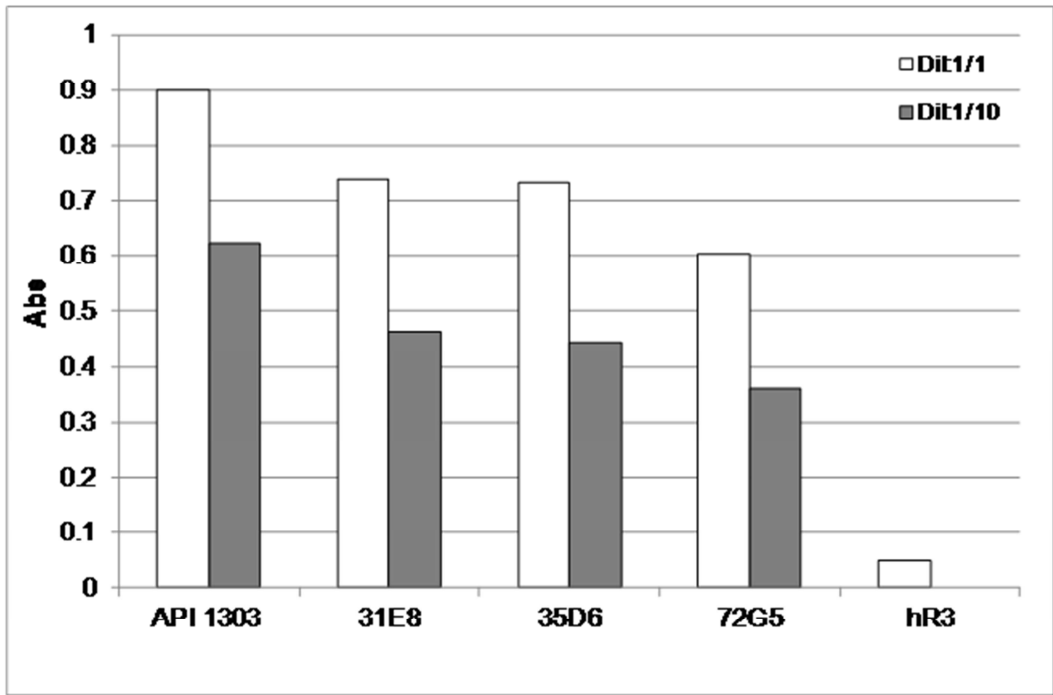


Figure 9


NSO
Negative control

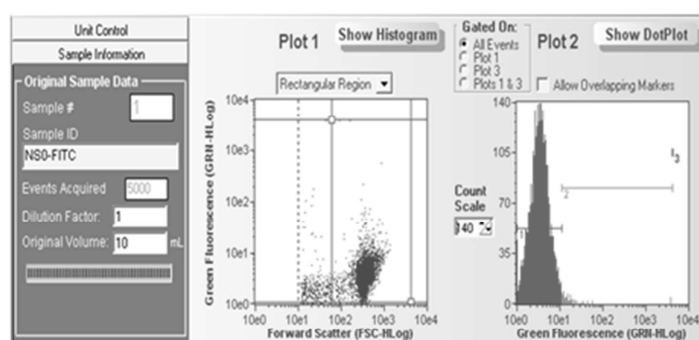

14F7htB58
PFHM II
+
cell boost

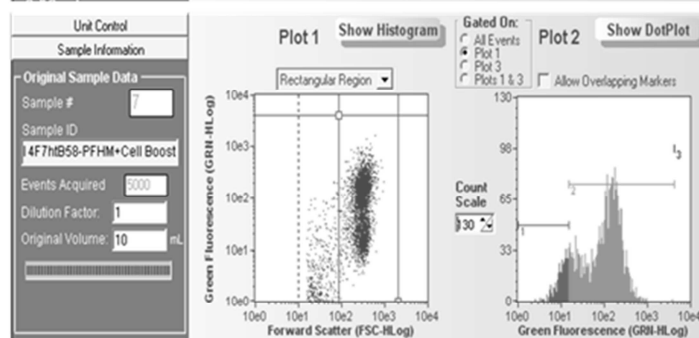

14F7htB58
Adapted PFHM II
+
Perfusion

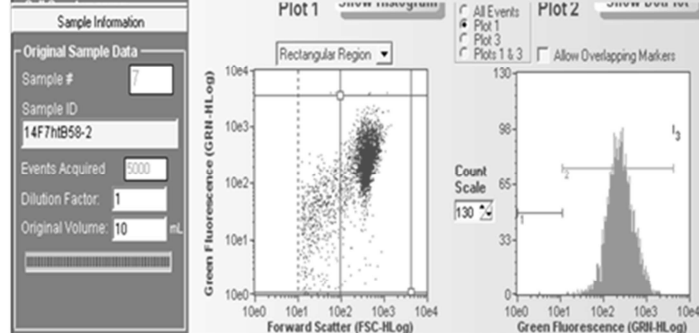

Clon
14F7htB58-31E7
PFHM II

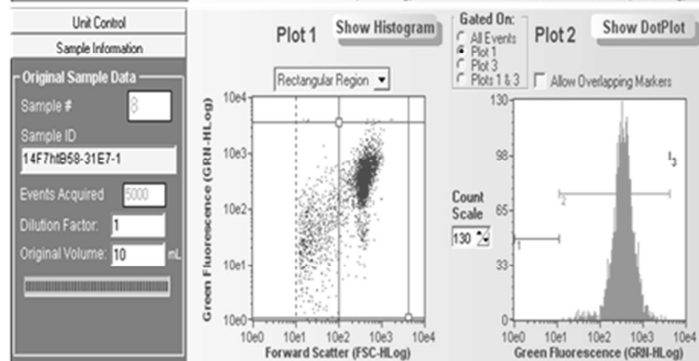


Figure 10

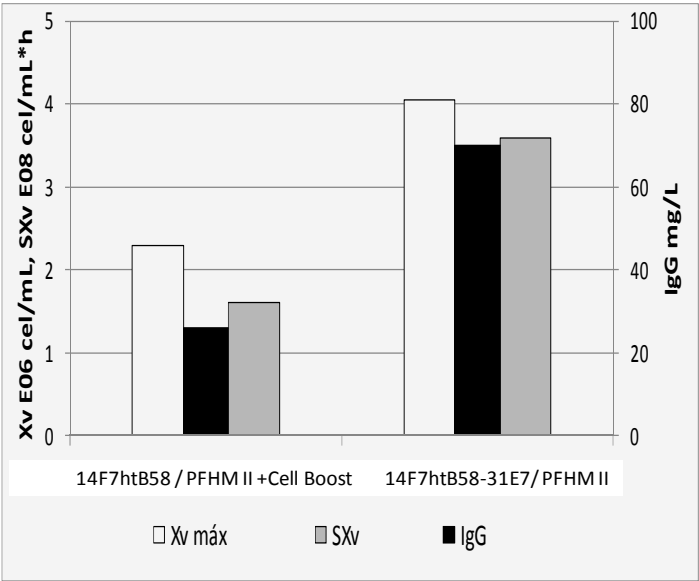


Figure 11



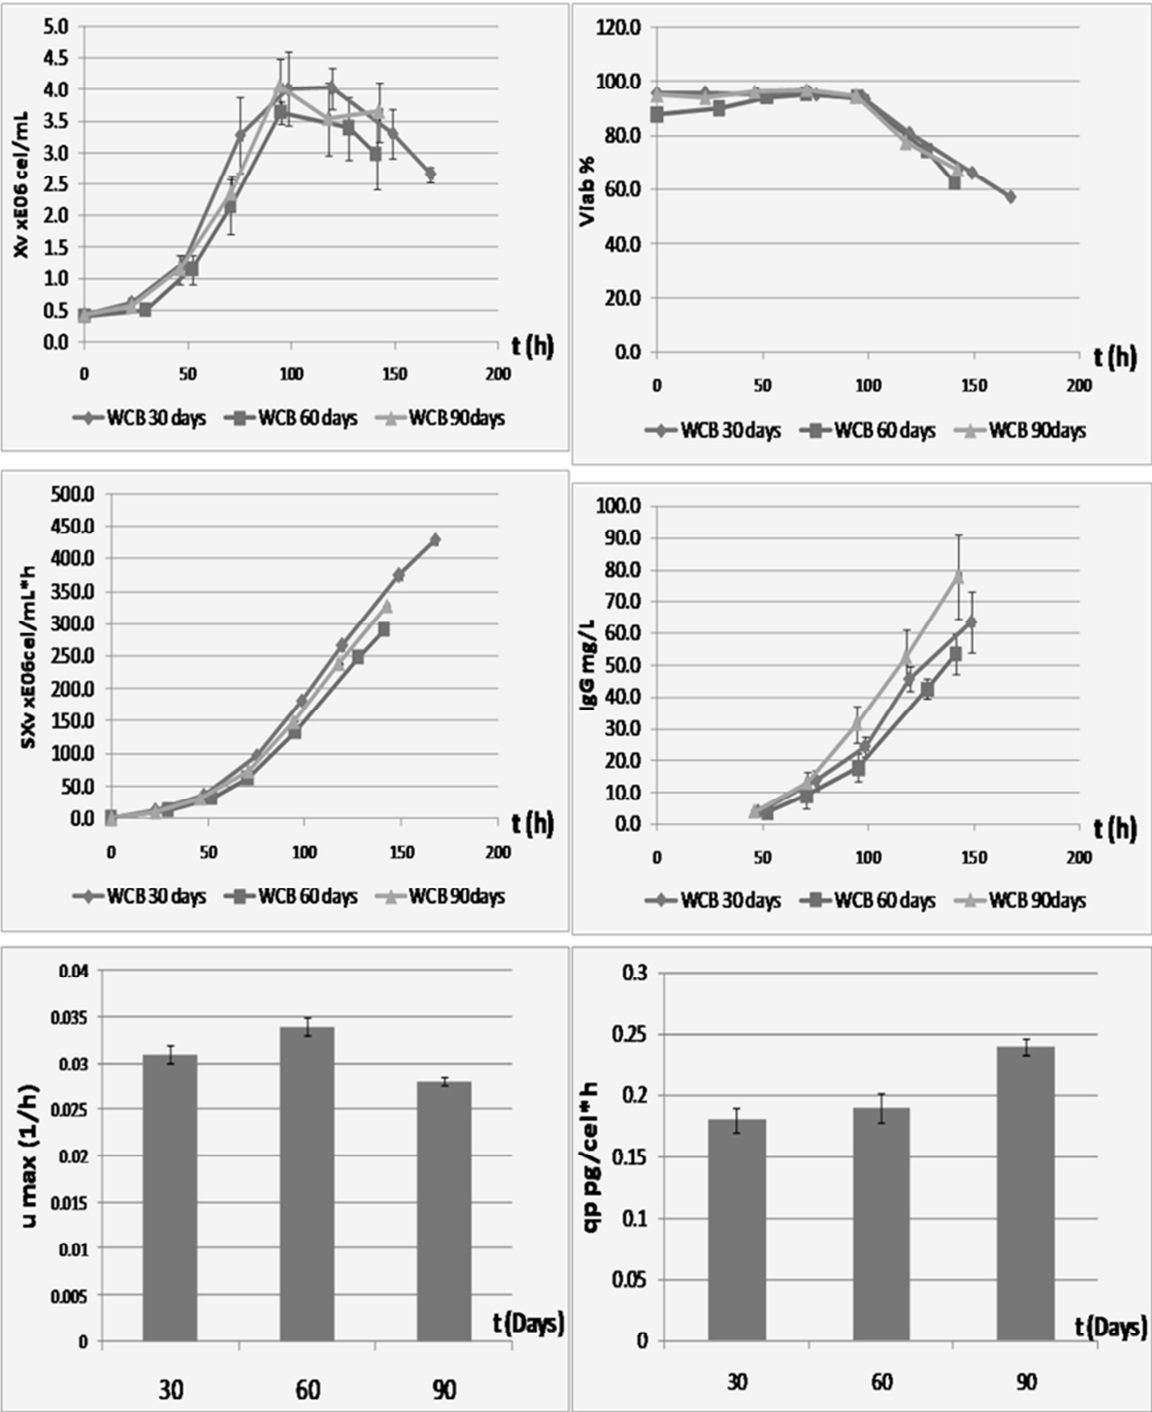


Figure 12


**14 days
MCB-Amp 47**

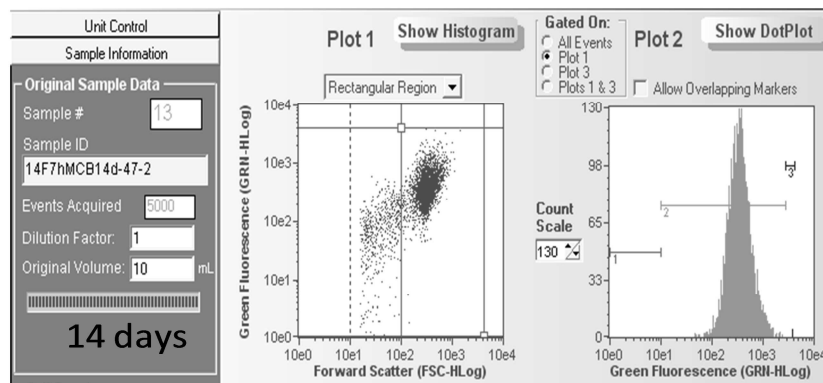

**> 90 days
WCB-Amp 12**

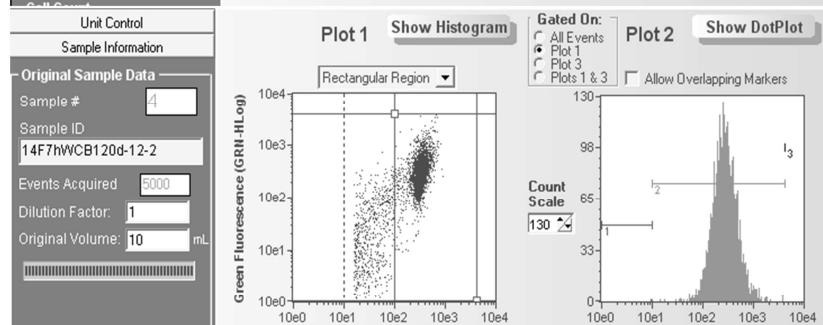

**> 90 days
WCB-Amp 51**

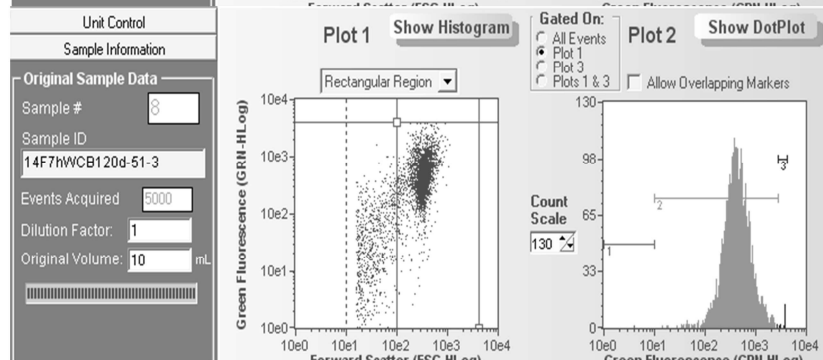

**> 90 days
WCB-Amp 92**

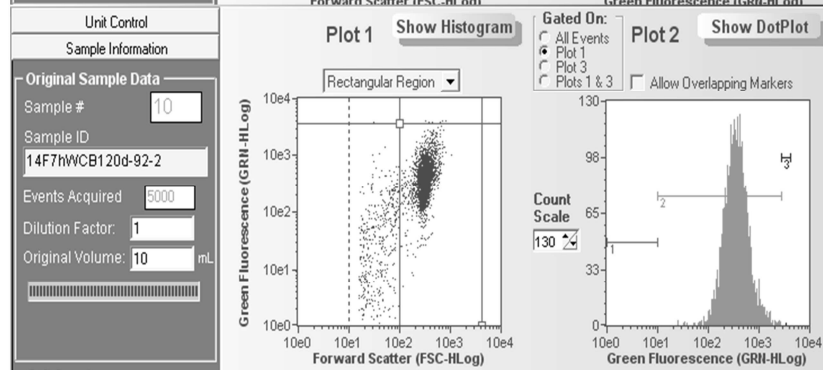


Figure 13

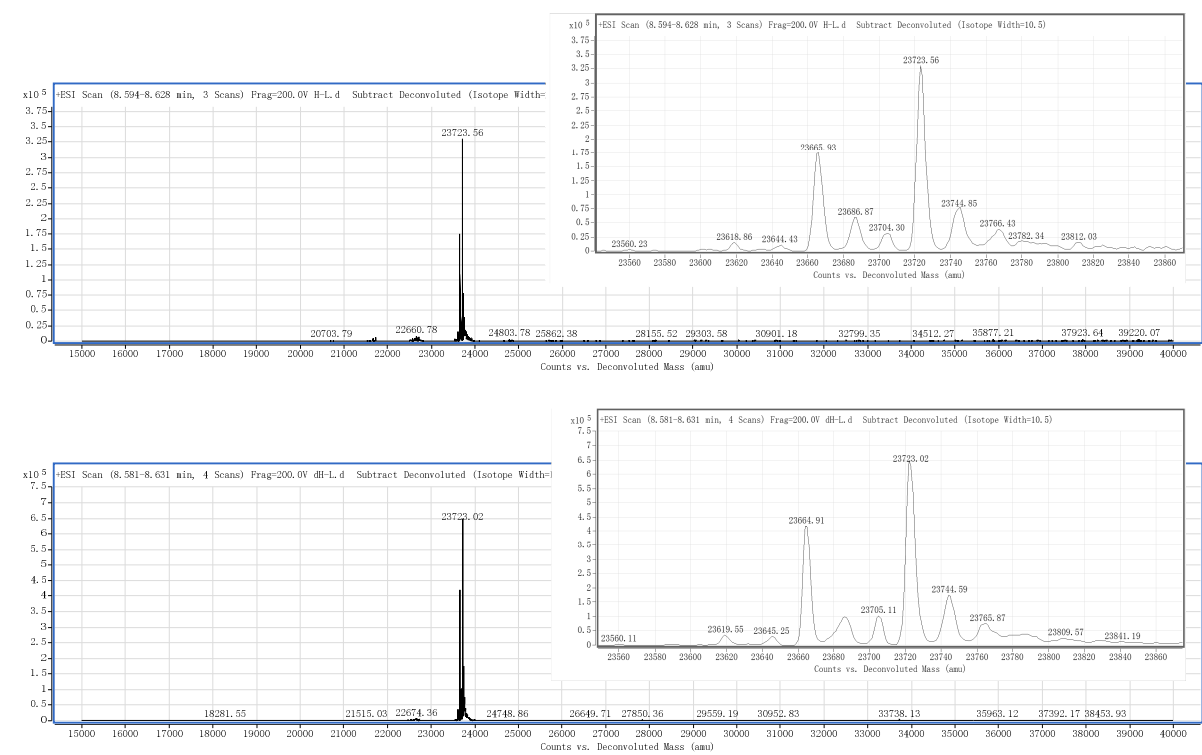


Figure 14

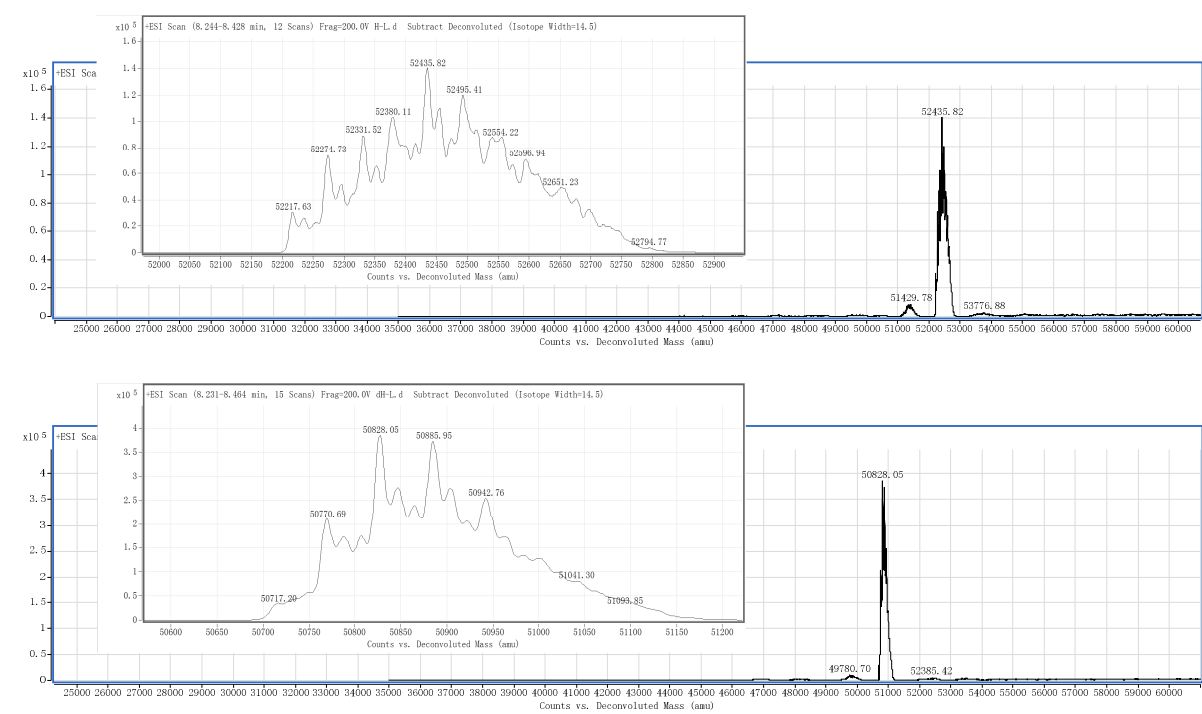


Figure 15

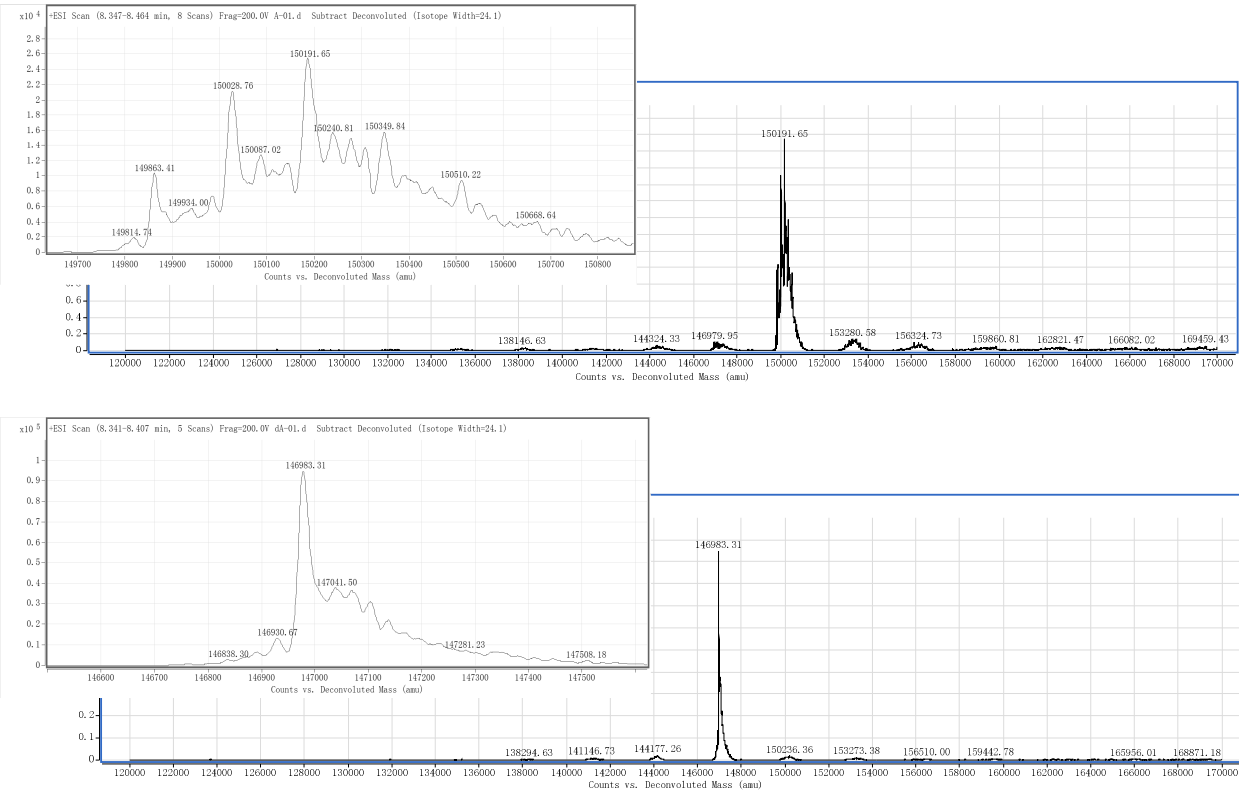


Figure 16

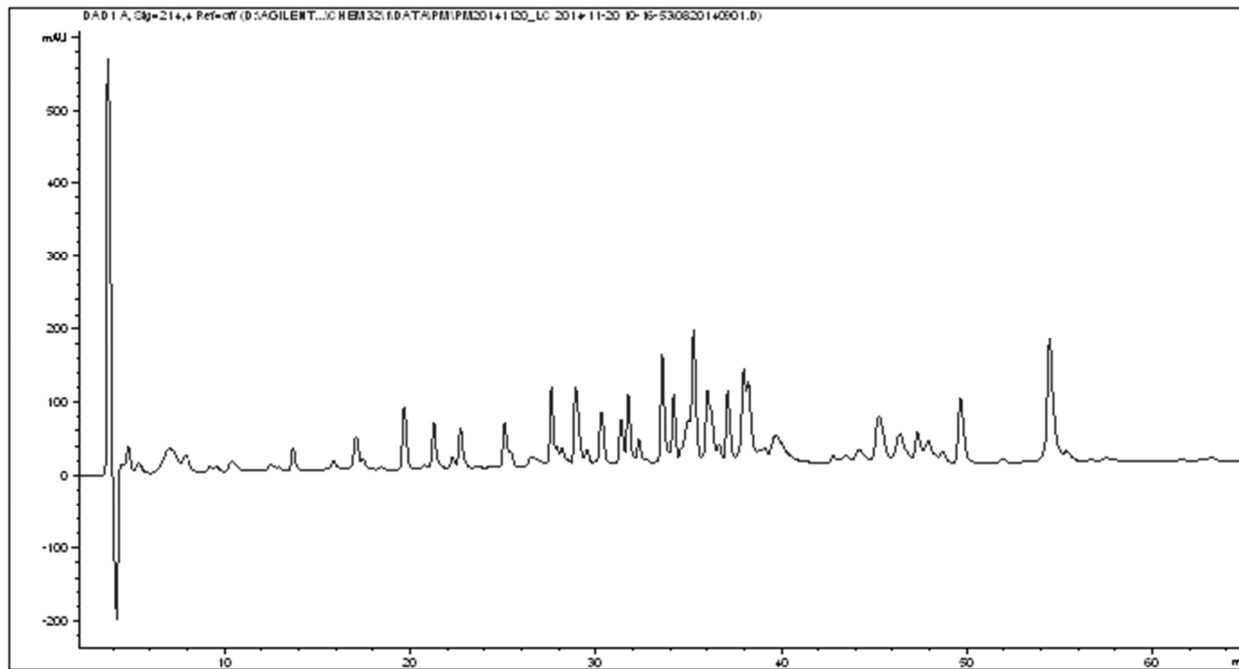


Figure 17

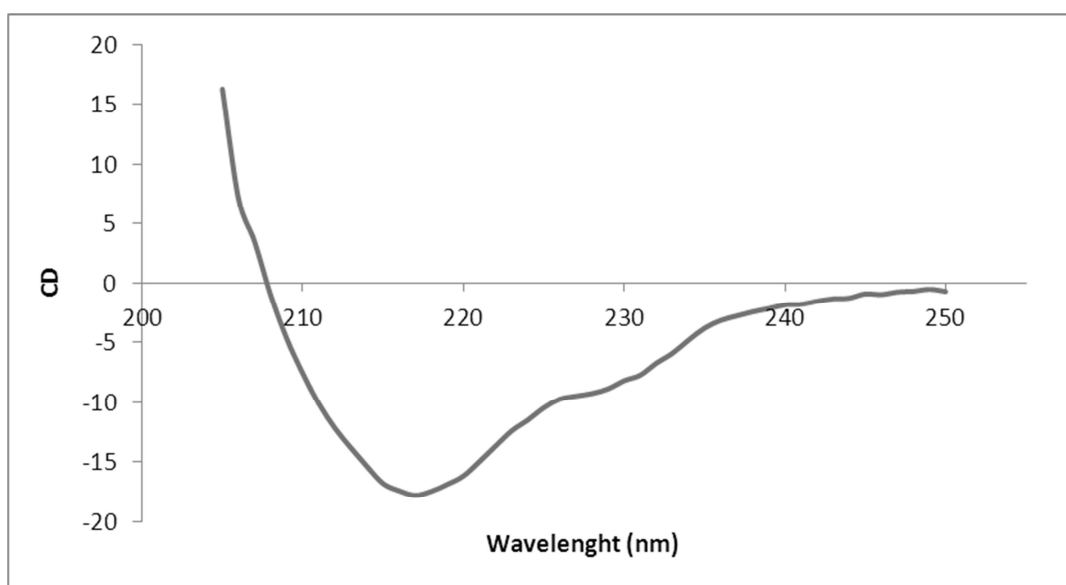


Figure 18

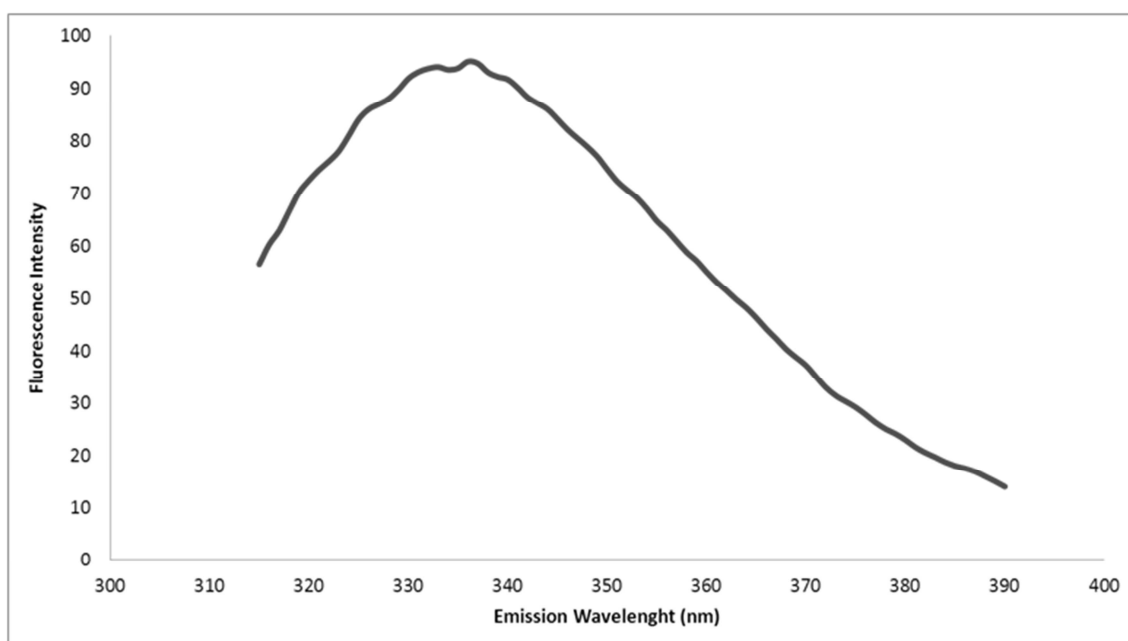


Figure 19

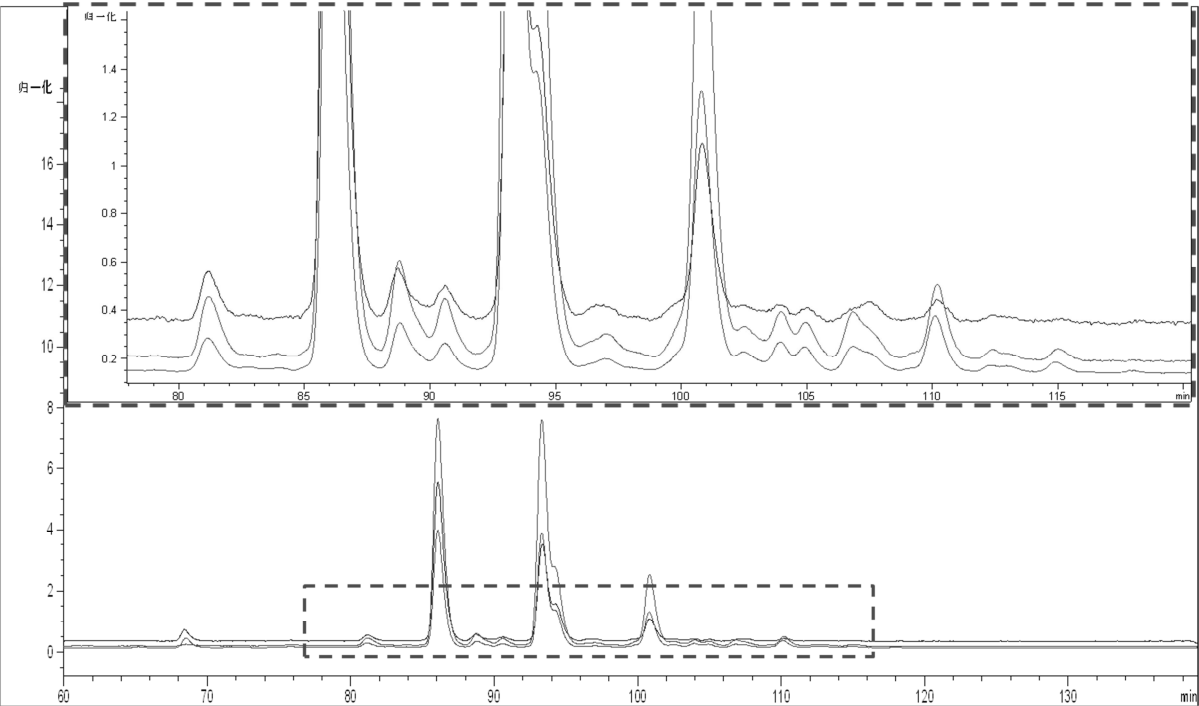


Figure 20

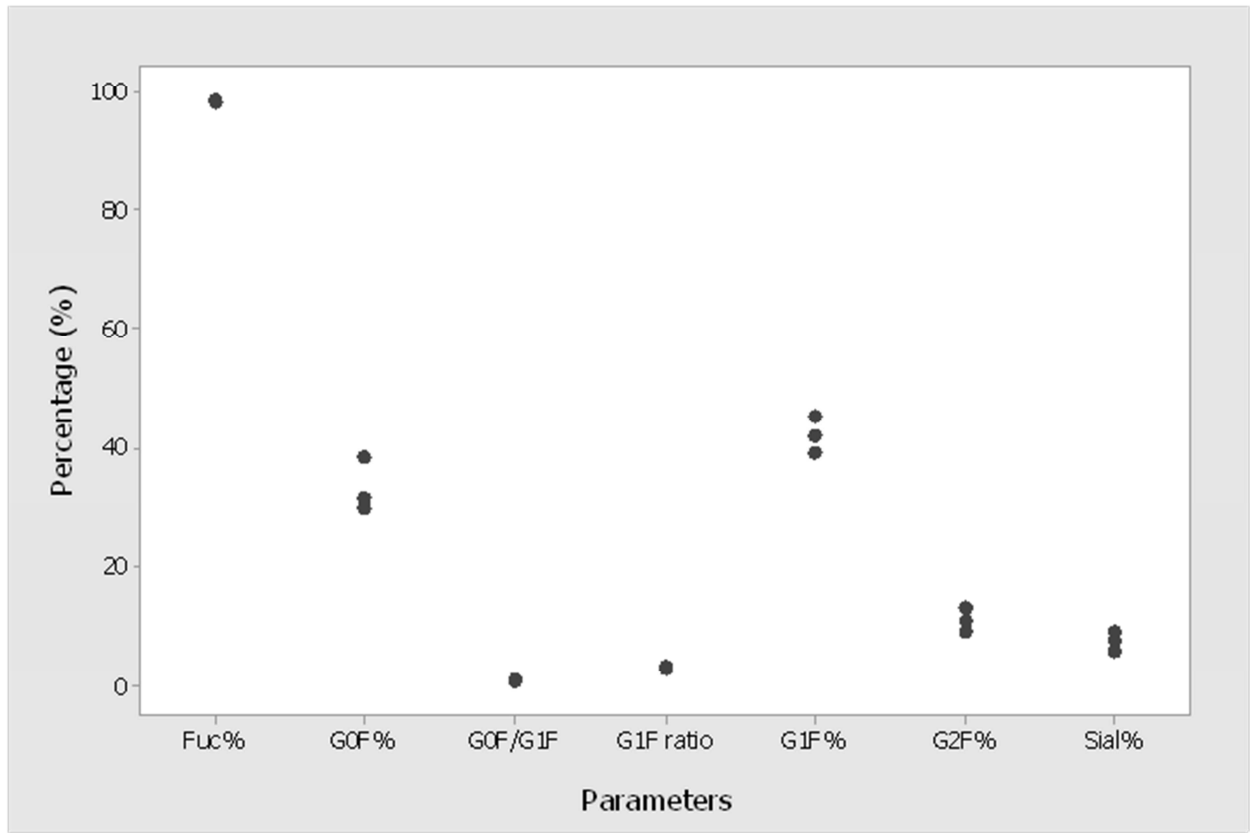


Figure 21

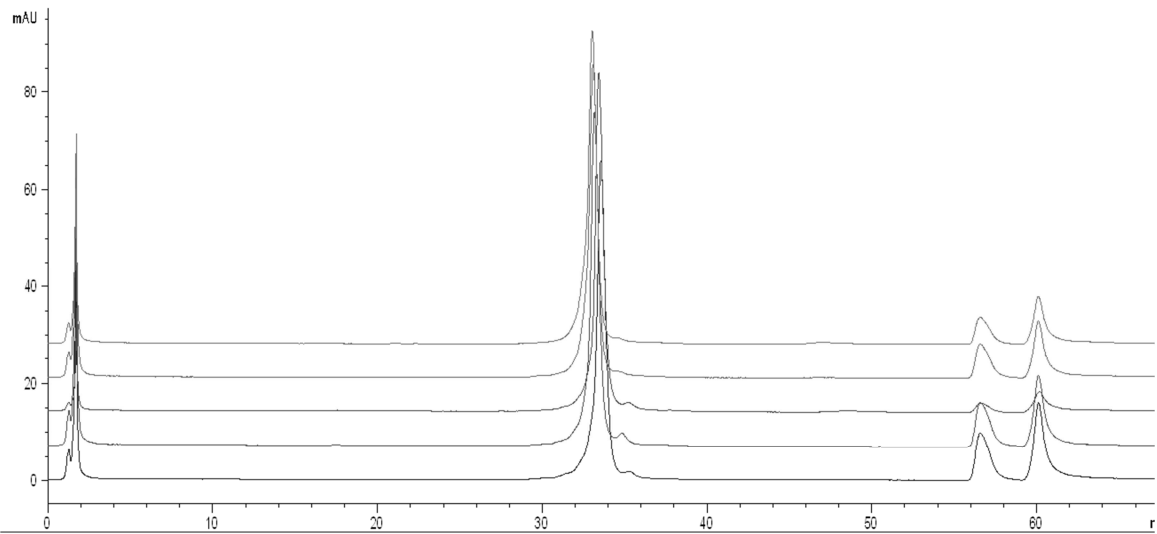


Figure 22

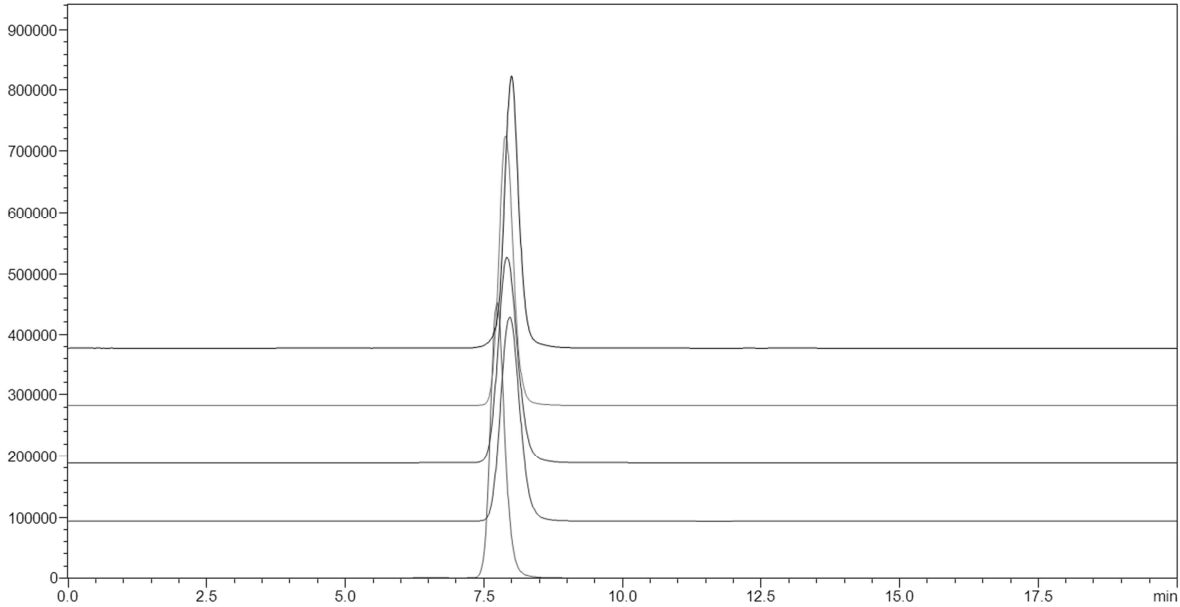


Figure 23

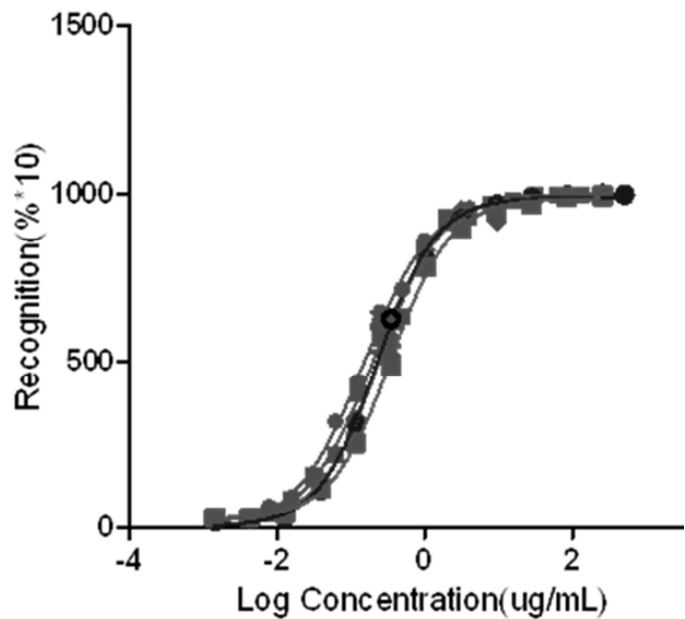


Figure 24

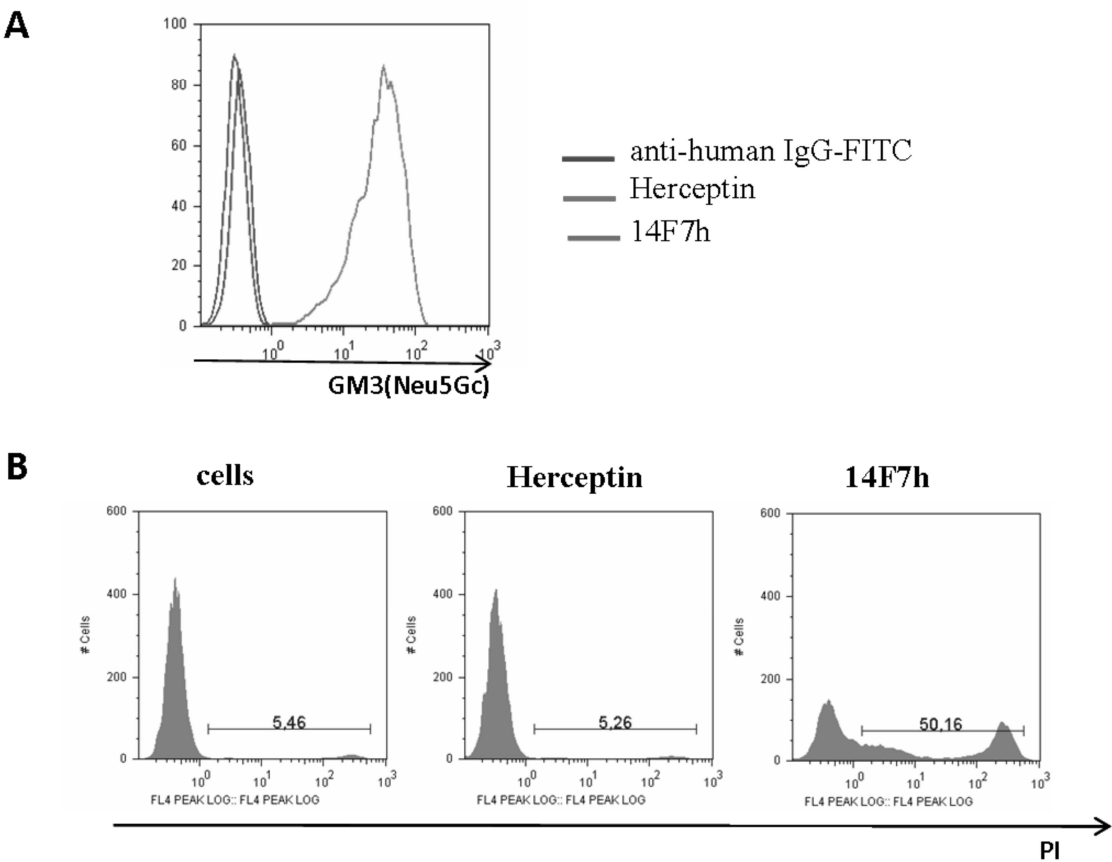


Figure 25

