

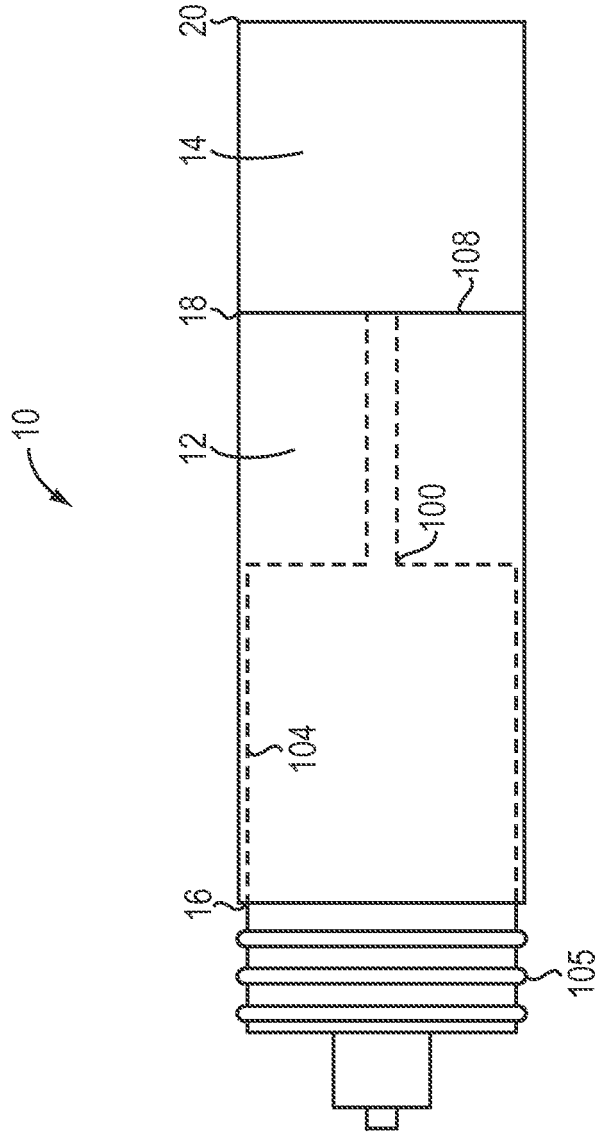


FIG. 1

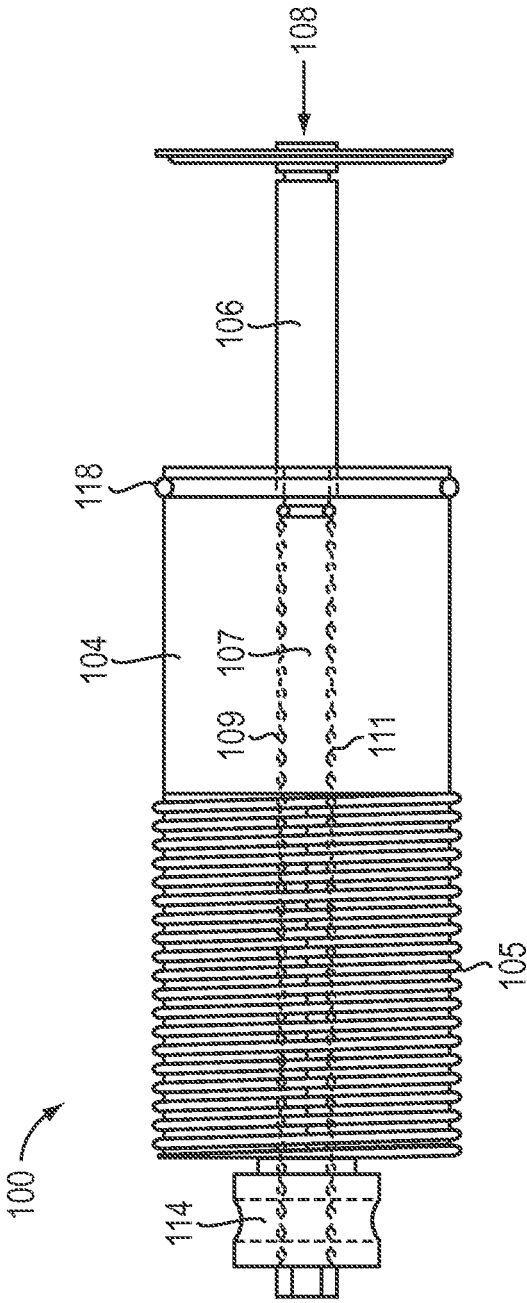


FIG. 2

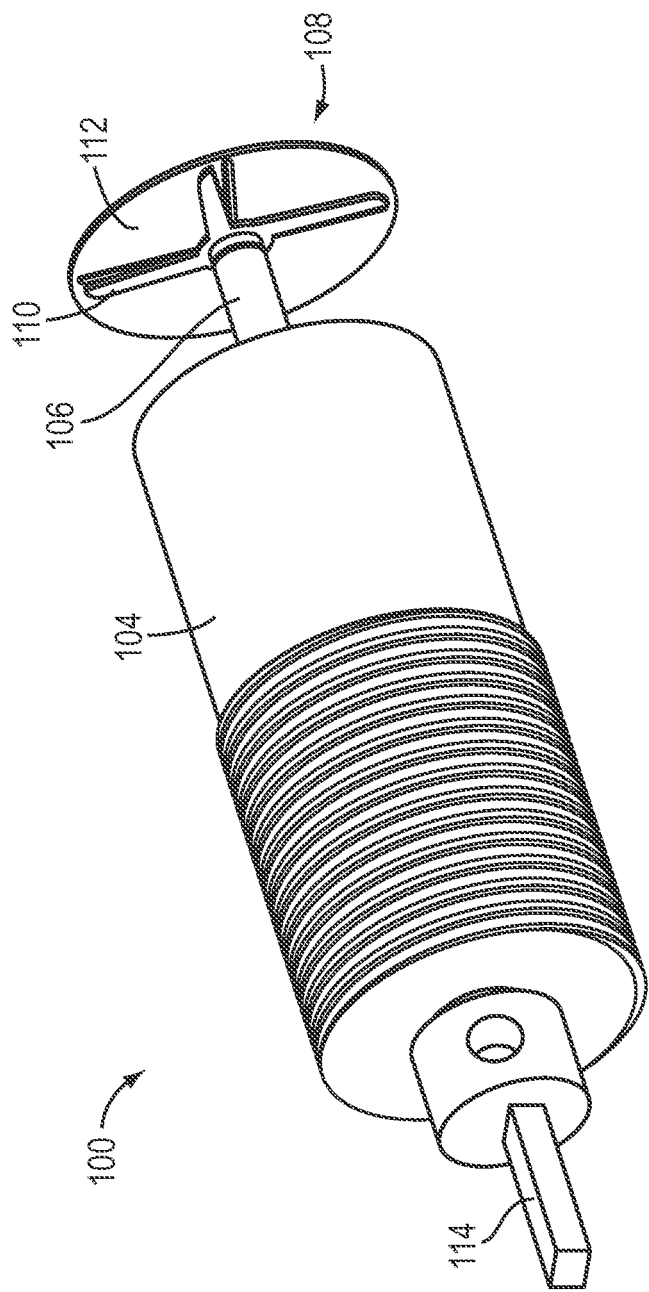


FIG. 3

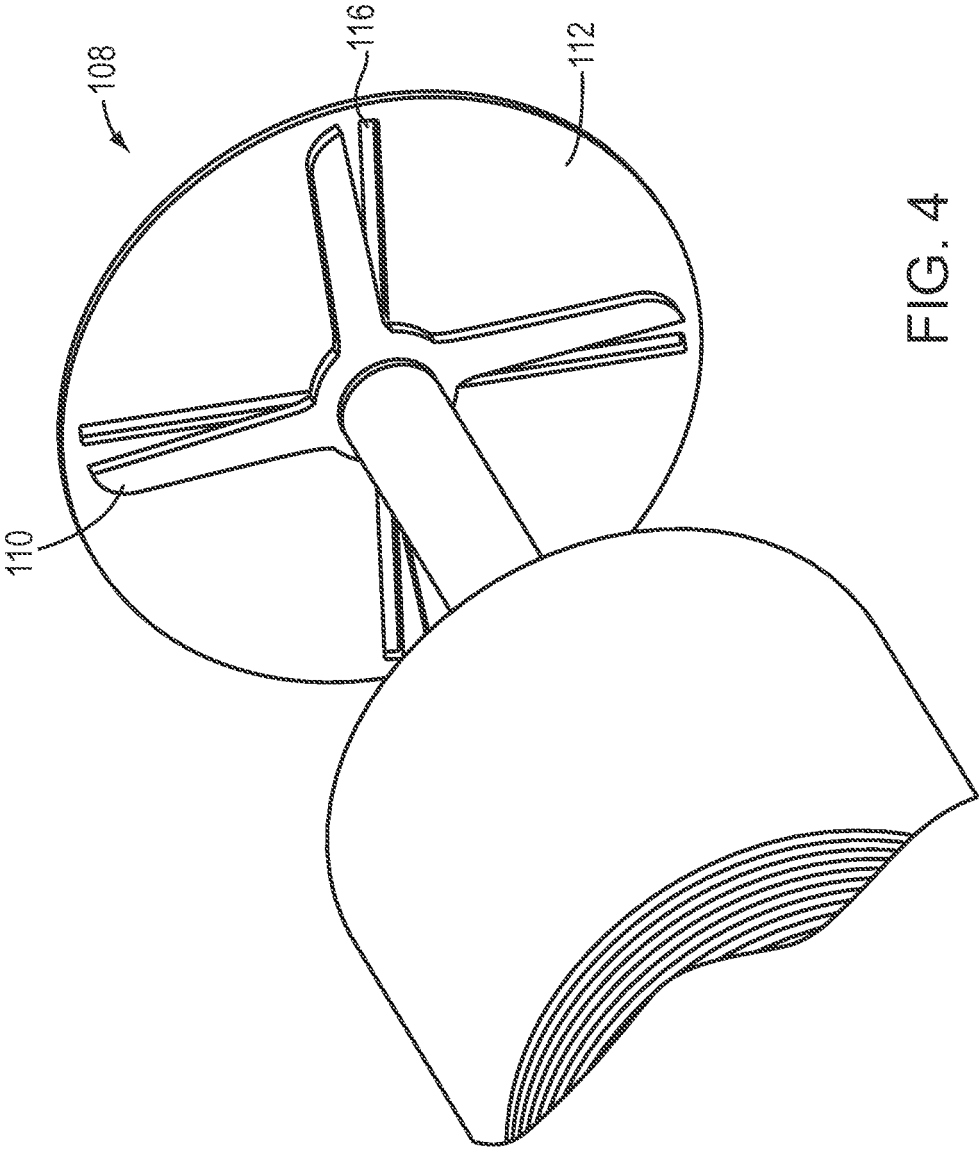


FIG. 4

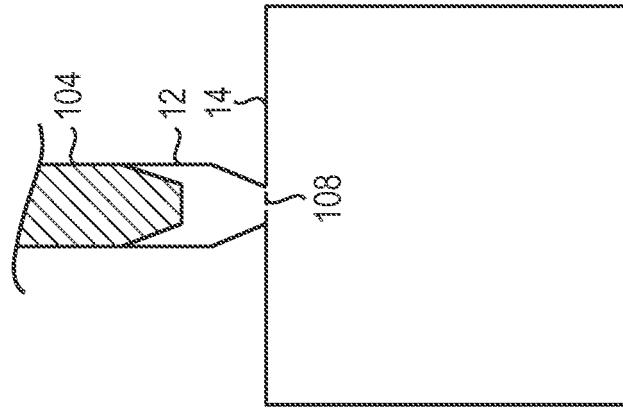


FIG. 5B

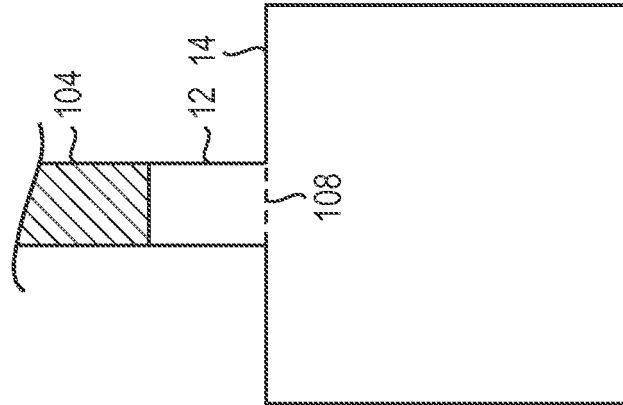


FIG. 5A

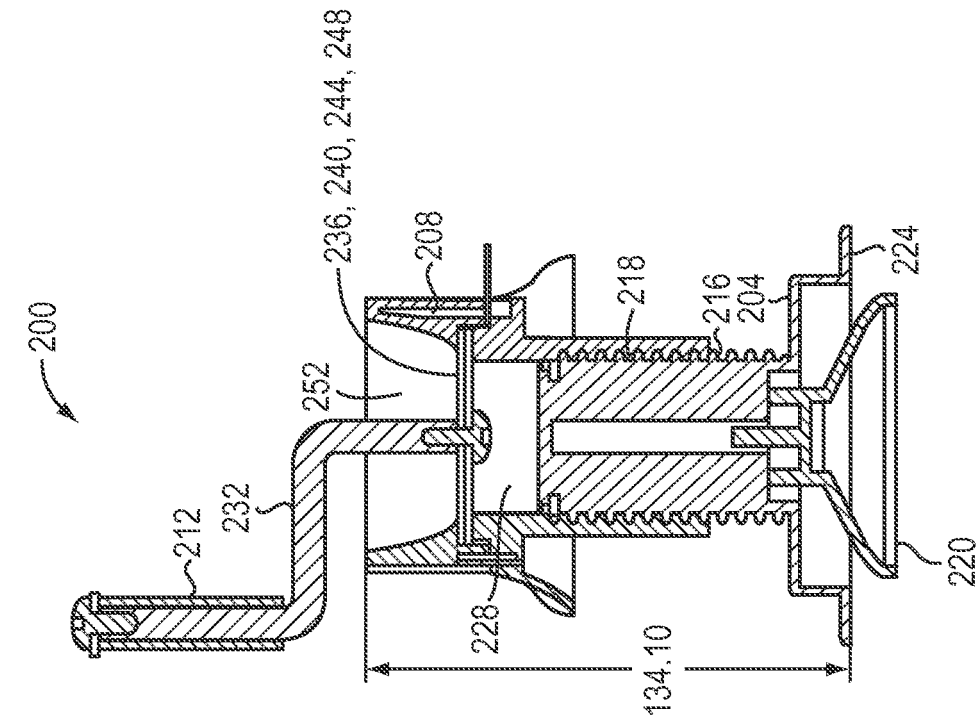


FIG. 6B

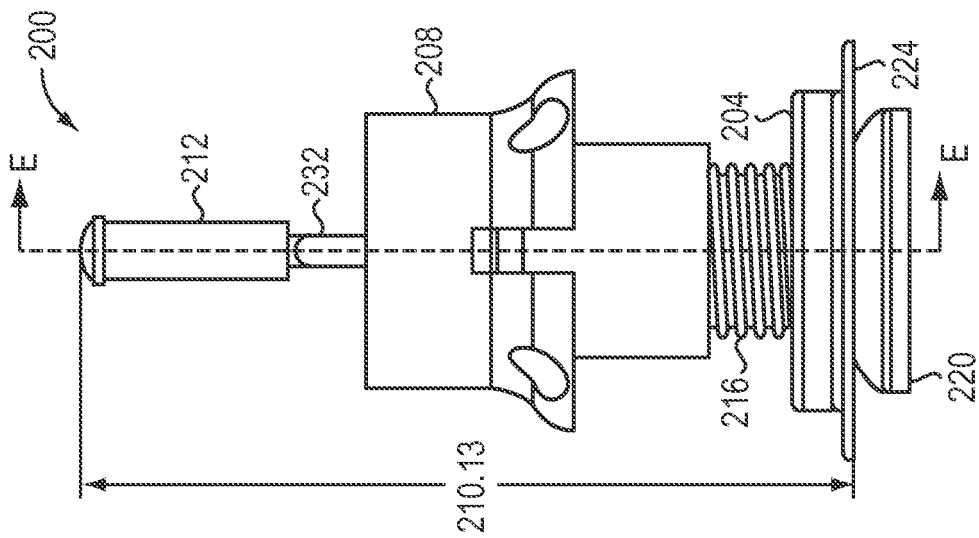


FIG. 6A

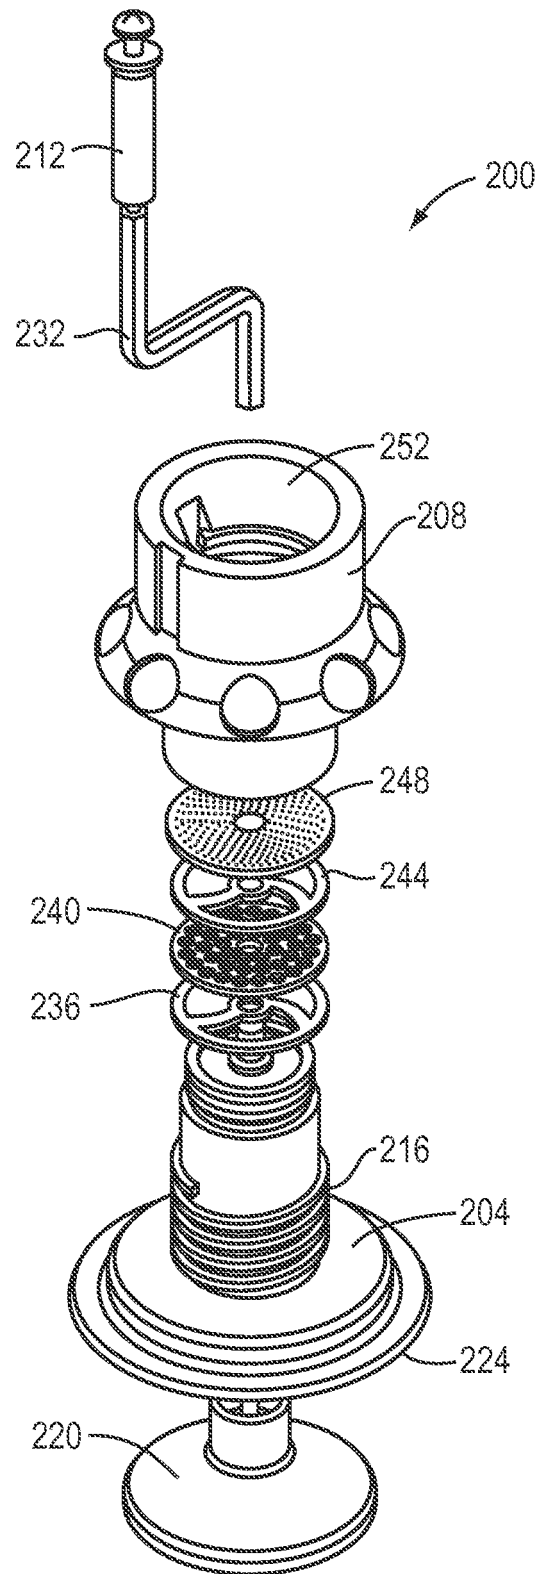


FIG. 6C

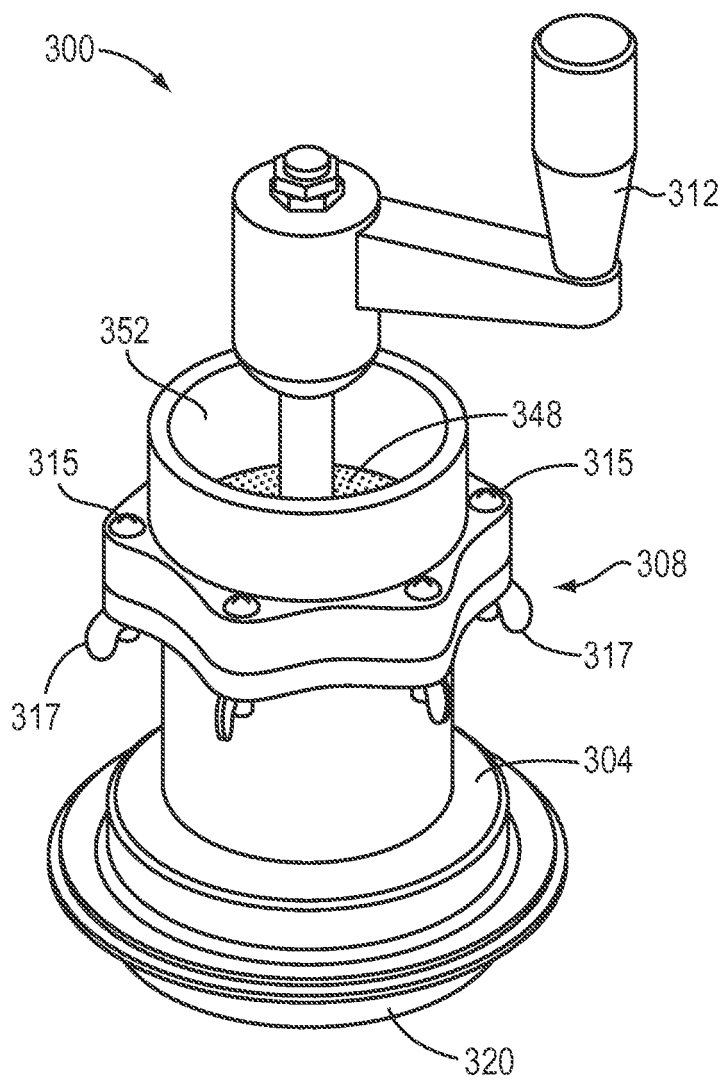


FIG. 7



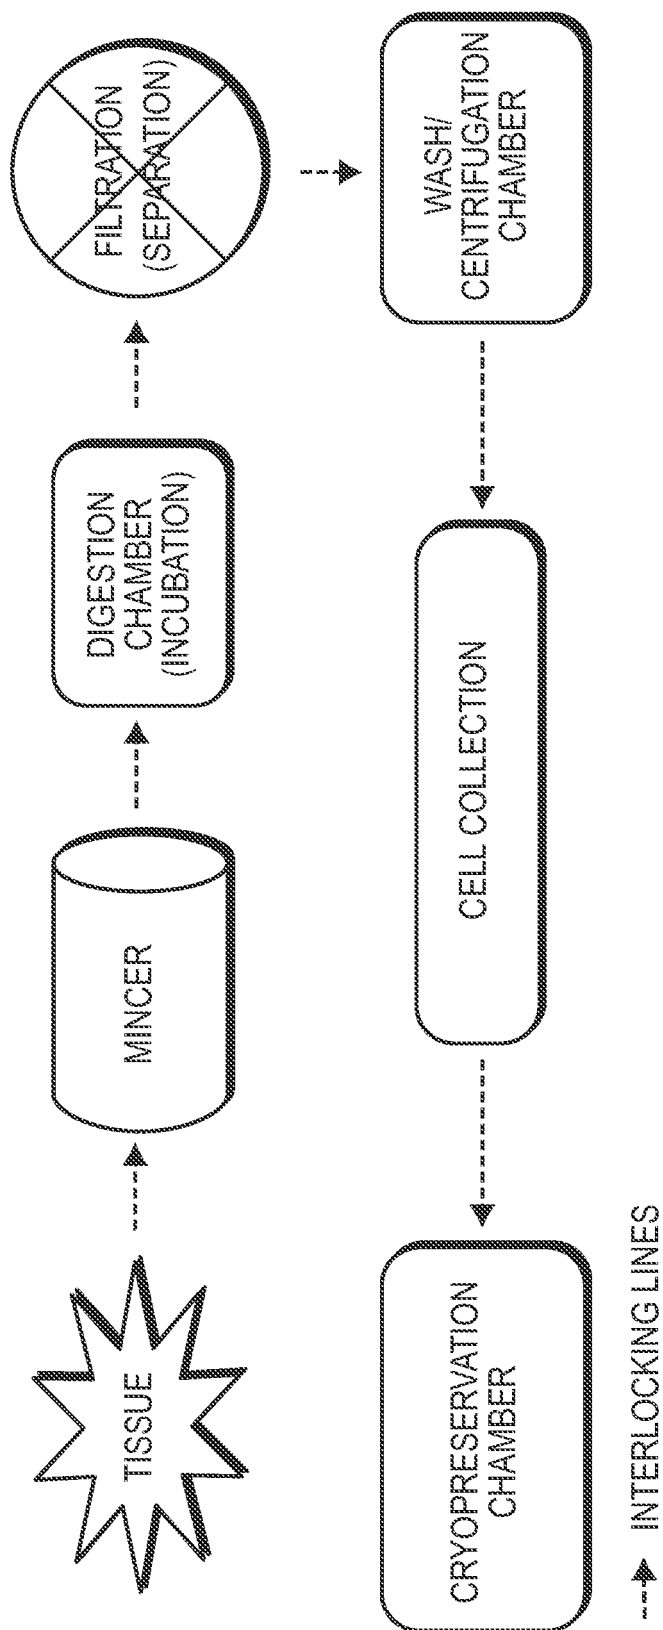


FIG. 8

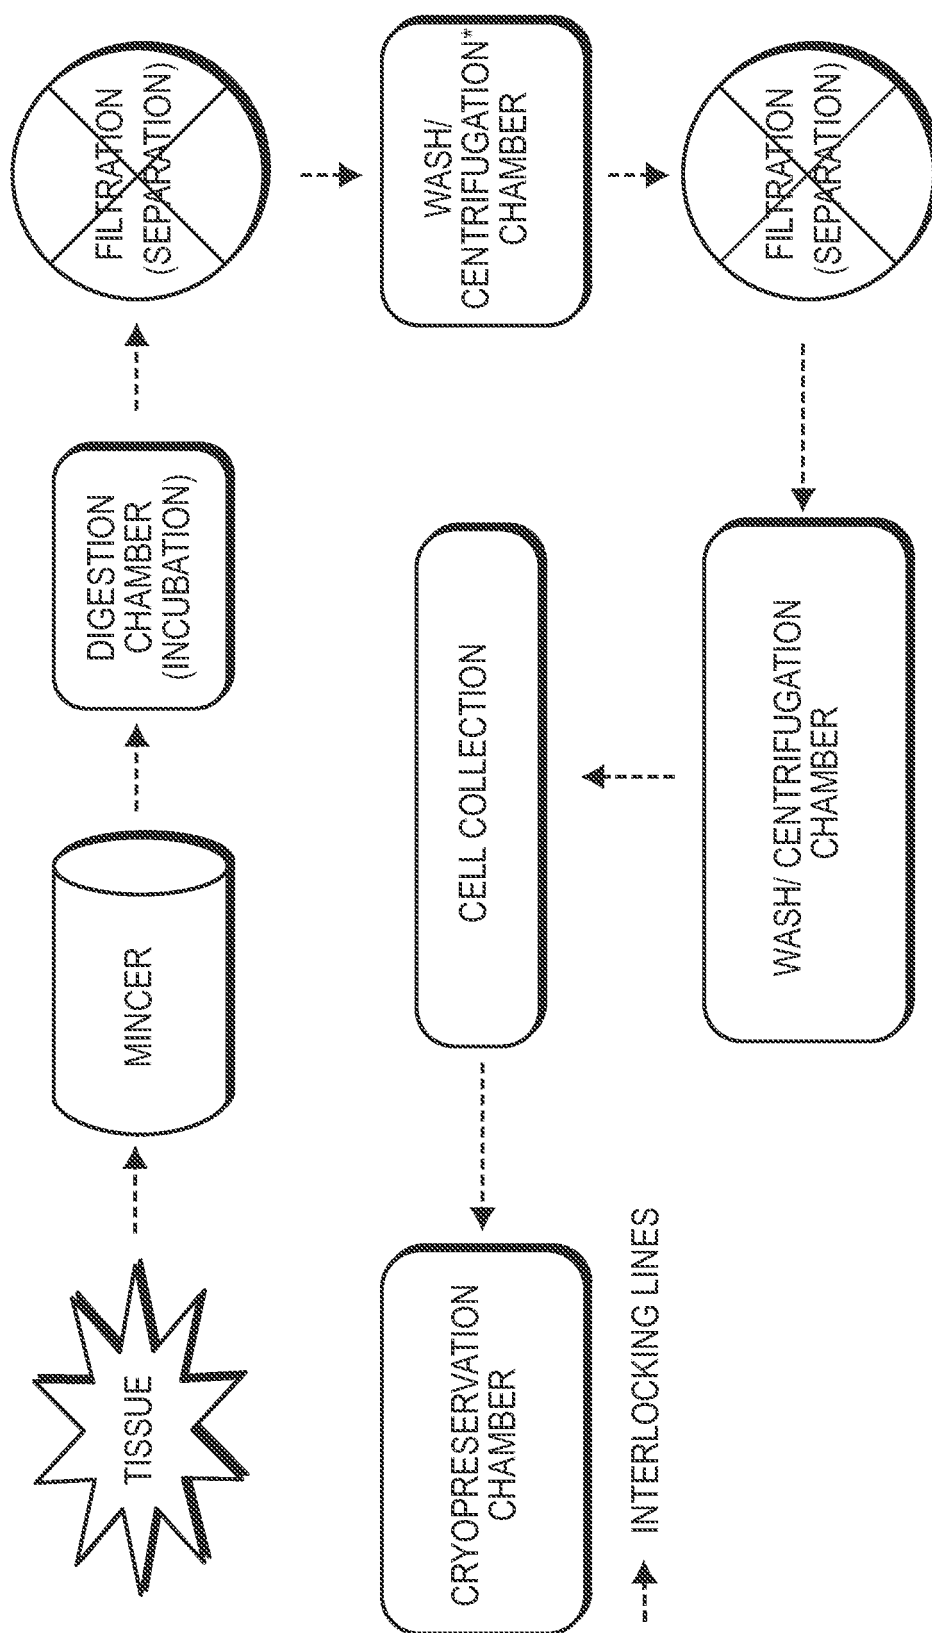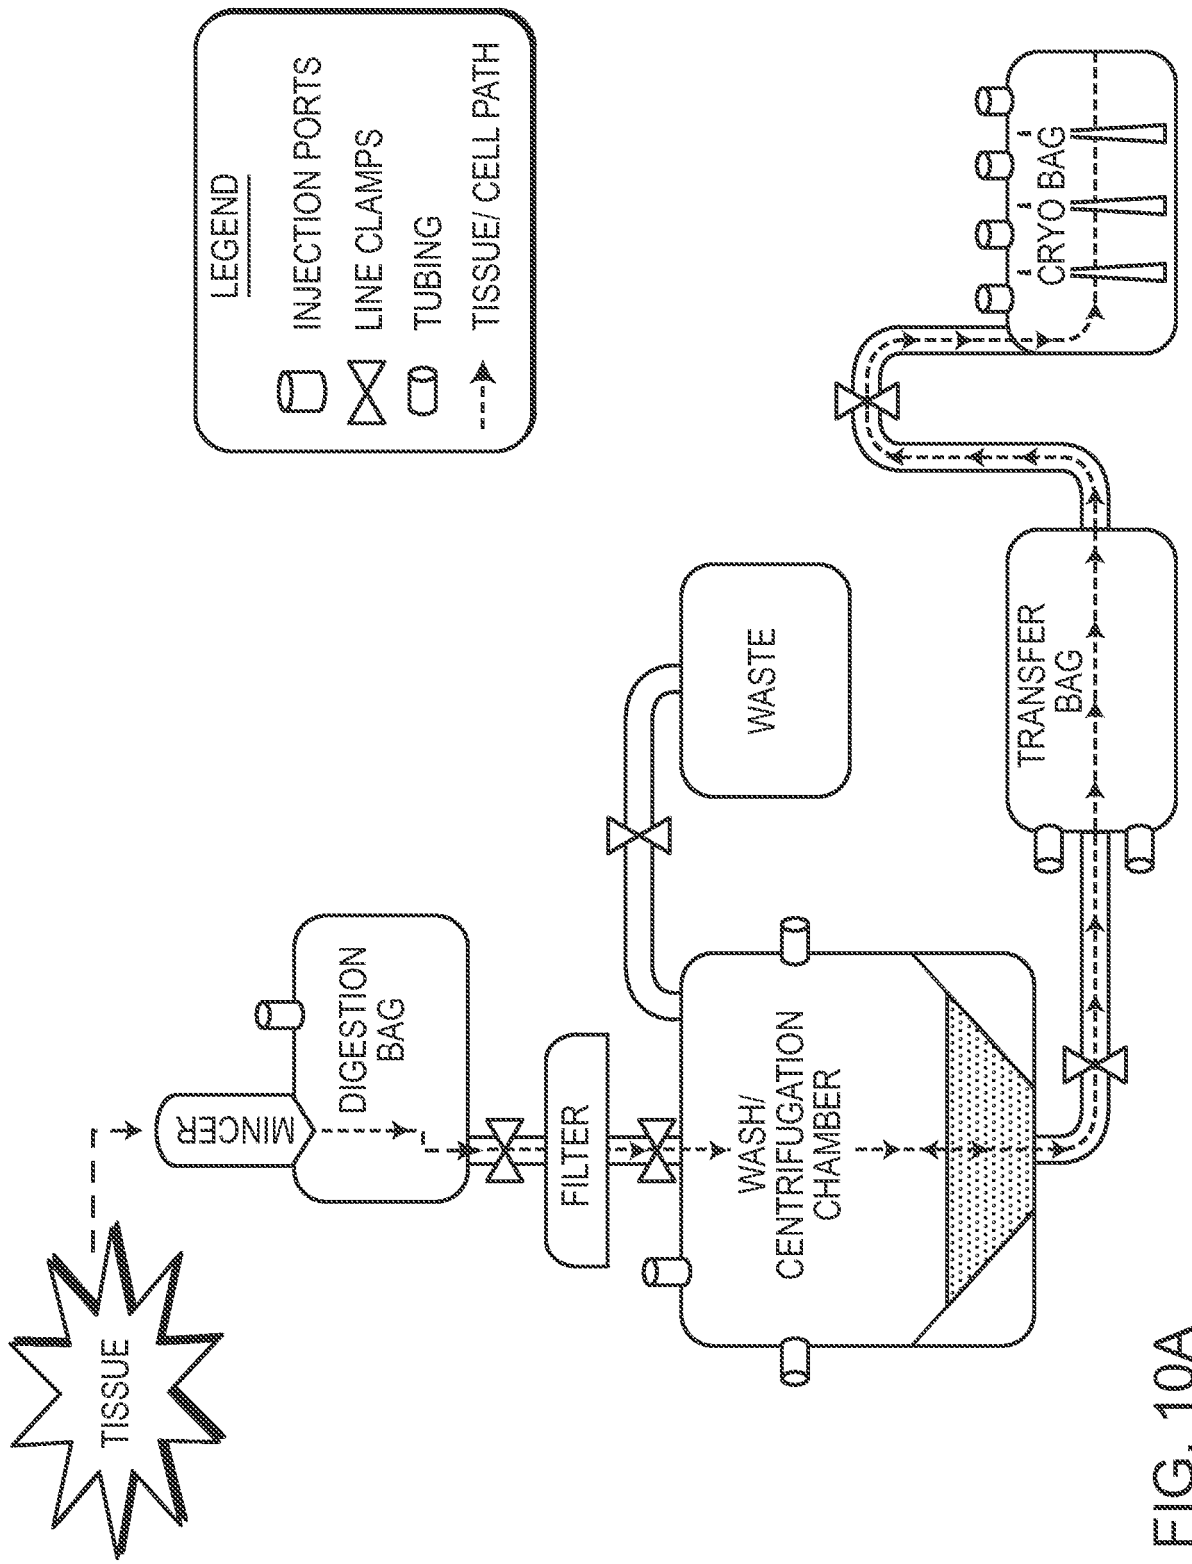

* CENTRIFUGATION NOT NECESSARY, BUT OPTIONAL

FIG. 9



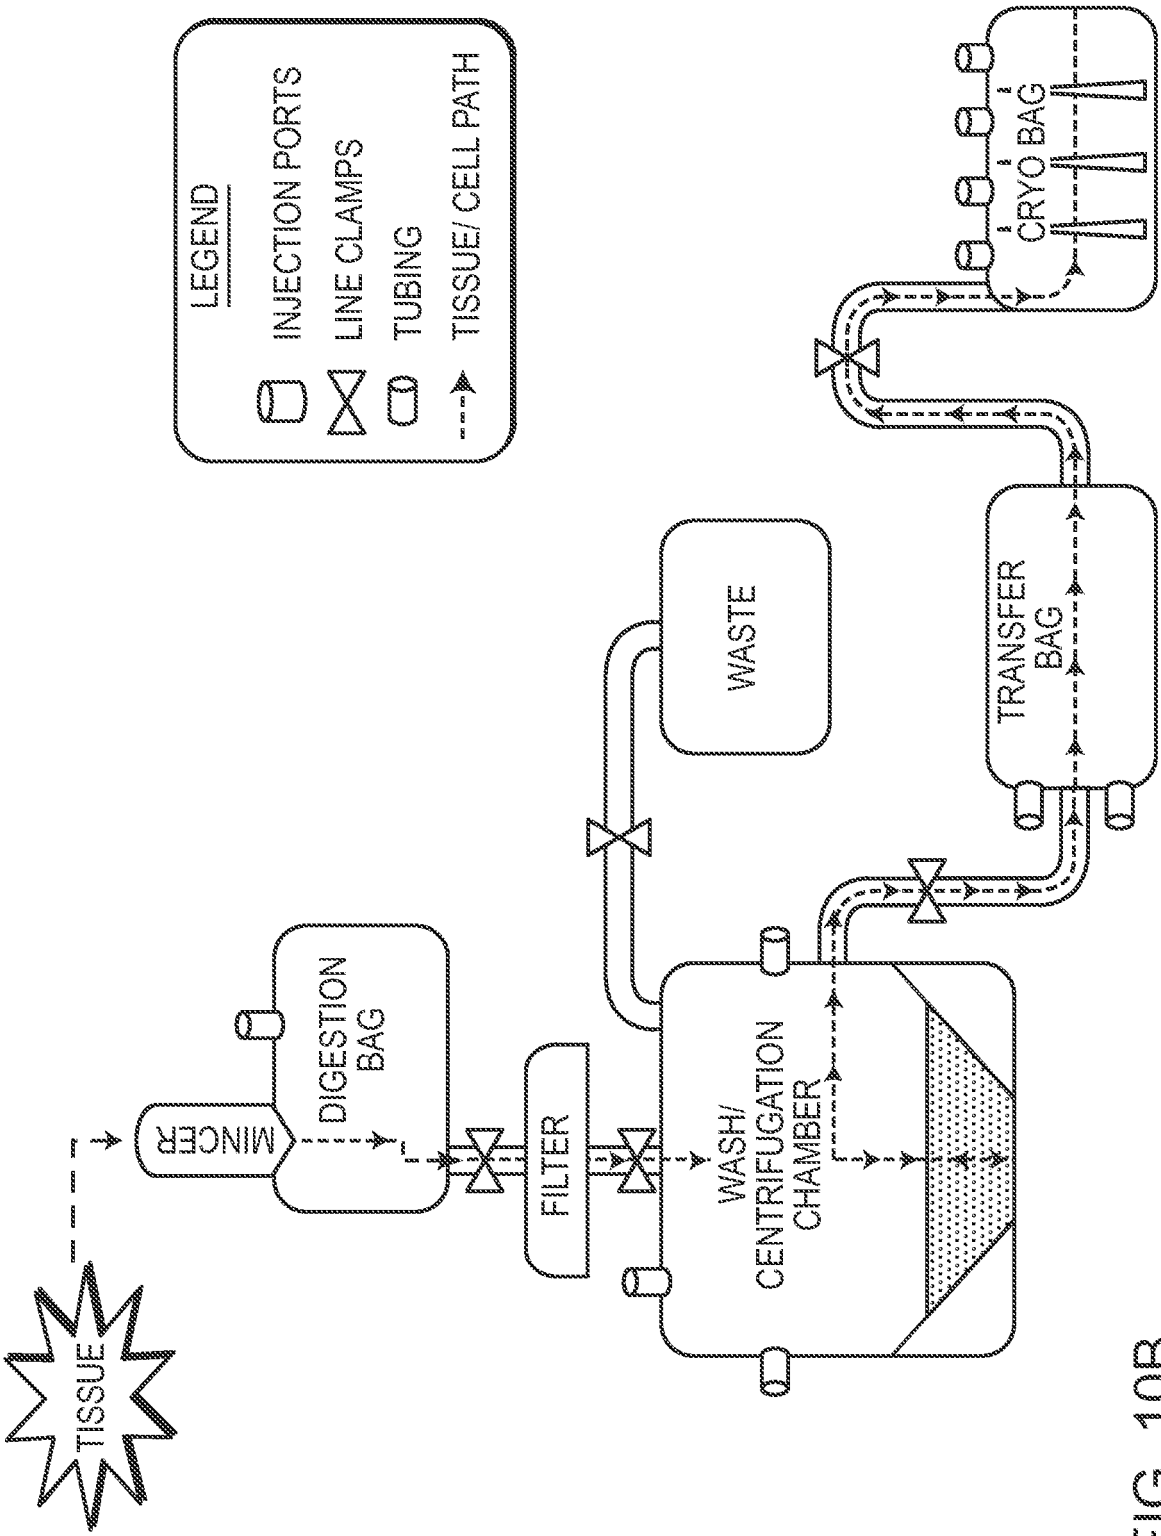


FIG. 10B


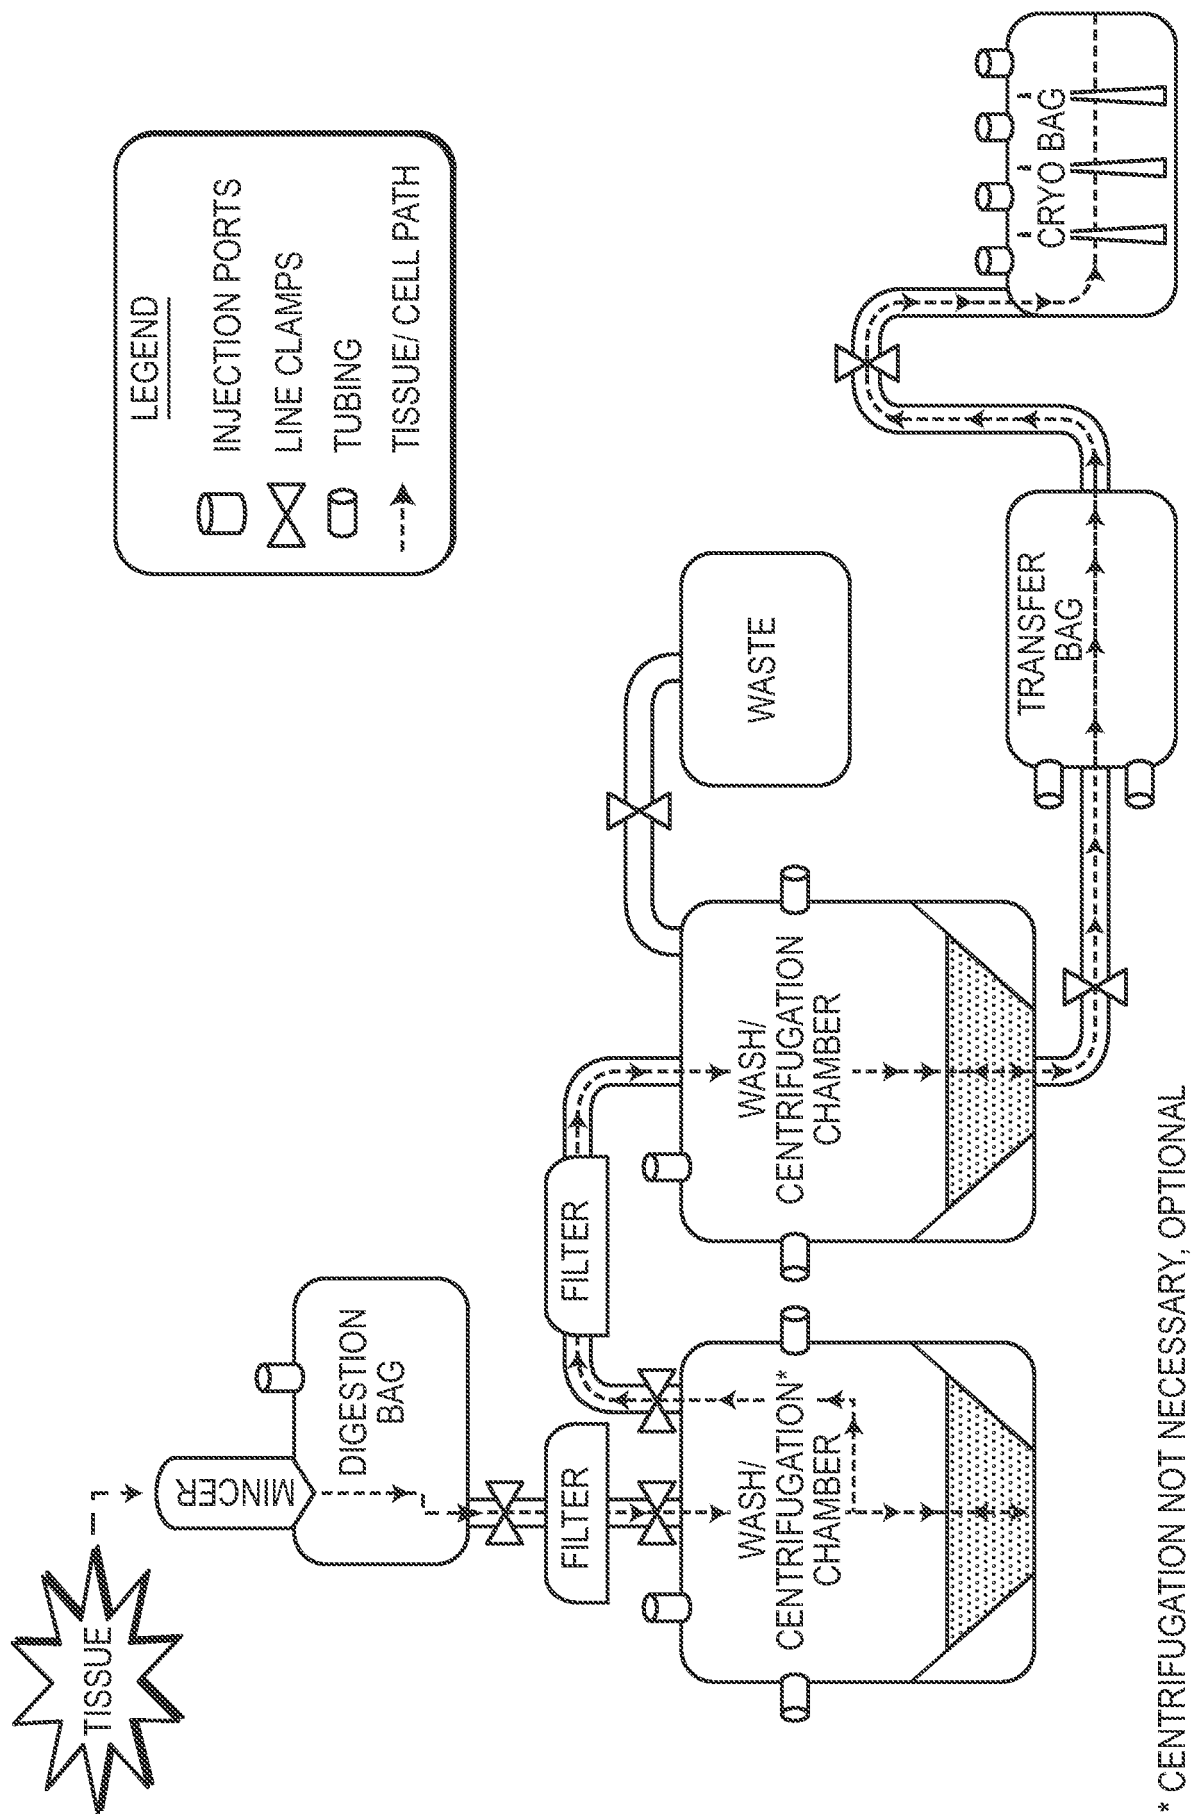


FIG. 10C

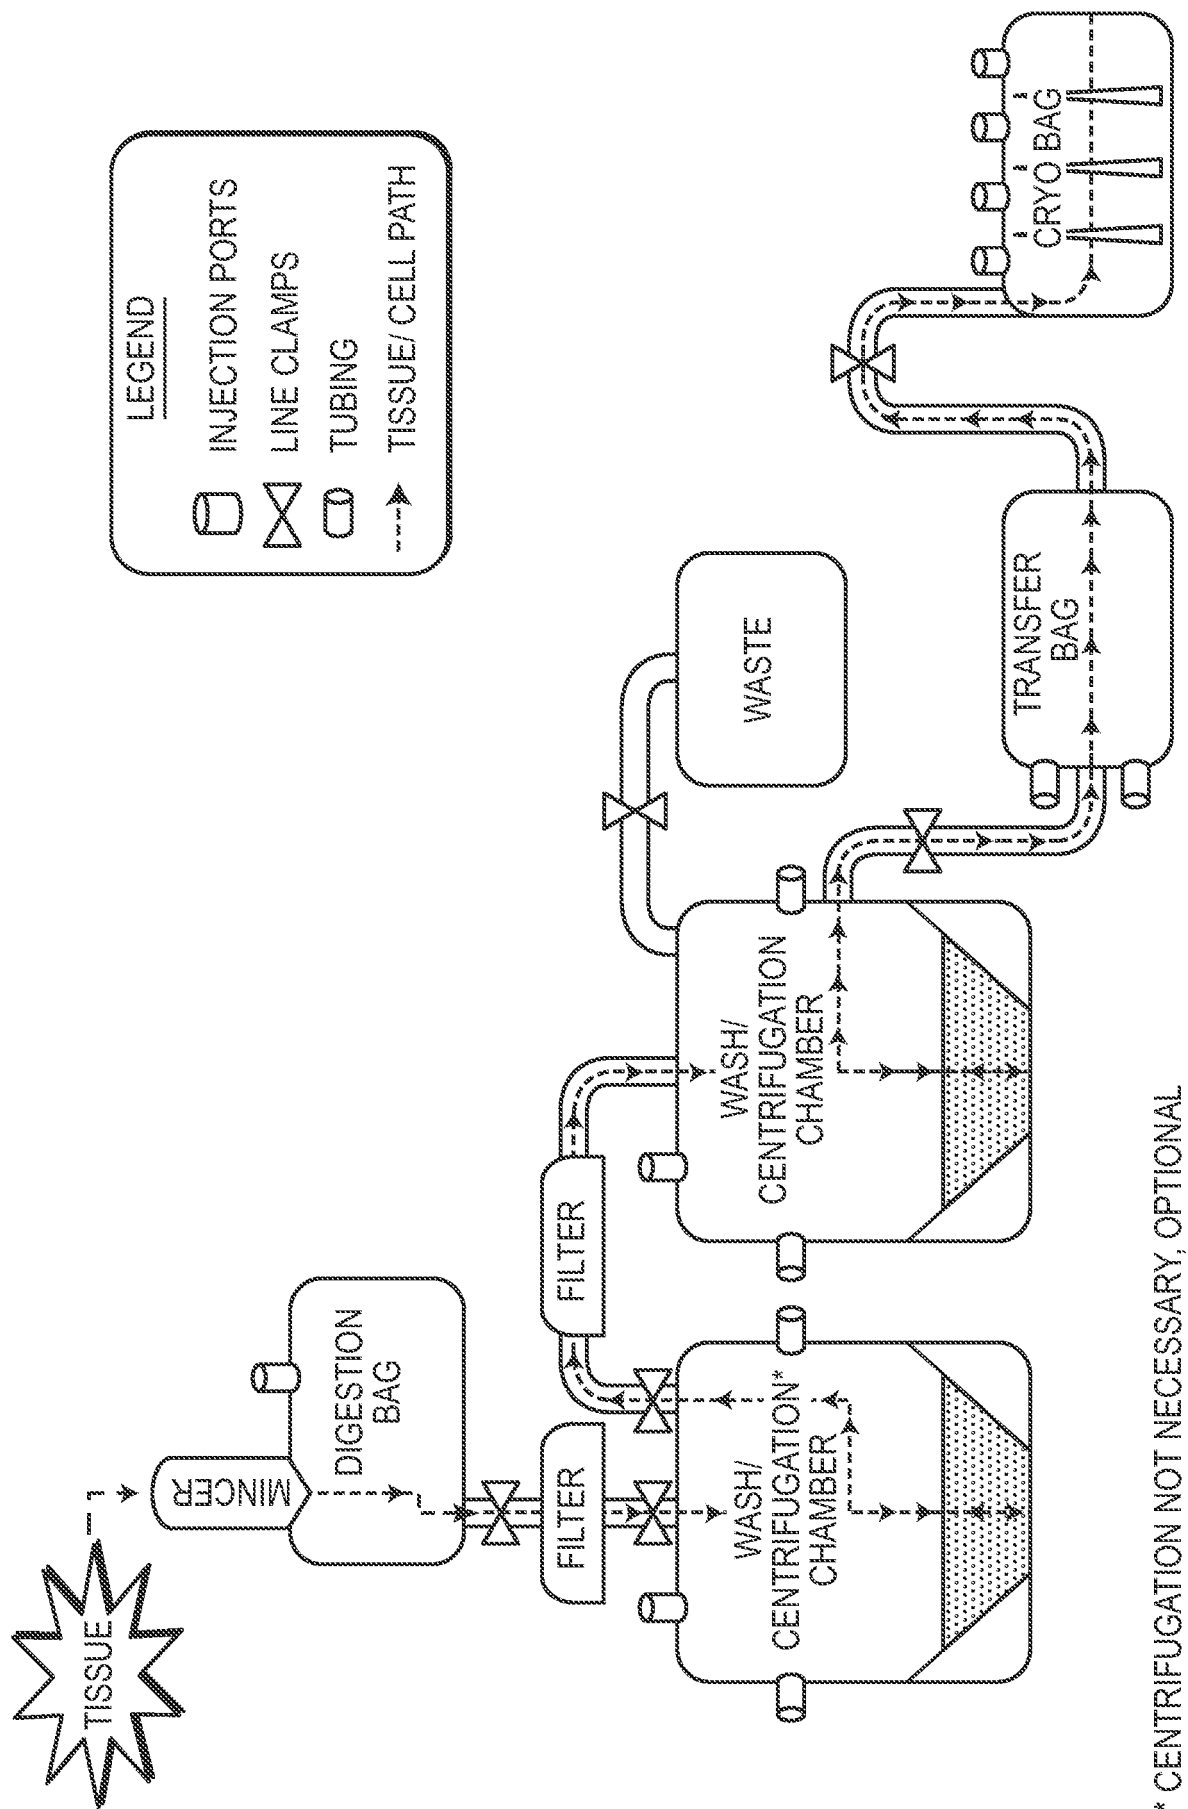

* CENTRIFUGATION NOT NECESSARY, OPTIONAL

FIG. 10D

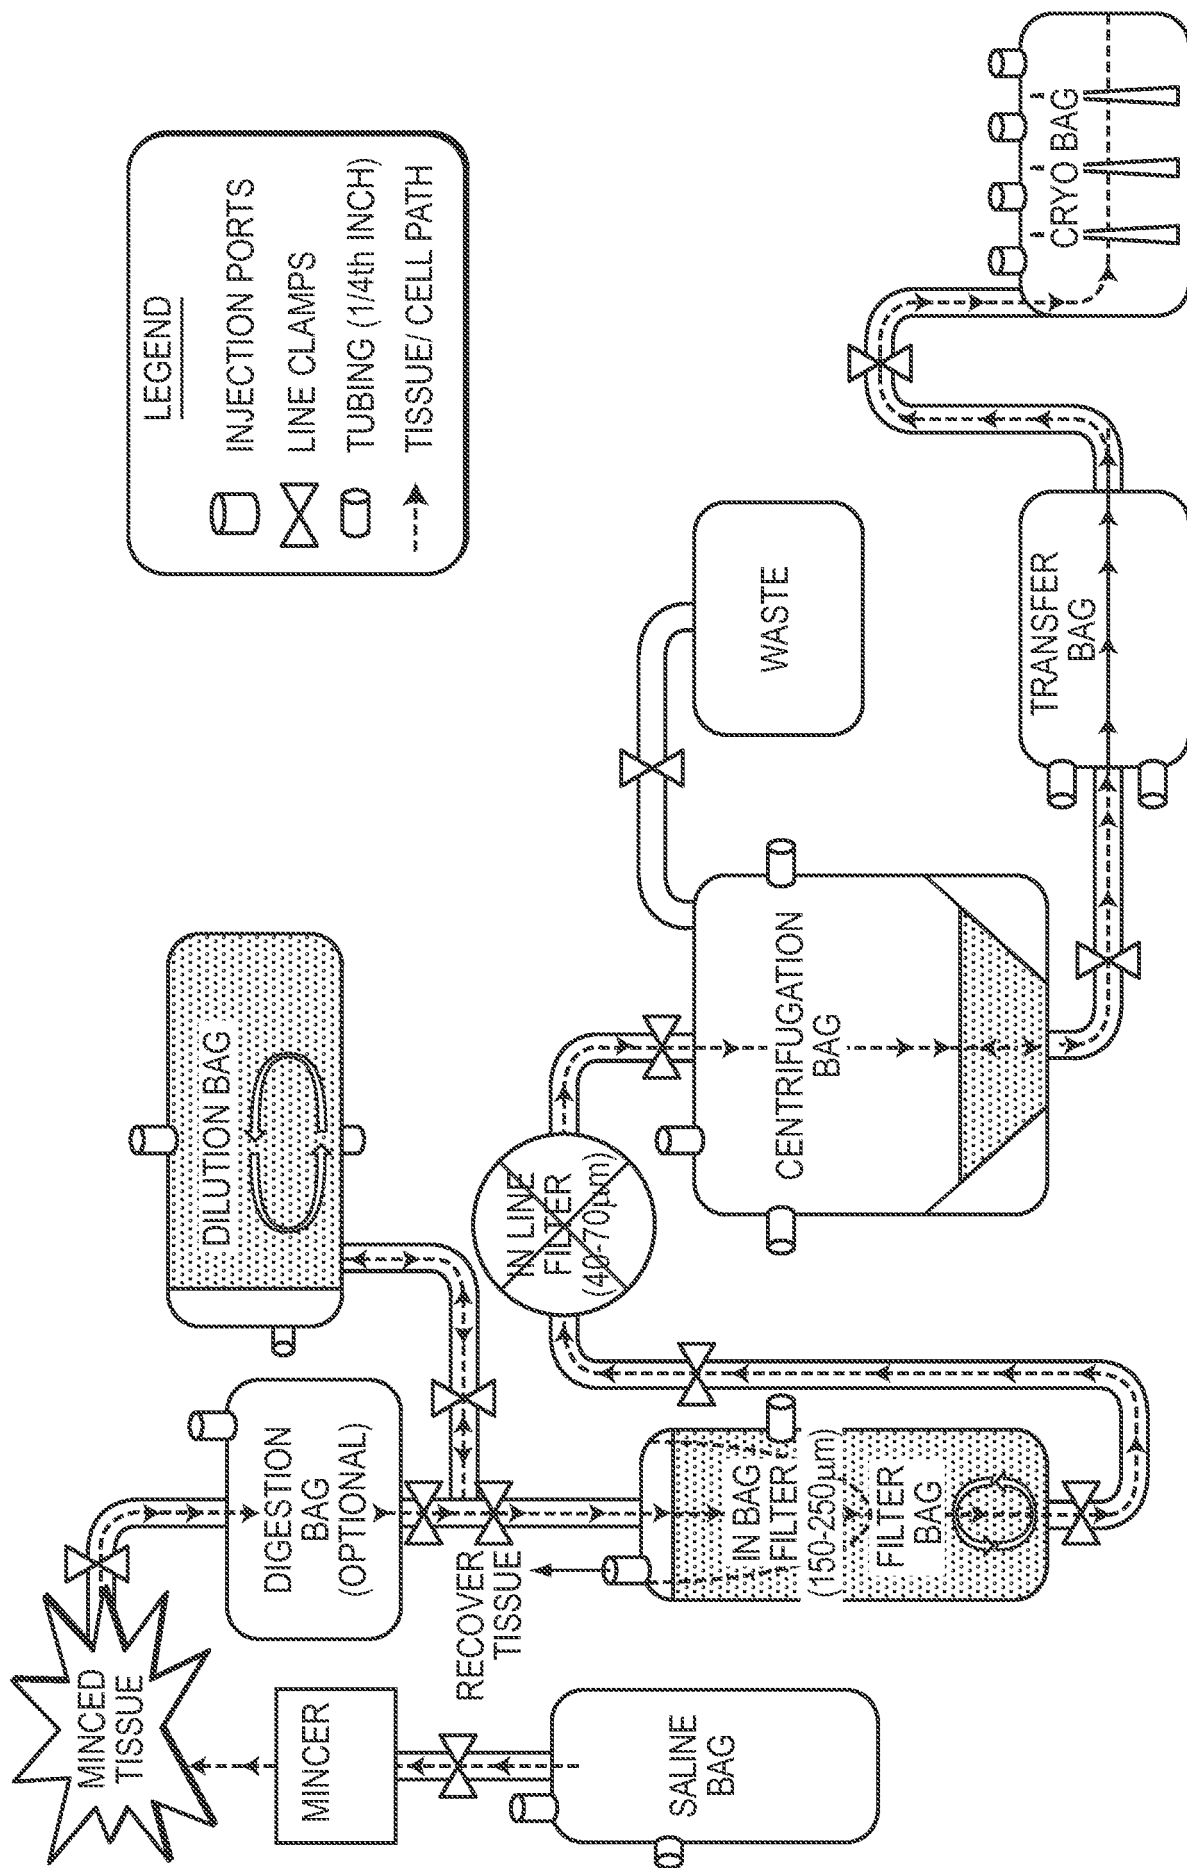


FIG. 10E

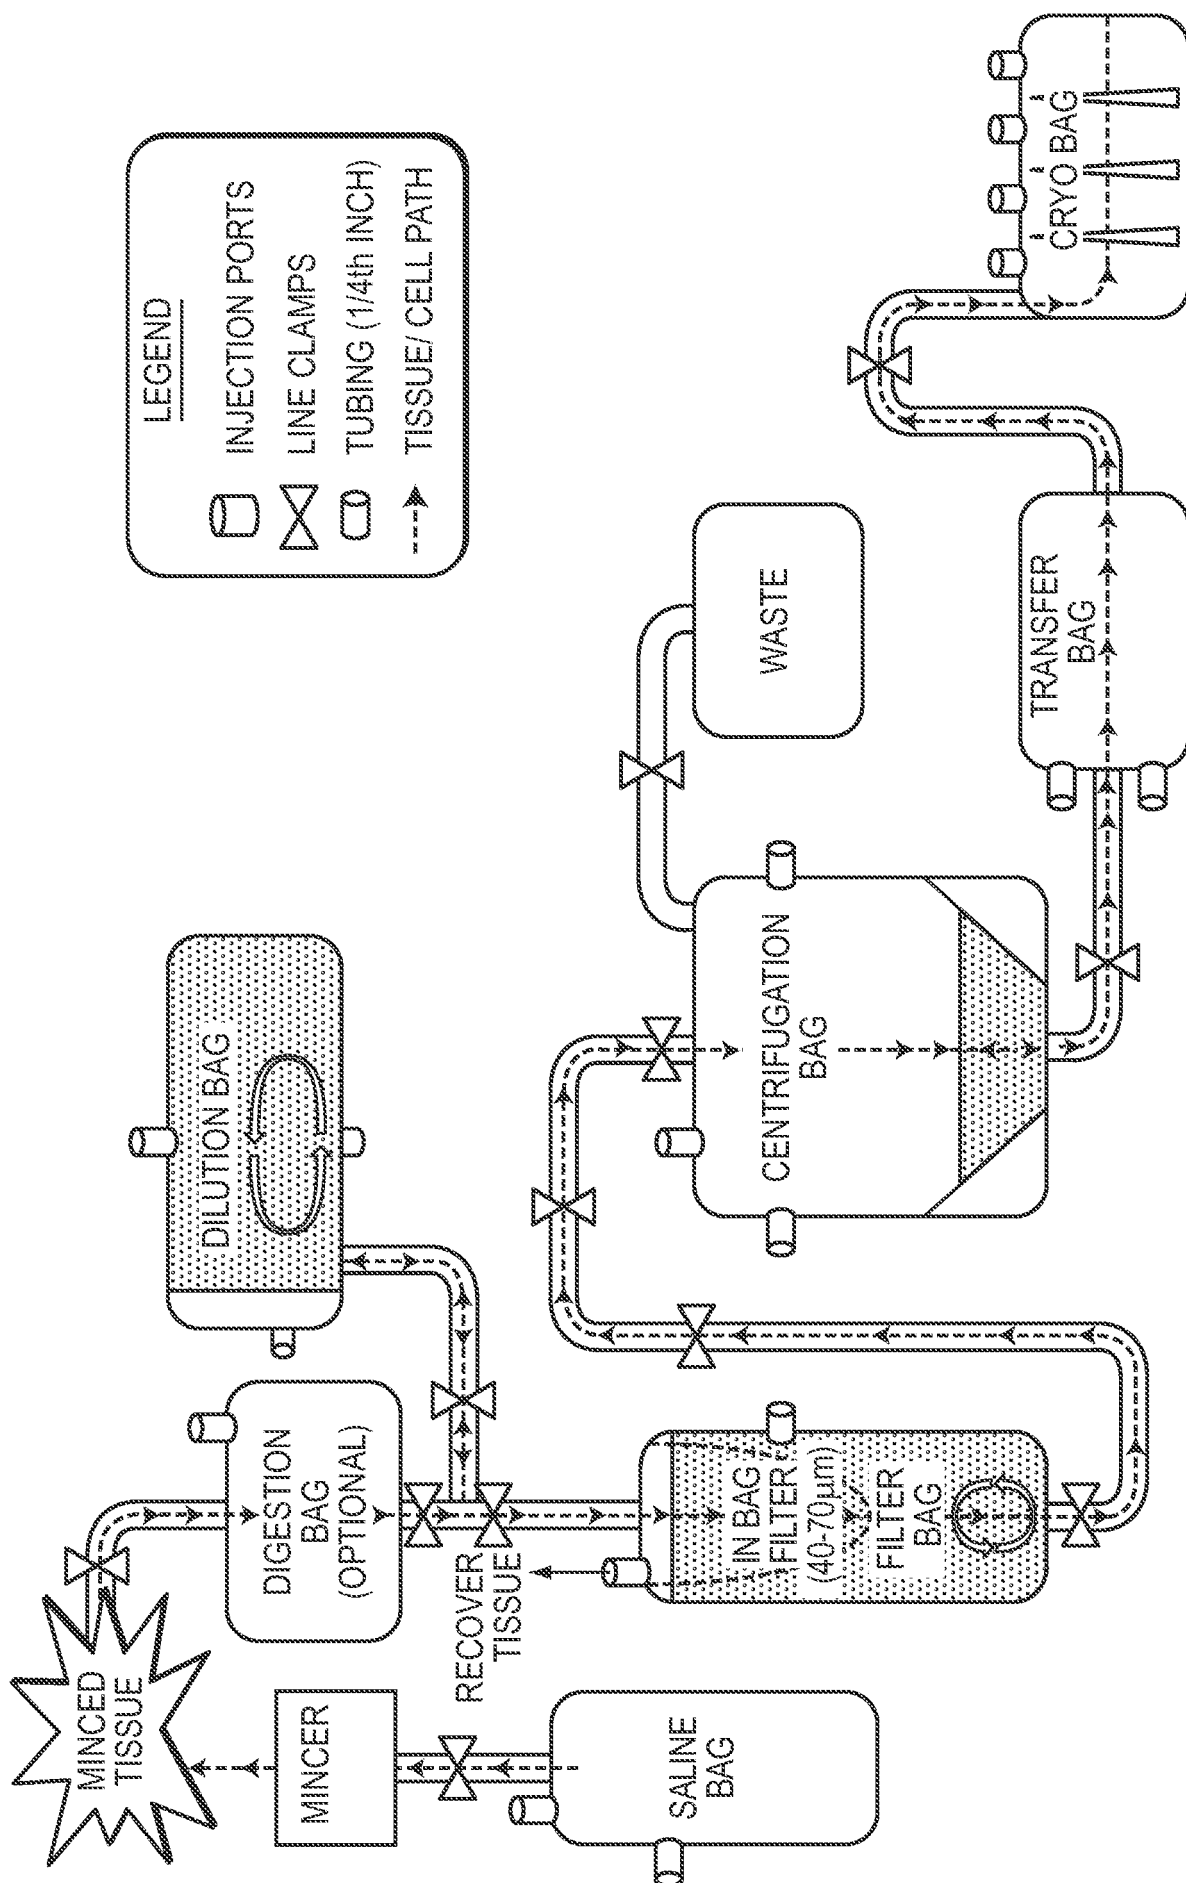


FIG. 10F

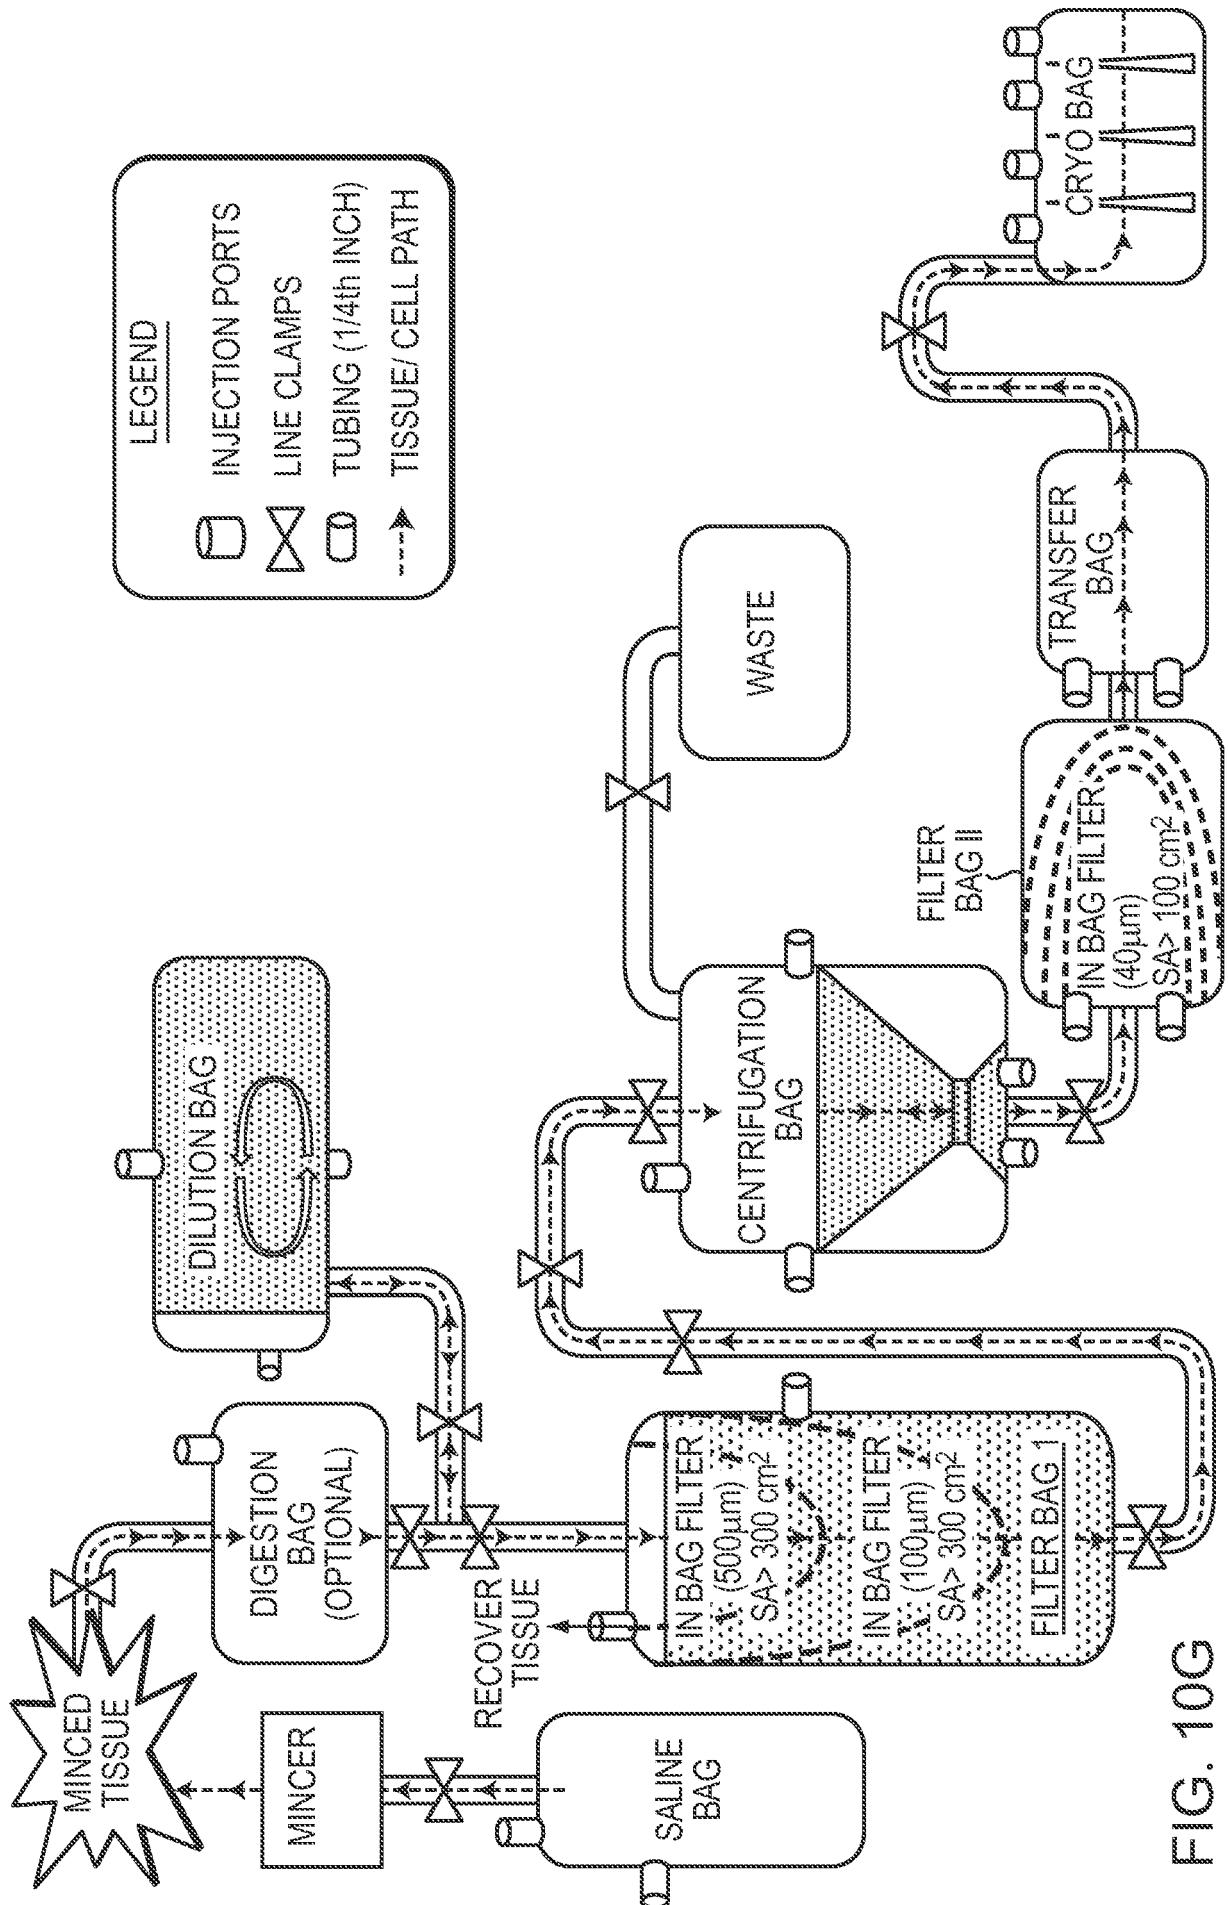


FIG. 10G