


(a) [NORMAL OPERATION]

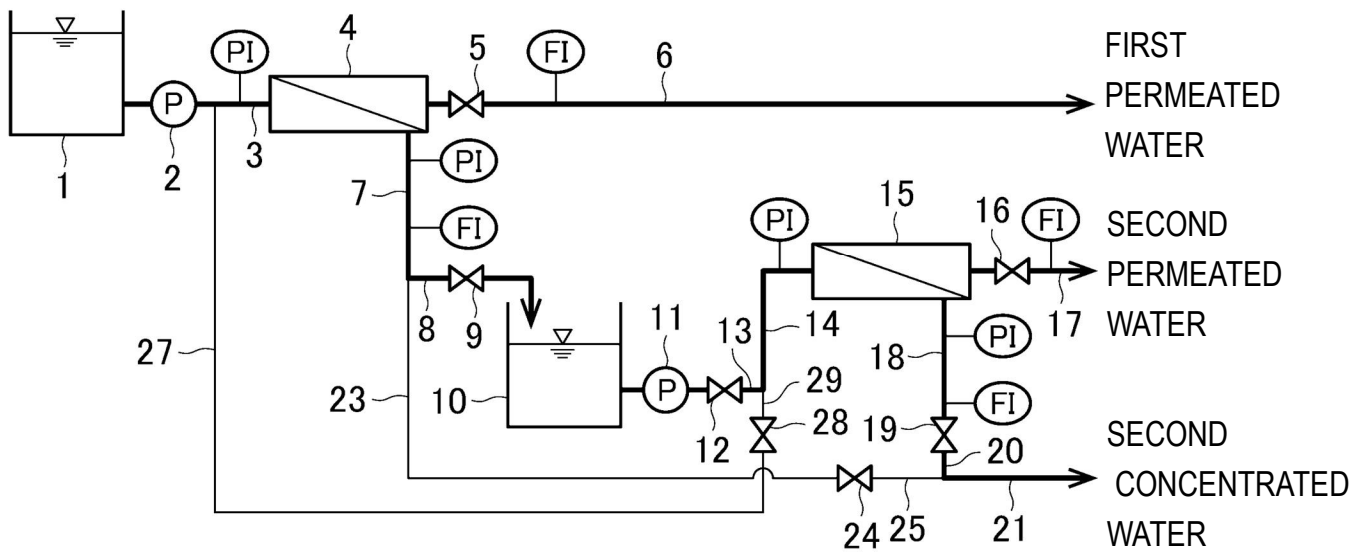

(b) [FLUX RECOVERY OPERATION]

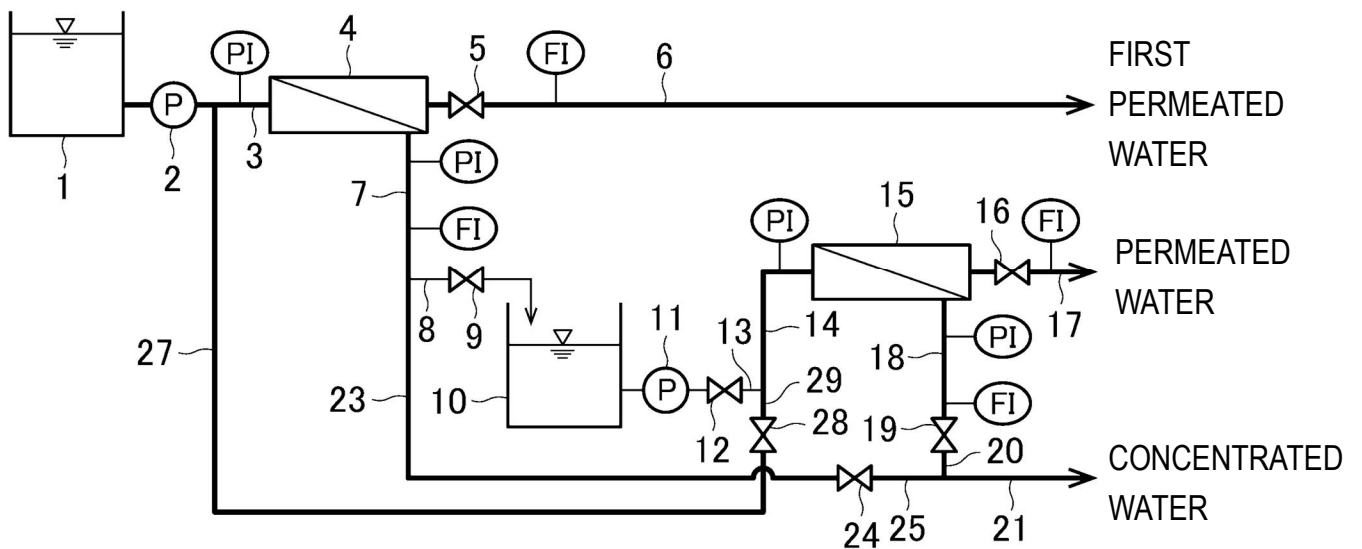


FIG. 1


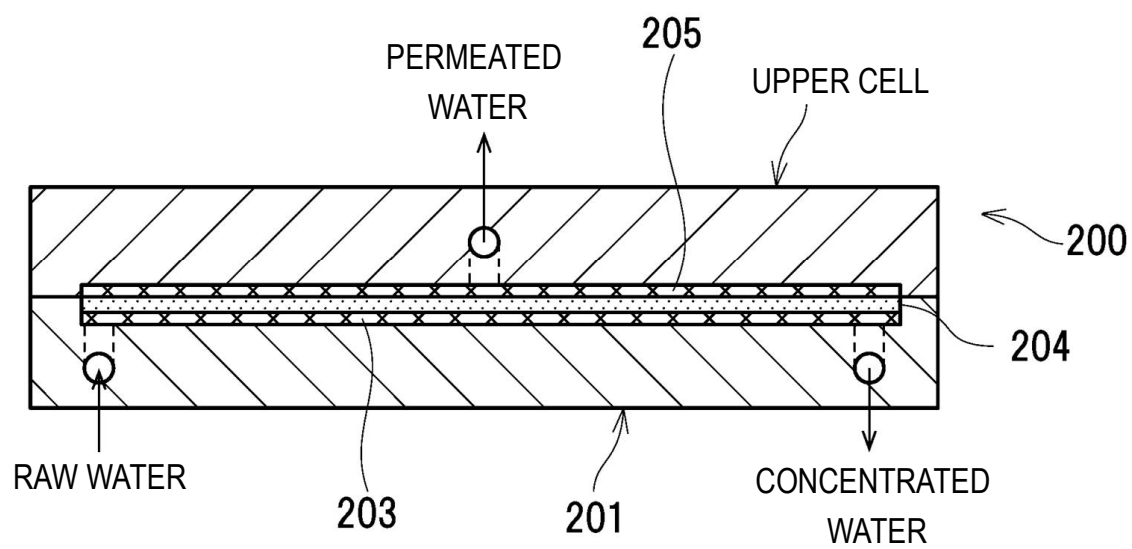


FIG. 2

(a) EXAMPLE 7

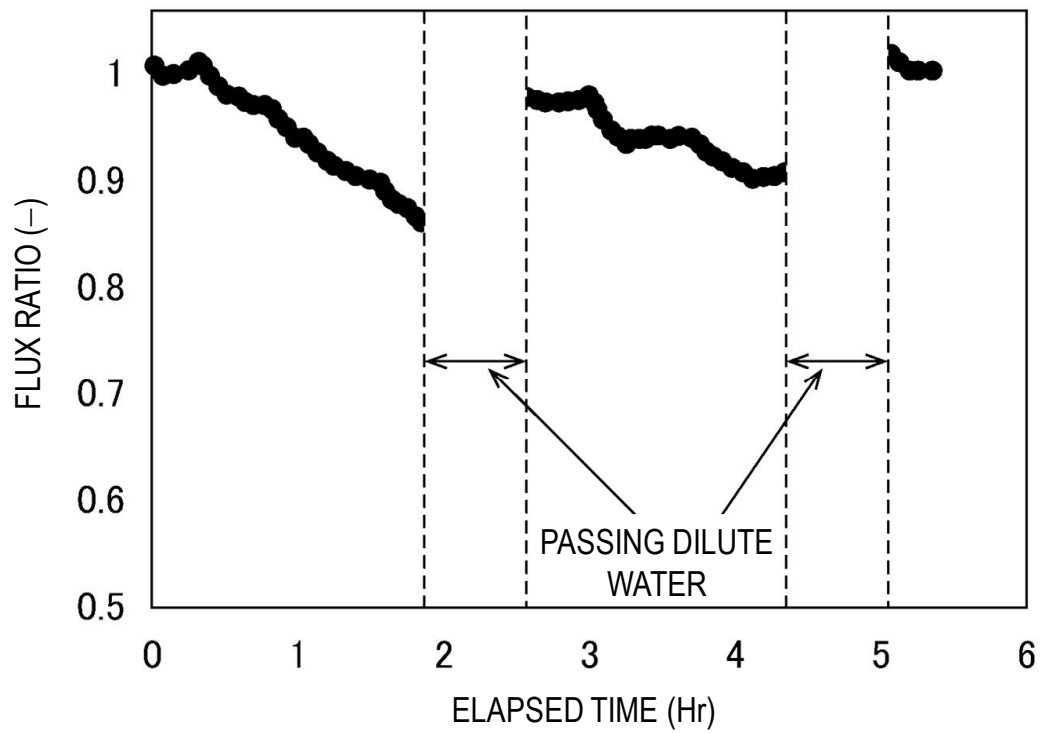

(b) COMPARATIVE EXAMPLE 2

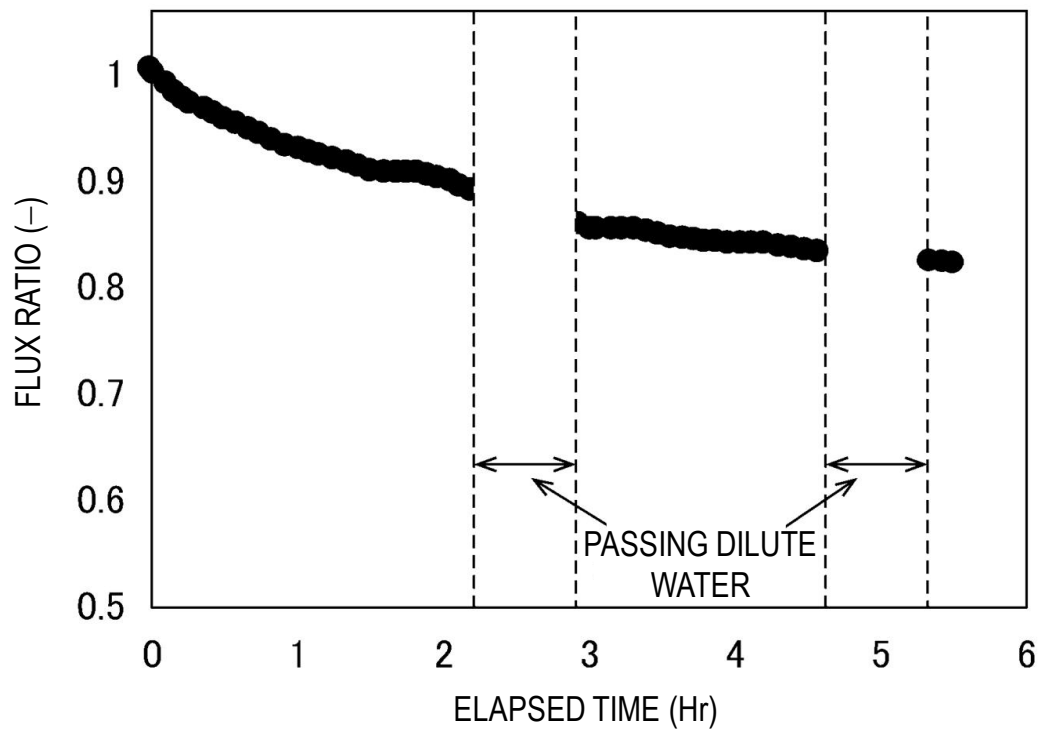


FIG. 3

((FLUX RECOVERY OPERATION OF SECOND RO APPARATUS 52))

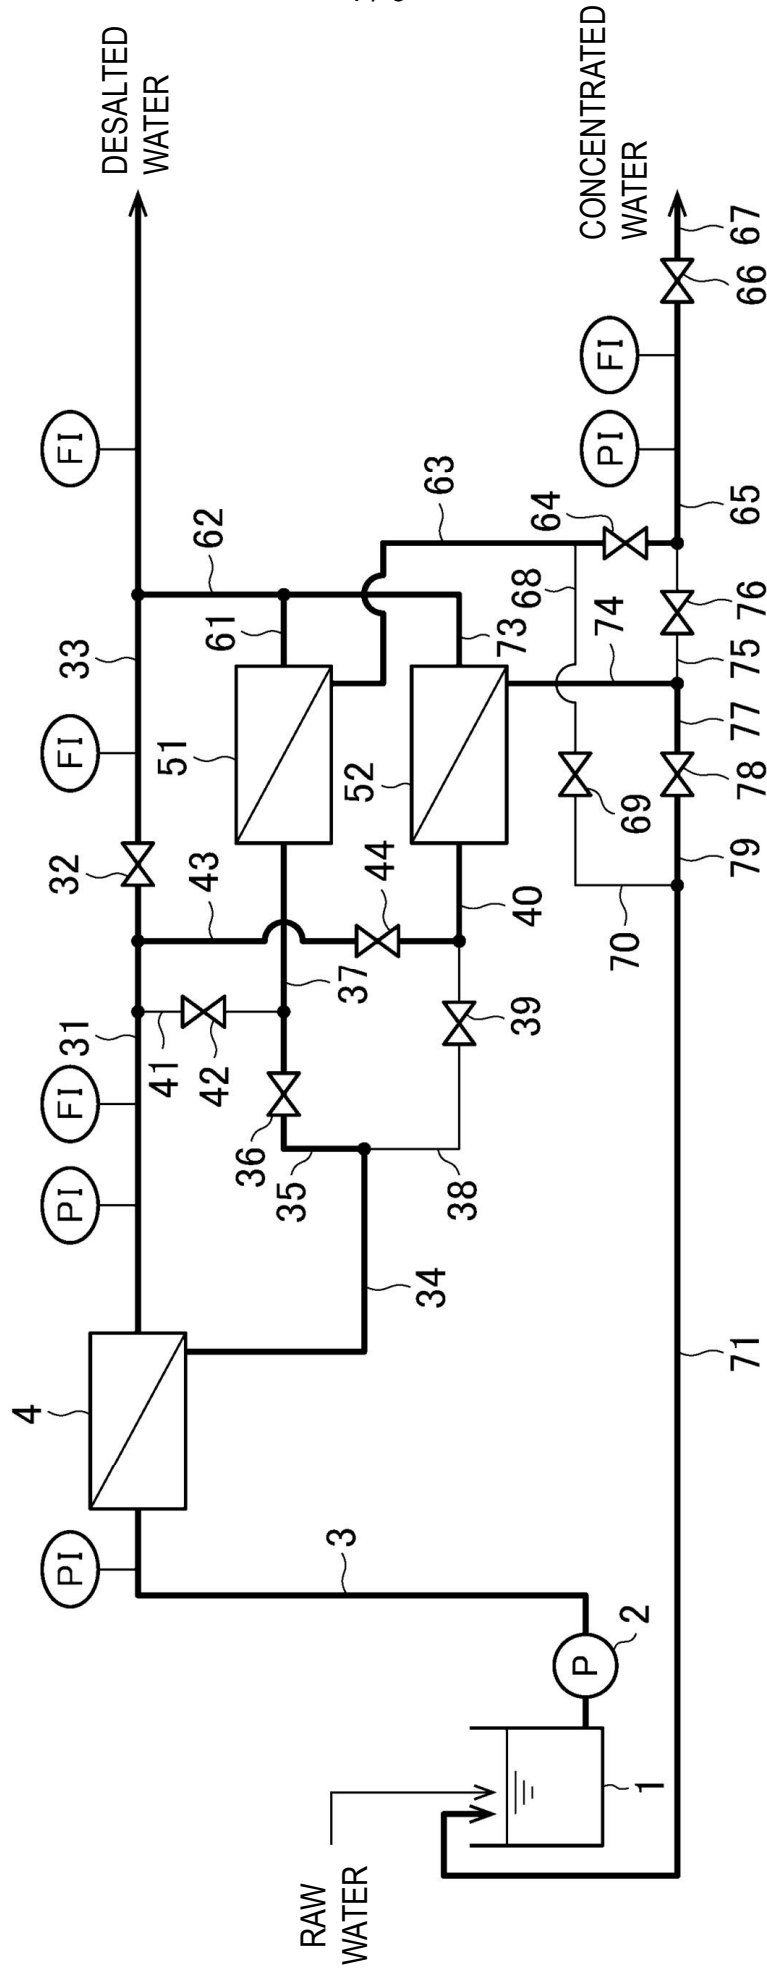


FIG. 4

(FLUX RECOVERY OPERATION OF SECOND RO APPARATUS 51)

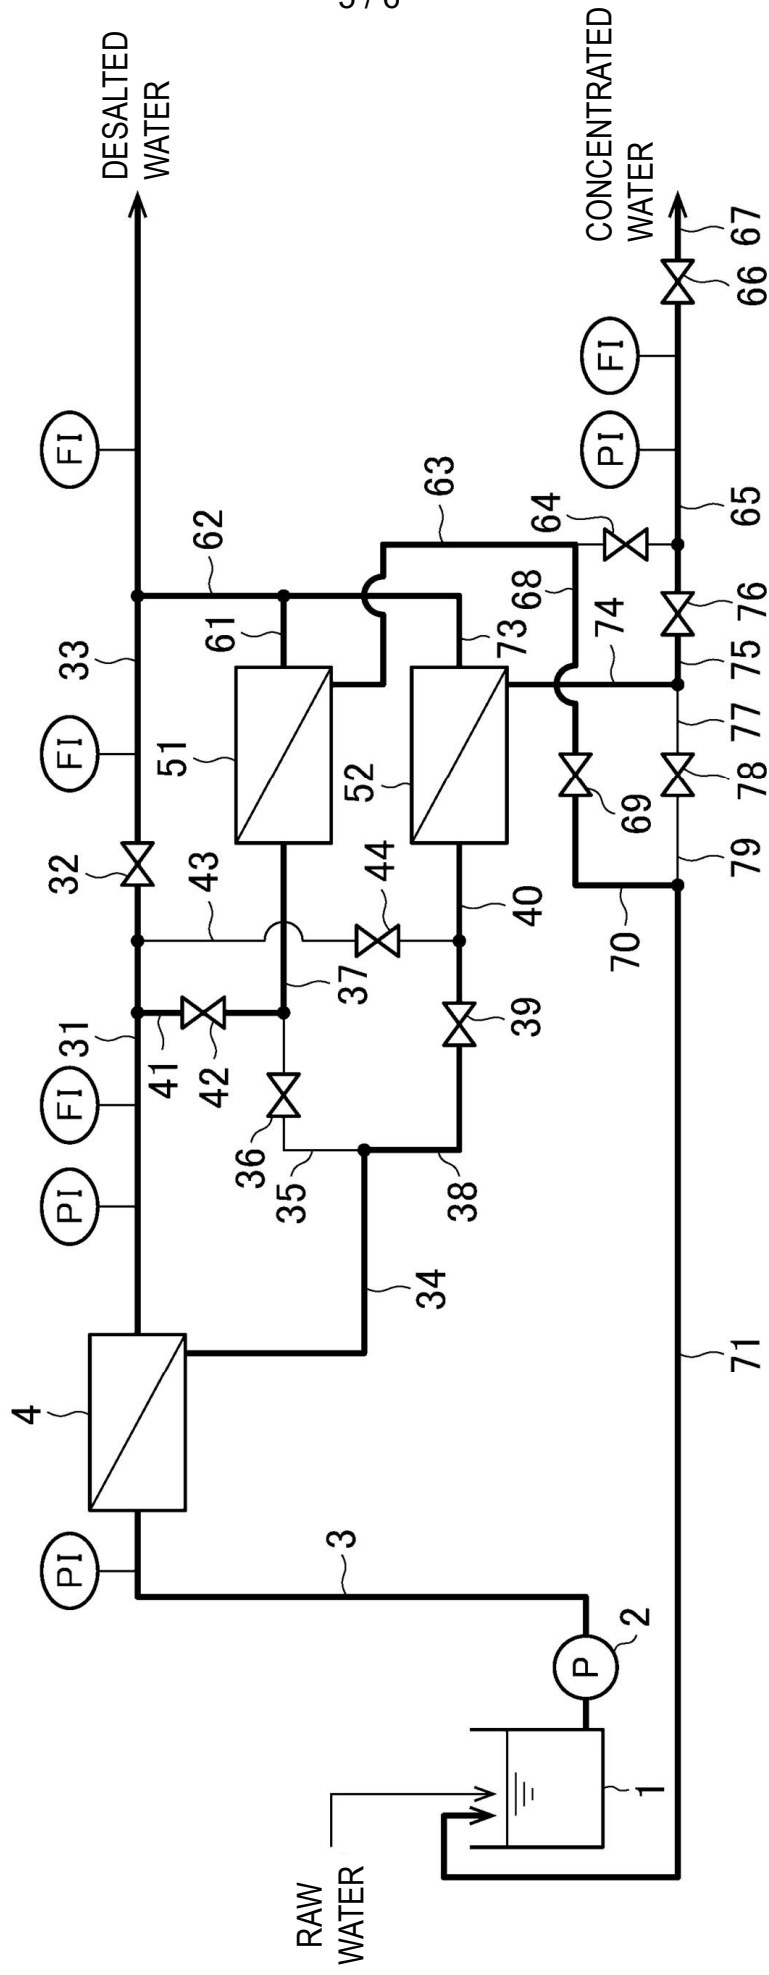


FIG. 5

