Figure 1

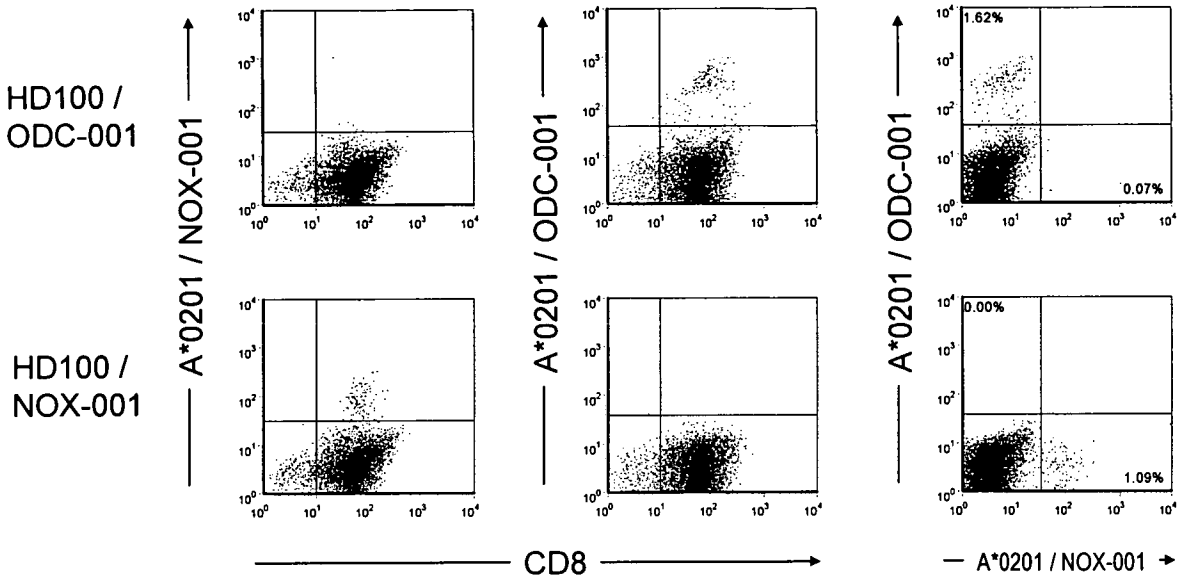

HD100 / ODC-001
HD100 / NOX-001
A*0201 / NOX-001
A*0201 / ODC-001
A*0201 / ODC-001
1.62%
0.07%
0.00%
1.09%
CD8
A*0201 / NOX-001

Figure 2

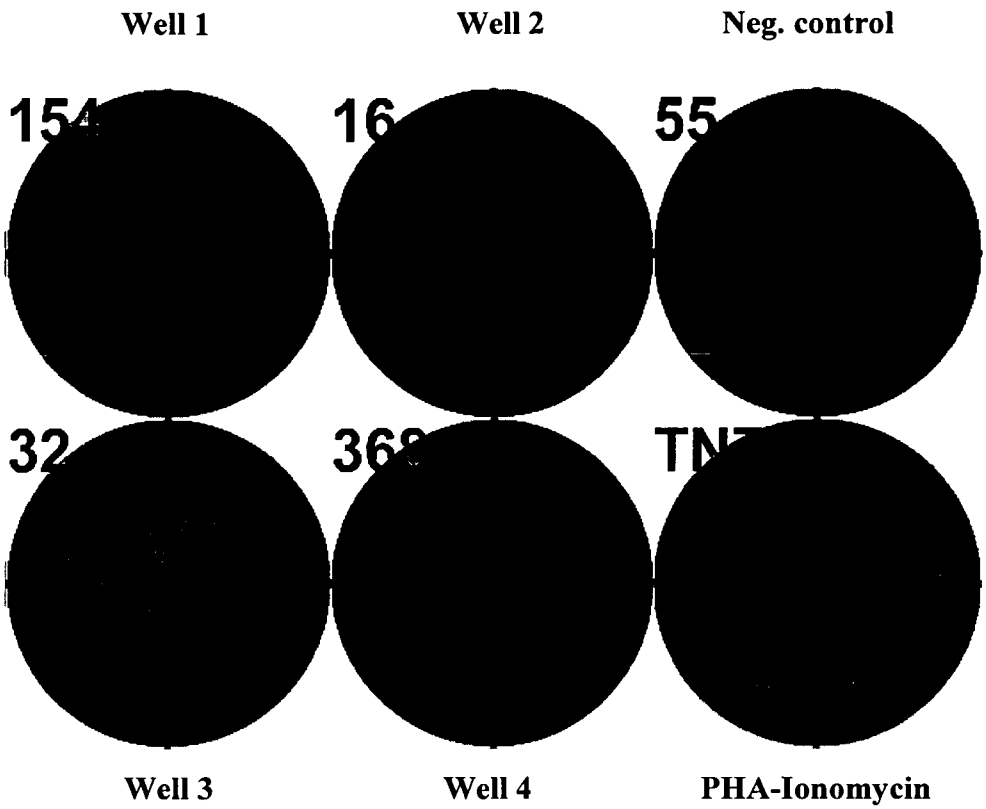

Well 1
Well 2
Neg. control
154
16
55
32
Well 3
Well 4
PHA-Ionomycin

Figure 3

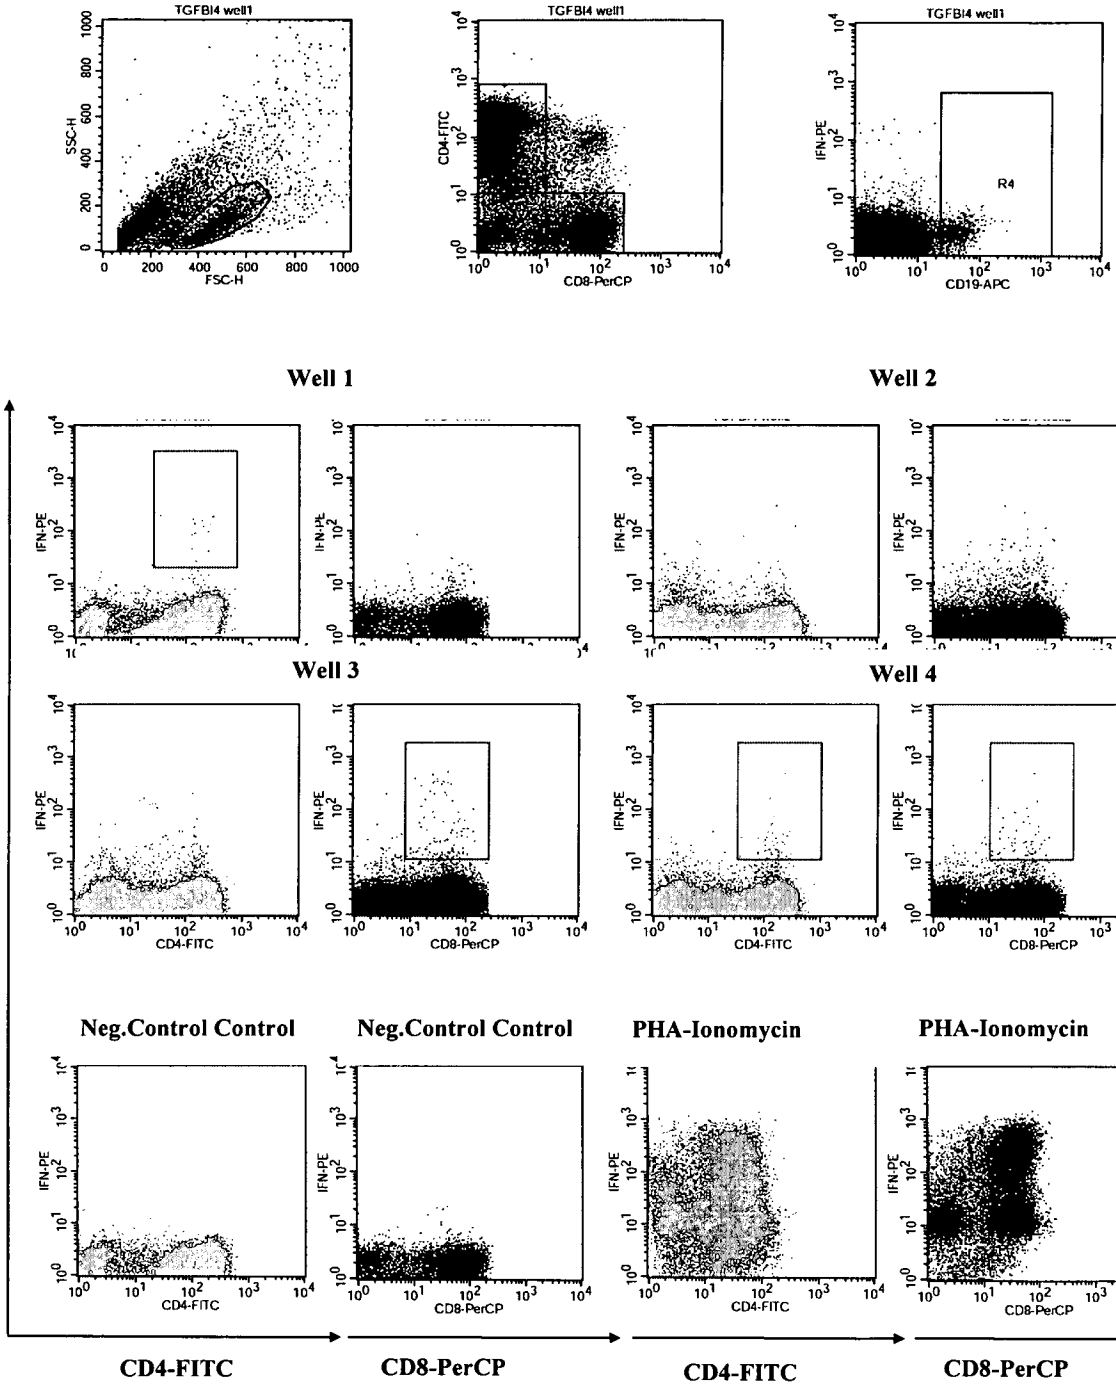

TGFBI4 well1
SSC-H
FSC-H
CD4-FITC
CD8-PerCP
IFN-PE
R4
CD19-APC
Well 1
Well 2
Well 3
Well 4
Neg.Control Control
Neg.Control Control
PHA-Ionomycin
PHA-Ionomycin
CD4-FITC
CD8-PerCP
CD4-FITC
CD8-PerCP

Figure 4

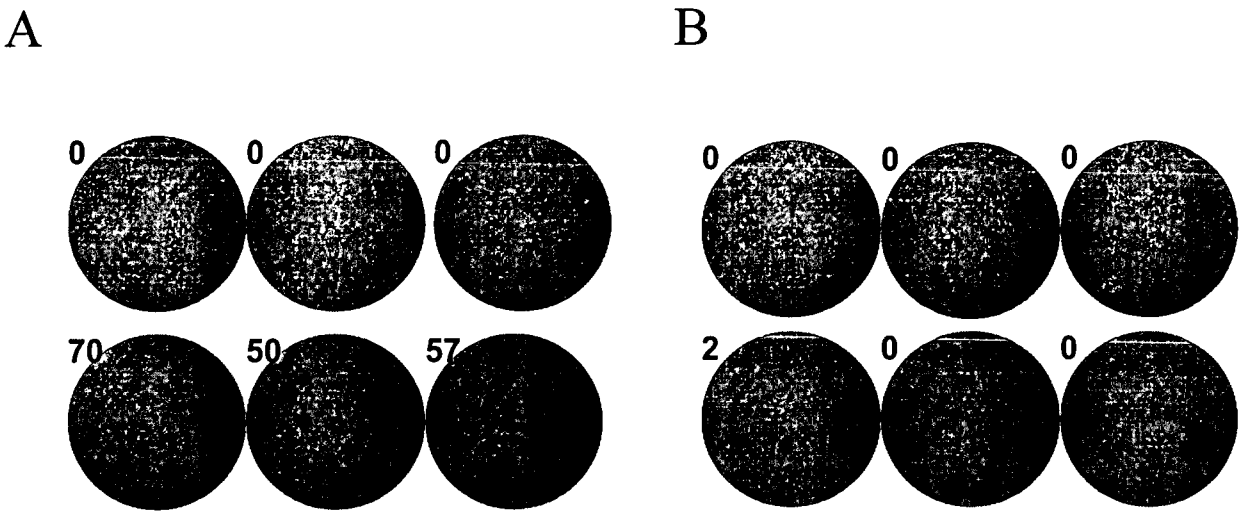


Figure 5

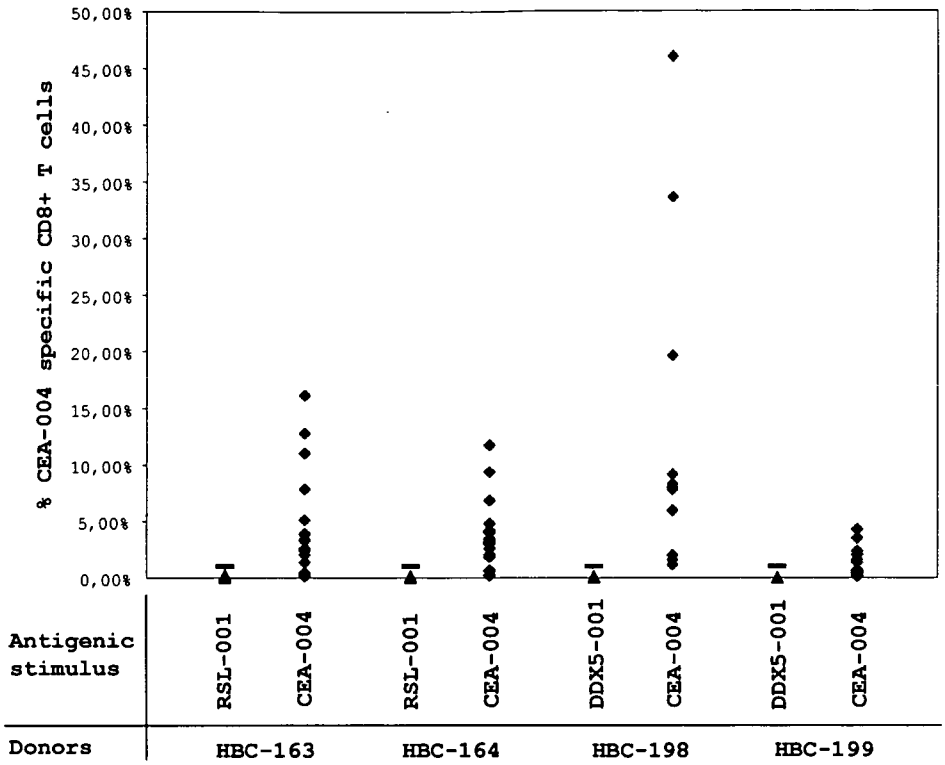


Figure 6

