

FIG. 1

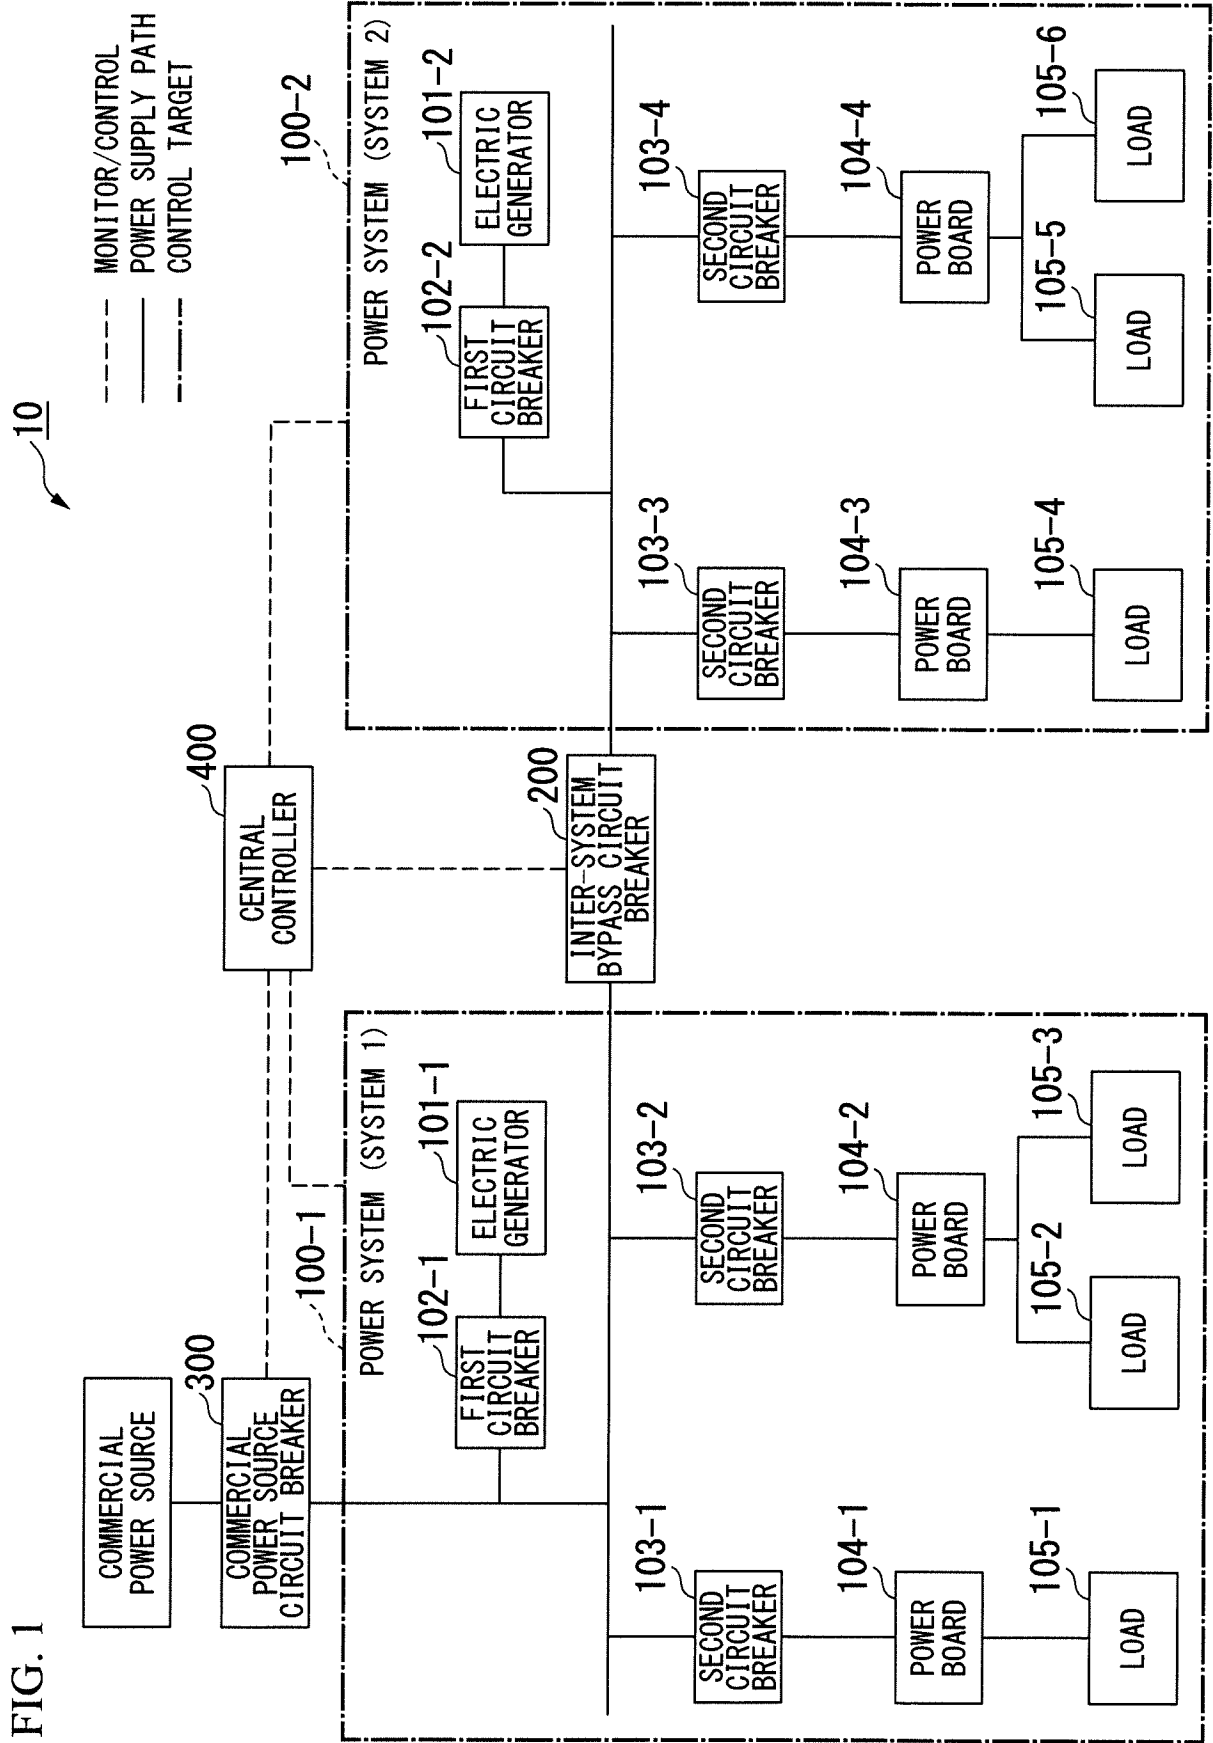


FIG. 2

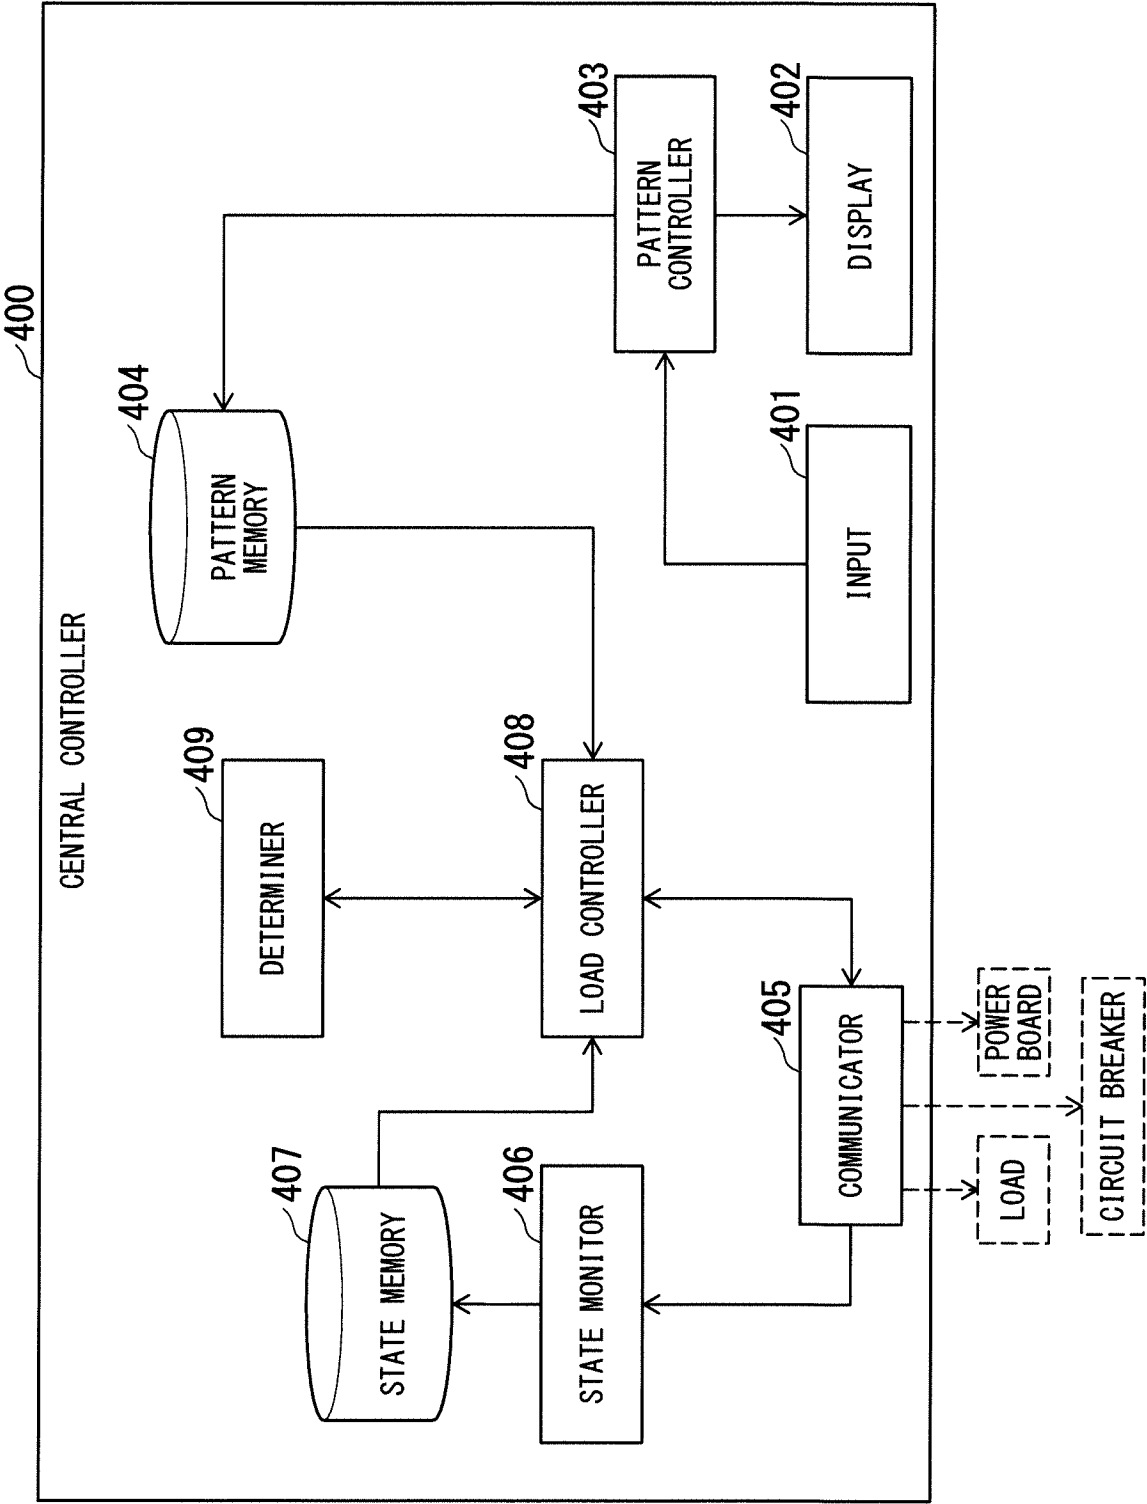


FIG. 3

41

NUMBER	PRIORITY	CONTROL TARGET	CAPACITY[kW]	EXCLUDED	TOTAL CAPACITY[kW]
NUMBER	PRIORITY	CONTROL TARGET	CAPACITY[kW]	EXCLUDED	TOTAL CAPACITY[kW]
42-1	1	TURN ON LIGHT OF 1st FLOOR A	20		42
42-2	1	TURN ON LIGHT OF 1st FLOOR B	22		42
42-3	2	TURN ON AIR CONDITIONER OF 1st FLOOR A	60		60
42-4	2	TURN ON AIR CONDITIONER OF 1st FLOOR B	55	EXCLUDED	60
42-5	3	SET TEMPERATURE OF AIR CONDITIONER OF 1st FLOOR A	0		0
⋮	⋮	⋮	⋮	⋮	⋮

FIG. 4

71

LOAD ID	LOAD STATE VALUE
72-1001	ON
72-1002	OFF
72-1003	OFF
72-1004	ON, COOLING, STRONG
72-1005	OFF
⋮	⋮

FIG. 5

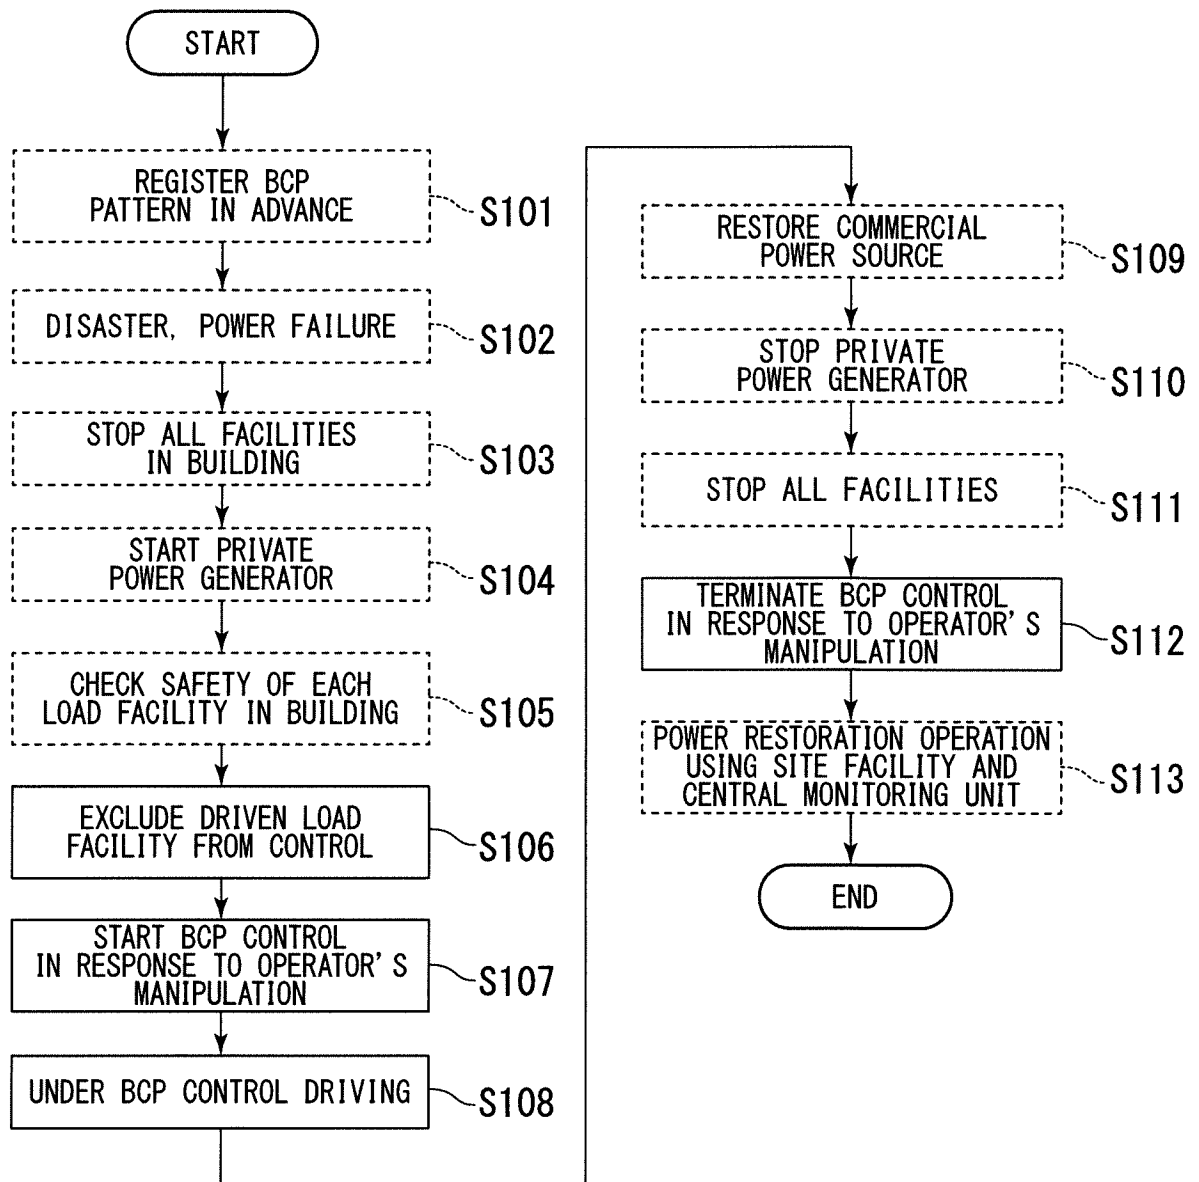


FIG. 6

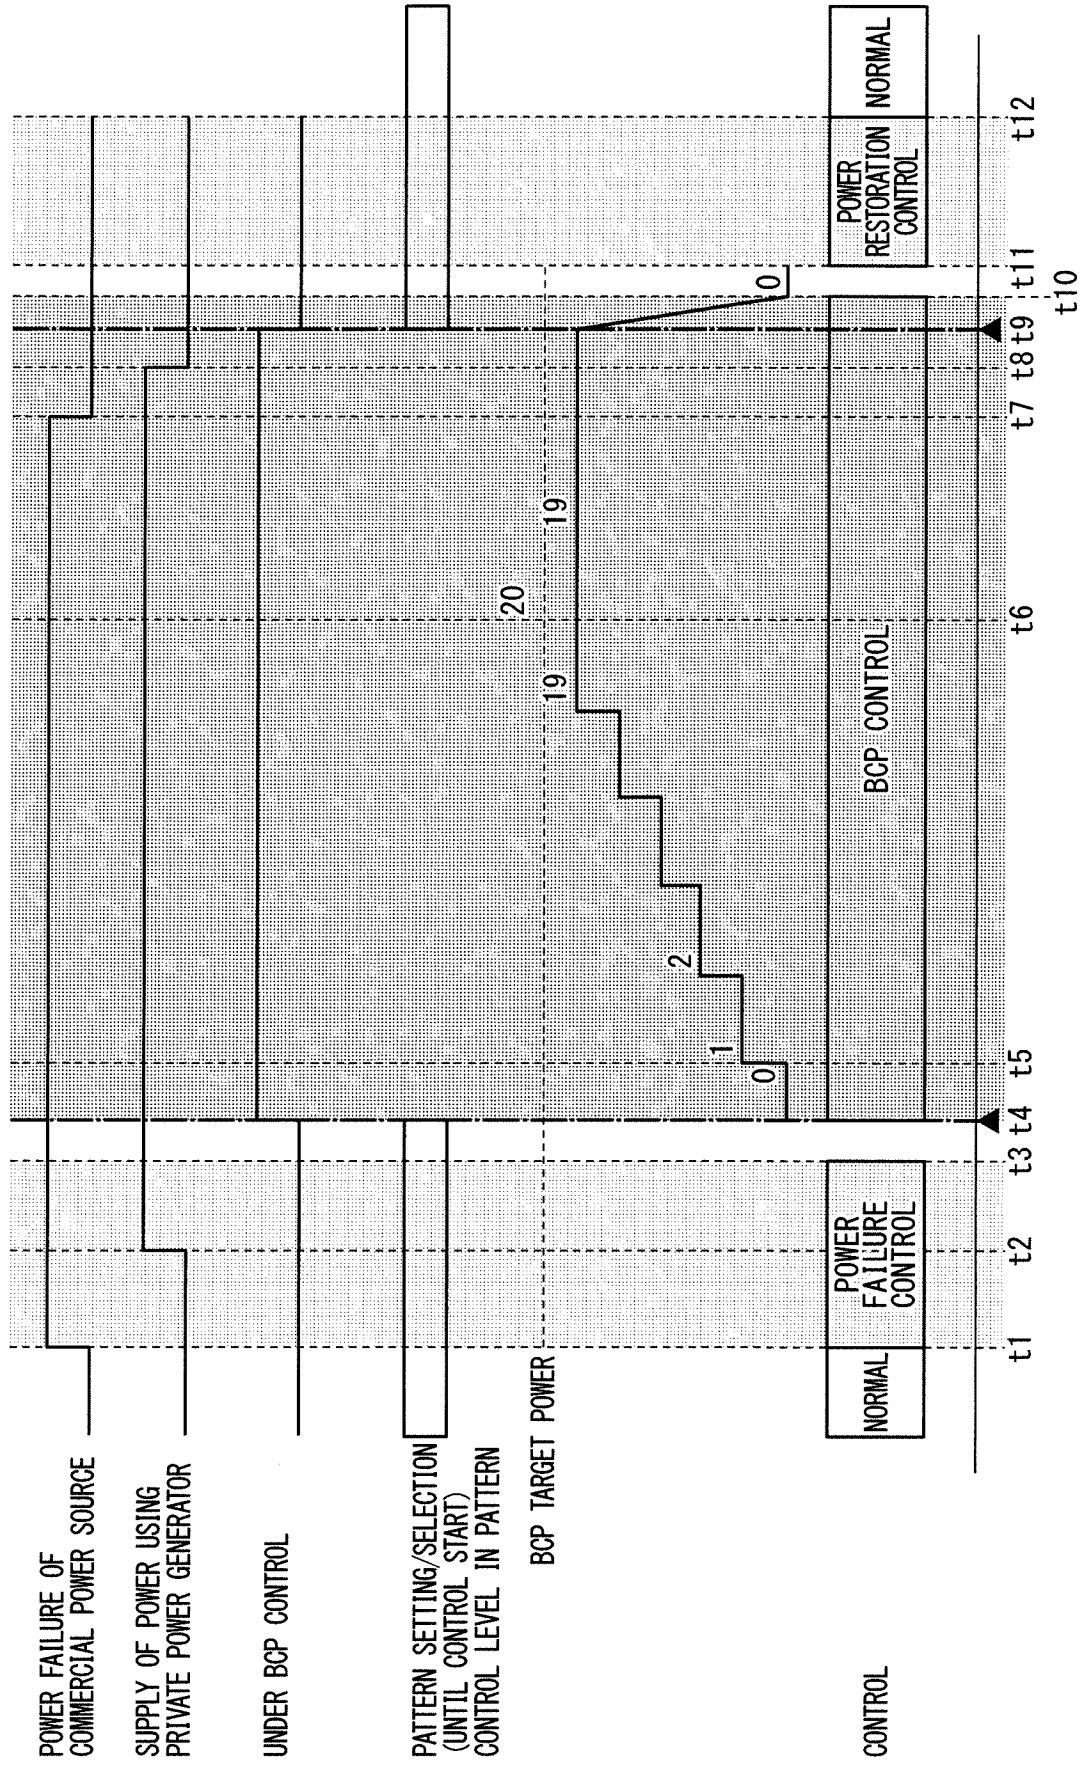


FIG. 7

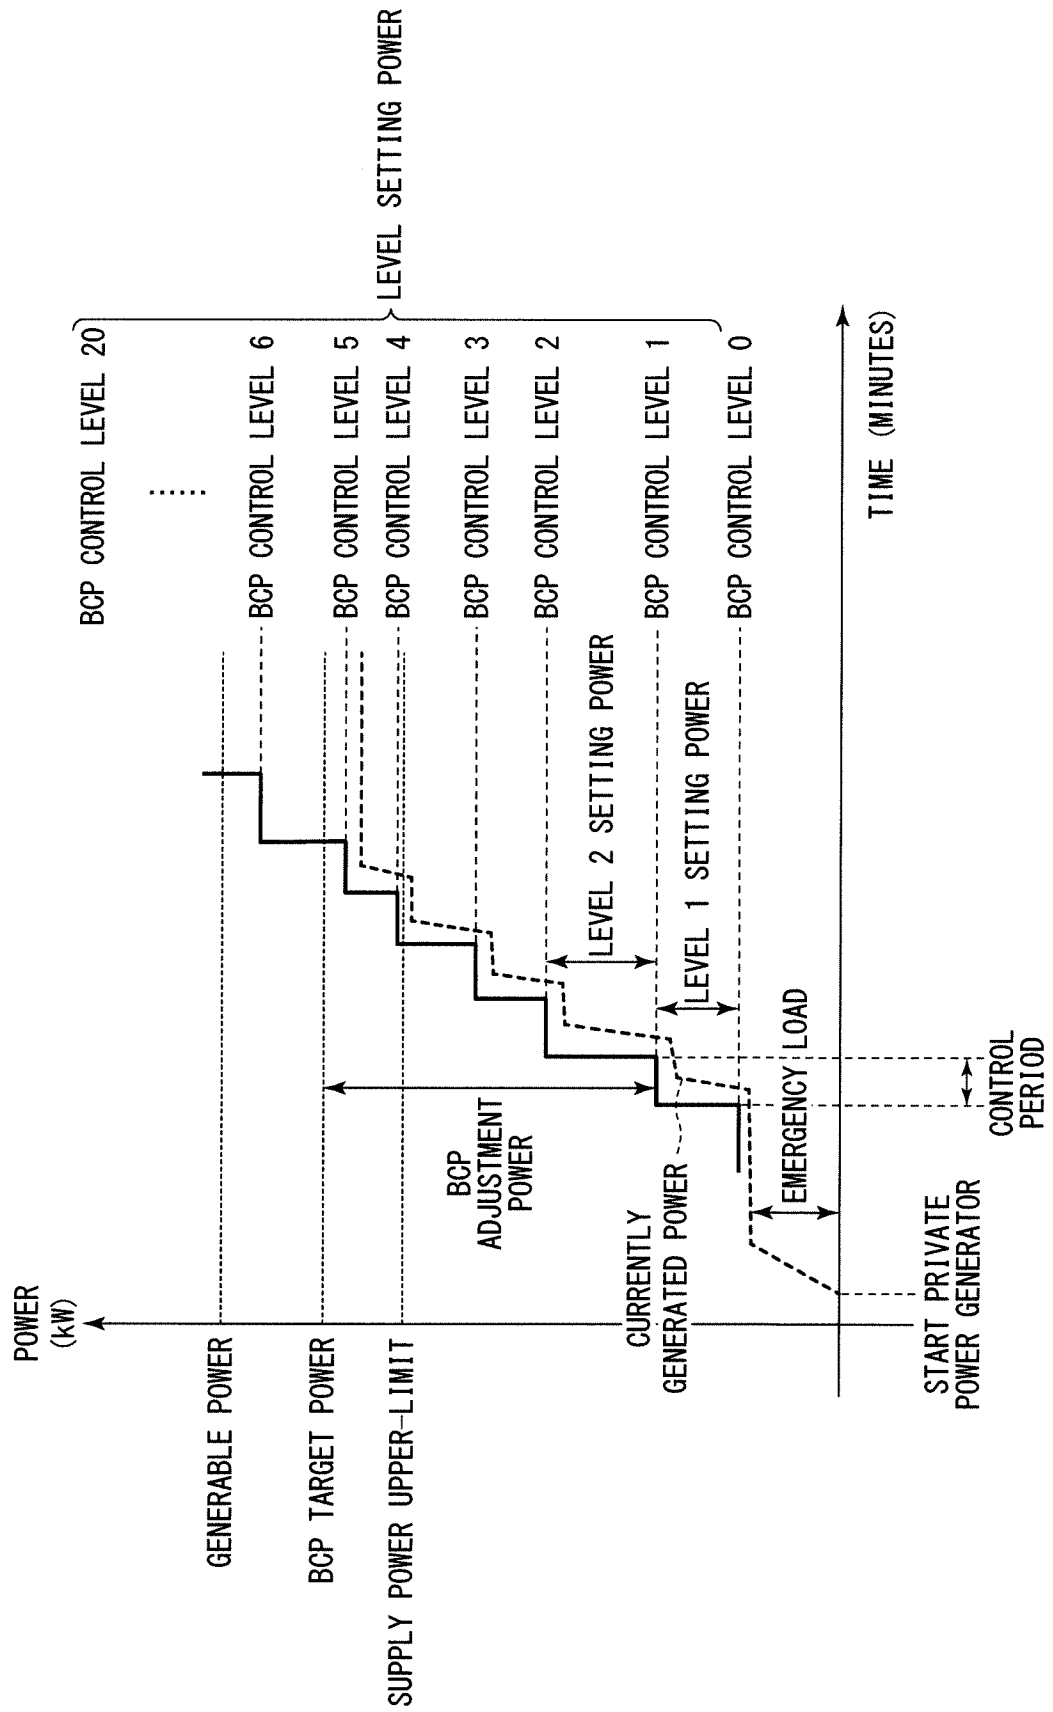


FIG. 8

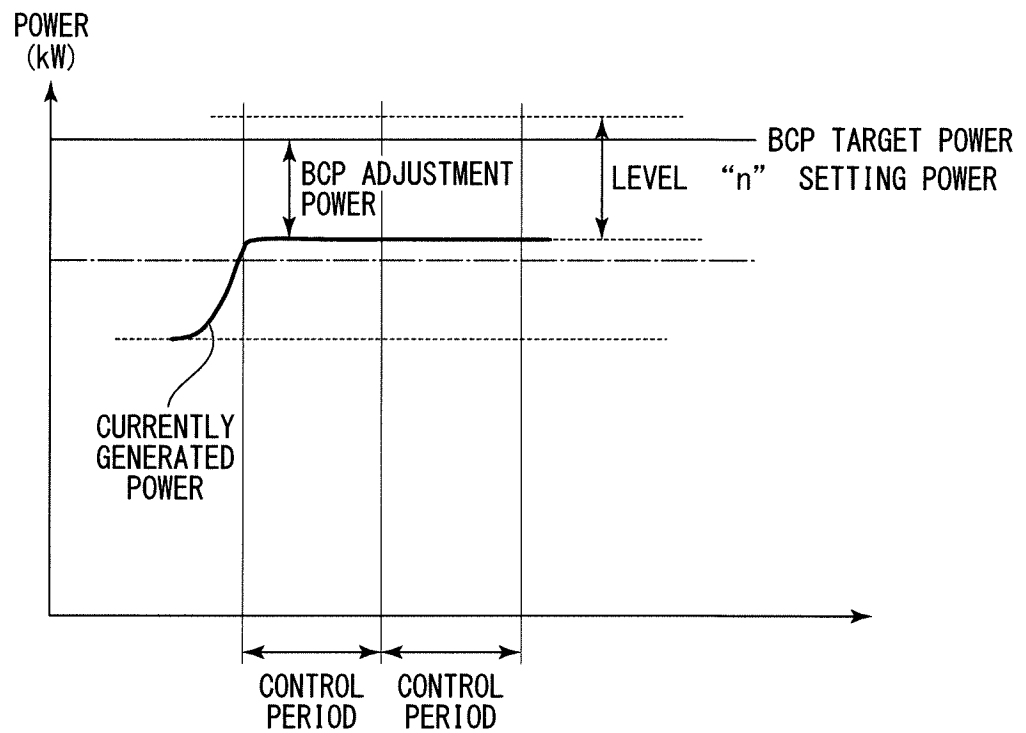


FIG. 9

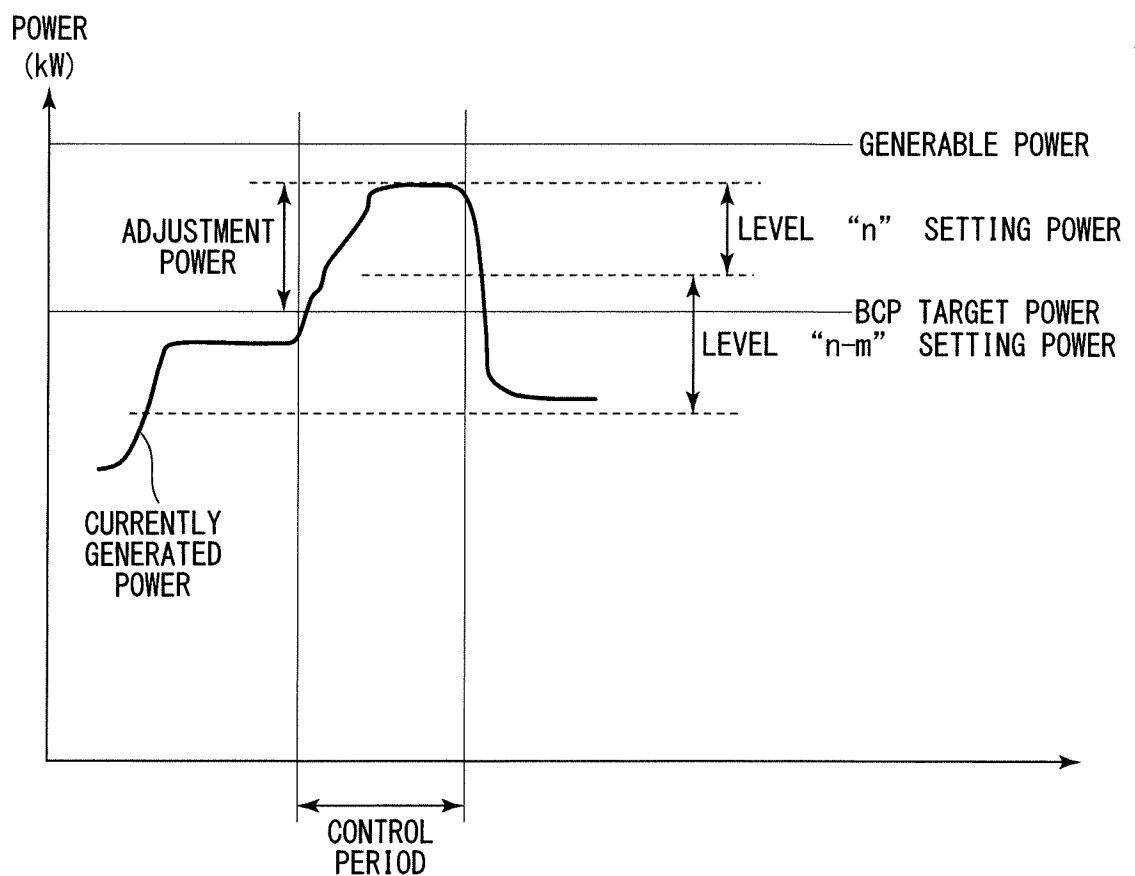


FIG. 10

BCP CONTROL

511 CONTROL MODE NORMAL (TIME-FIXED MODE)

504 SET CONTROL

505 SELECT PATTERN

506 SET PATTERN

507 SET CONTROL CONDITION

508 SET GENERATOR

509 CSV SAVE

510 PRINT

501

SYSTEM 1

SYSTEM 2

FULFILLMENT OF BCP CONTROL CONDITION

UNDER BCP CONTROL

GENERABLE POWER(kW)

BCP TARGET POWER(kW)

SUPPLY POWER UPPER-LIMIT(kW)

CURRENTLY GENERATED POWER(kW)

BCP ADJUSTMENT POWER(kW)

BCP TRANSITION REQUEST

HEATER

AIR CONDITIONER /OUTDOOR UNIT

LIGHTS

SYSTEM 1

SYSTEM 2

CONTROL LEVEL

CONTROL LEVEL

2

2

2200.00

756.50

605.20

410.00

346.50

900.00

365.00

0.00

0.00

365.00

TRANSITION REQUEST FAILURE

TRANSITION REQUEST COMPLETED

TRANSITION REQUEST COMPLETED

LEVEL SETTING POWER

PATTERN 1

FACILITIES OF B1F TO 2F

PATTERN 2

FACILITIES OF 11F TO 12F

1	35.80	490.40	1	35.80	11	100.00
2	50.80	590.40	2	55.00	12	100.00
3	65.80	677.40	3	65.00	13	100.00
4	100.80	707.40	4	75.00	14	100.00
5	125.80	767.40	5	85.80	15	100.00
6	175.80	792.40	6	100.00	16	100.00
7	235.80	807.40	7	100.00	17	100.00
8	290.80	827.40	8	100.00	18	100.00
9	340.80	847.40	9	100.00	19	100.00
10	440.40	897.40	10	100.00	20	100.00

FIG. 11

PATTERN SETTING

SETTING IS NOT ALLOWED DURING START OF CONTROL

SELECT PATTERN

PATTERN 1

NAME OF PATTERN

FACILITIES OF B1F TO 2F

TOTAL LOAD CAPACITY OF PATTERN 897.4kW

No.	LEVEL	NAME OF LOAD	STATUS	SETTING VALUE	SETTING CAPACITY [kW]	EXCLUDED	CHANGE STATUS	TOTAL [kW]
1	1	ACP-1-A-a_TEMPERATURE SETTING		☐	0.0			35.8
2	1	ACP-1-B-a_TEMPERATURE SETTING		☐	0.0			35.8
3	1	ACP-1-A-a_LIGHT ON	○		20.0			35.8
4	1	ACP-1-B-a_LIGHT ON	○		22.0	EXCLUDED		35.8
5	1	ACP-MDF-A-a_LIGHT ON	○		15.8			35.8
6	1	ACP-1-A-a_ILLUMINANCE SETTING		☒	0.0		SKIP	35.8
7	2	ACP-1-B-c_LIGHT ON	○		15.0			15.0
8	3	ACP-1-C-a_LIGHT ON	○		15.0			15.0
9	4	ACP-1-C-d_LIGHT ON	○		35.0			35.0
10	5	ACP-1-C-e_LIGHT ON	○		25.0			25.0
11	6	ACP-1-A-b_LIGHT ON	○		50.0			50.0
12	7	ACP-1-Ad-a_LIGHT ON	○		60.0			60.0
13	8	ACP-1-Ad-b_LIGHT ON	○		55.0			55.0
14	9	ACP-1-B-b_LIGHT ON	○		50.0			50.0
15	10	ACP-1-B-d_LIGHT ON	○		99.6			99.6

NEW REGISTRATION

CHANGE

DELETE

CANCEL

FIG. 12

PATTERN SELECTION

SYSTEM 1	1
SYSTEM 2	2

701

702 SET 703 CANCEL