


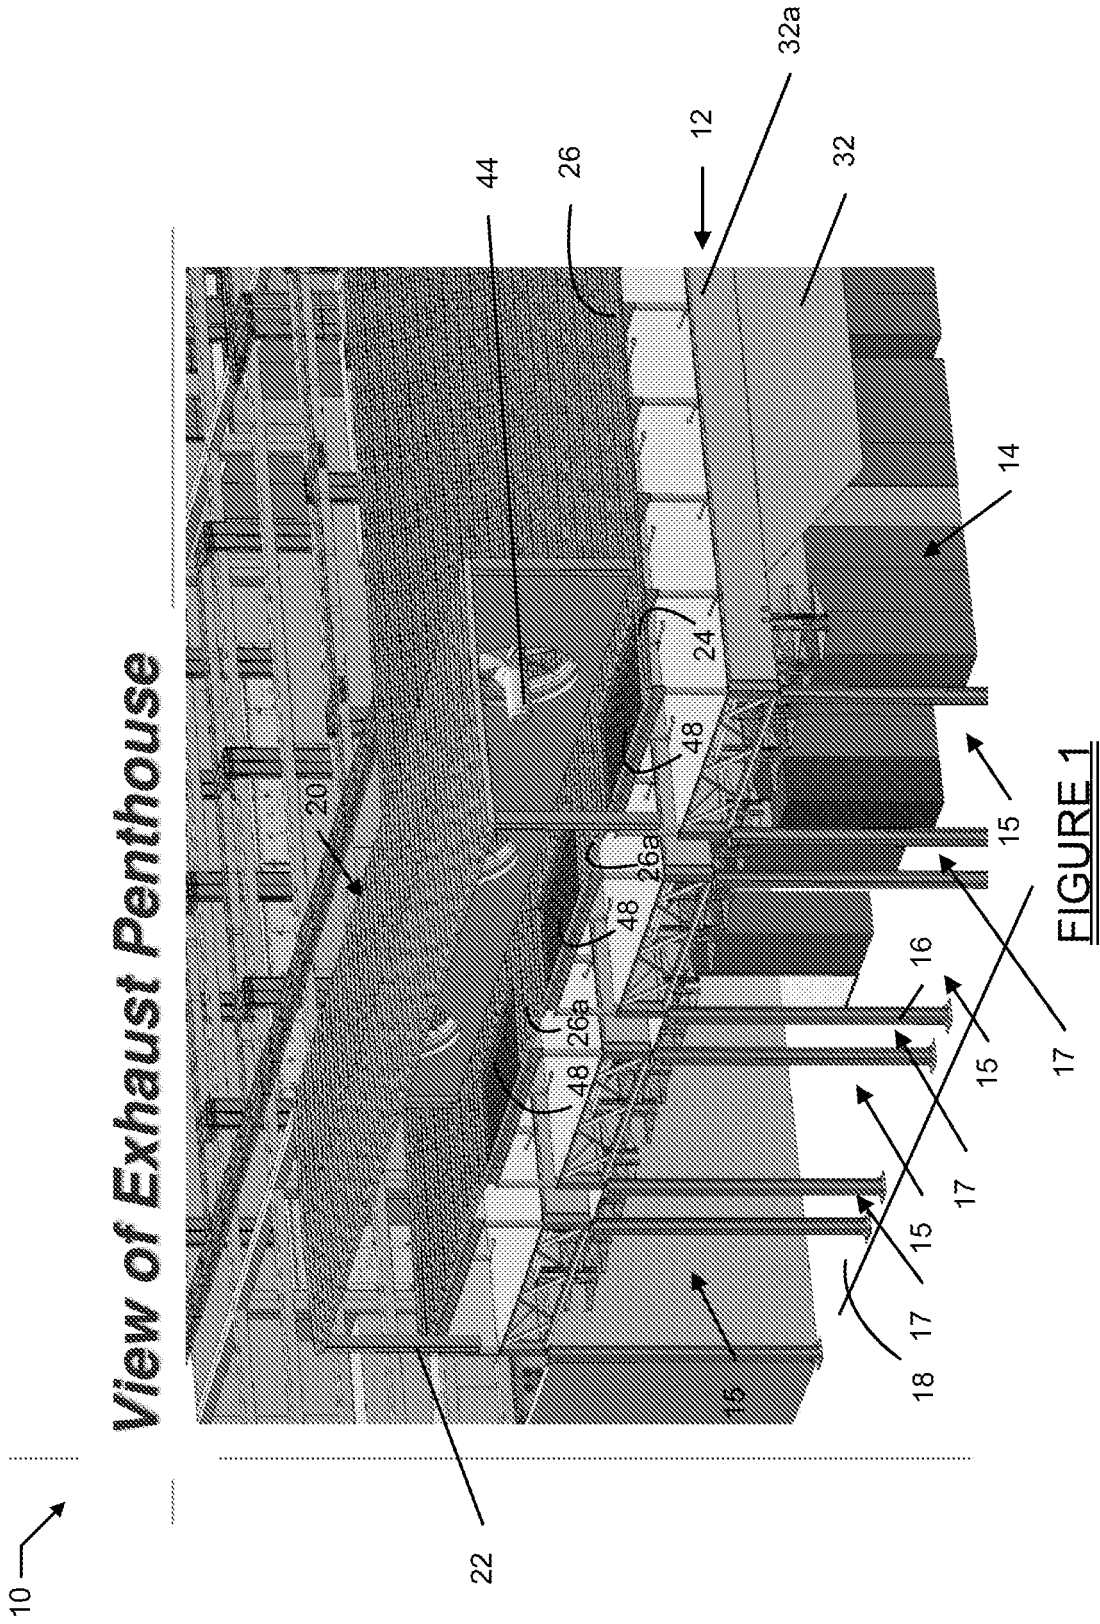

View of Cable Trays

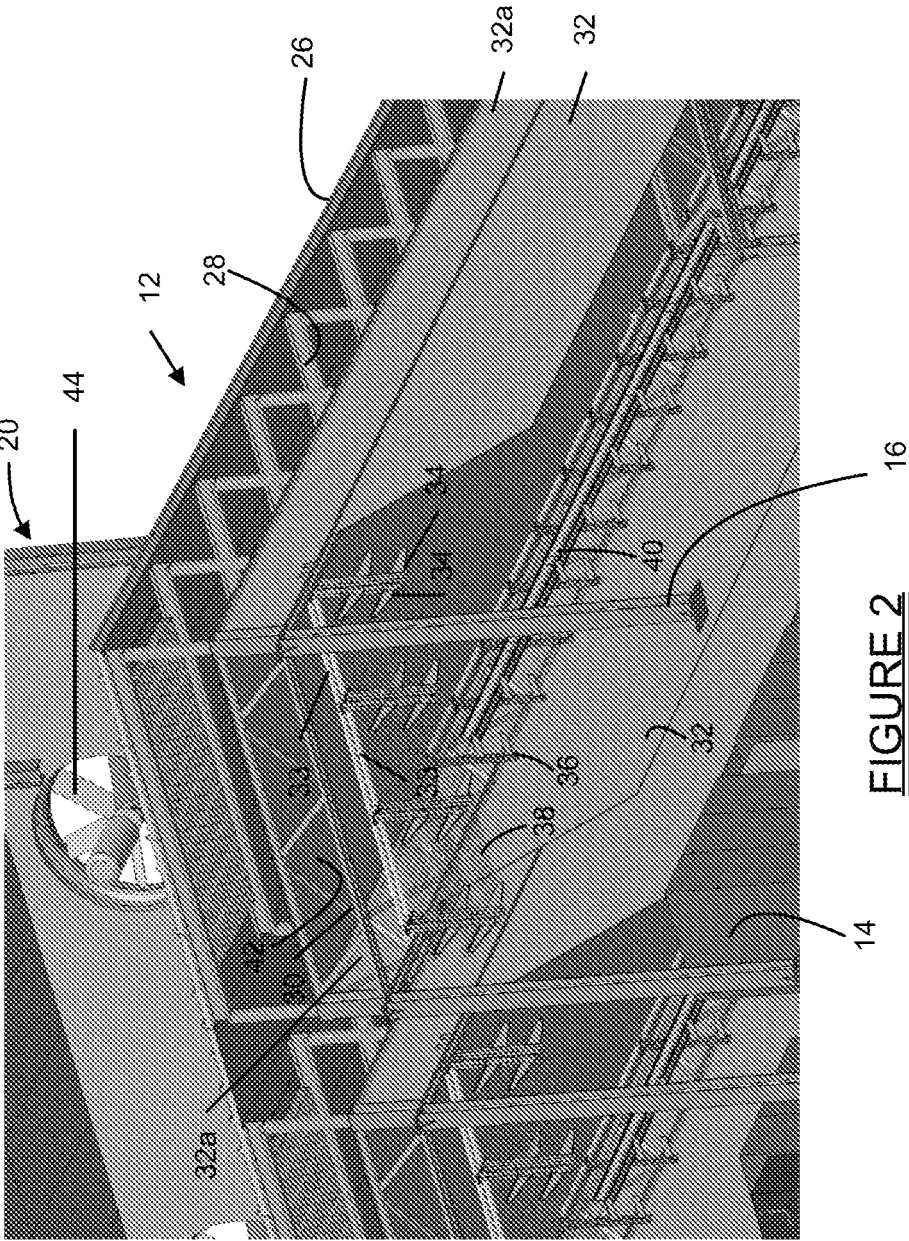


FIGURE 2

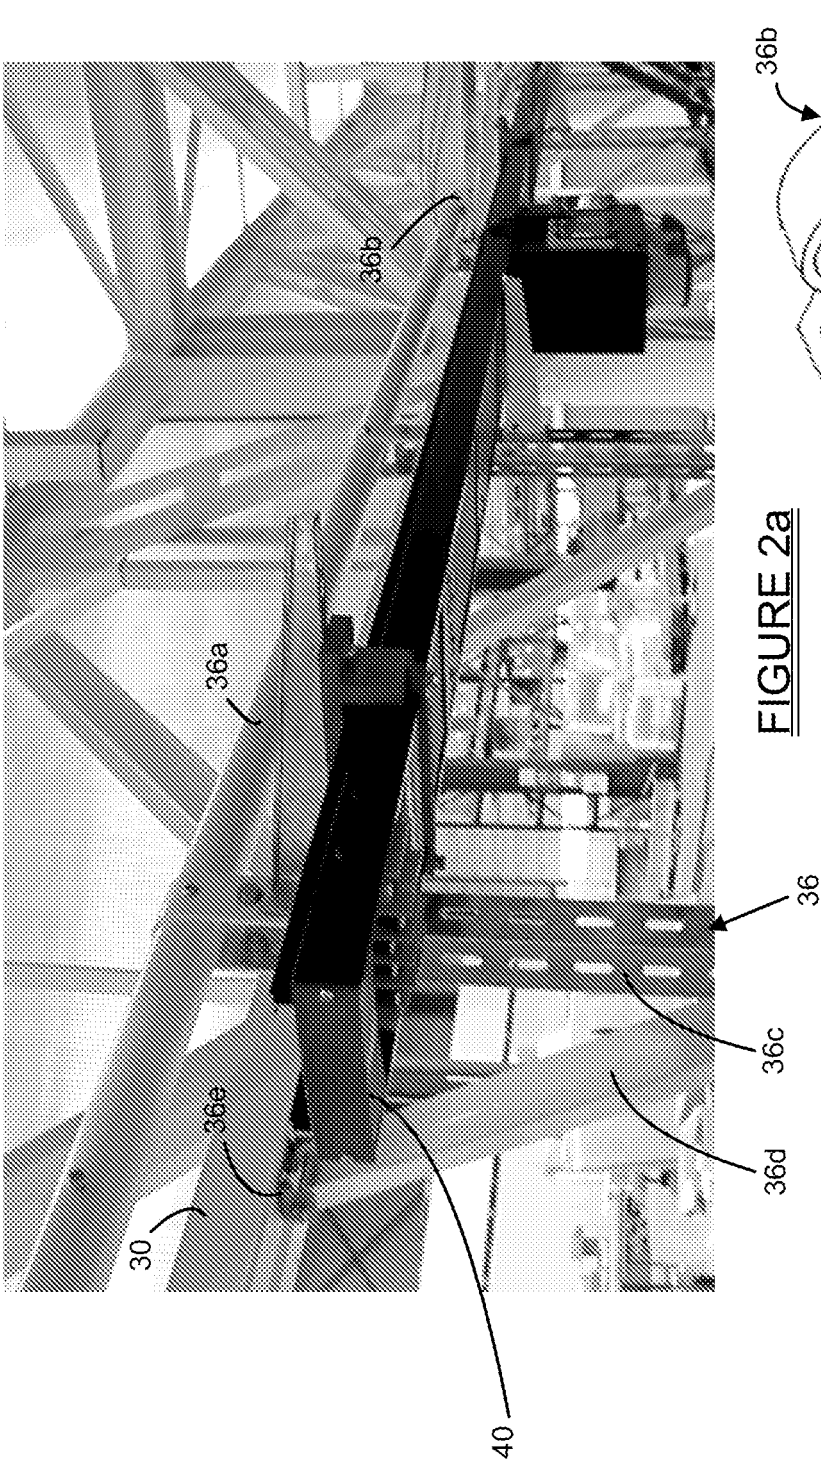


FIGURE 2a

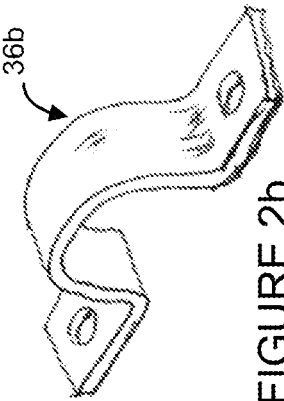


FIGURE 2b

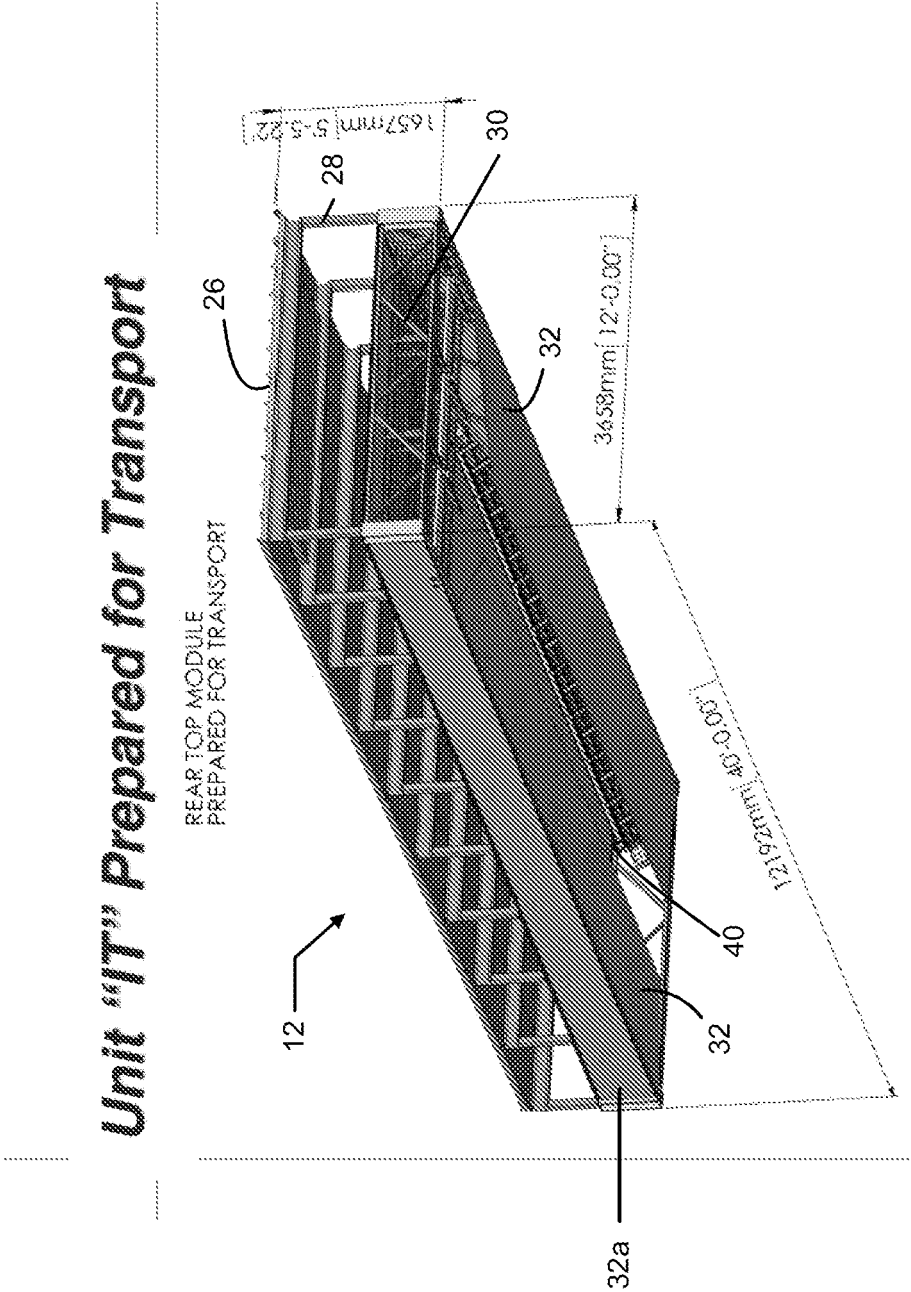


FIGURE 3

5/22

Unit "IT" Prepared for Transport
Front and Back Modules


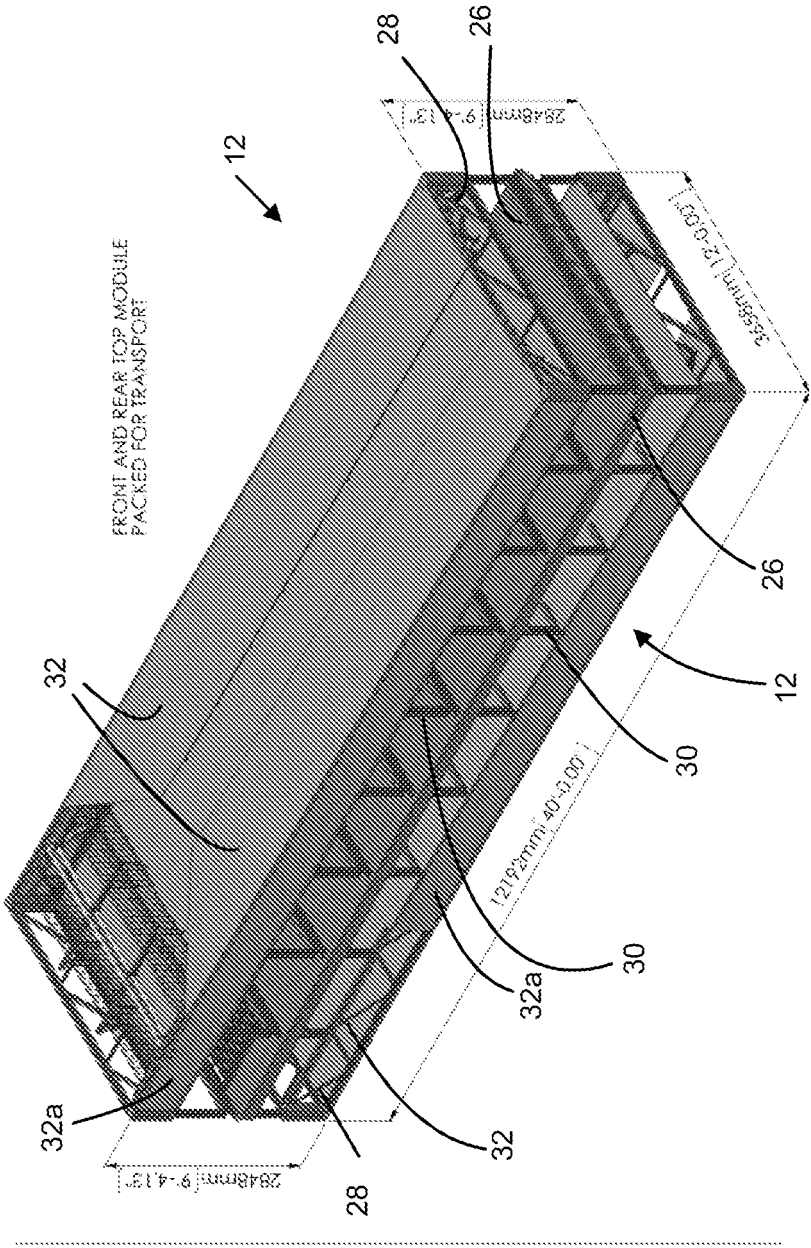


FIGURE 4

6/22

Side View with Penthouse Detail

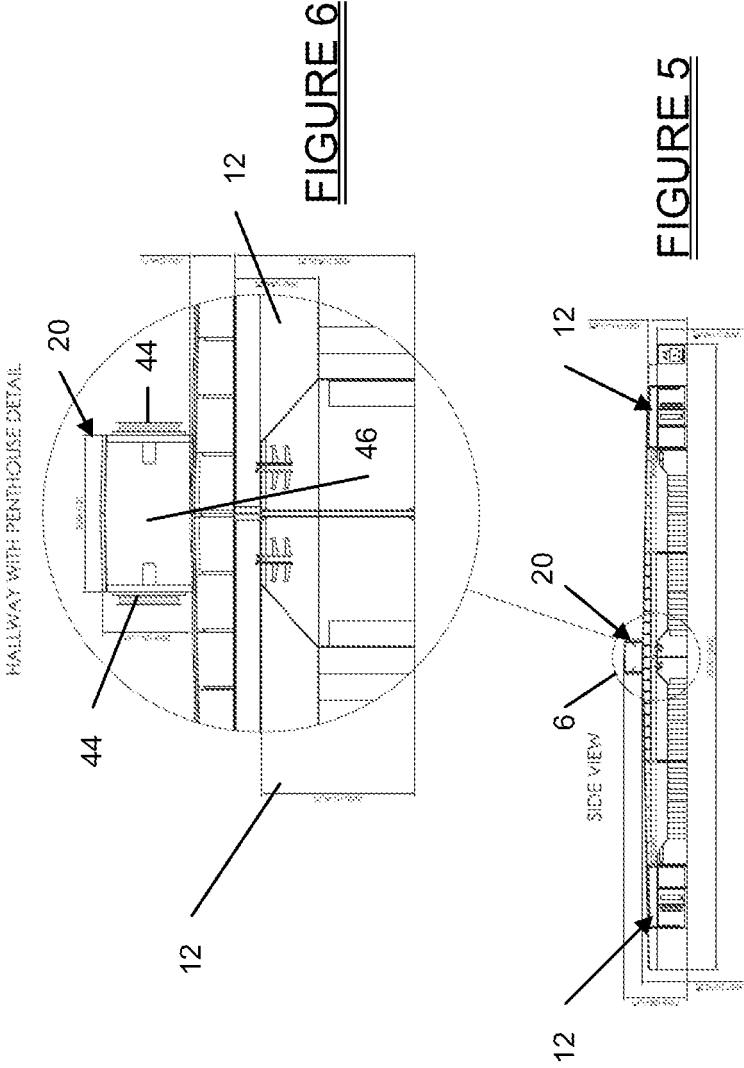

Exhaust System Structure


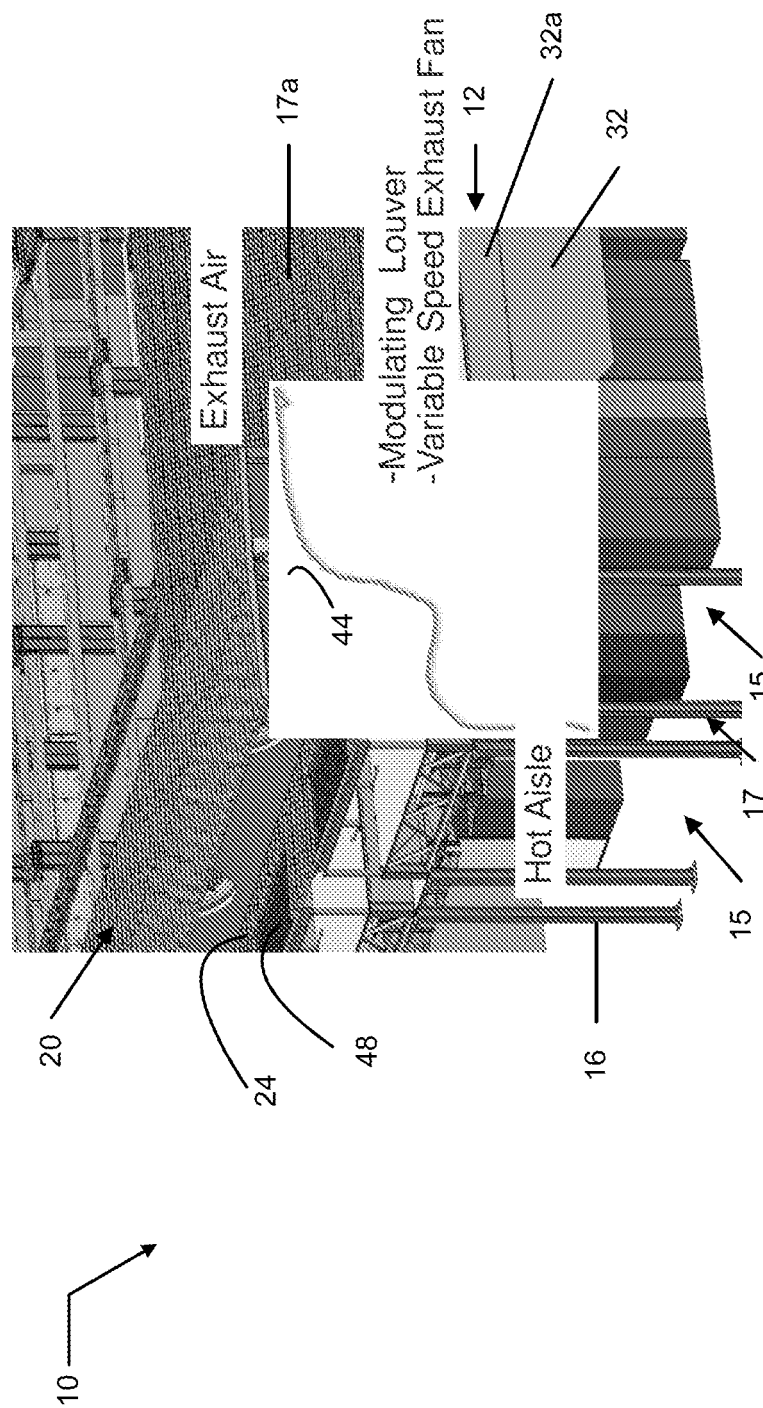


FIGURE 6a

Isometric View of Cooling Module

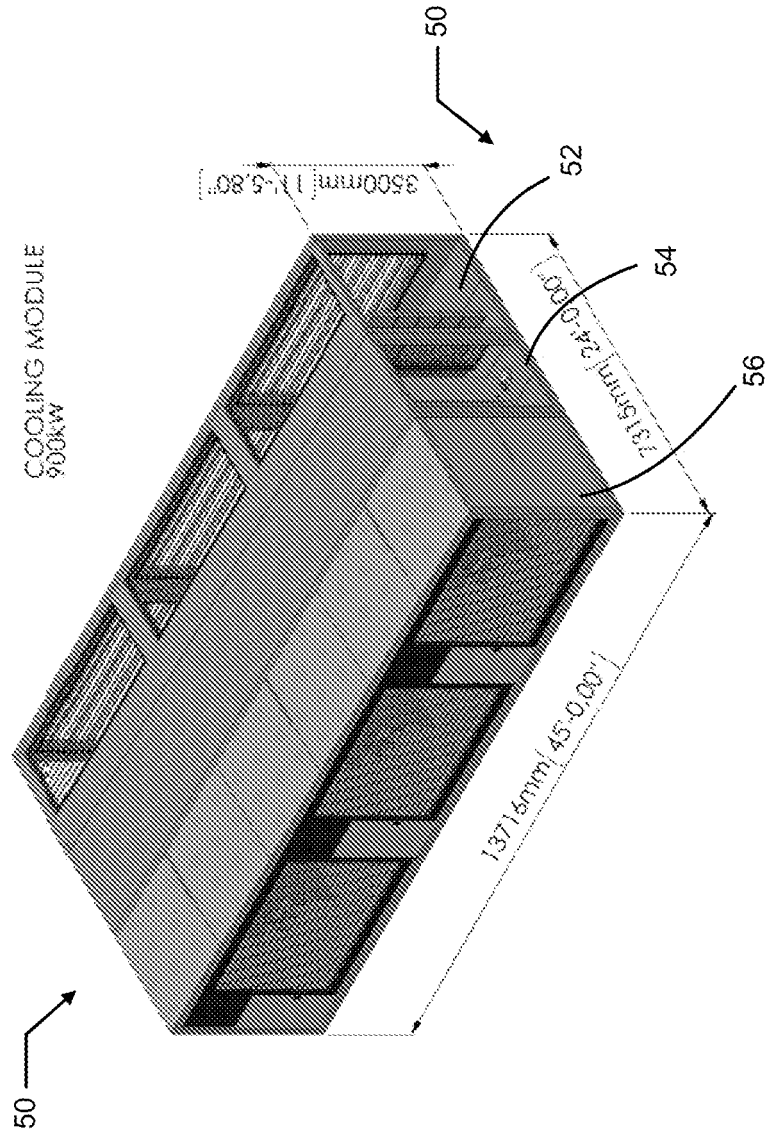

9/22

View of Cooling Module


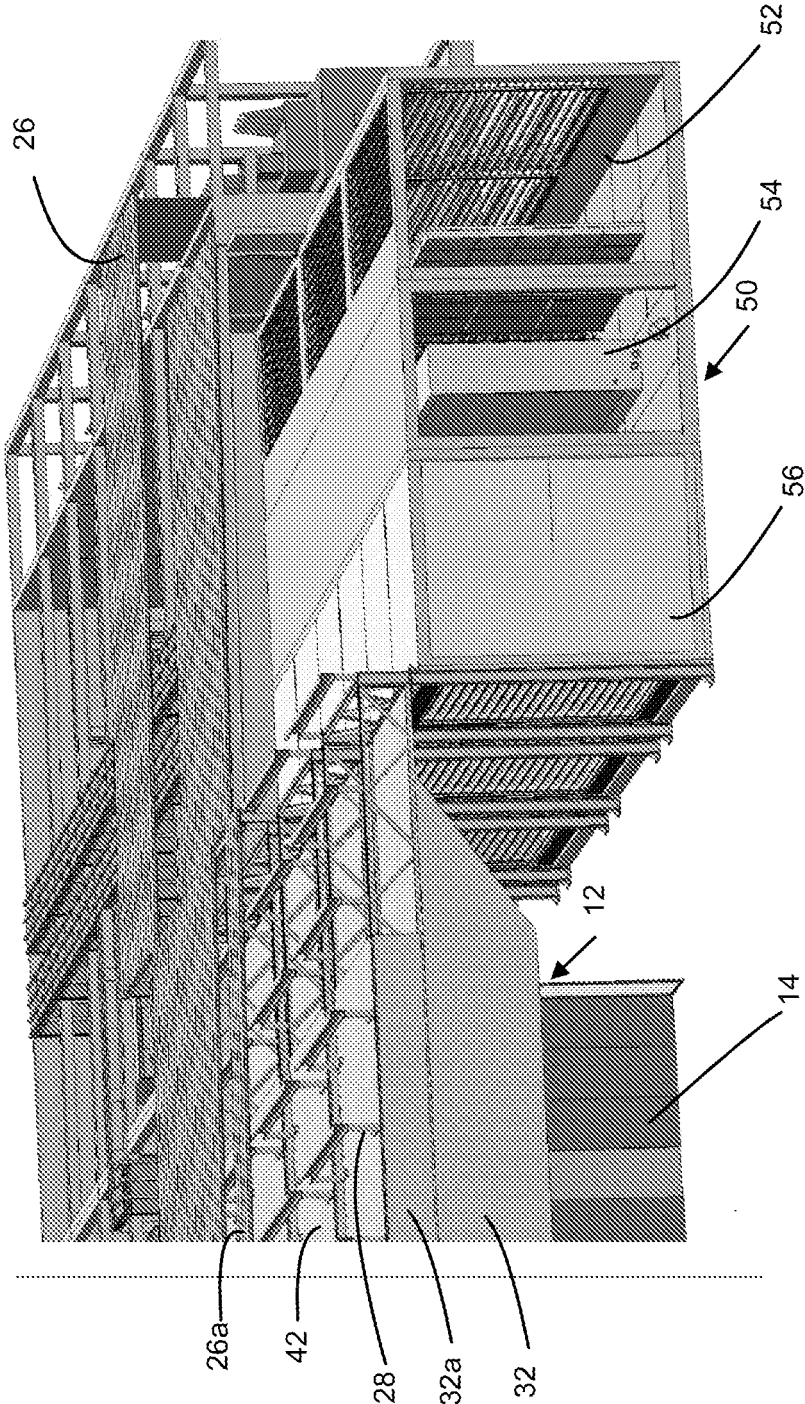


FIGURE 8

10/22

Adiabatic Cooling Solution

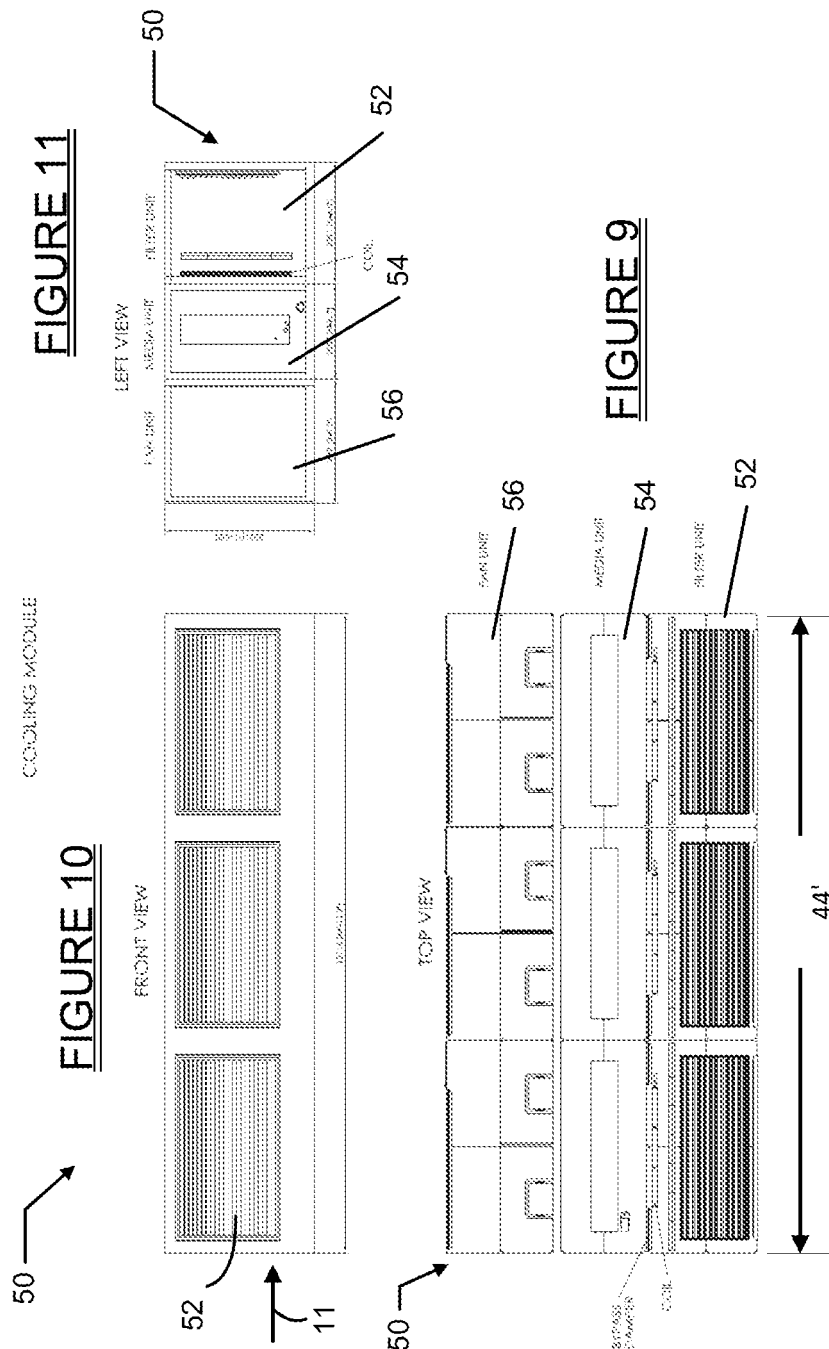

Cooling Components

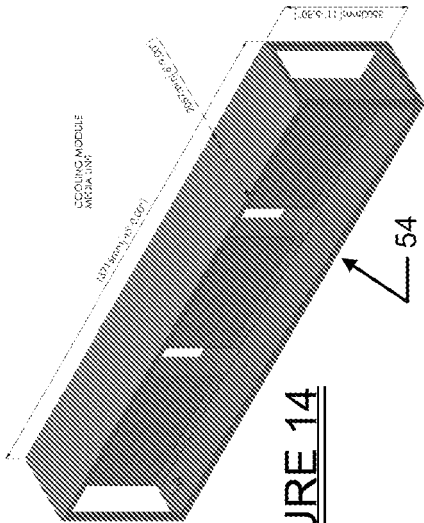


FIGURE 14

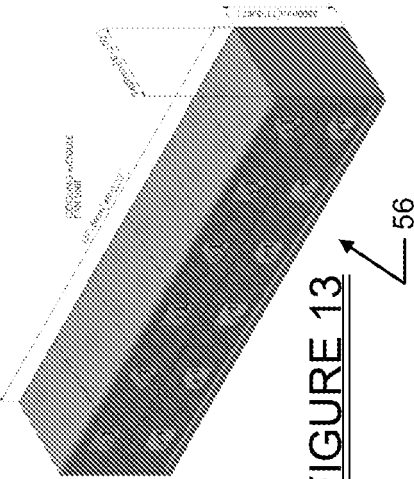


FIGURE 13

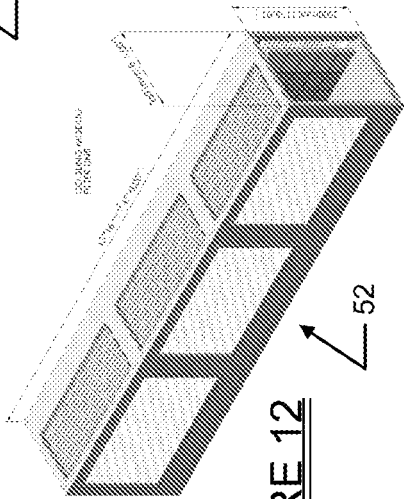


FIGURE 12

12/22

Cooling Module Components


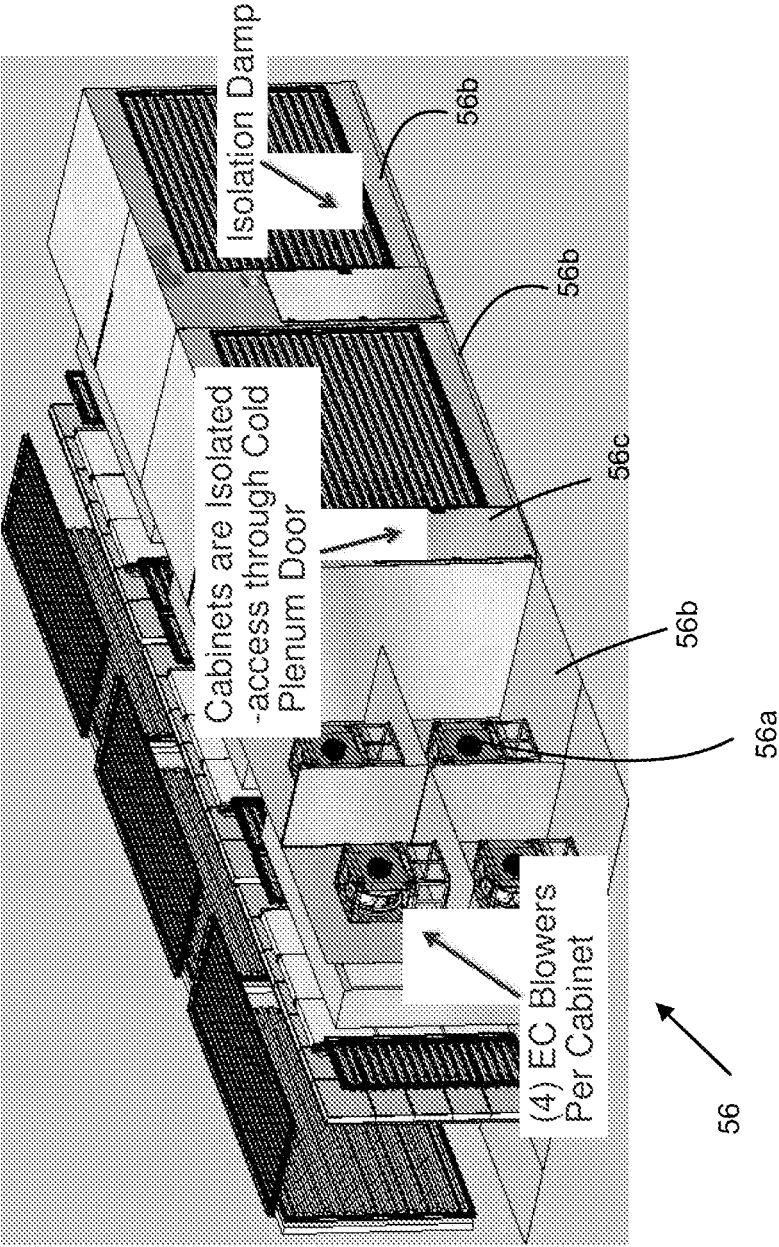


FIGURE 15

Cooling Module Components

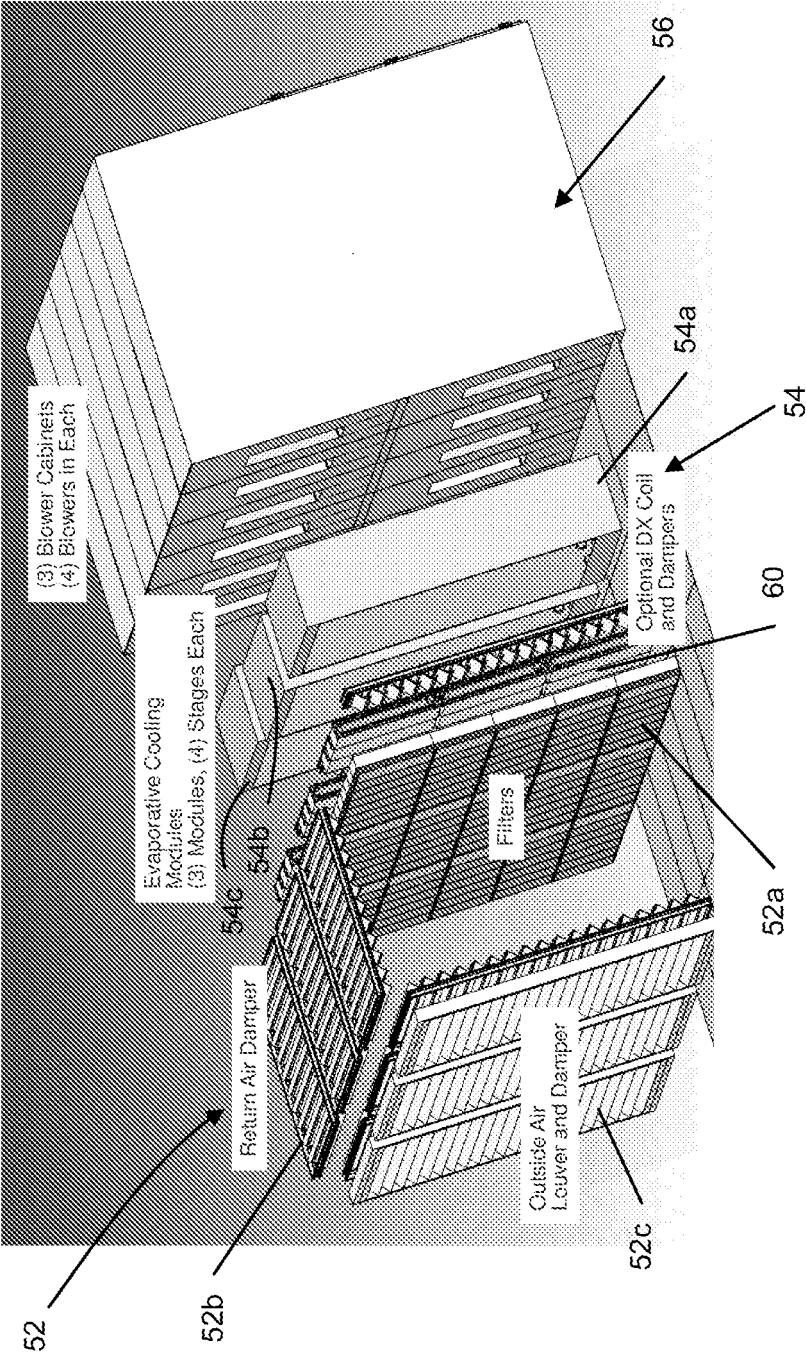

Return System Structure

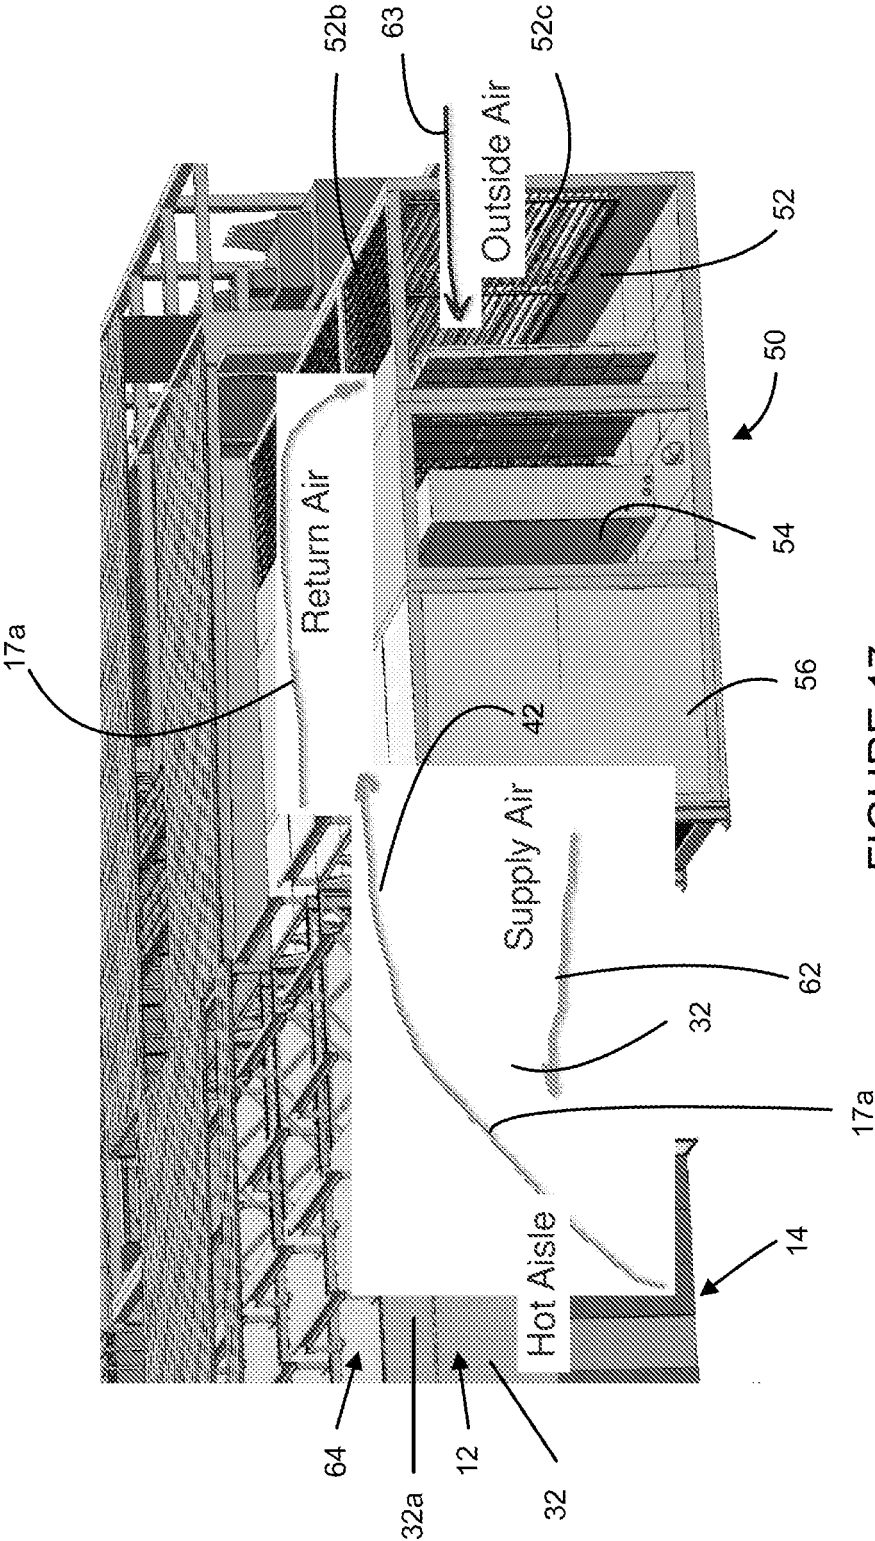


FIGURE 17

60 Hz Power Hall with Bus Bars

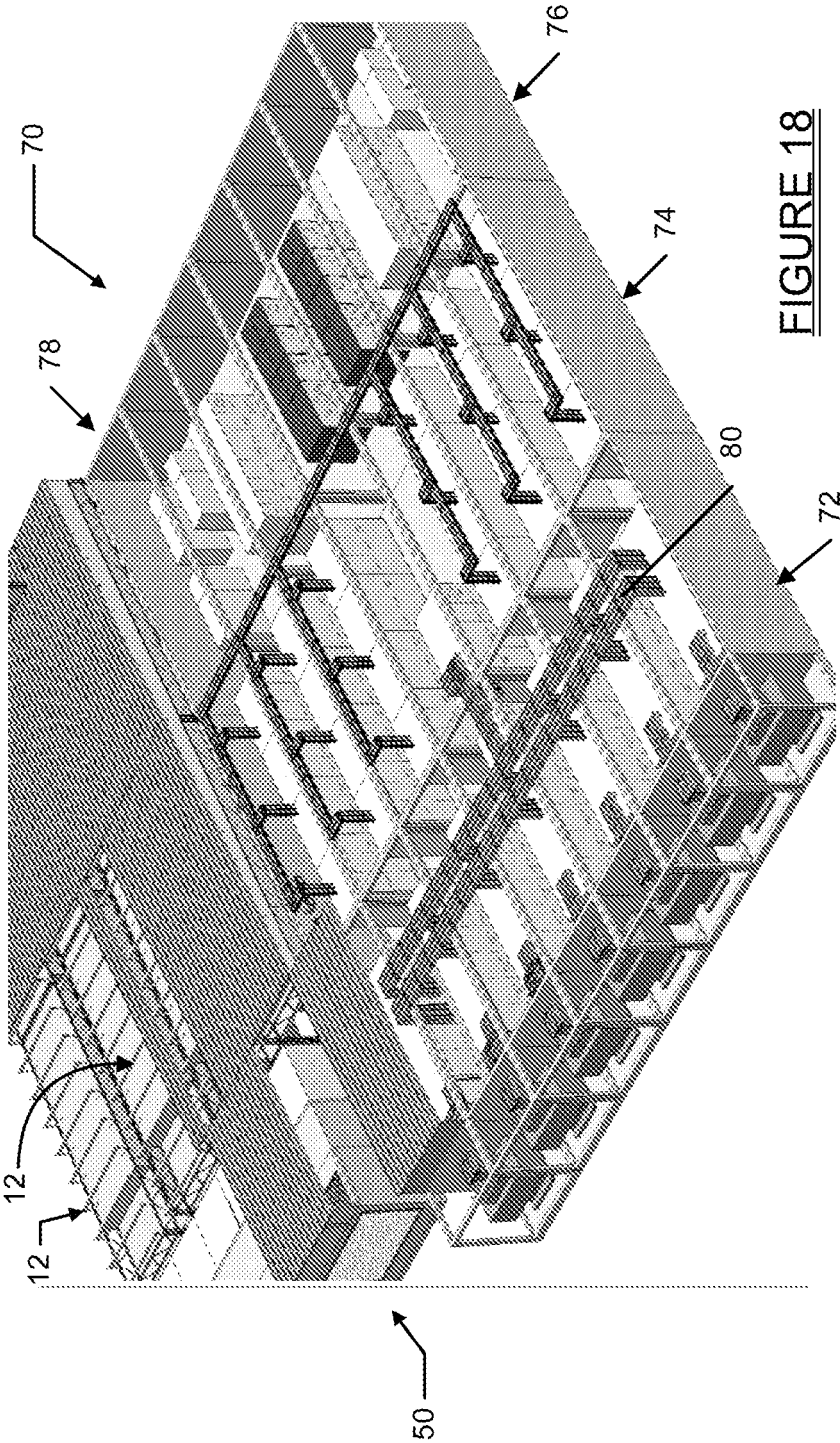


FIGURE 18

MSB5 – 60Hz

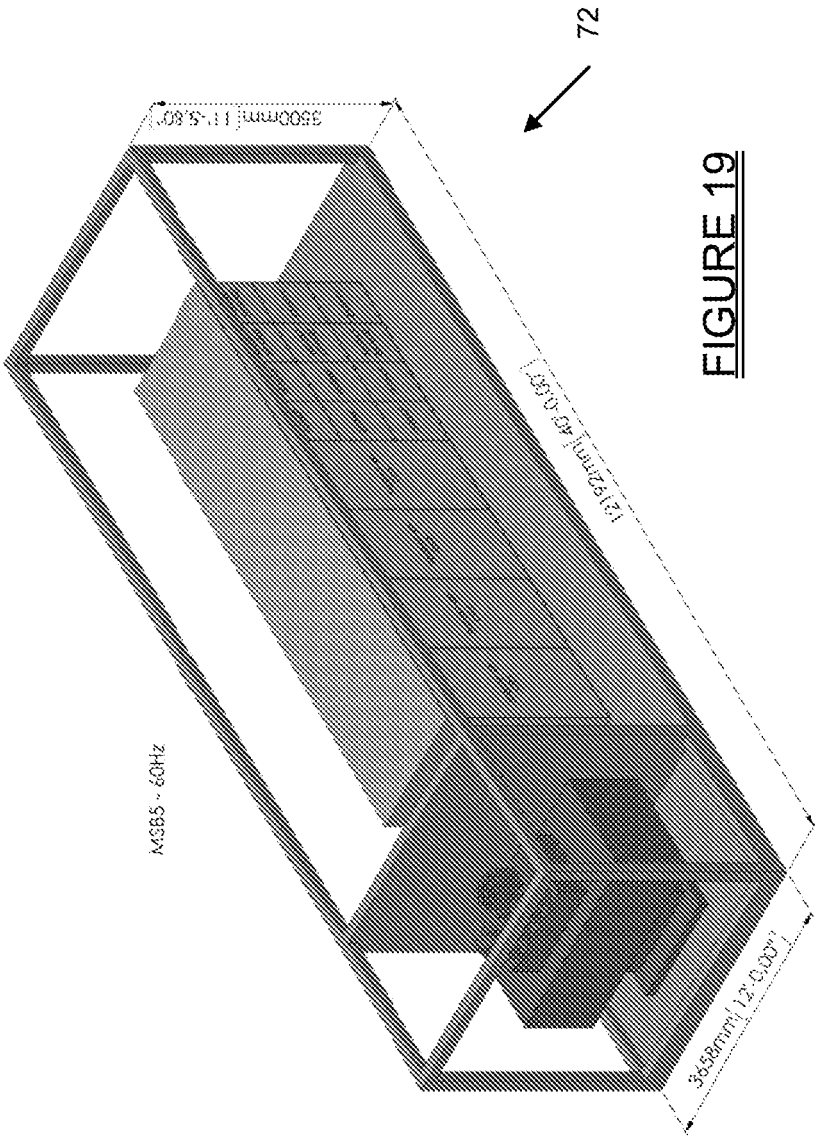


FIGURE 19

SB2 – 60Hz


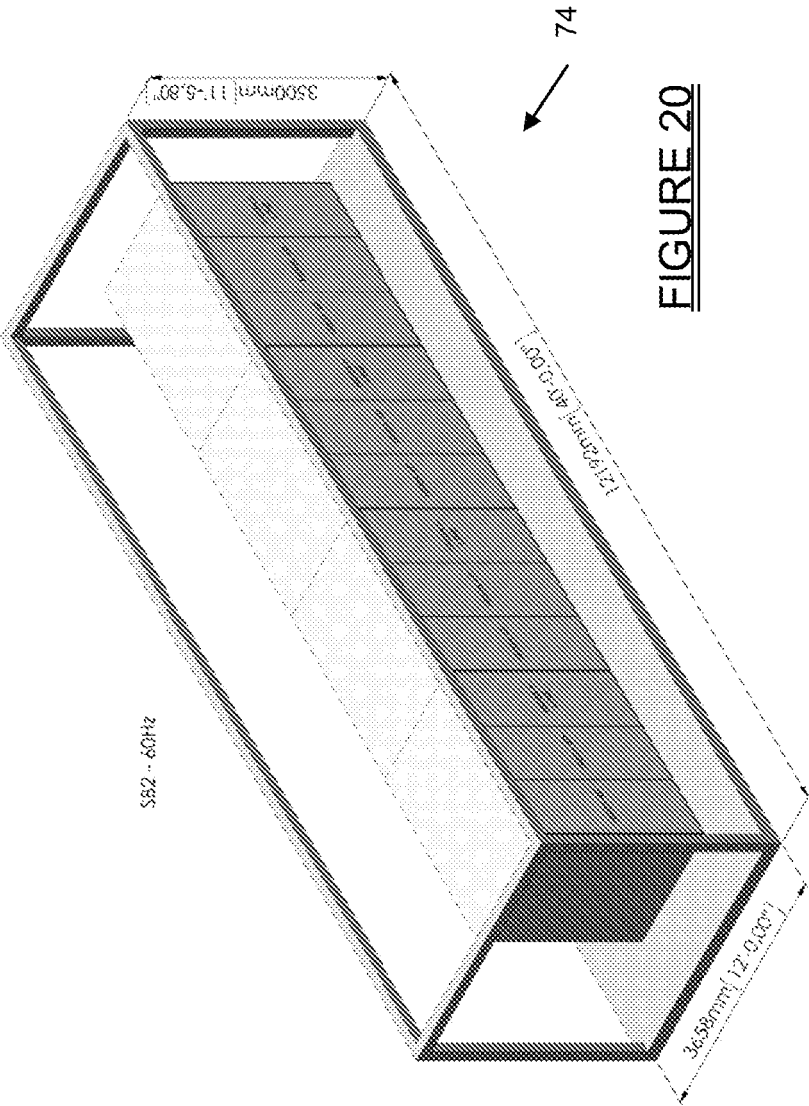


FIGURE 20

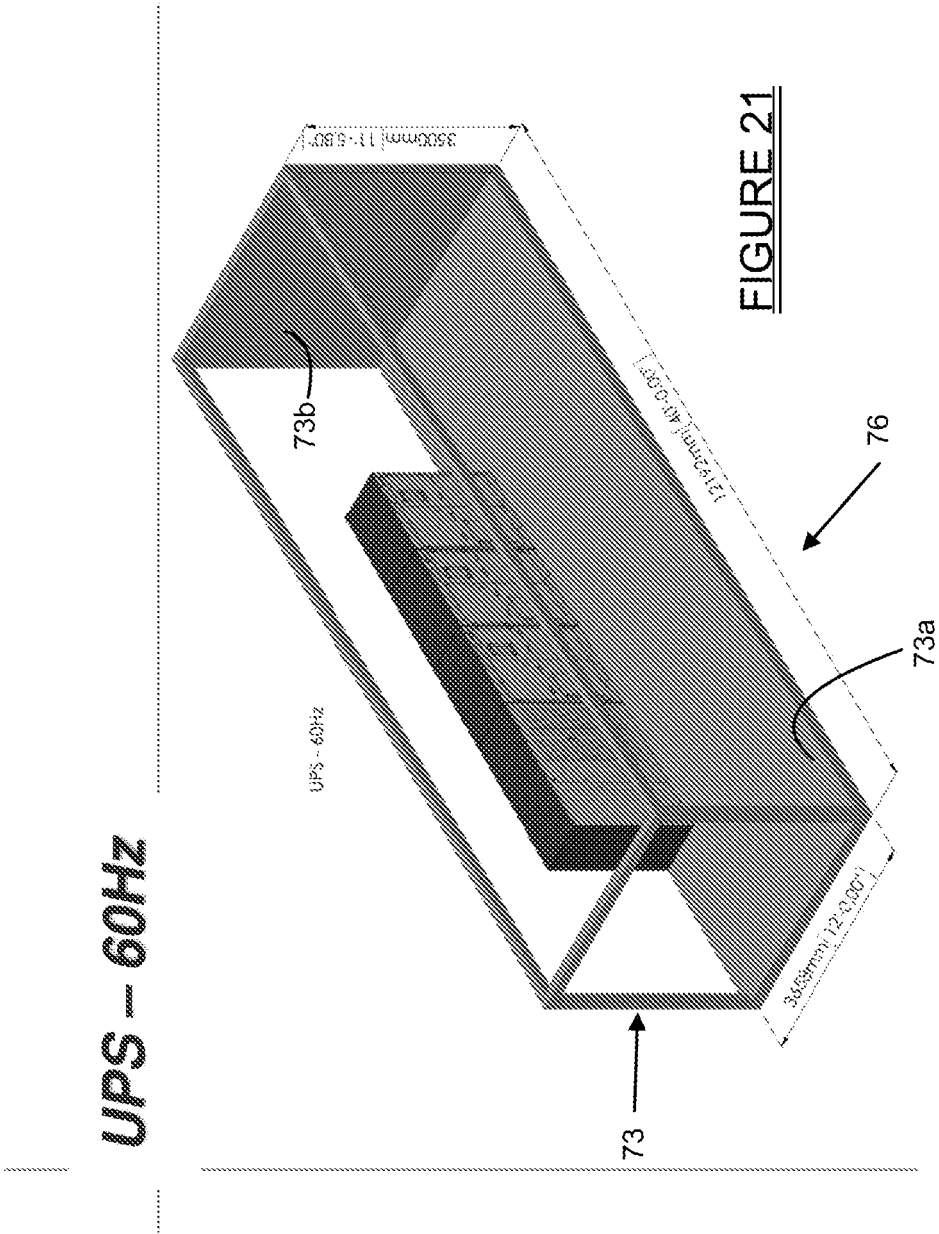

PDU – 60Hz

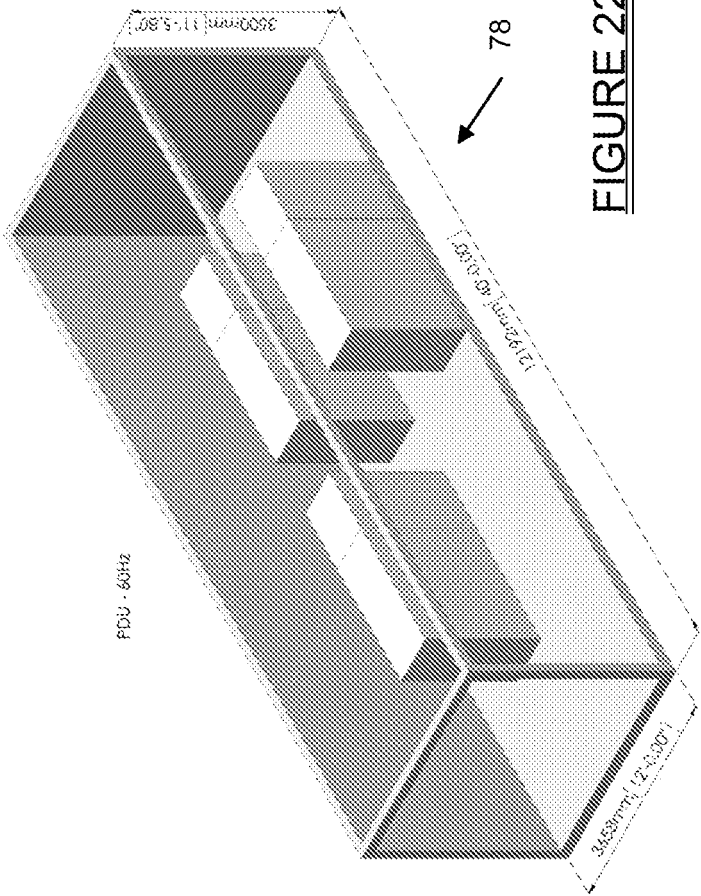


FIGURE 22

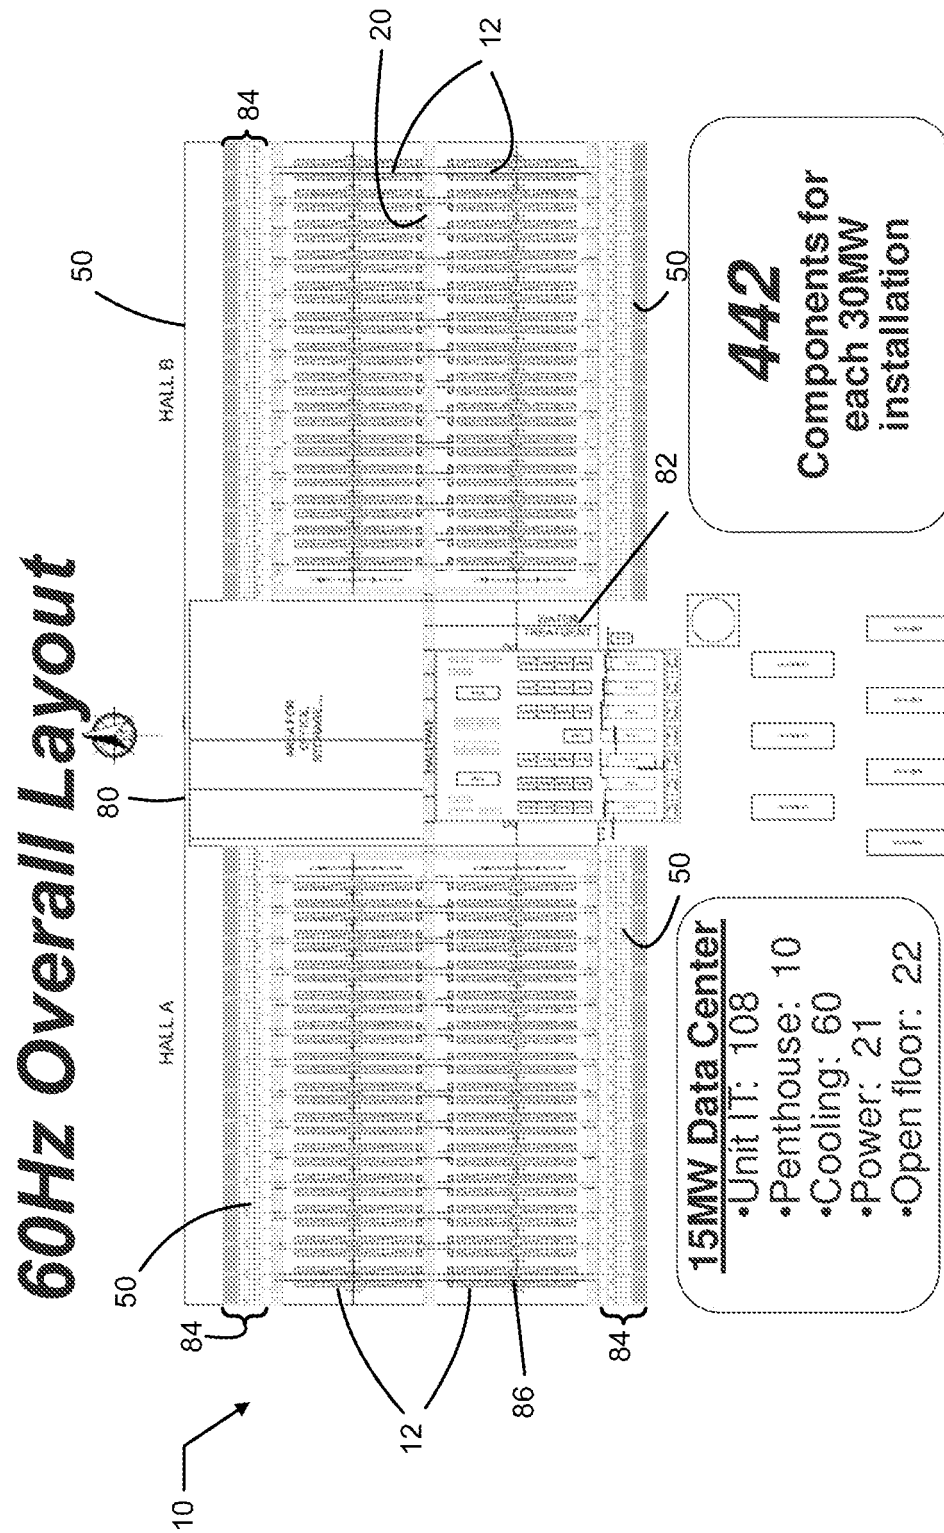


FIGURE 23

