FIG. 1

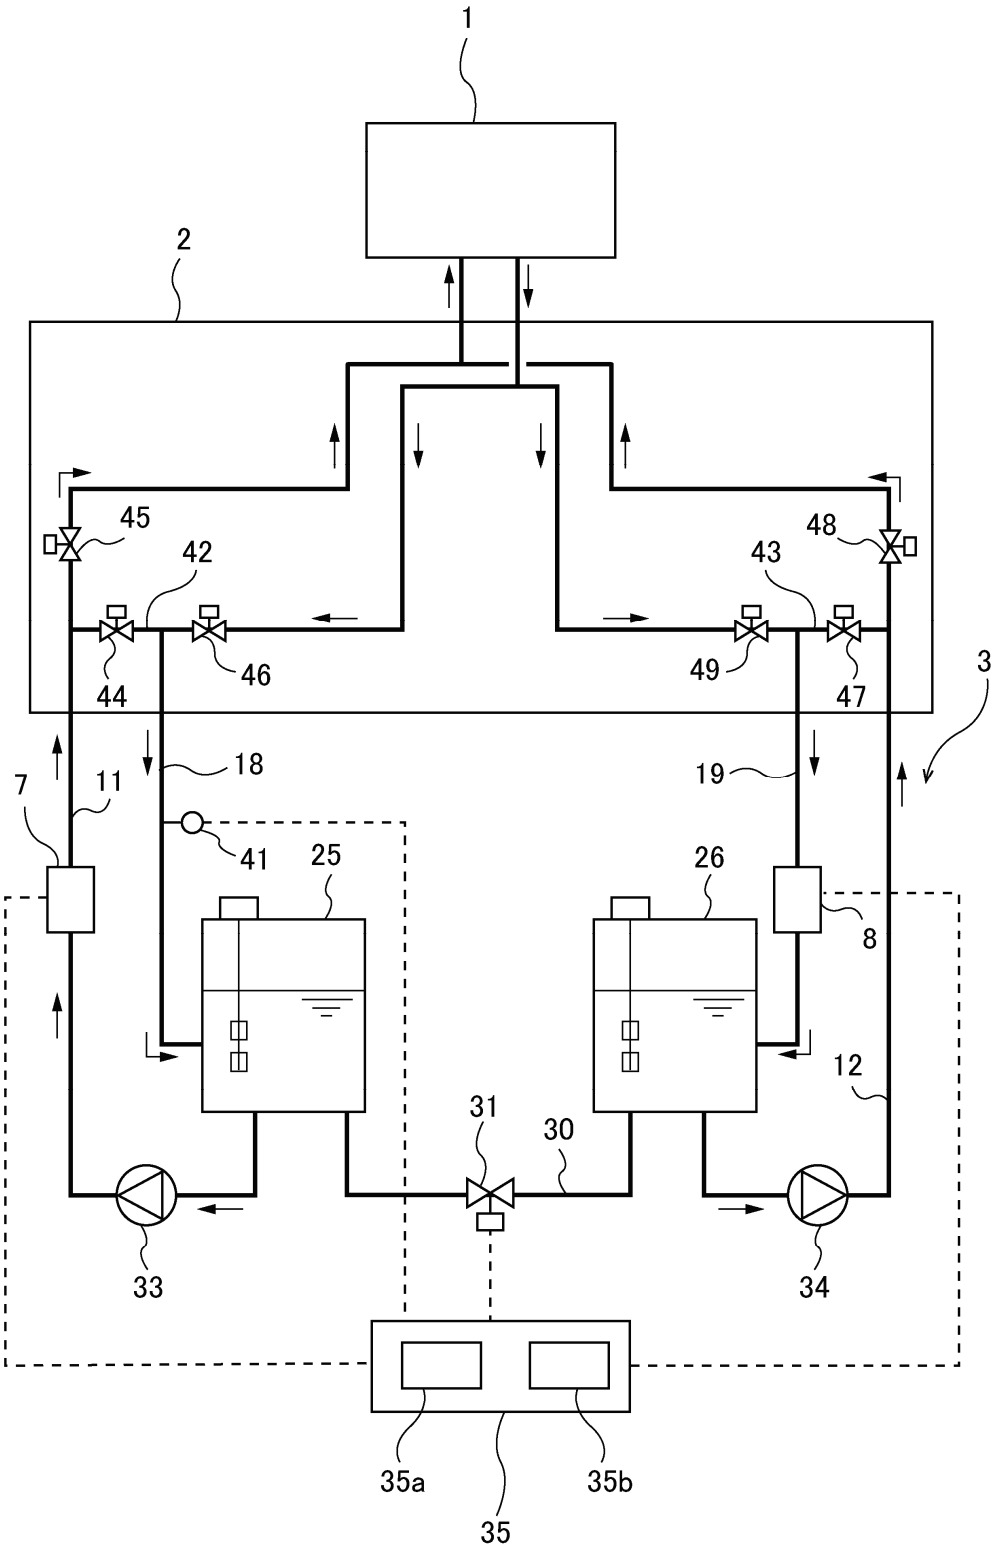

1
2
45
42
48
43
44
46
49
47
3
18
19
7
11
41
25
26
8
12
31
30
33
34
35a
35
35b

FIG. 2

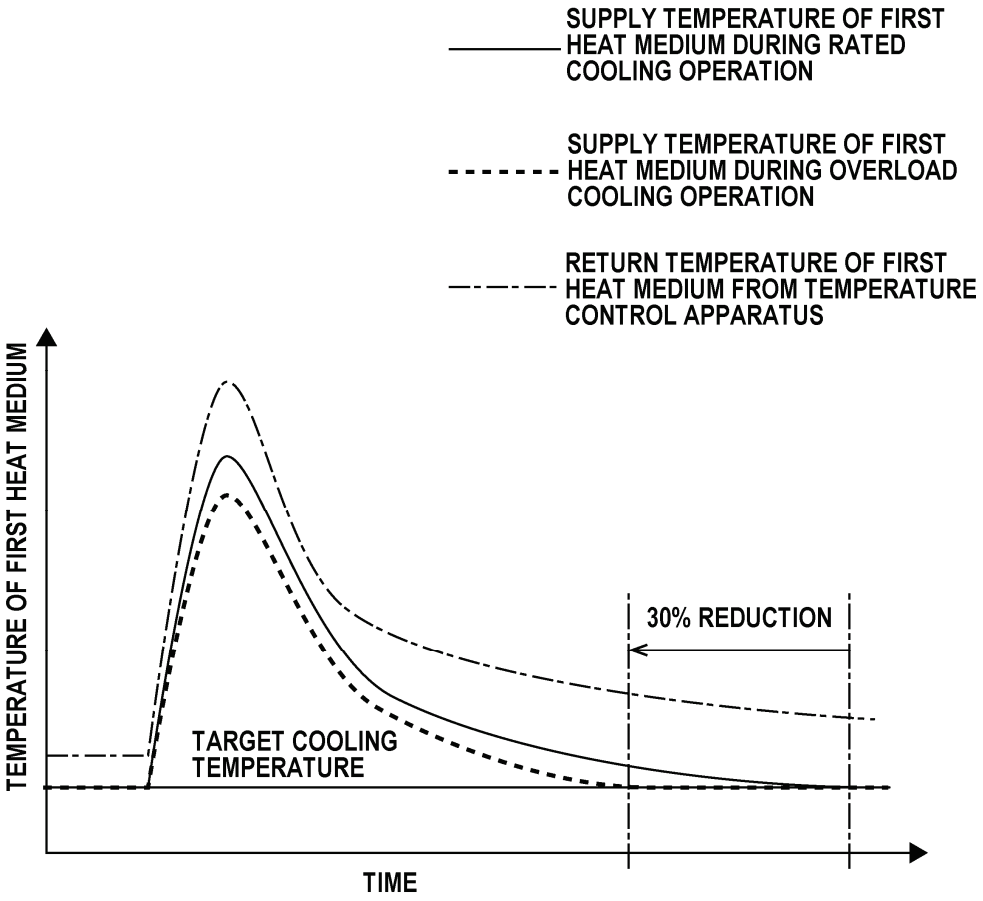

SUPPLY TEMPERATURE OF FIRST HEAT MEDIUM DURING RATED COOLING OPERATION
SUPPLY TEMPERATURE OF FIRST HEAT MEDIUM DURING OVERLOAD COOLING OPERATION
RETURN TEMPERATURE OF FIRST HEAT MEDIUM FROM TEMPERATURE CONTROL APPARATUS
TEMPERATURE OF FIRST HEAT MEDIUM
30% REDUCTION
TARGET COOLING TEMPERATURE
TIME

FIG. 3

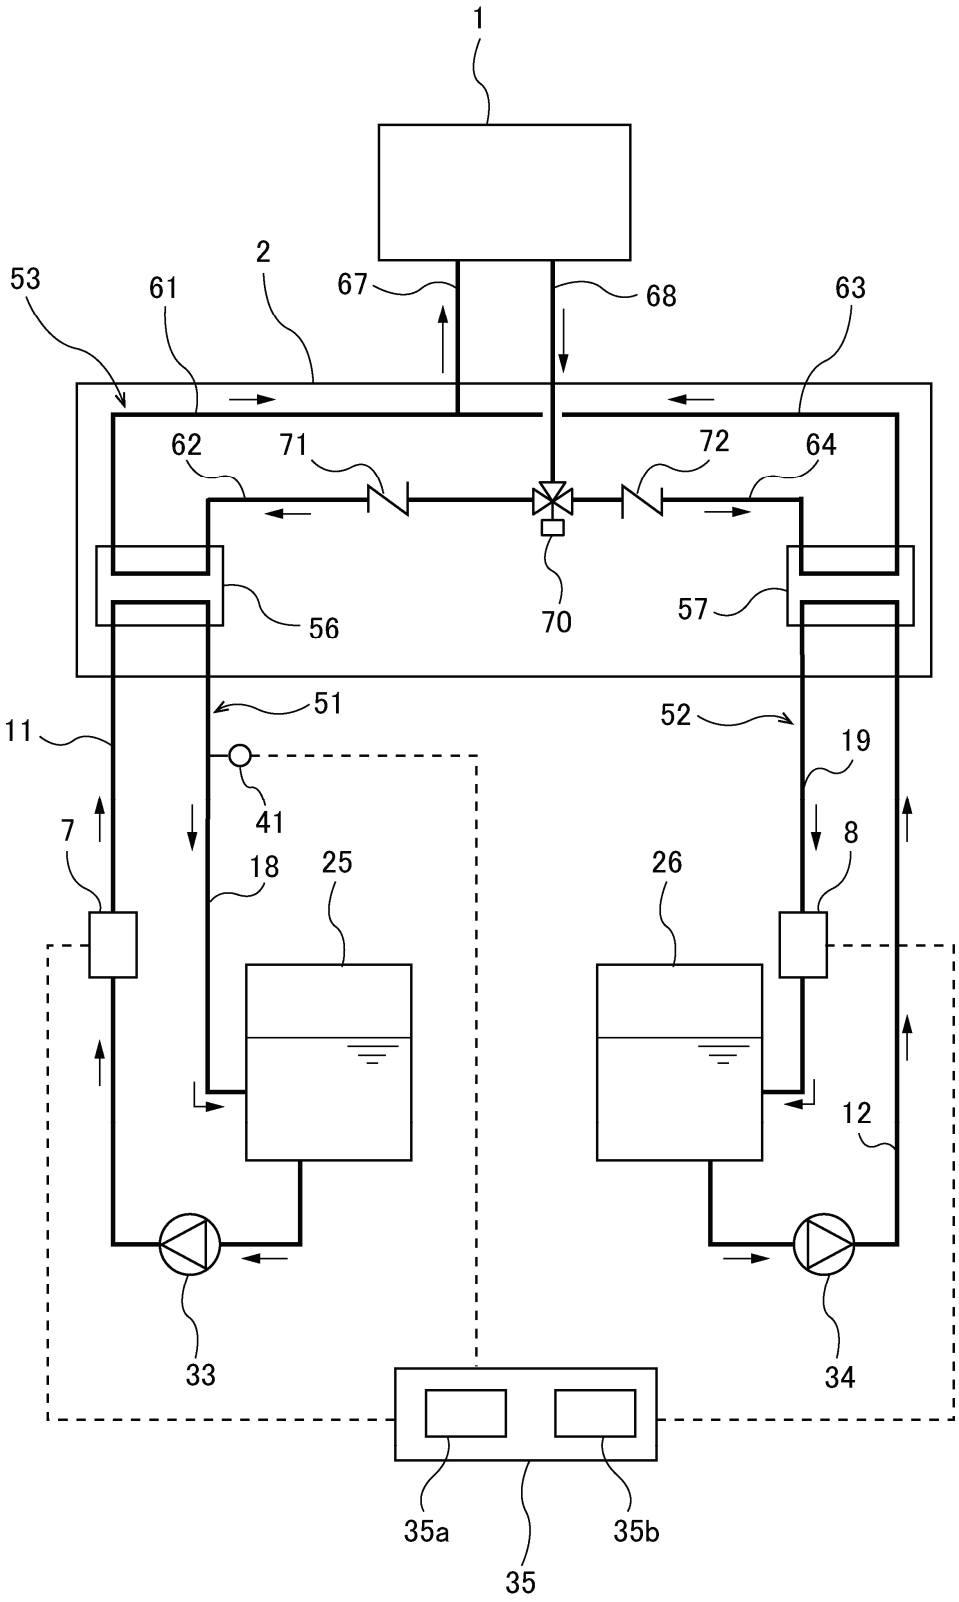

1
2
53
61
67
68
63
62
71
72
64
56
70
57
51
52
11
19
41
7
8
18
25
26
12
33
34
35a
35
35b

FIG. 4

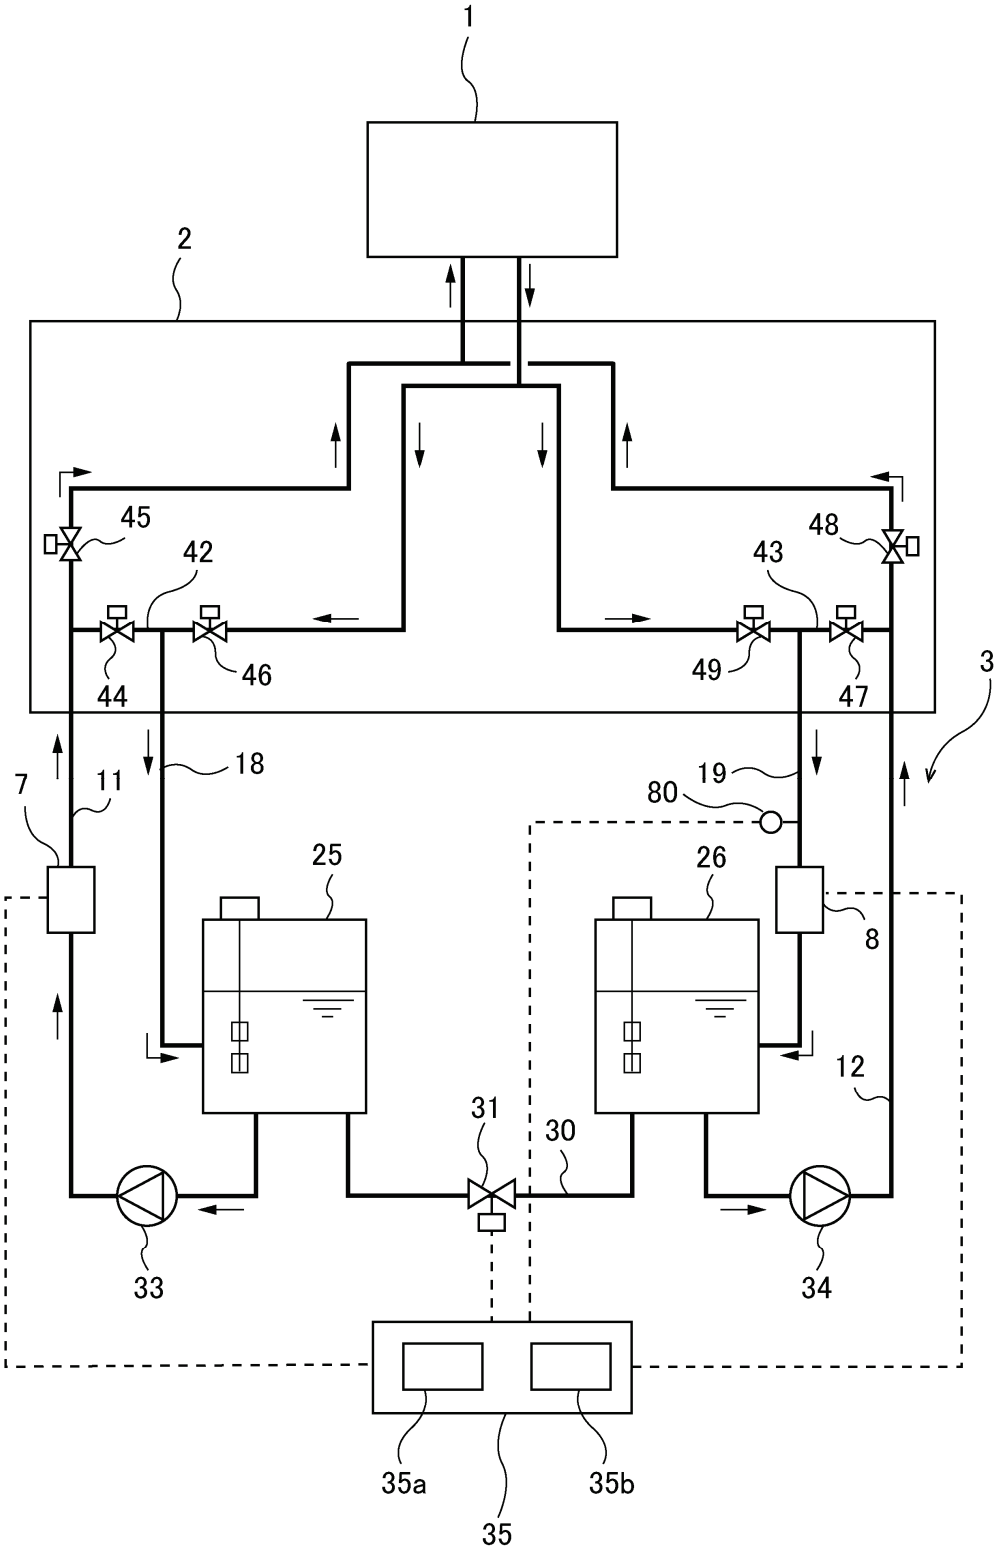

1
2
45
42
48
43
44
46
49
47
3
7
11
18
19
80
25
26
8
12
31
30
33
34
35a
35
35b

FIG. 5

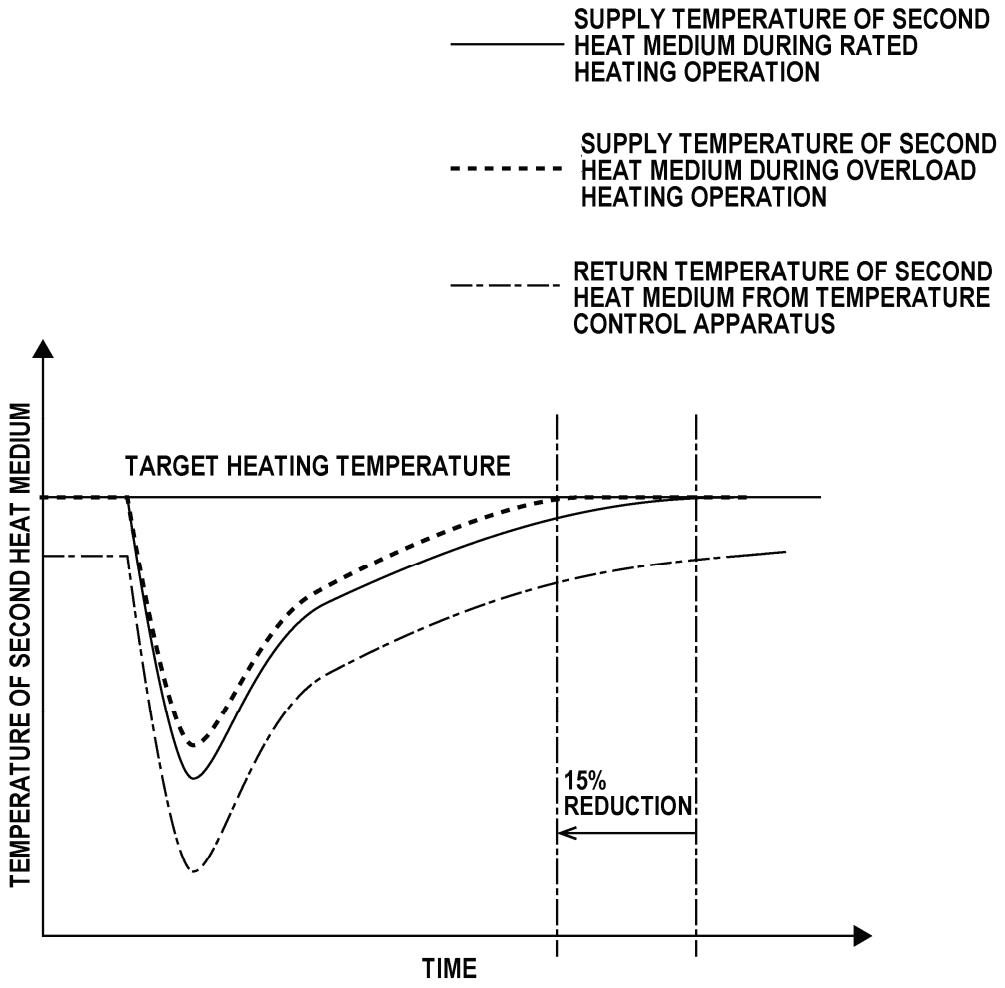

SUPPLY TEMPERATURE OF SECOND HEAT MEDIUM DURING RATED HEATING OPERATION
SUPPLY TEMPERATURE OF SECOND HEAT MEDIUM DURING OVERLOAD HEATING OPERATION
RETURN TEMPERATURE OF SECOND HEAT MEDIUM FROM TEMPERATURE CONTROL APPARATUS
TEMPERATURE OF SECOND HEAT MEDIUM
TARGET HEATING TEMPERATURE
15% REDUCTION
TIME

FIG. 6

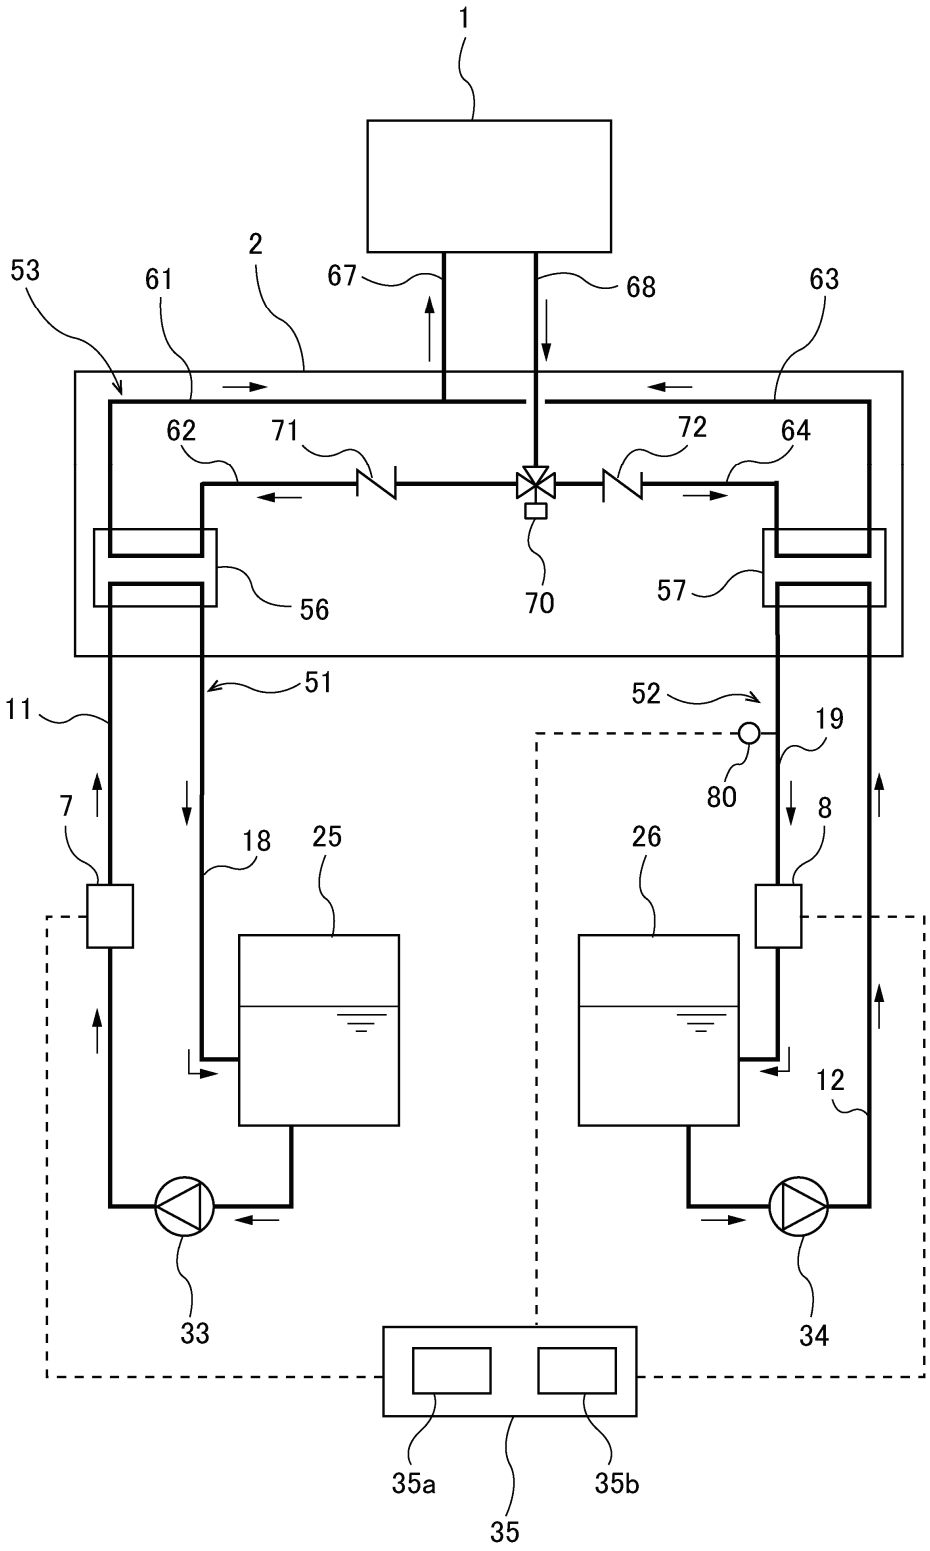

1
2
53
61
67
68
63
62
71
72
64
56
70
57
51
52
11
19
80
7
18
25
26
8
12
33
34
35a
35
35b

FIG. 7

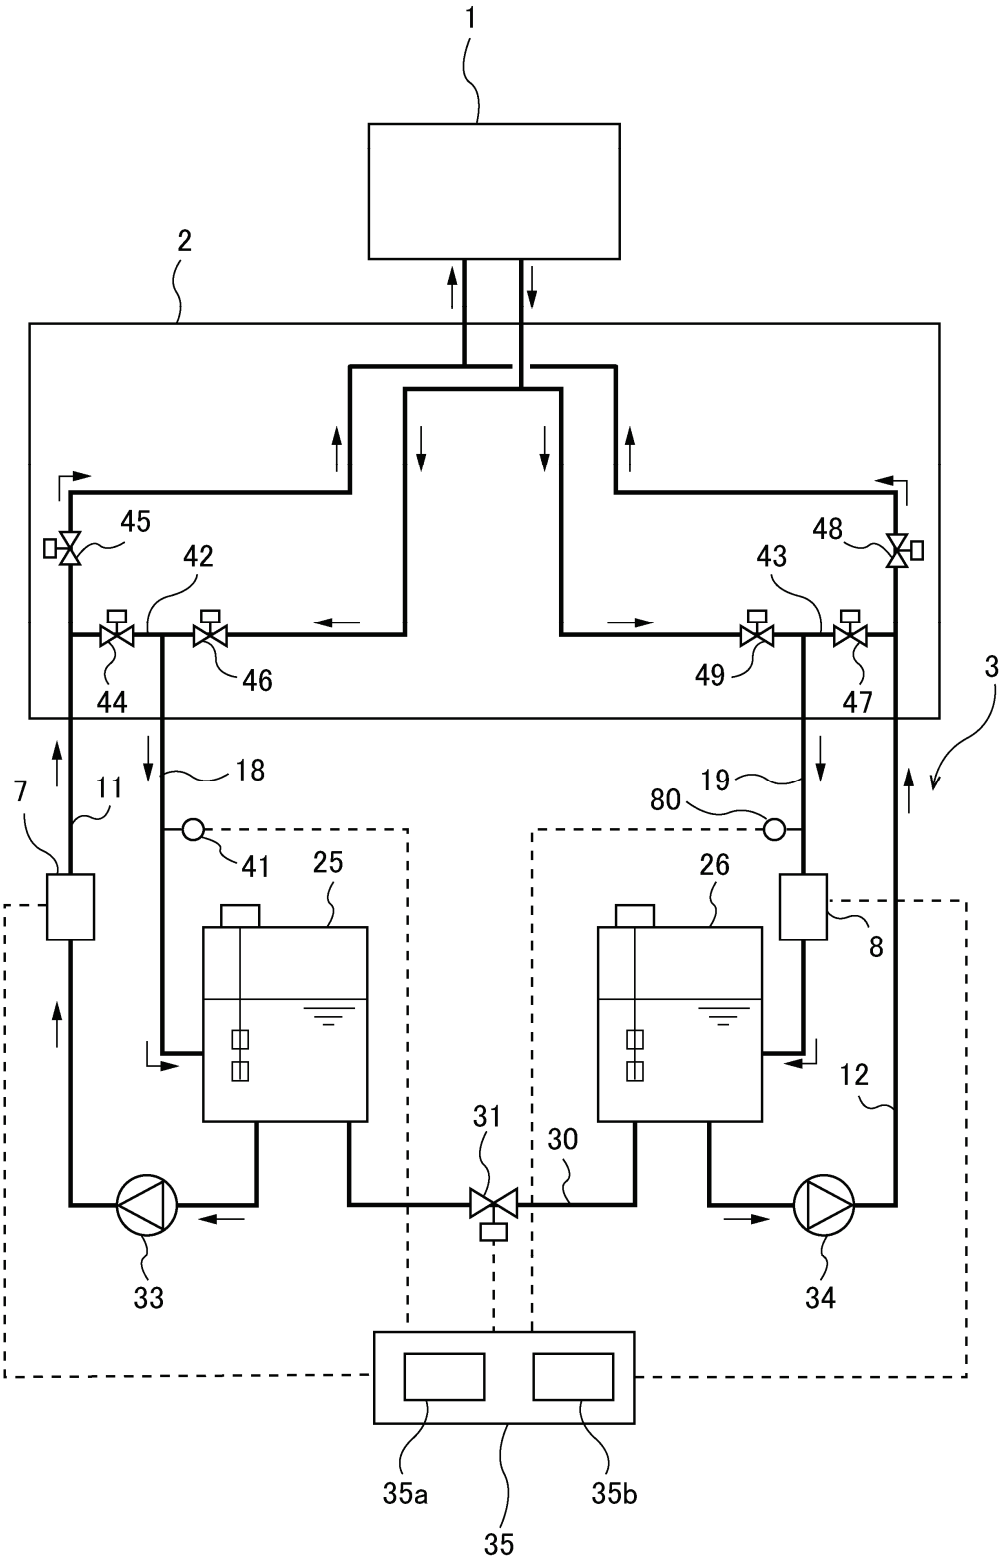
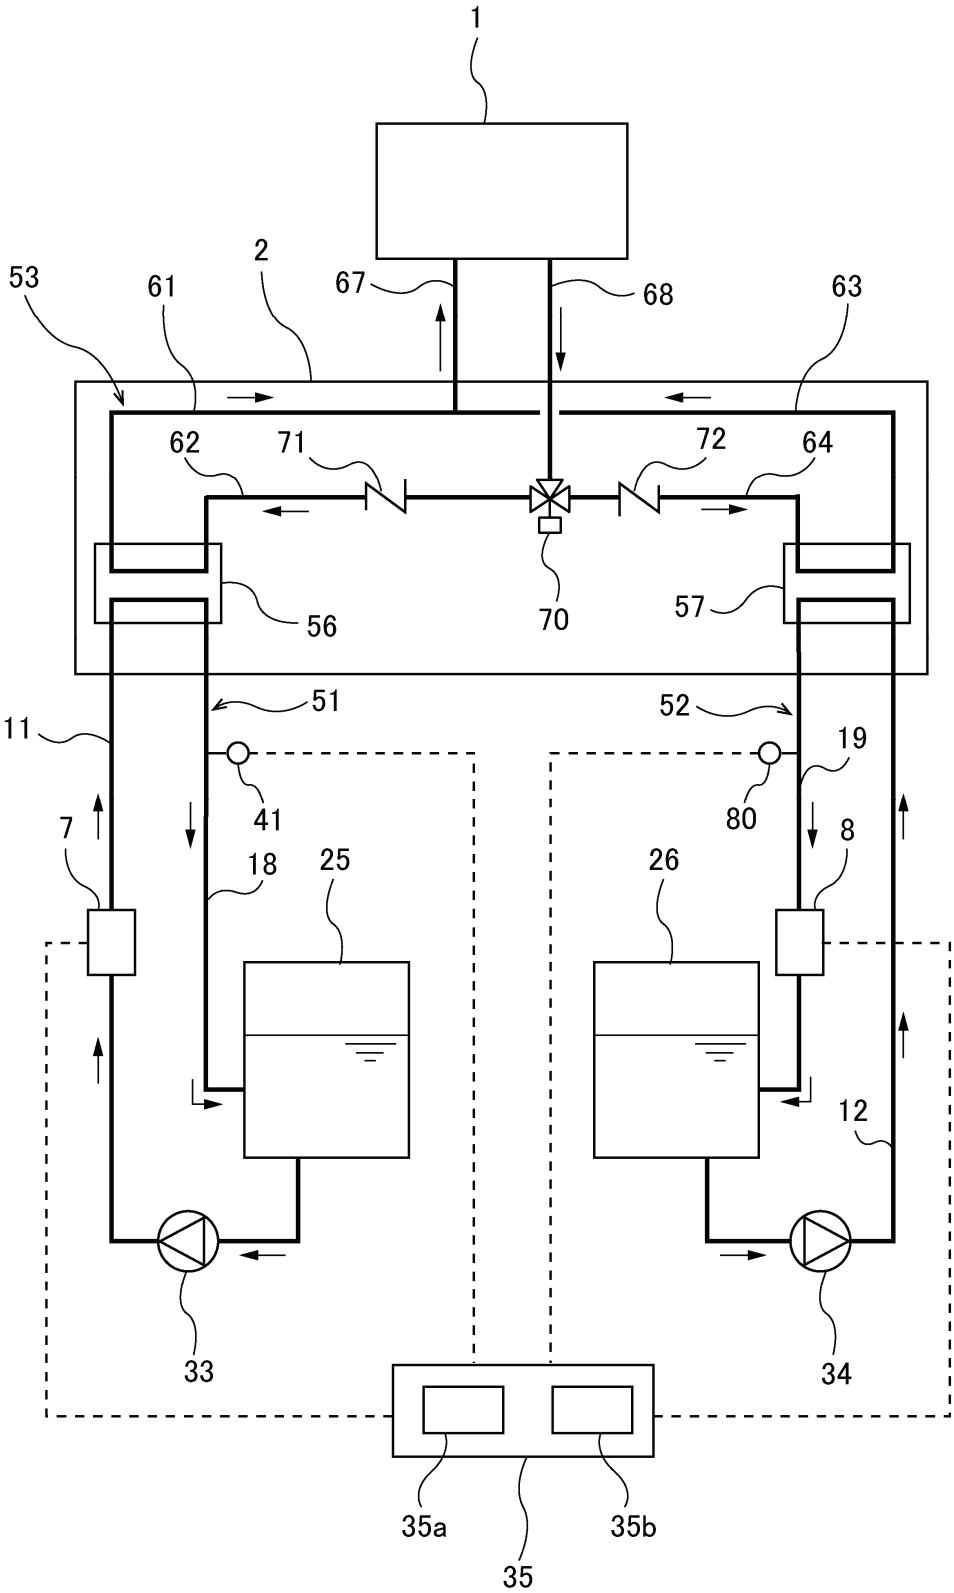

1
2
45
42
48
43
44
46
49
47
3
18
19
7
11
80
41
25
26
8
12
31
30
33
34
35a
35
35b

FIG. 8


1
2
53
61
67
68
63
62
71
72
64
56
70
57
51
52
11
19
41
80
7
8
18
25
26
12
33
34
35a
35
35b