

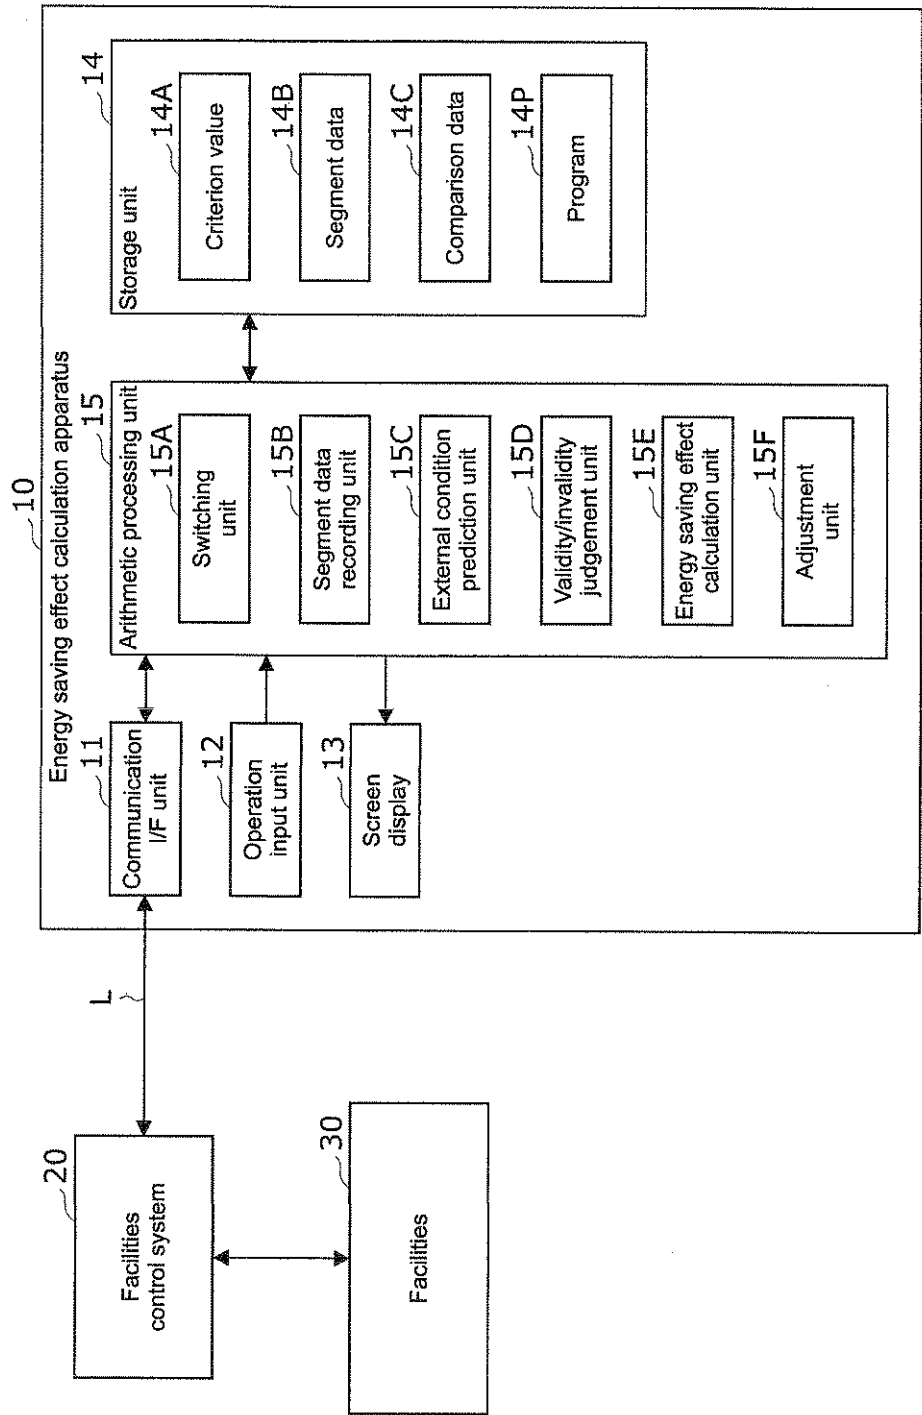


FIG.1

External condition variable	Criterion value
Cooling water temperature	Within ± 0.5 [°C]
Thermal load	Within ± 10 [kWh]

FIG.2

Segment ID	Segment starting time and date	Applicability/Inapplicability of energy saving control	Cooling water temperature [°C]	Thermal load [kWh]	Energy consumption amount [kWh]
0	yymmdd,hhmmss	Inapplicability	21.8	206.5	349.7
⋮					

FIG.3

Invalid segment				Valid segment			
Segment ID	Cooling water temperature [°C]	Thermal load [kWh]	Energy consumption amount [kWh]	Segment ID	Cooling water temperature [°C]	Thermal load [kWh]	Energy consumption amount [kWh]
⋮							

FIG.4

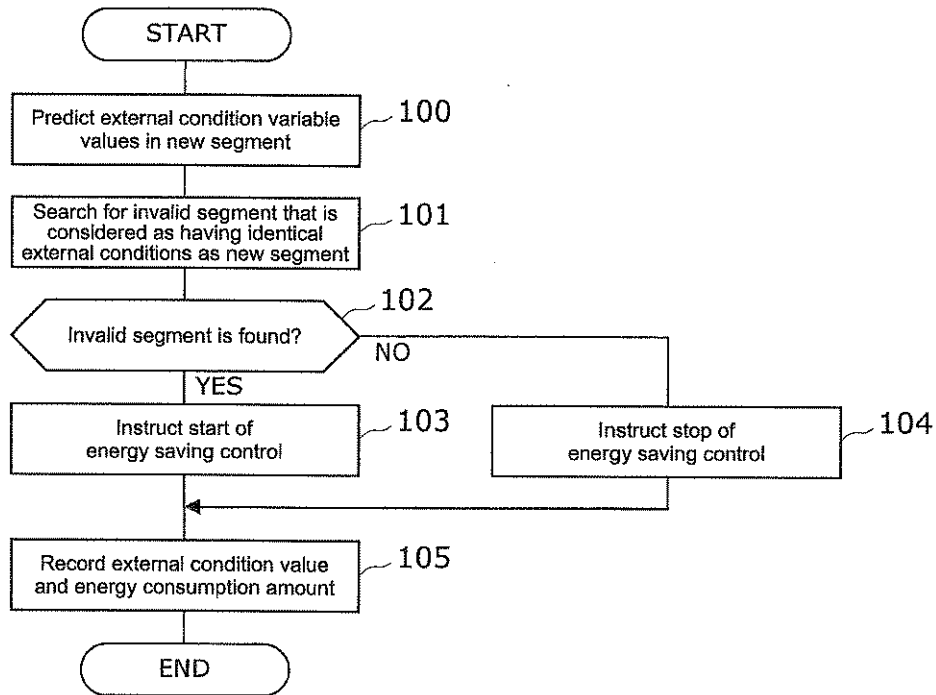


FIG.5

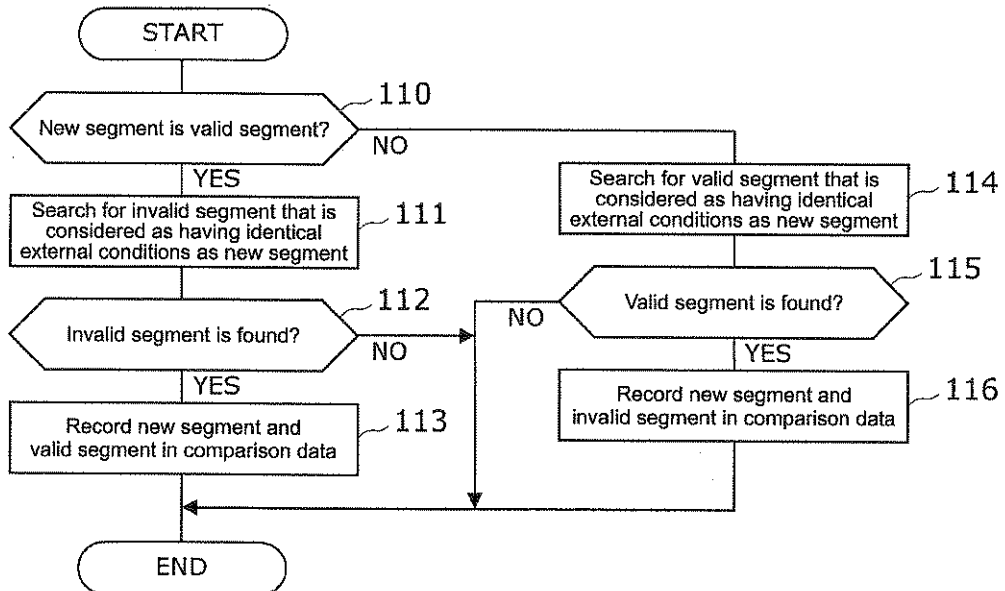


FIG.6

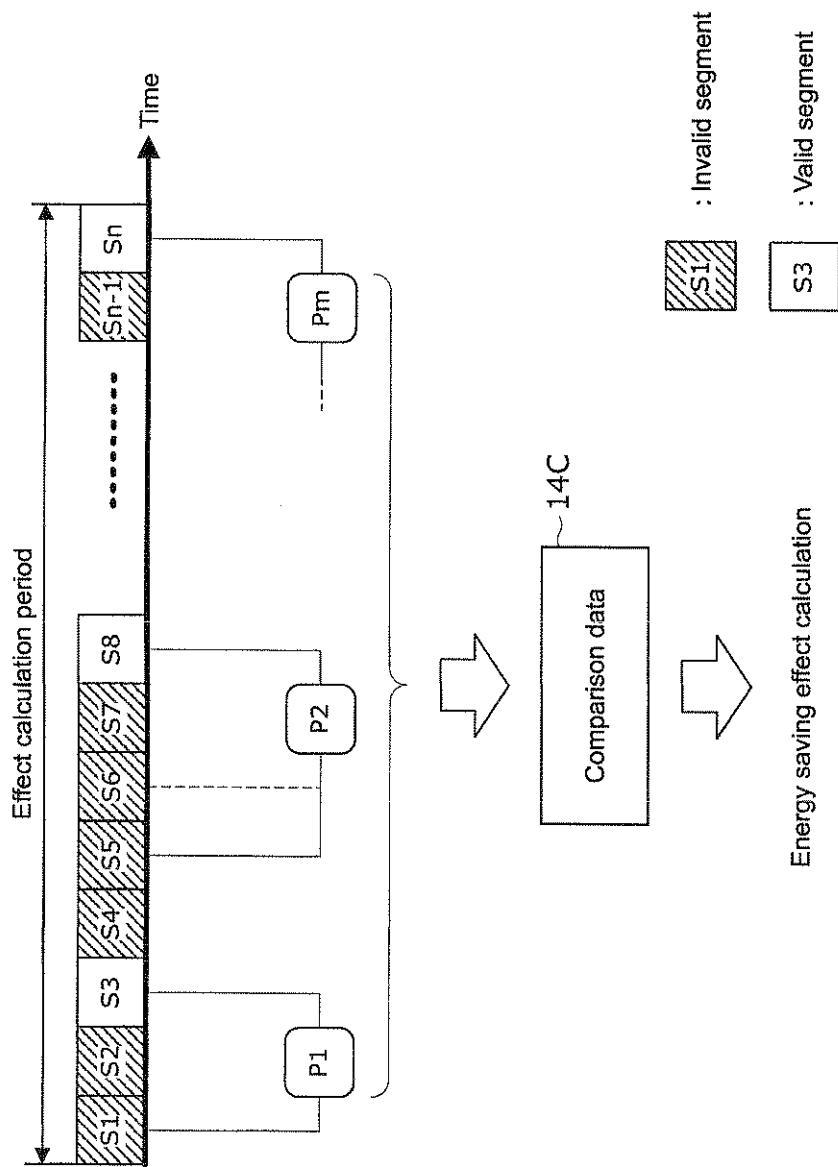


FIG.7

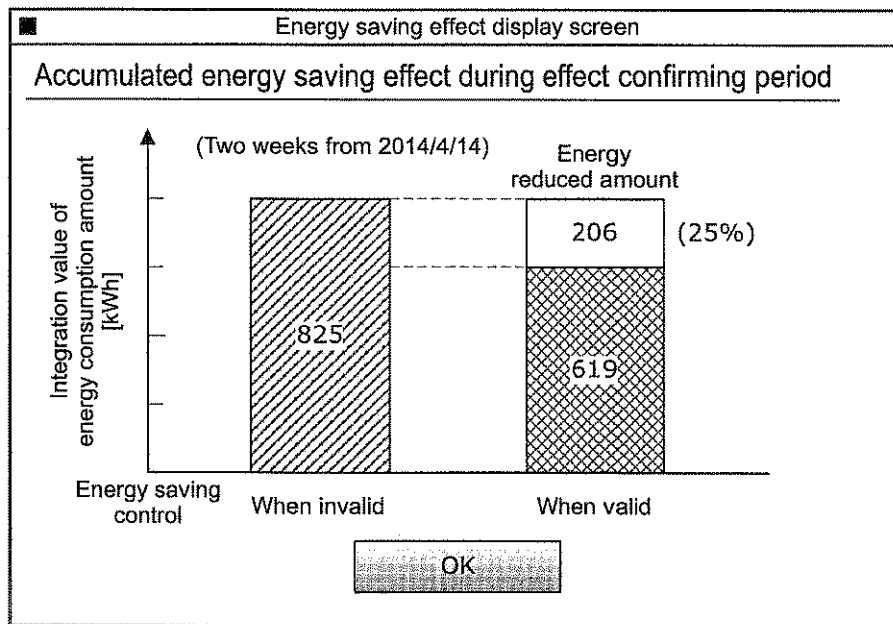


FIG.8

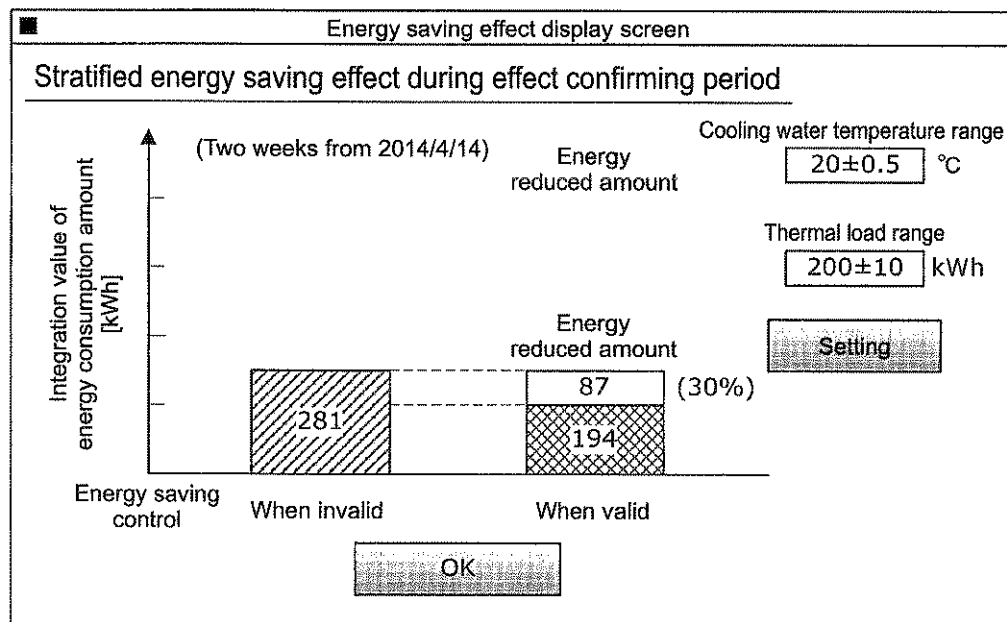


FIG.9