



FIG. 1

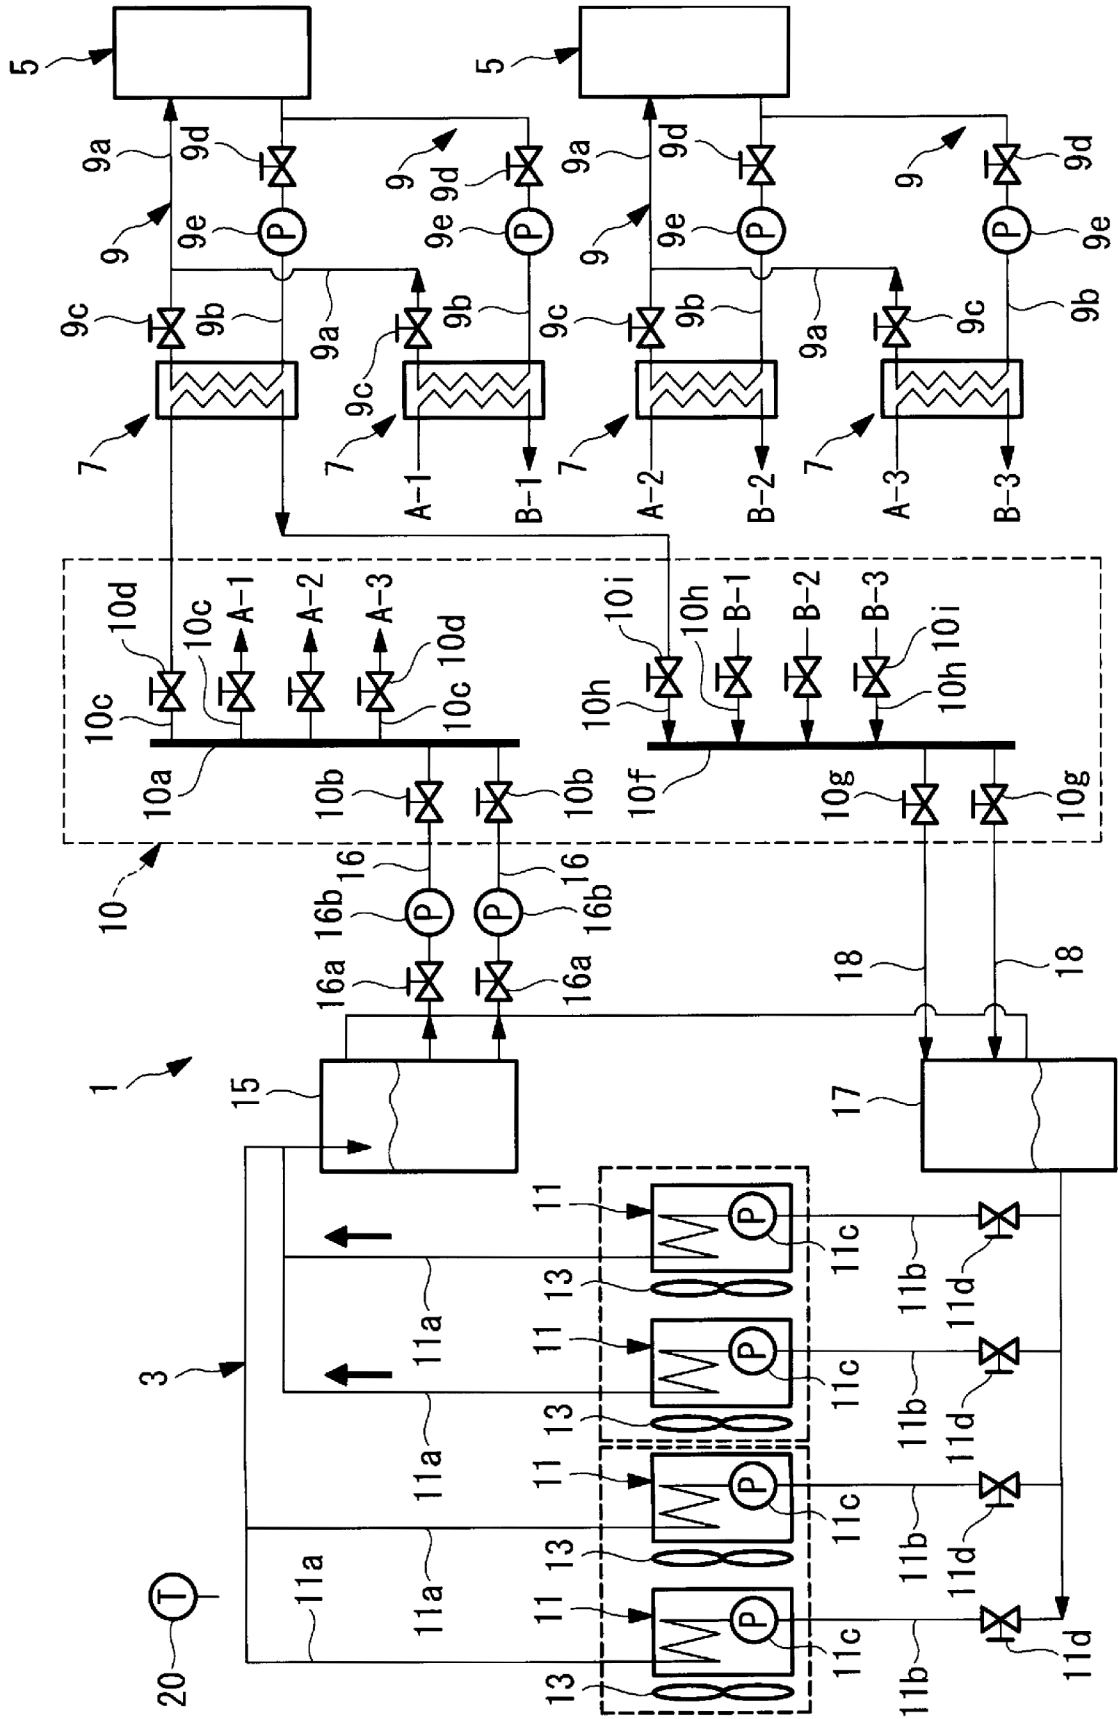

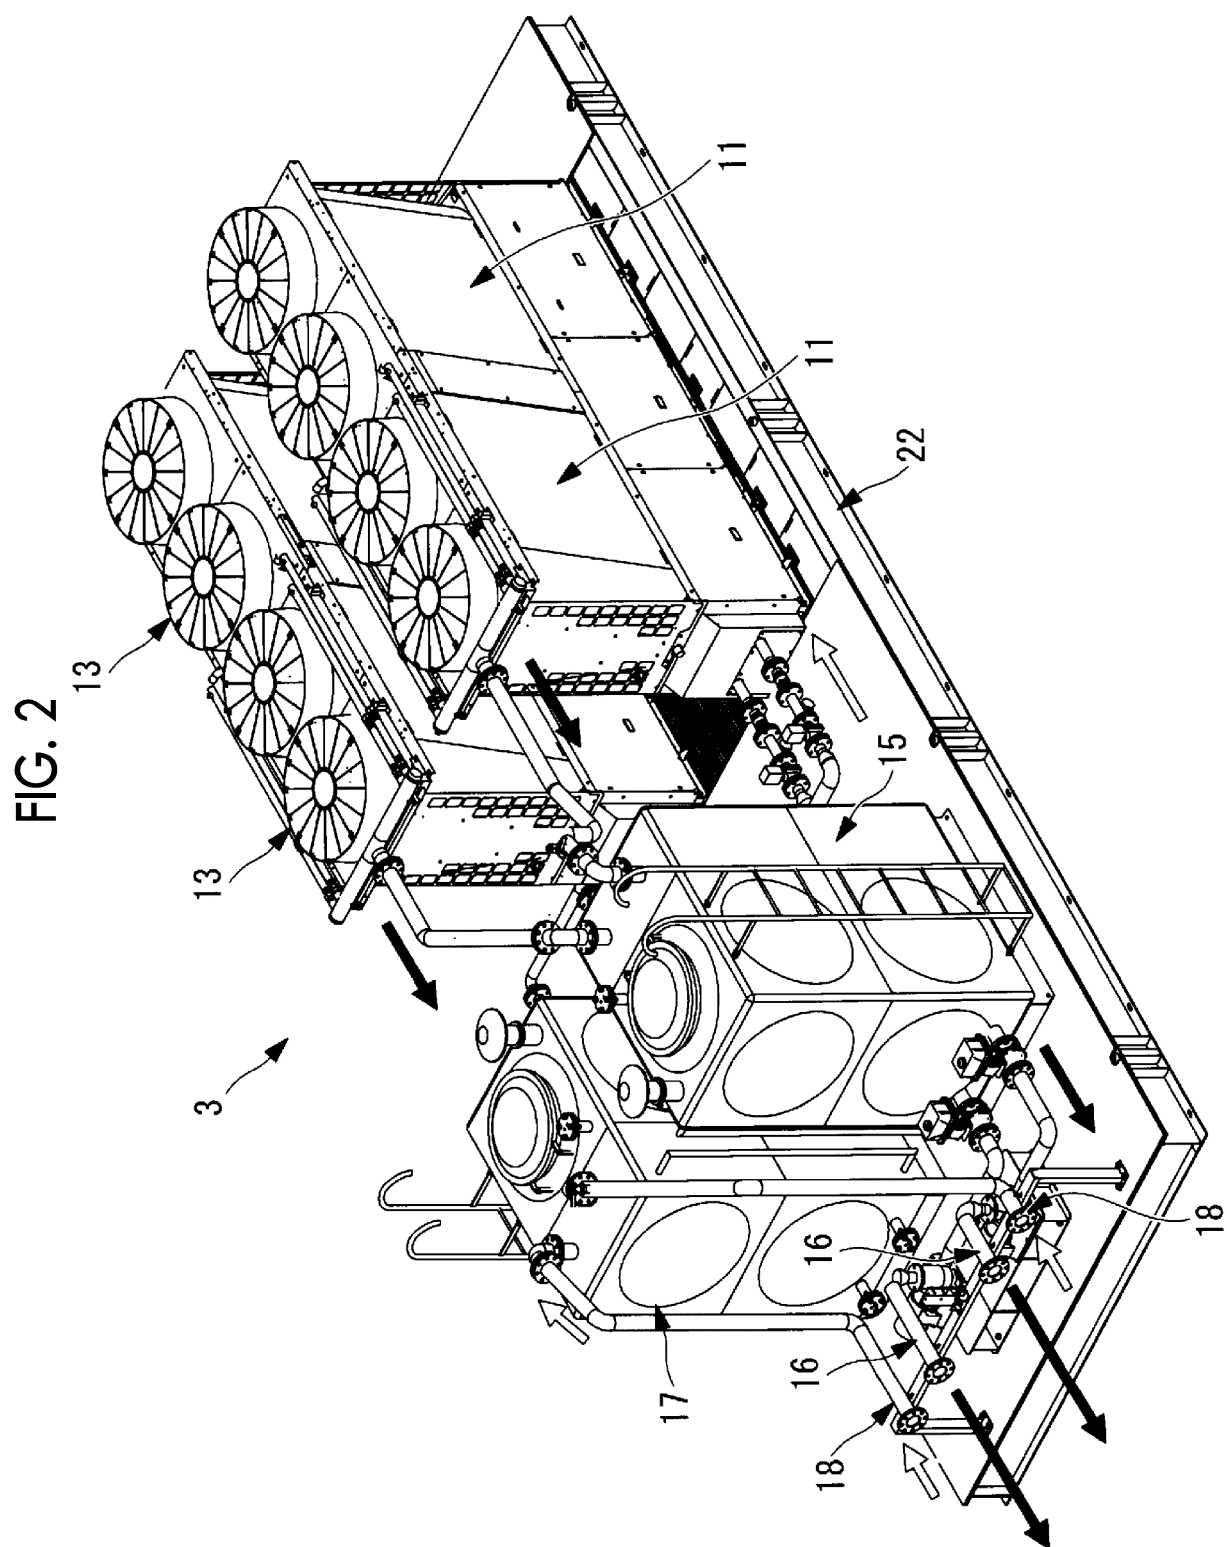

3/6
FIG. 3


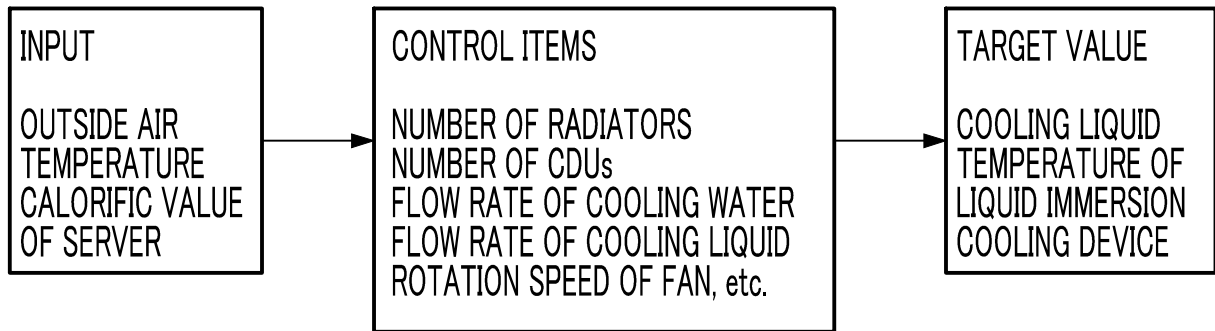


FIG. 4A

NUMBER OF RADIATORS AND NUMBER OF CDUs

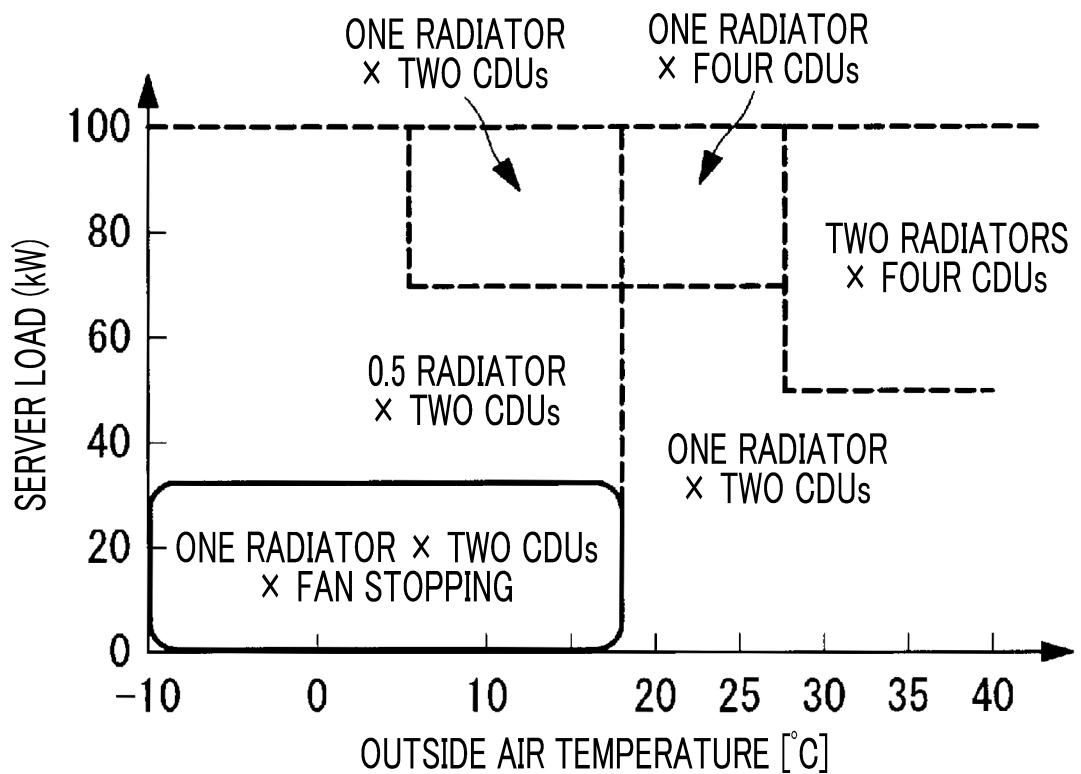

4/6
FIG. 4B

ROTATION SPEED OF FAN

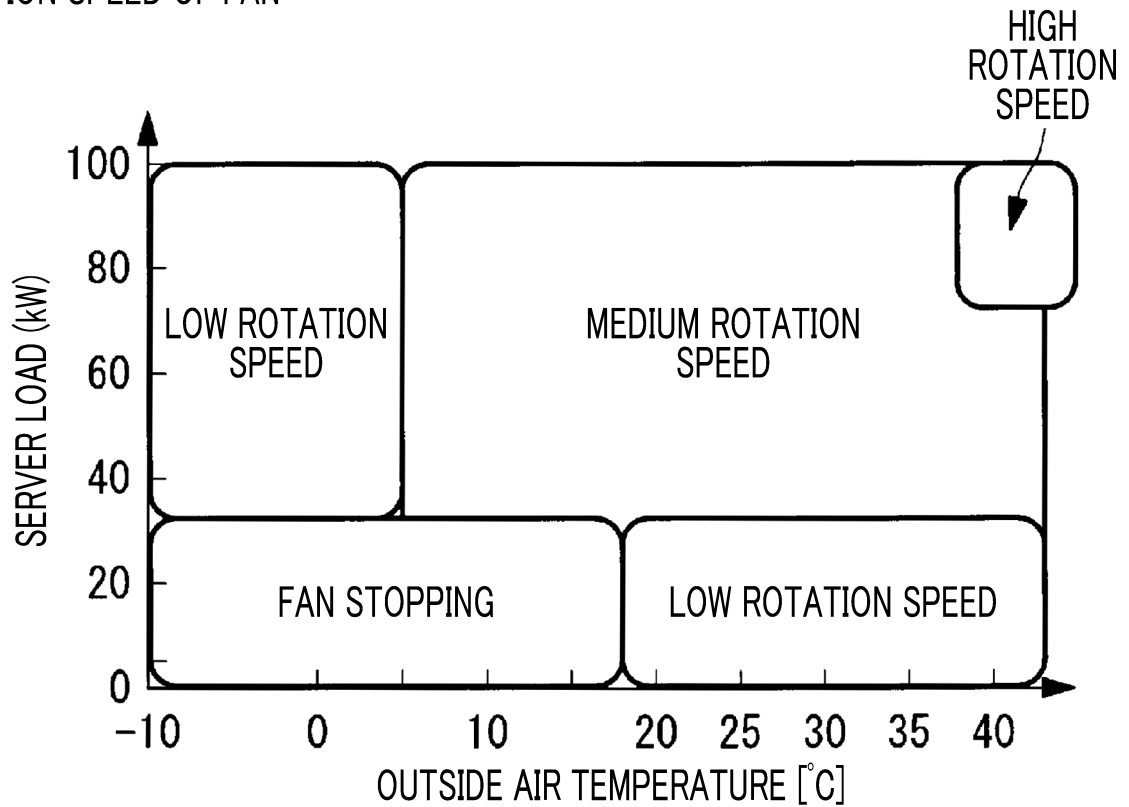


FIG. 4C

FLOW RATE OF COOLING WATER PUMP

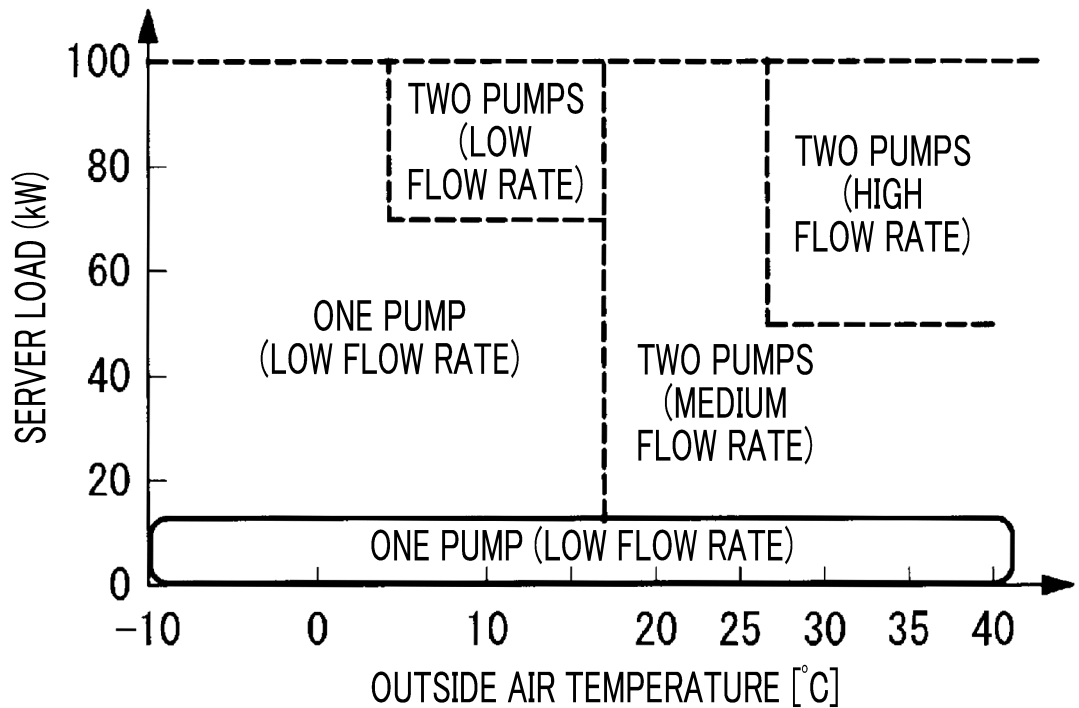


FIG. 4D

TOTAL FLOW RATE OF RADIATOR PUMP

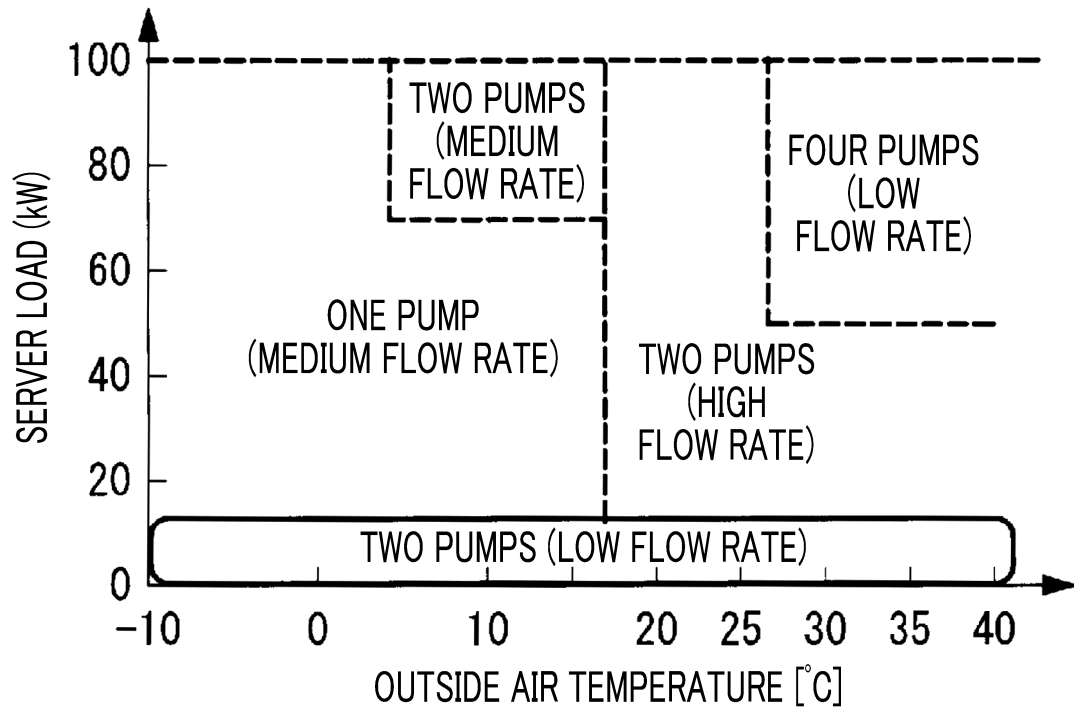


FIG. 4E

FLOW RATE OF COOLING LIQUID PUMP
 NUMBER OF PUMPS = NUMBER OF CDUs

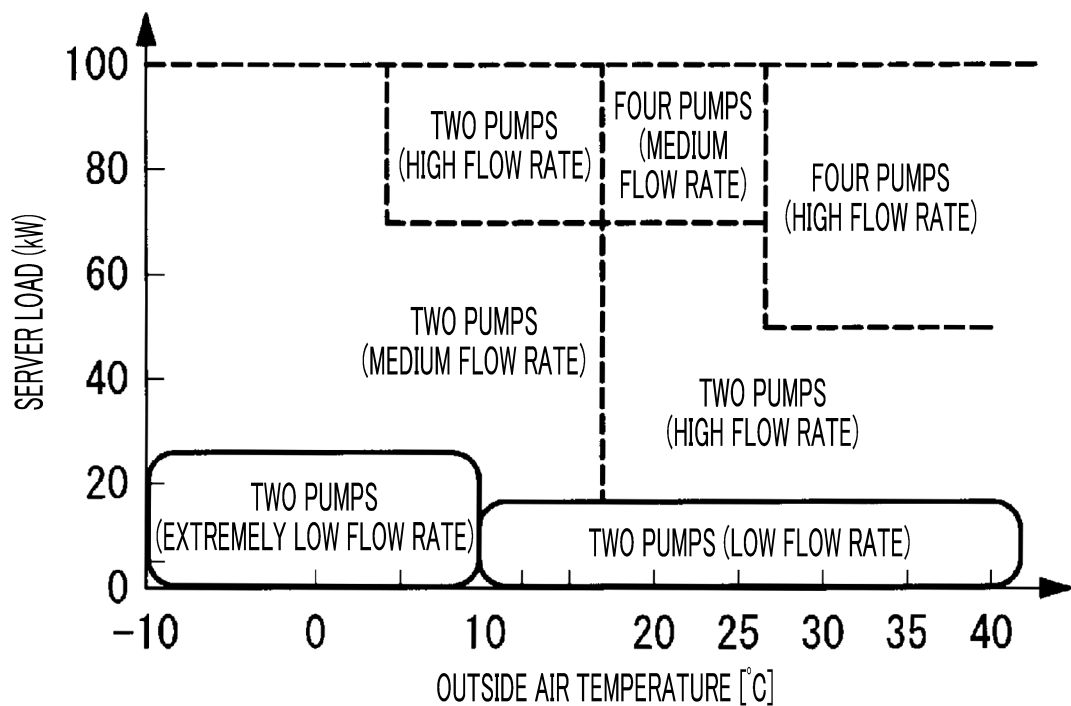


FIG. 4F

TIME OF SWITCHING RADIATORS

TIME OF SWITCHING COOLING WATER OUTLET PIPE AND COOLING WATER INLET PIPE

