

FIG. 1

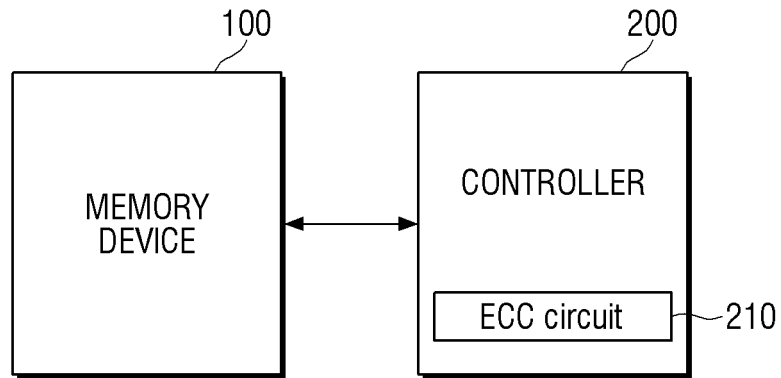


FIG. 2

100

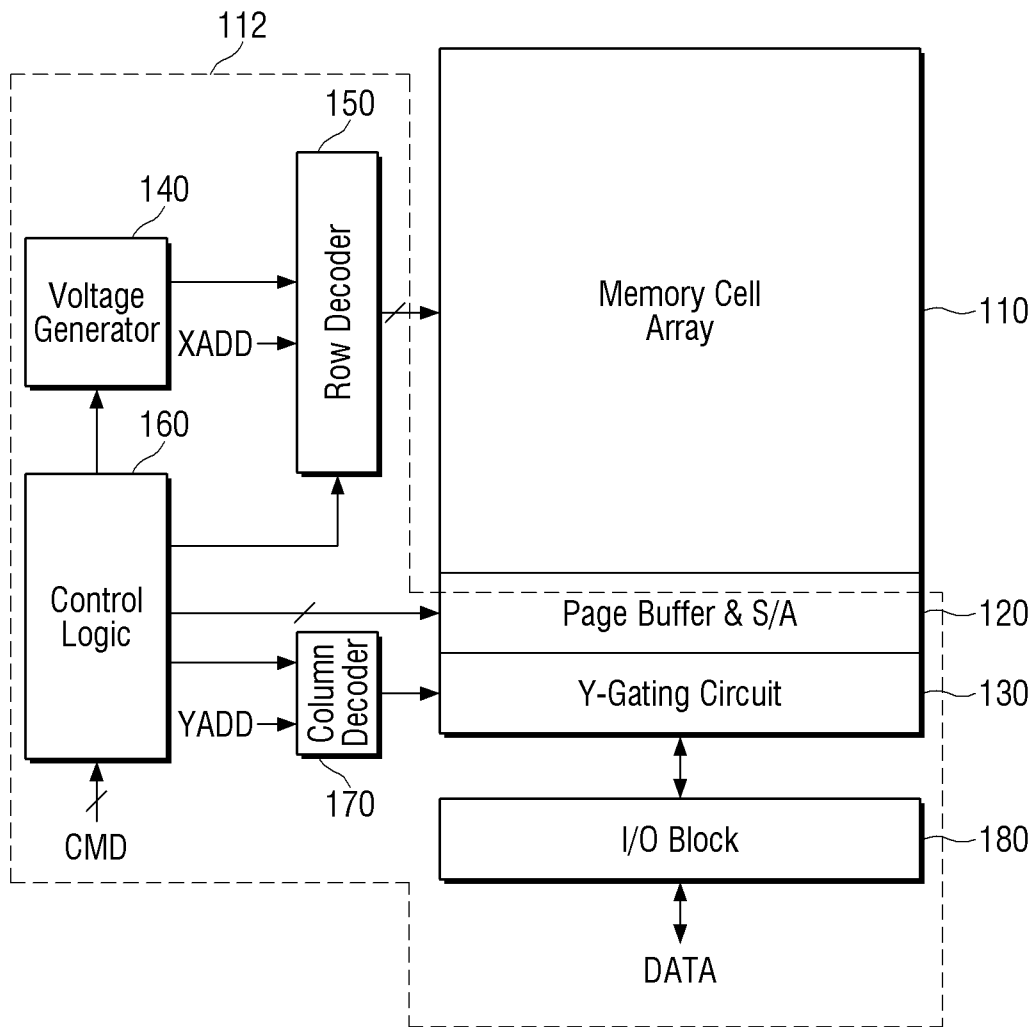


FIG. 3

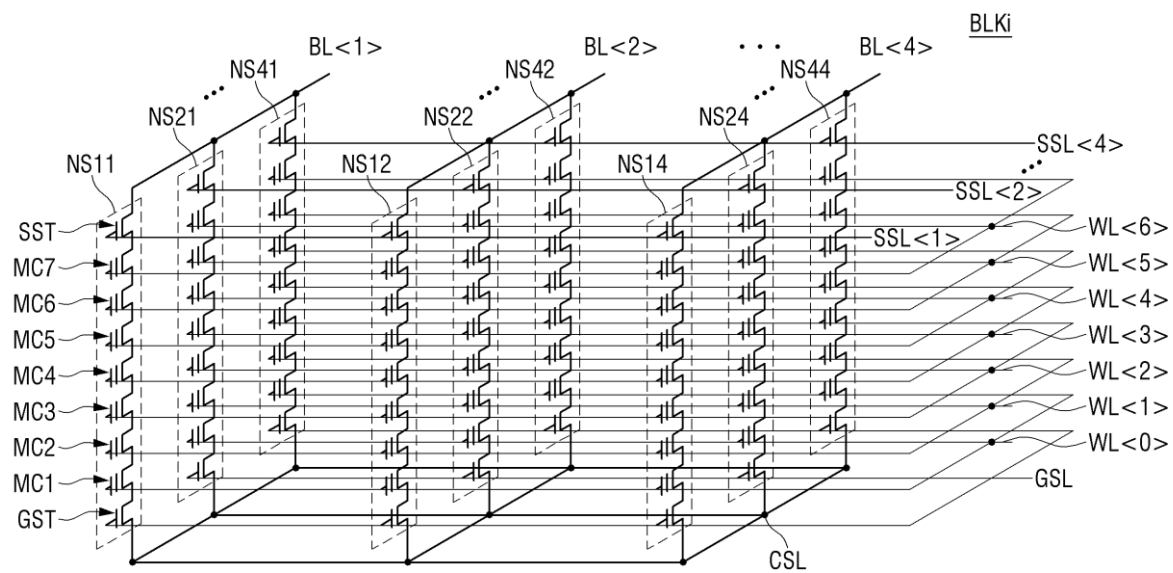


FIG. 4

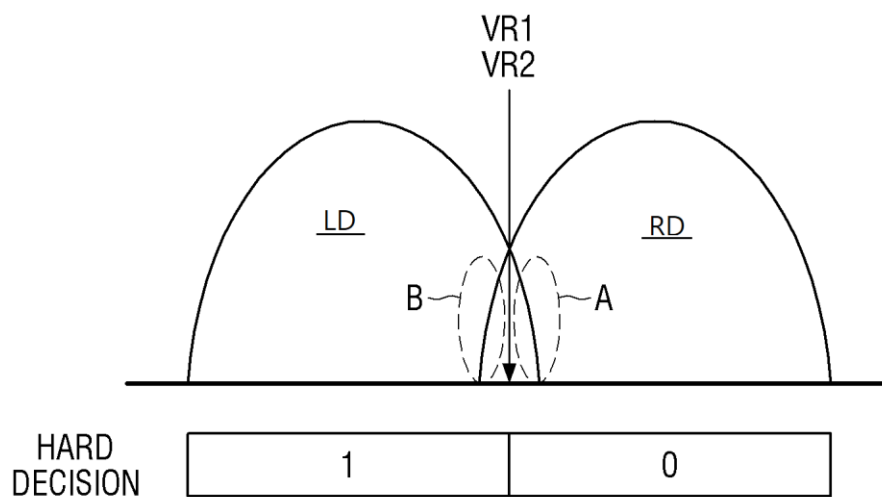


FIG. 5

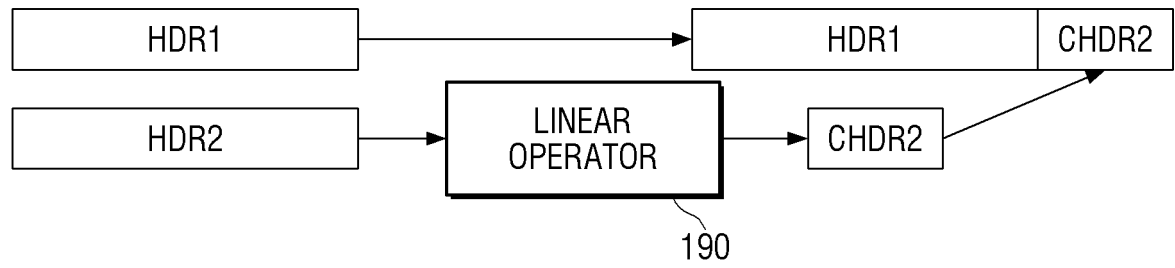


FIG. 6

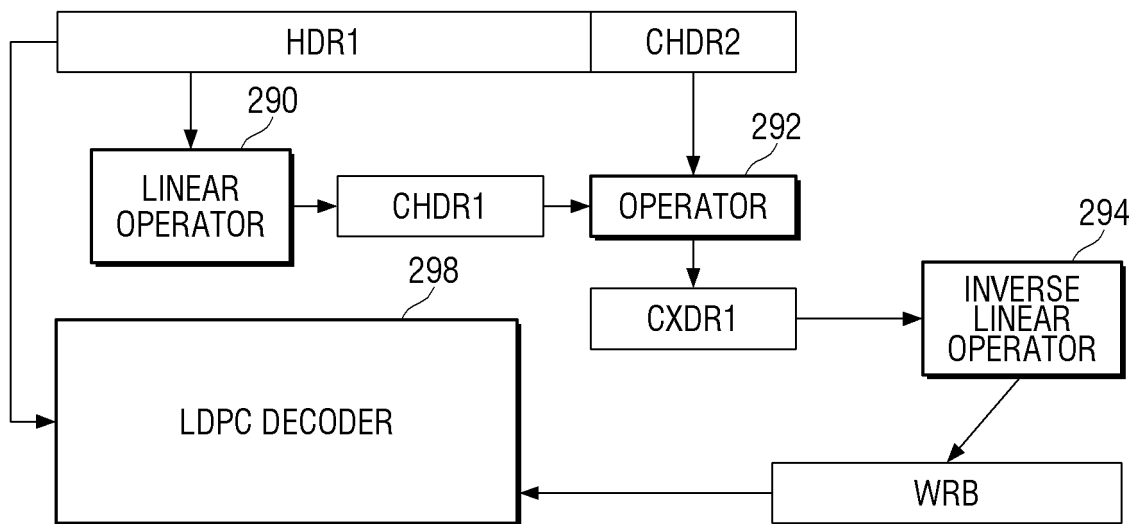


FIG. 7

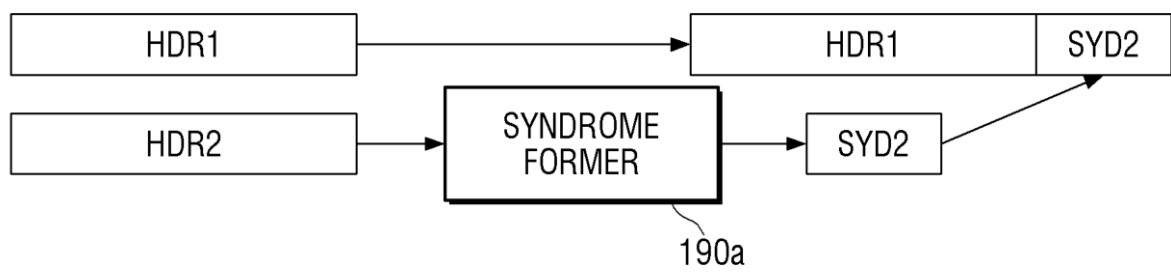


FIG. 8

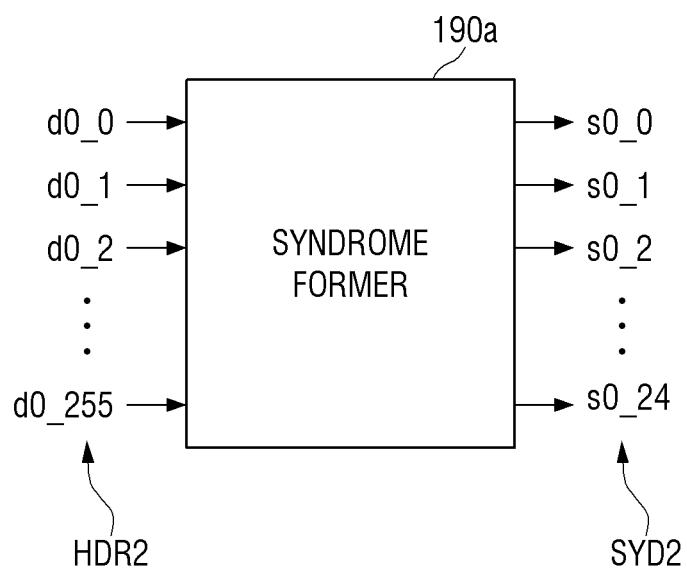


FIG. 9

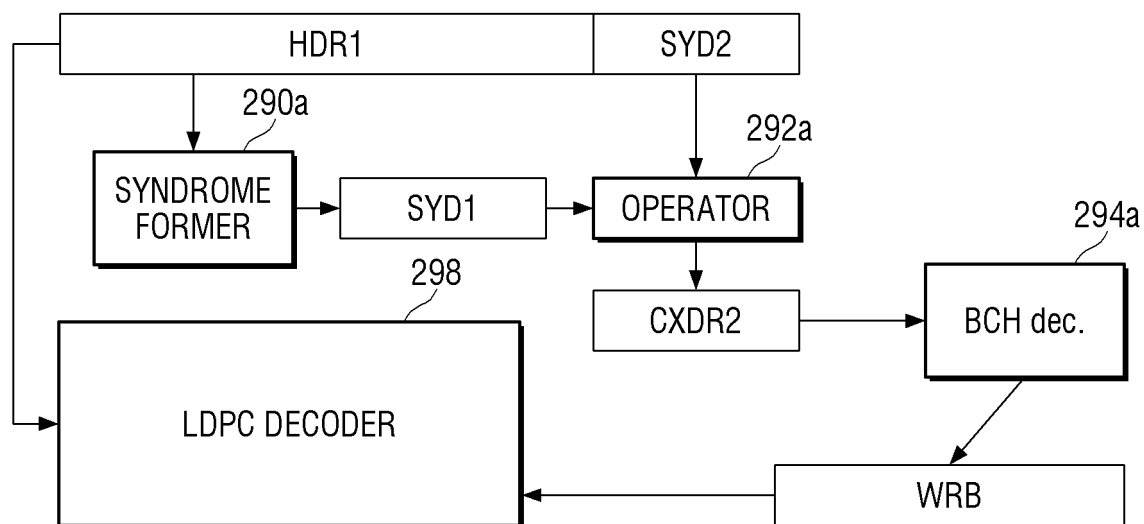


FIG. 10

new syndrome(CXOR2)	reliability information(WRB)
000	0000000
001	0000001
010	0000010
100	0000100
011	0001000
110	0010000
101	0100000
111	1000000

FIG. 11

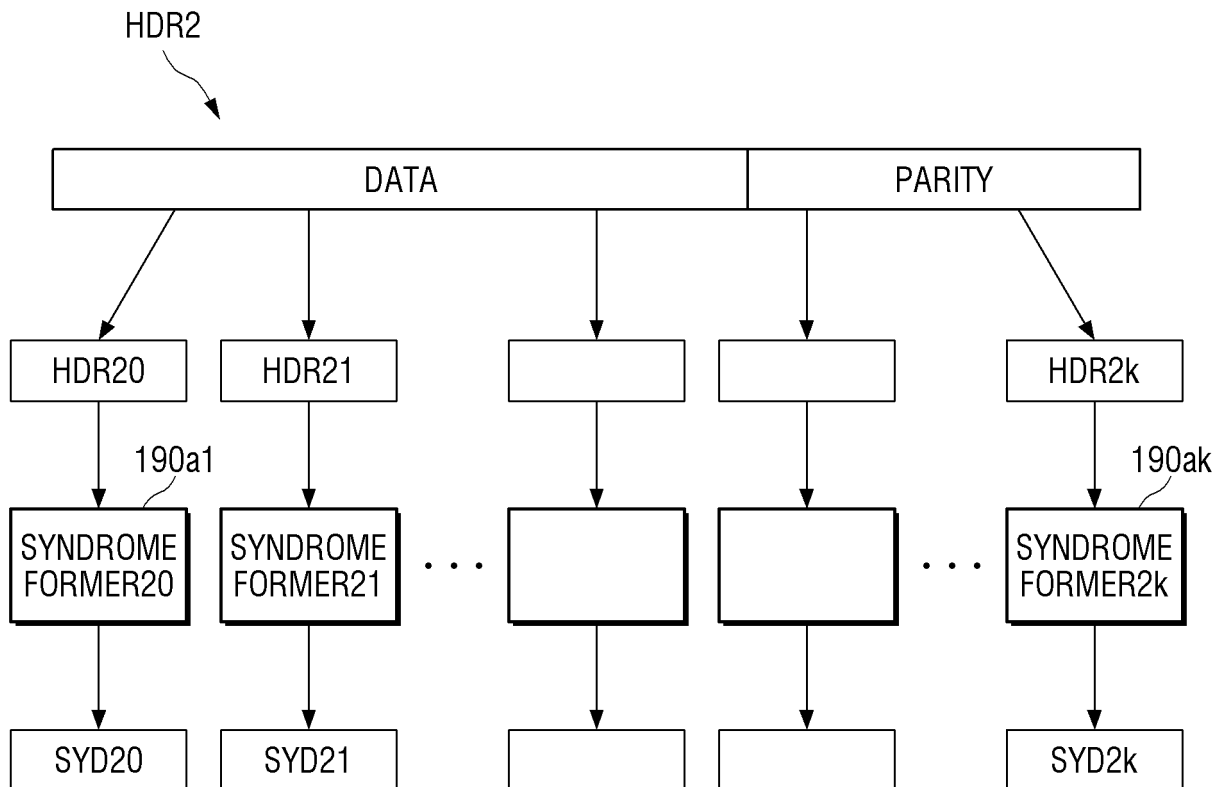


FIG. 12

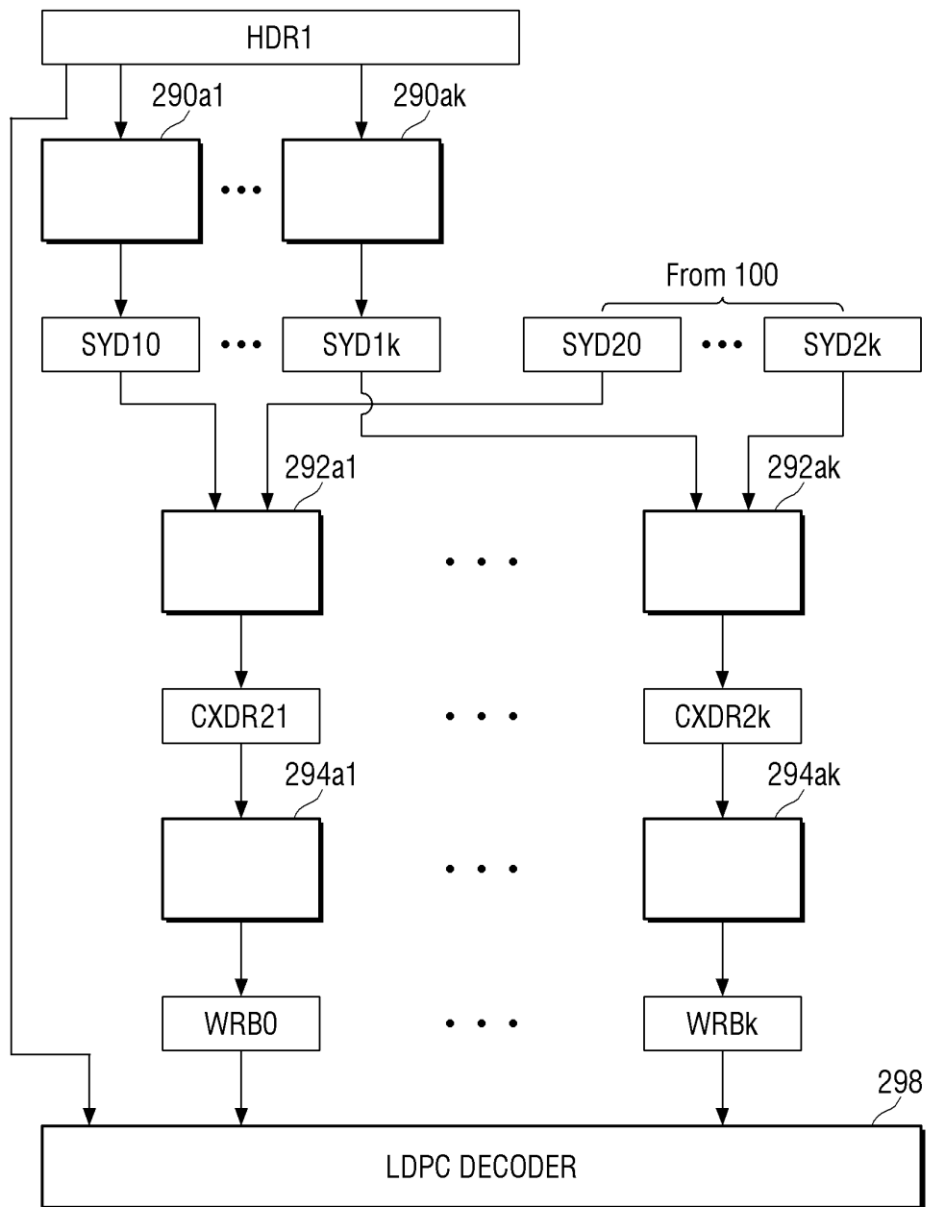


FIG. 13

