


FIGURES


Figure 1. Compound 1 pattern 1 XRPD diffractogram

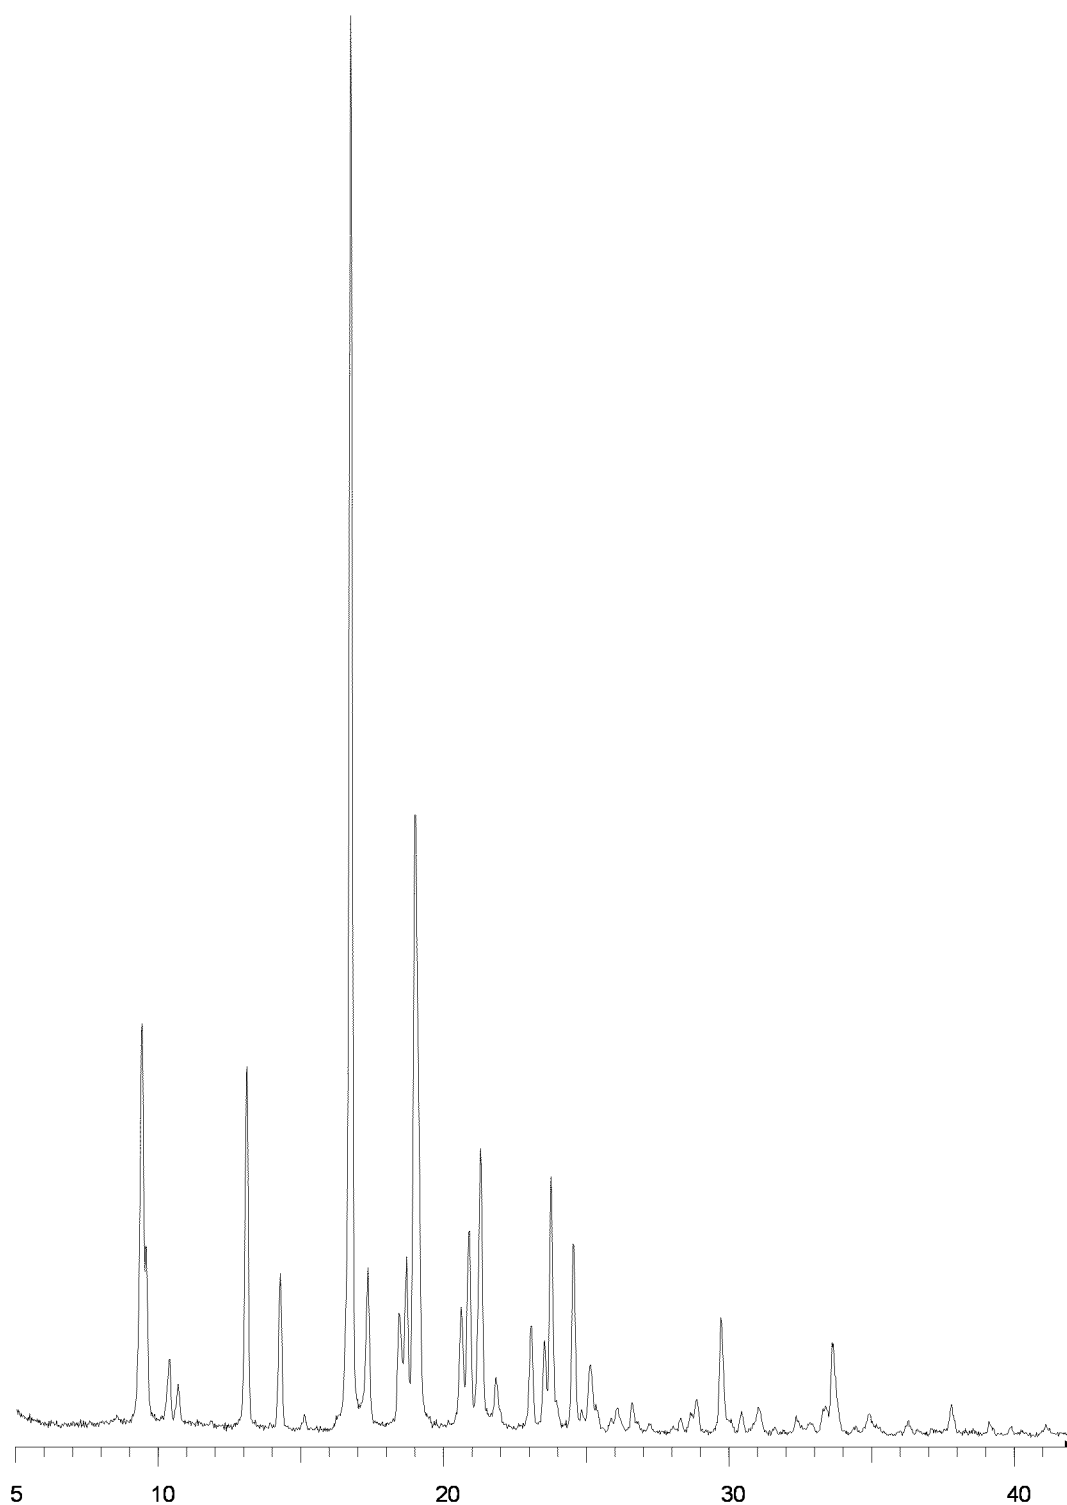

2-Theta - Scale


Type: Locked Coupled - Comment: 5-42 2-theta, 0.024 step size, 0.1sec/step

Figure 2. Compound 1 pattern 3 XRPD diffractogram

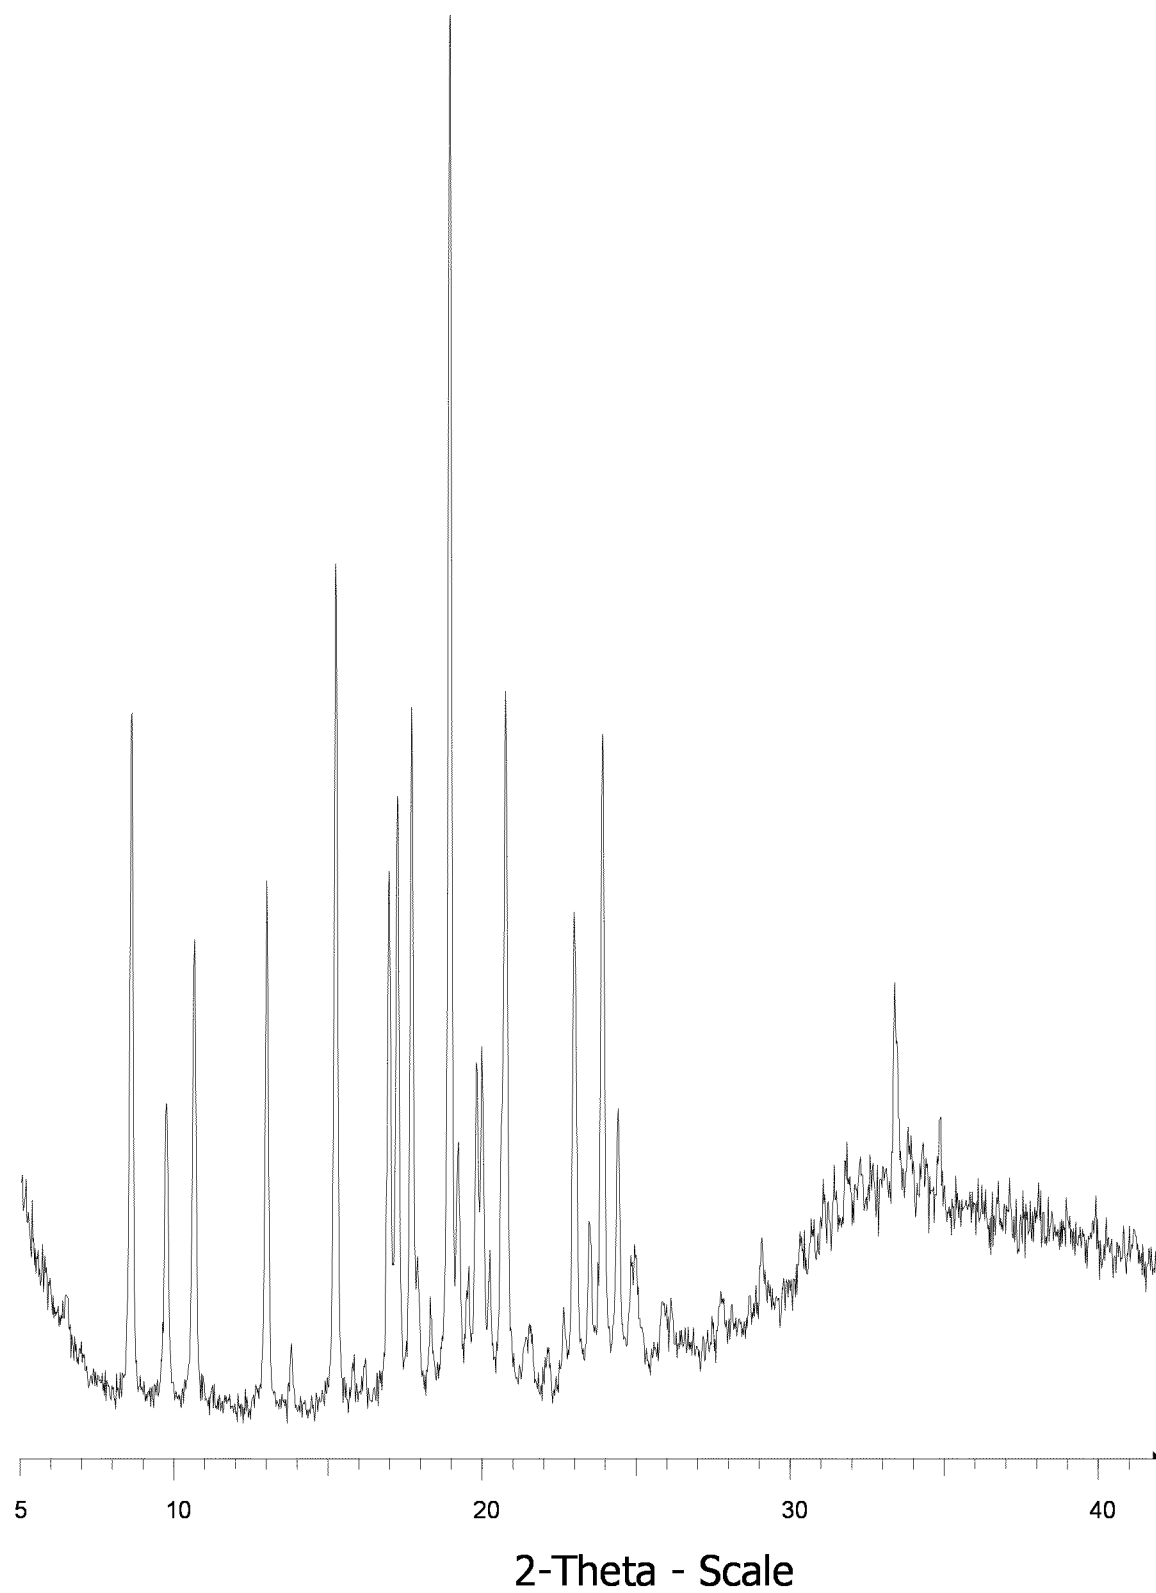

Type: Locked Coupled - Comment: 5-42 2-theta, 0.024 step size, 0.1sec/step

Figure 3. Compound 1 pattern 4 XRPD diffractogram

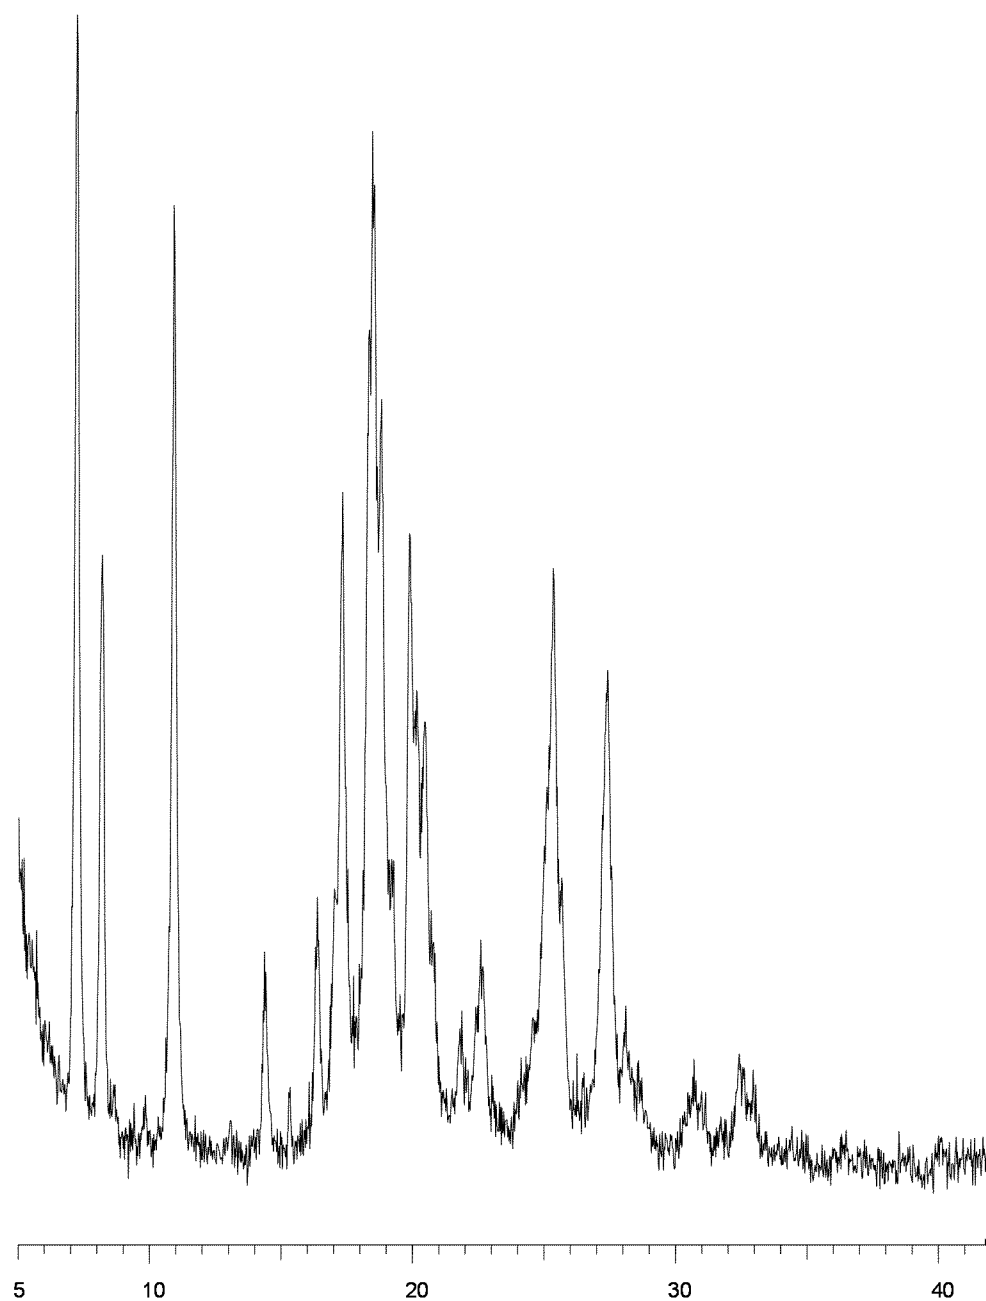

2-Theta - Scale

Type: Locked Coupled - Comment: 5 -42 2-theta, 0.024 step size, 0.1sec/step

Figure 4. Compound 1. HCl XRPD diffractogram


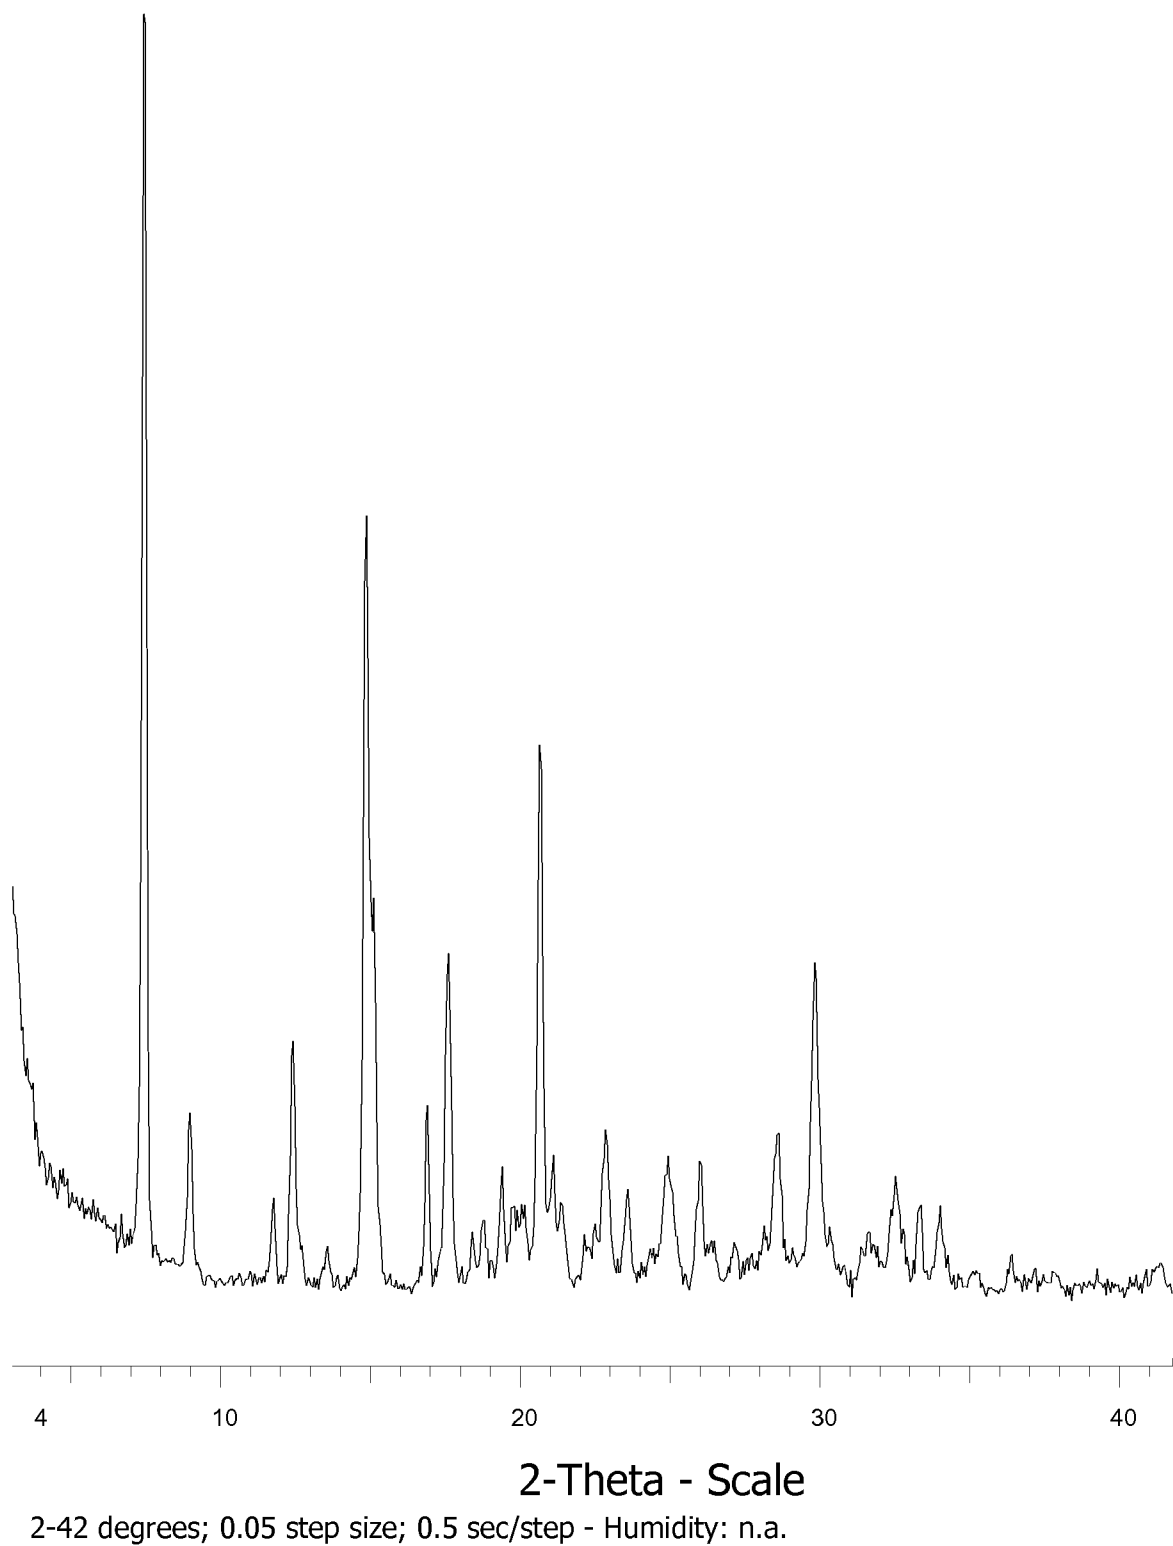


Figure 5. Compound 1. HCl.3H₂O XRPD diffractogram

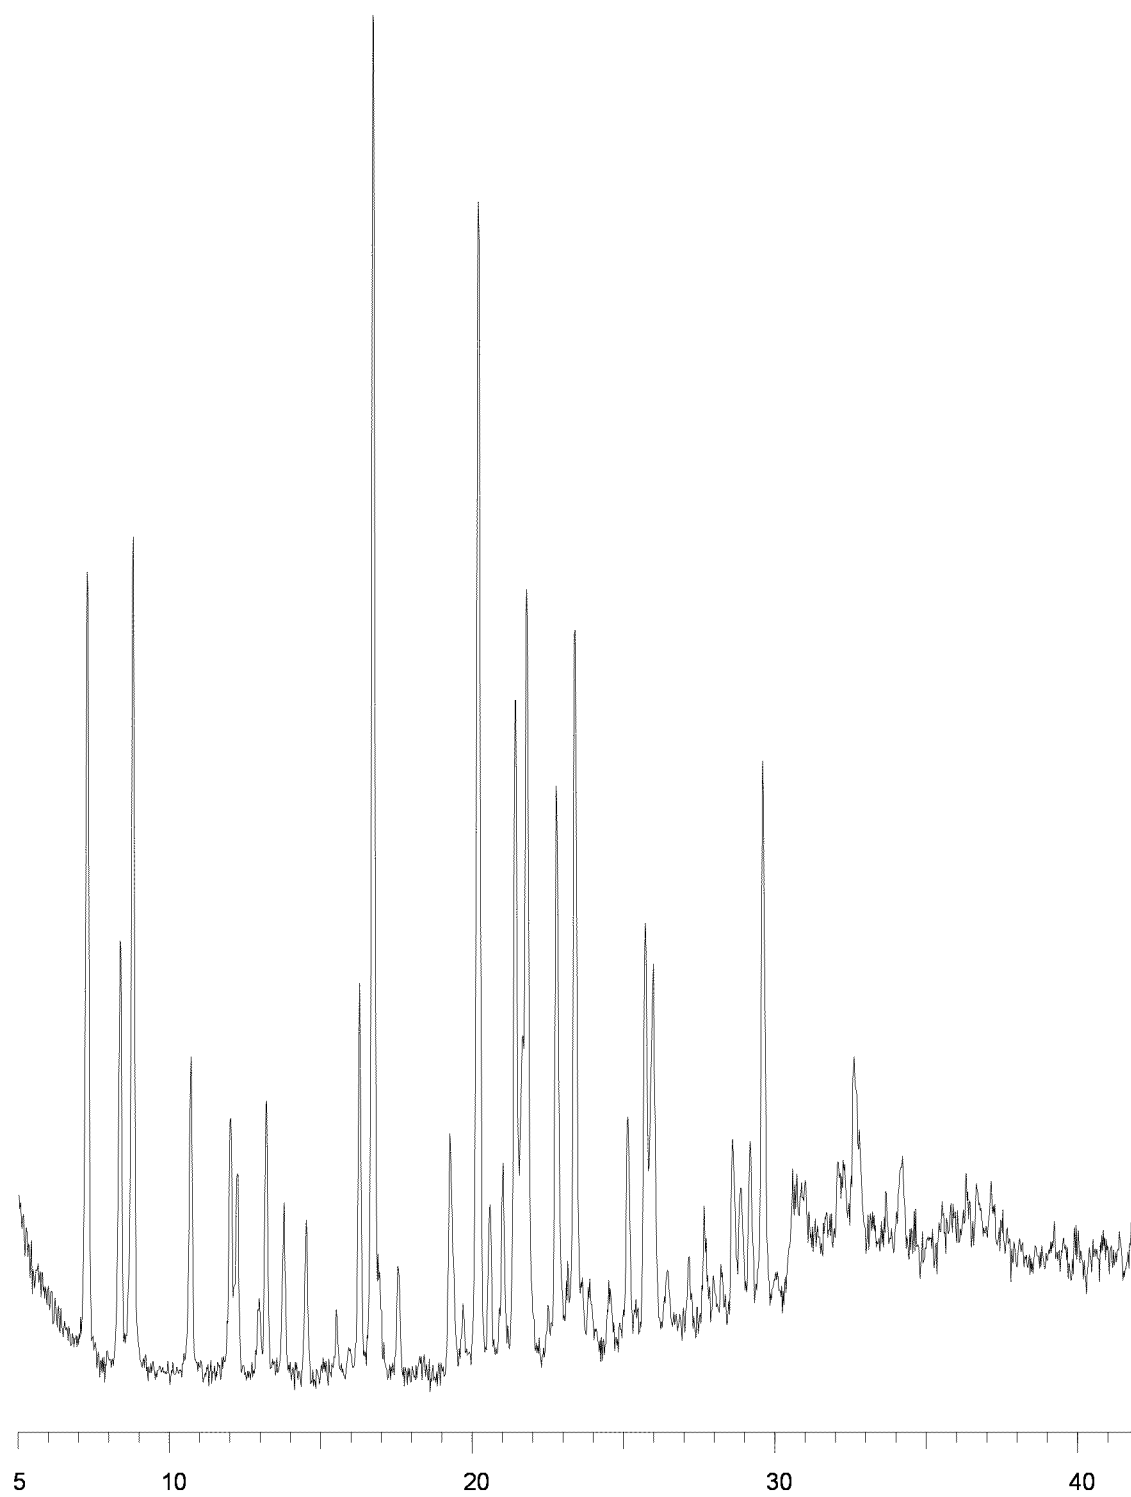

2-Theta - Scale

2-theta, 0.024 step size, 0.1sec/step

Figure 6. Compound 1. HCl.3H₂O Pattern 4 DVS analysis

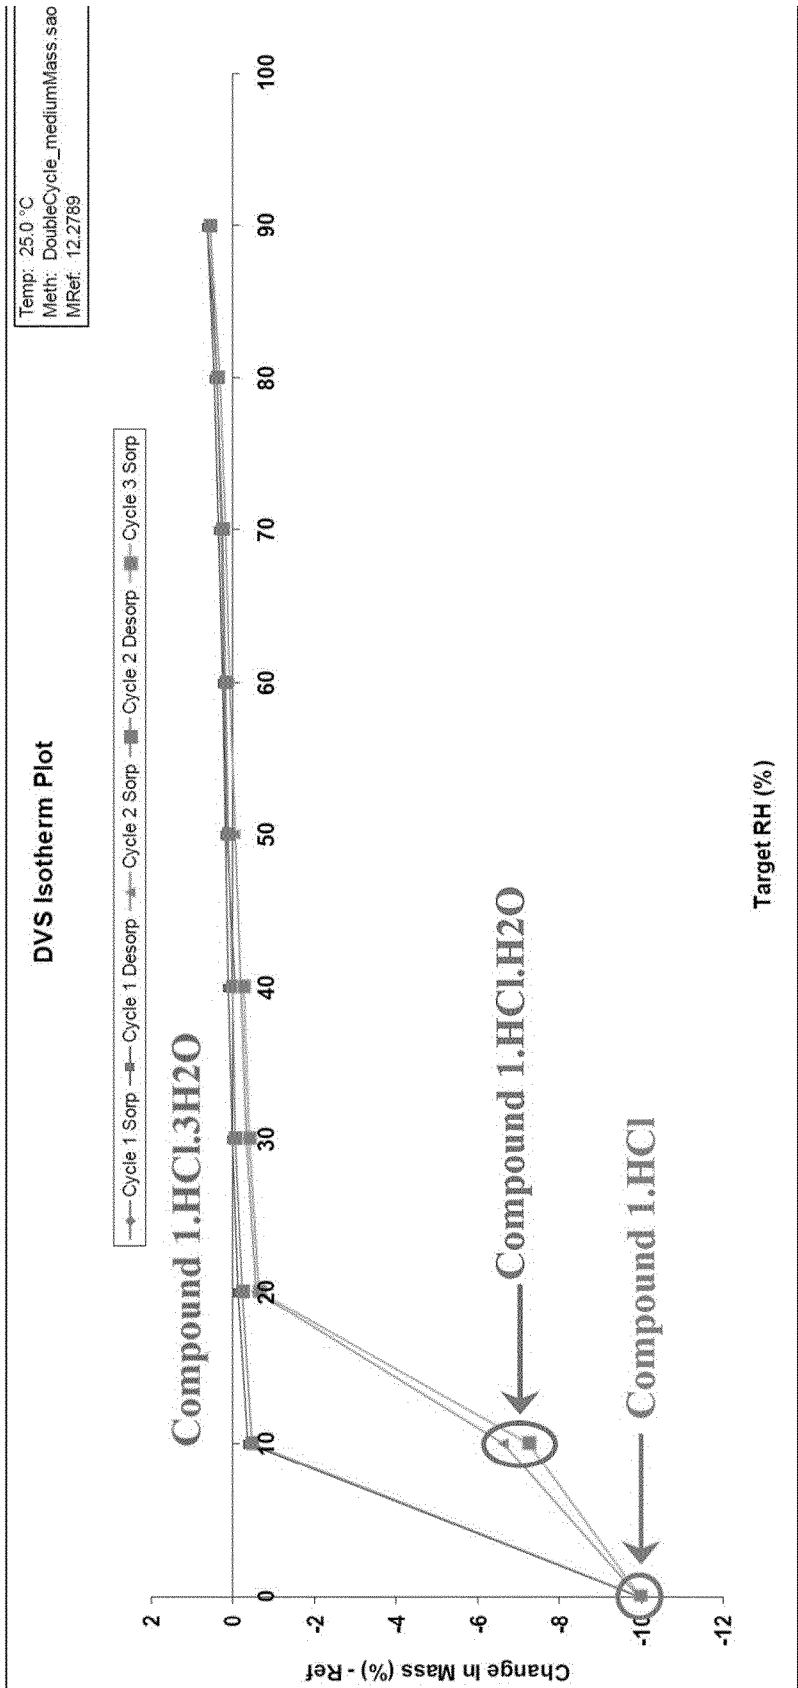


Figure 7. Compound 1. HCl.3H₂O DSC trace

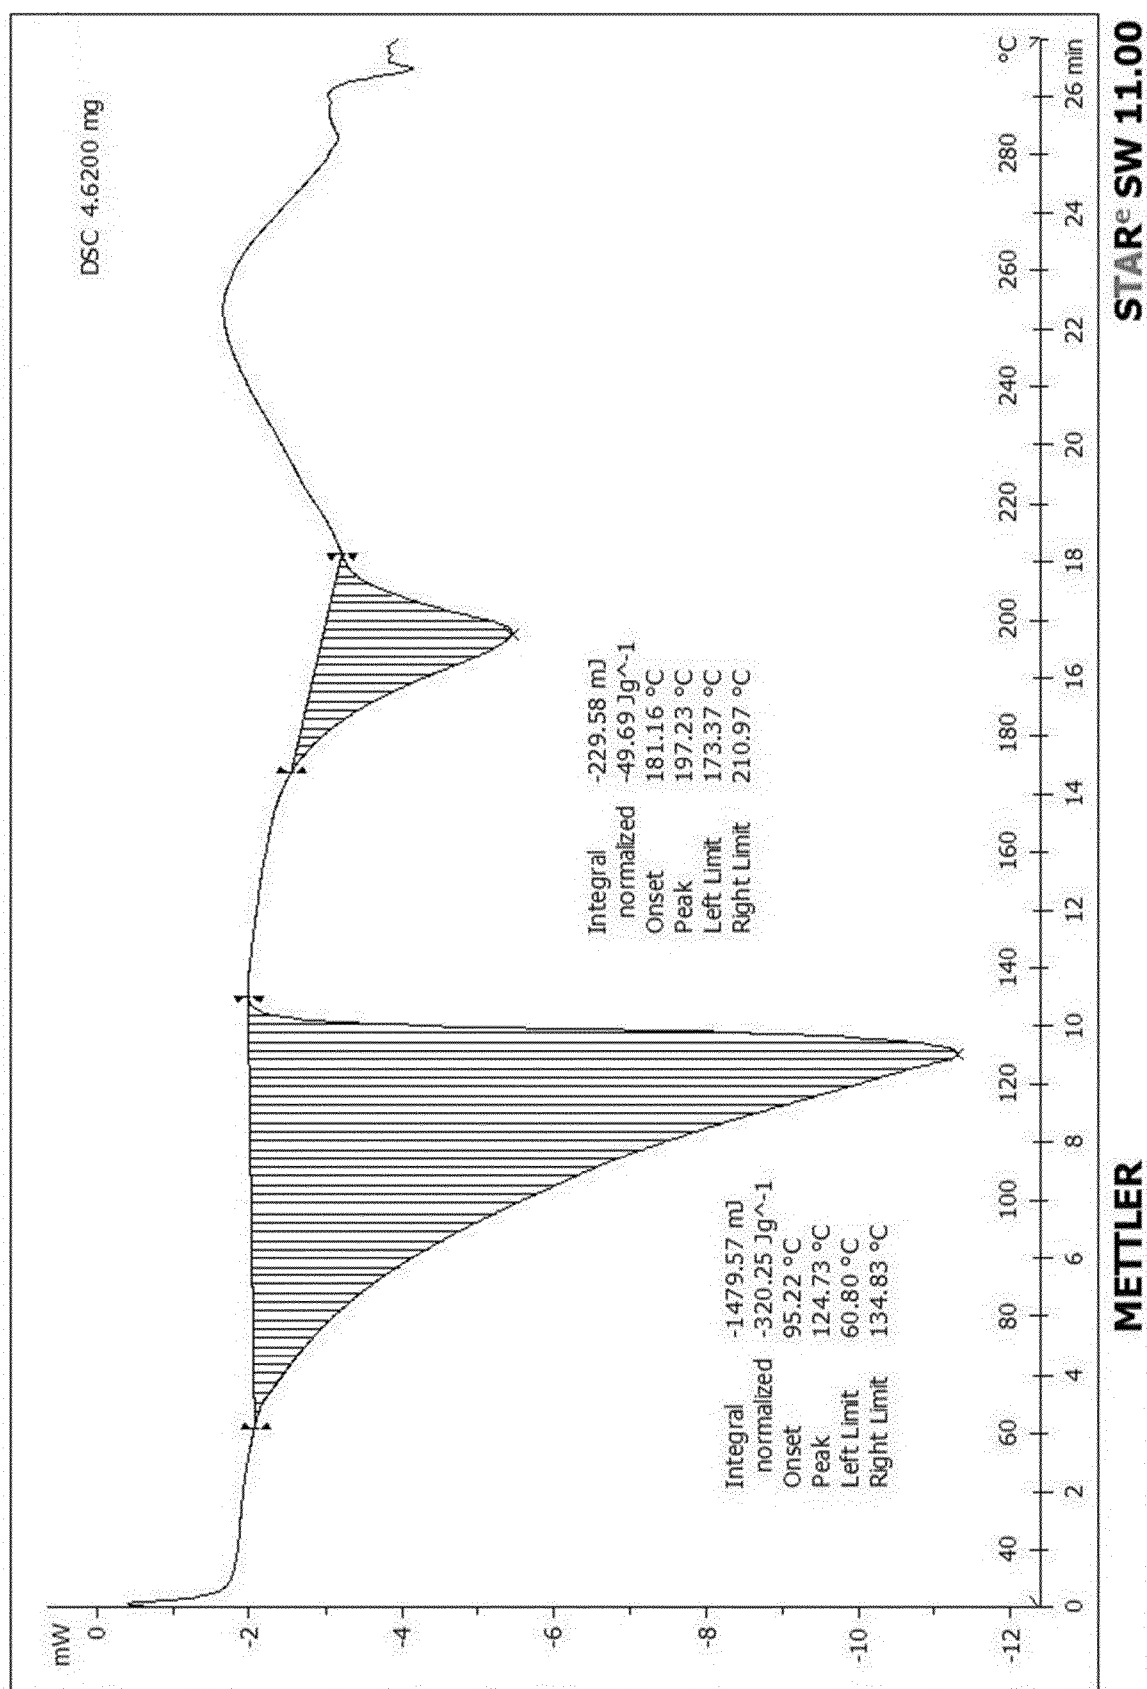


Figure 8. Compound 1. HCl. MeOH XRPD diffractogram

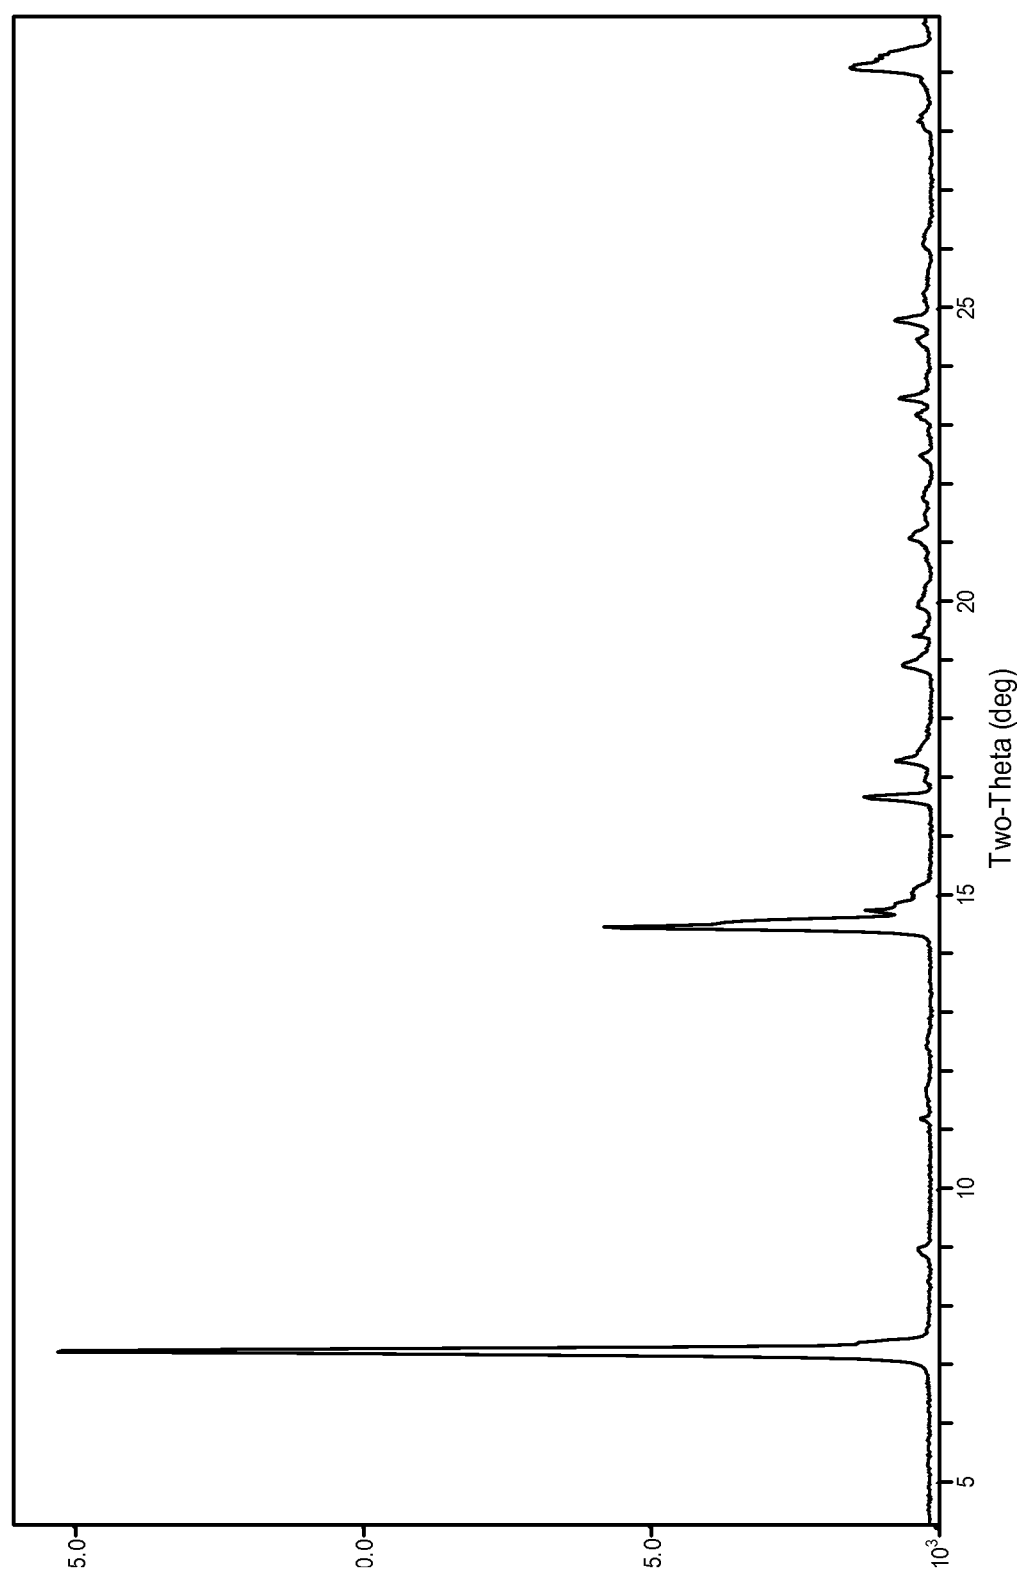


Figure 9. Compound 1. HCl.1.5 HCO₂H XRPD diffractogram

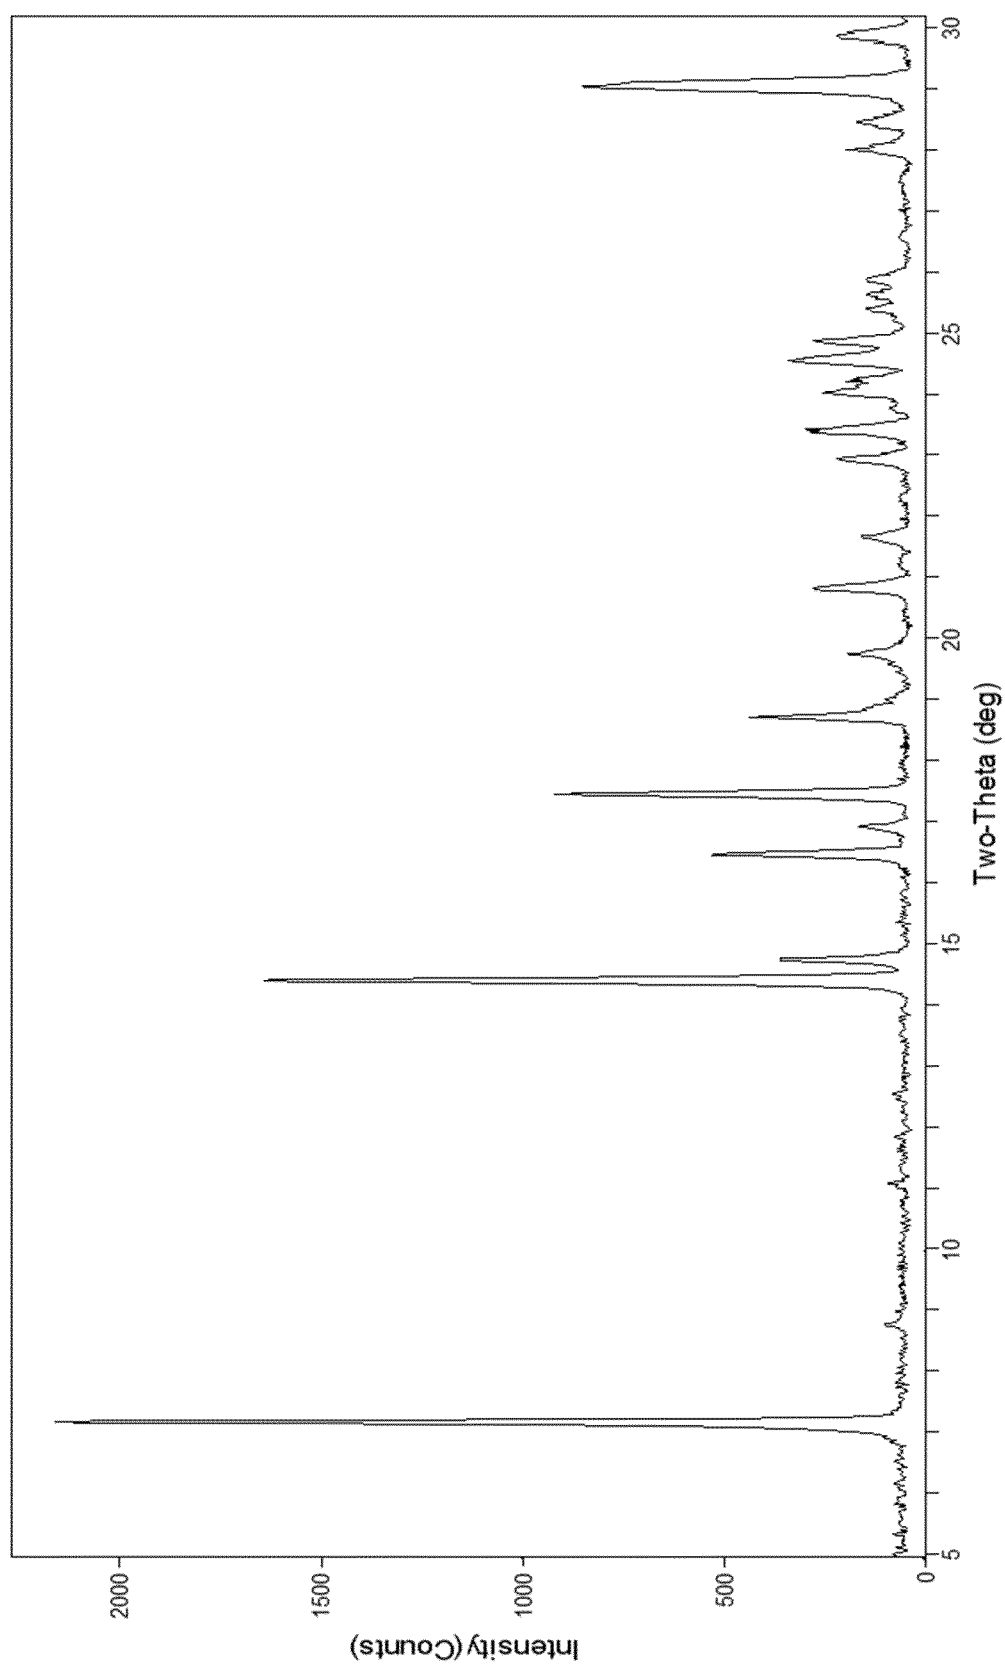


Figure 10. Compound 1 AUC values following once daily p.o. dosing.

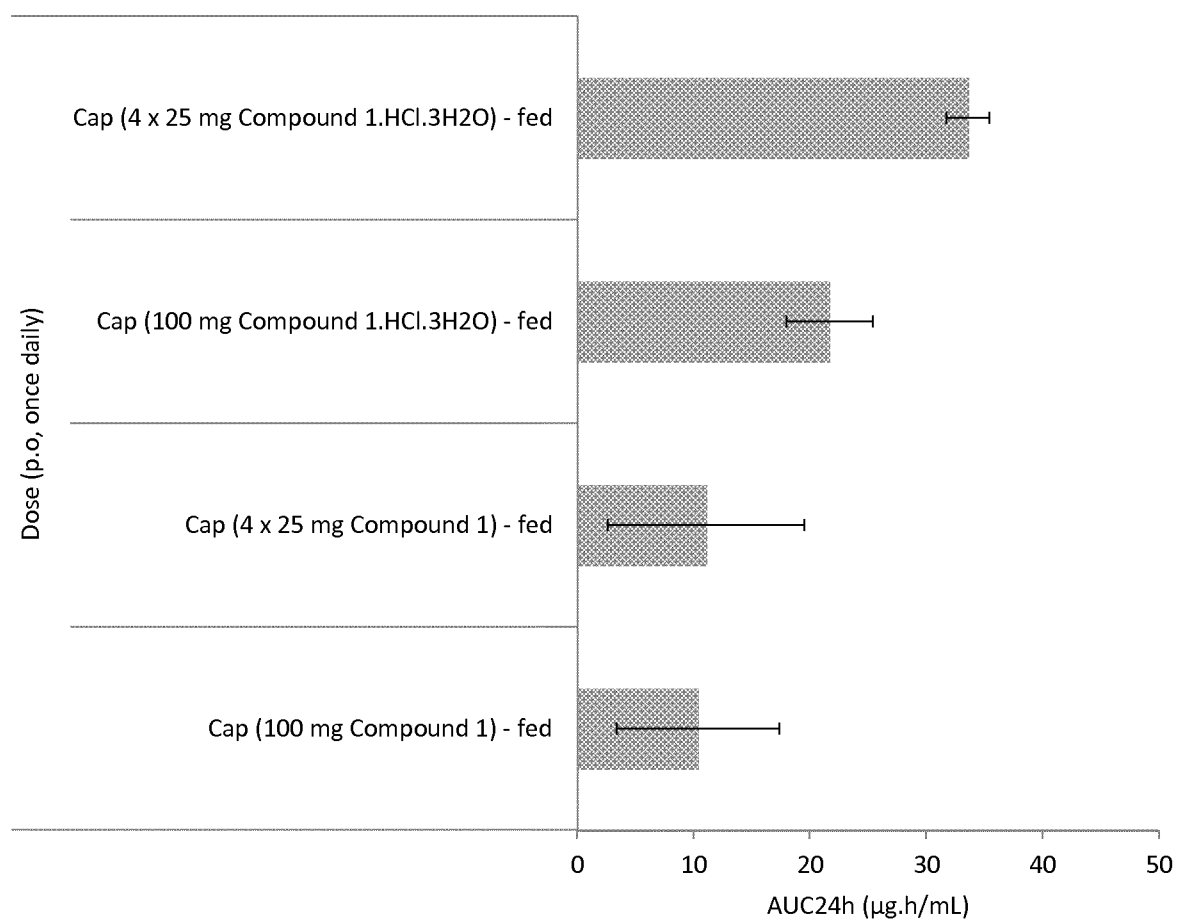


Figure 11. Compound1.HCl.3H₂O Crystal Structure.

