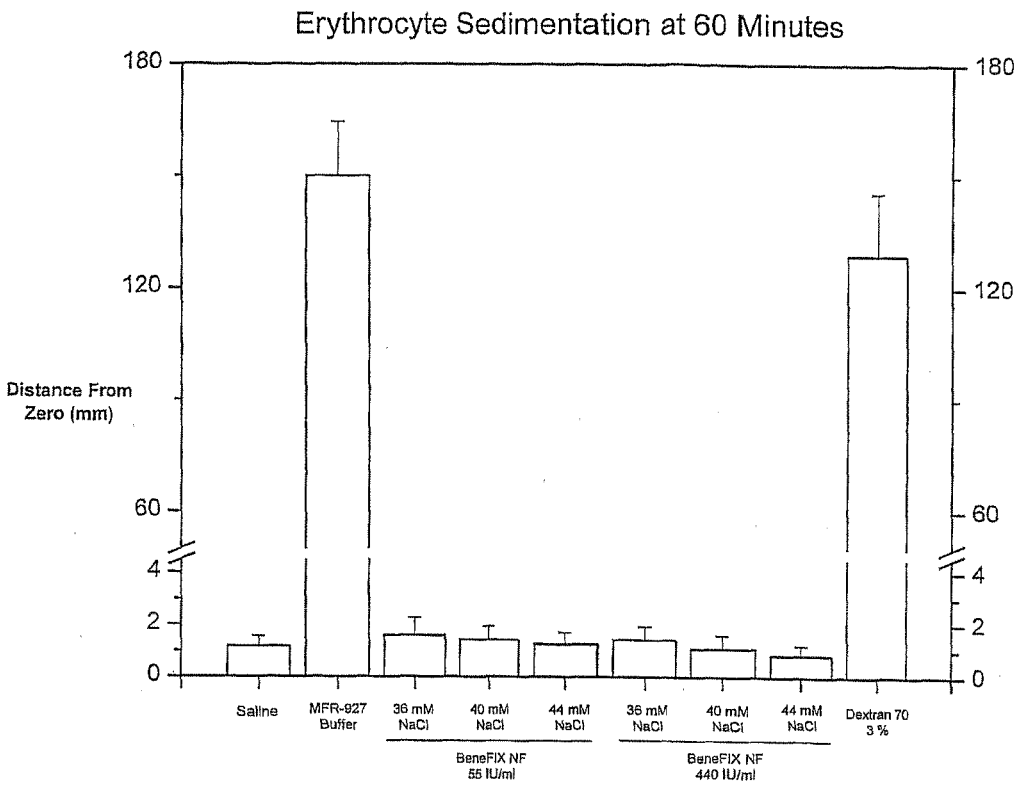

Erythrocyte Sedimentation at 60 Minutes
Distance From Zero (mm)
180
120
60
4
2
0
Saline
MFR-927 Buffer
36 mM NaCl
40 mM NaCl
44 mM NaCl
36 mM NaCl
40 mM NaCl
44 mM NaCl
Dextran 70 3 %
BeneFIX NF 55 IU/ml
BeneFIX NF 440 IU/ml

FIG. 1

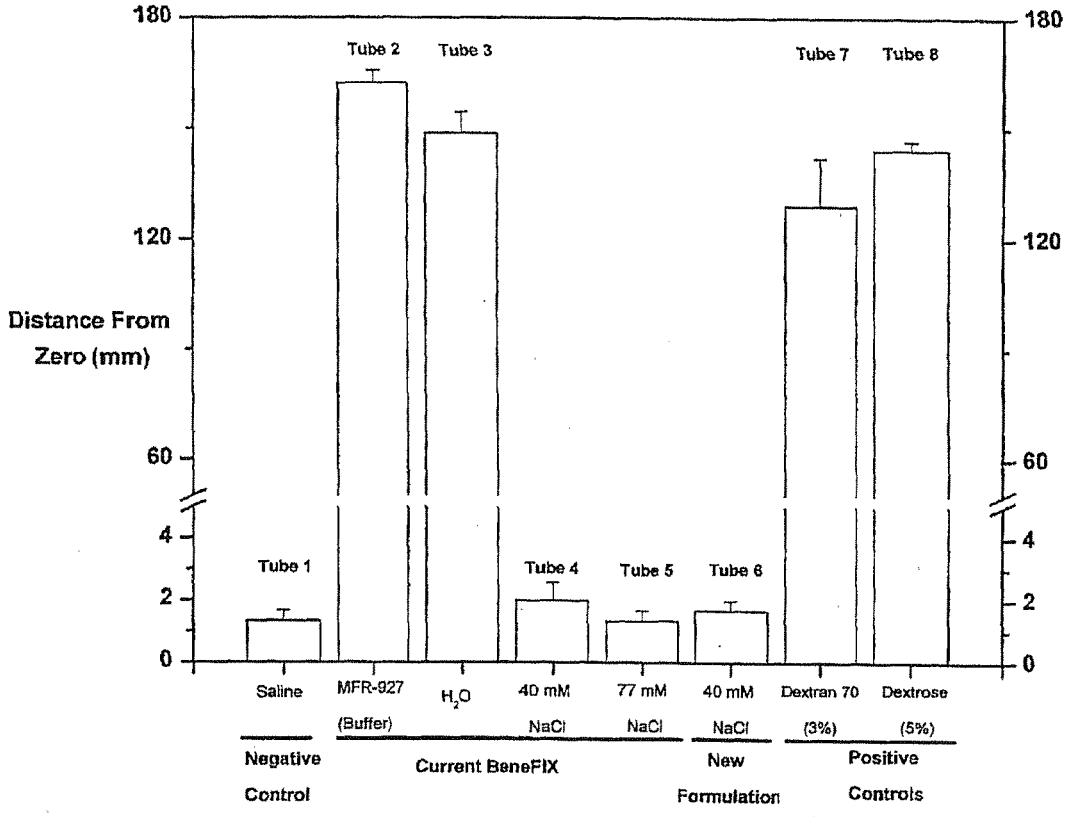

180
120
60
4
2
0
Distance From Zero (mm)
Tube 1
Tube 2
Tube 3
Tube 4
Tube 5
Tube 6
Tube 7
Tube 8
Saline
MFR-927 (Buffer)
H2O
40 mM NaCl
77 mM NaCl
40 mM NaCl
Dextran 70 (3%)
Dextrose (5%)
Negative Control
Current BeneFIX
New Formulation
Positive Controls

FIG. 2