

FIG. 1


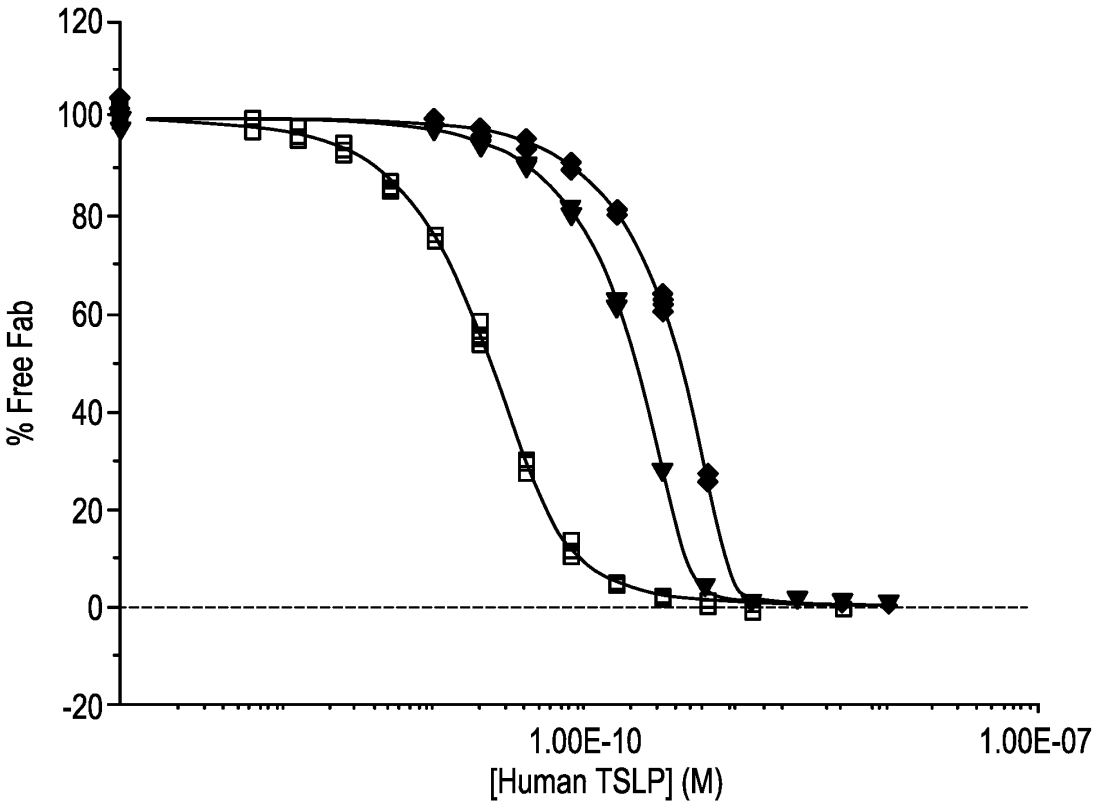


FIG. 2

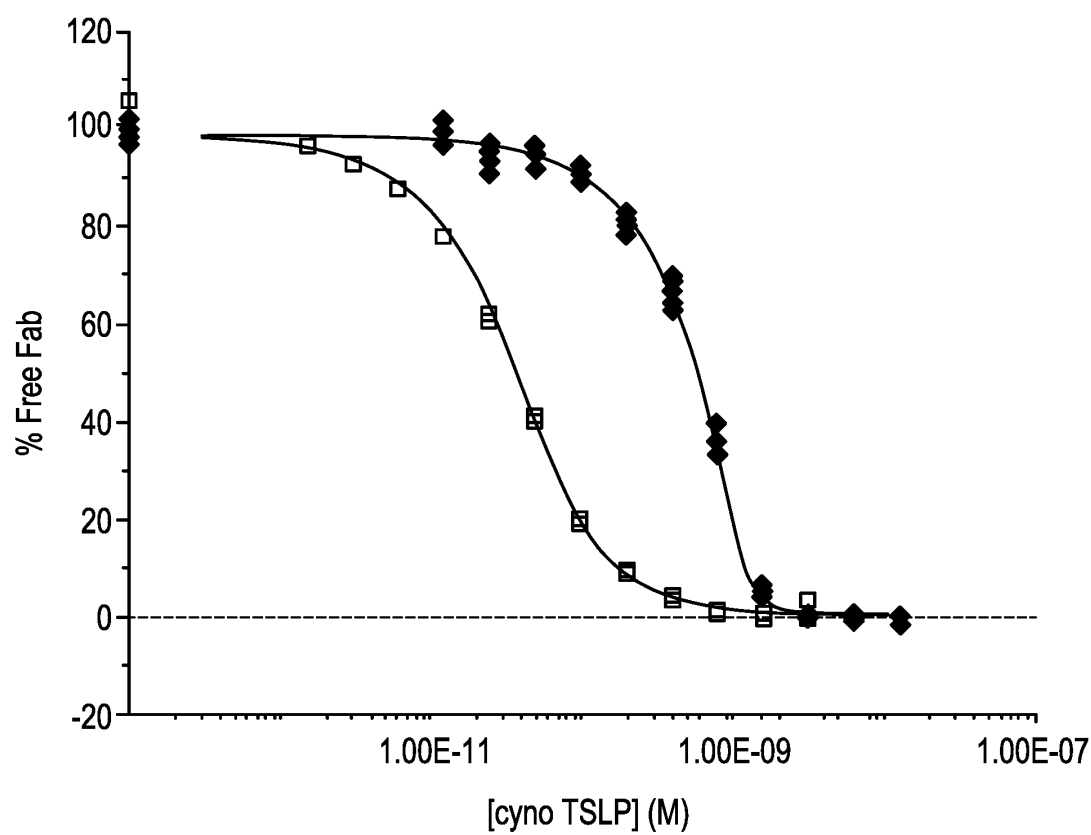

3/25

FIG. 3

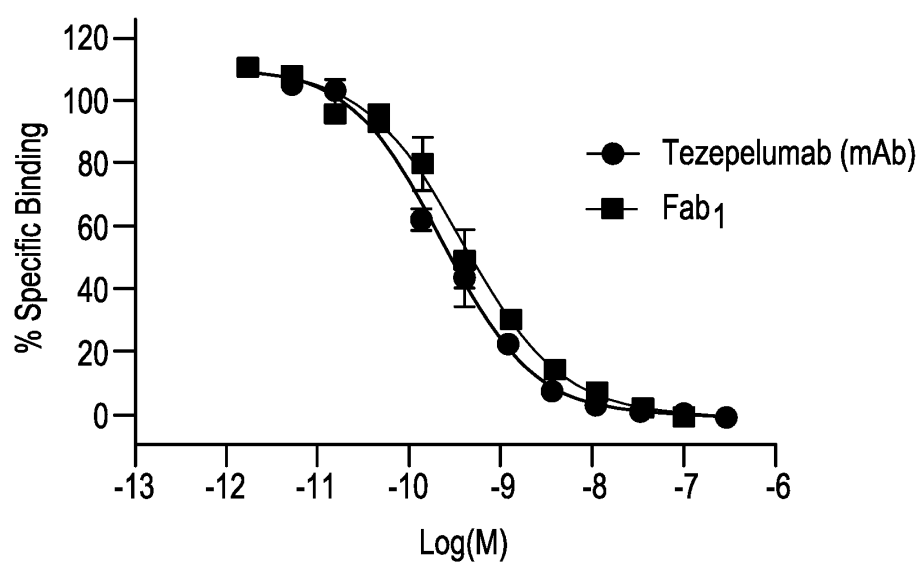


FIG. 4

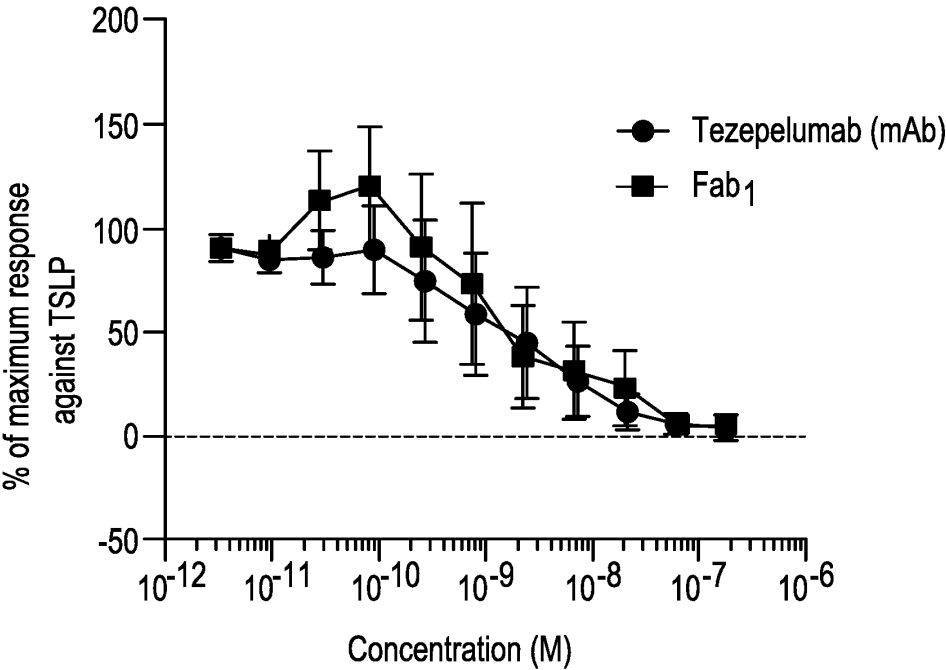


FIG. 5

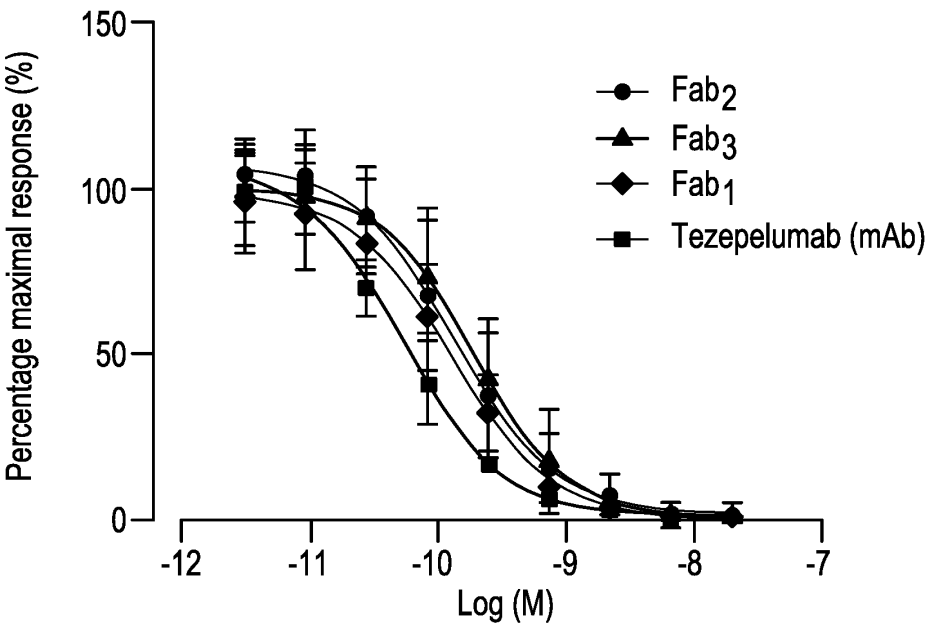


FIG. 6A

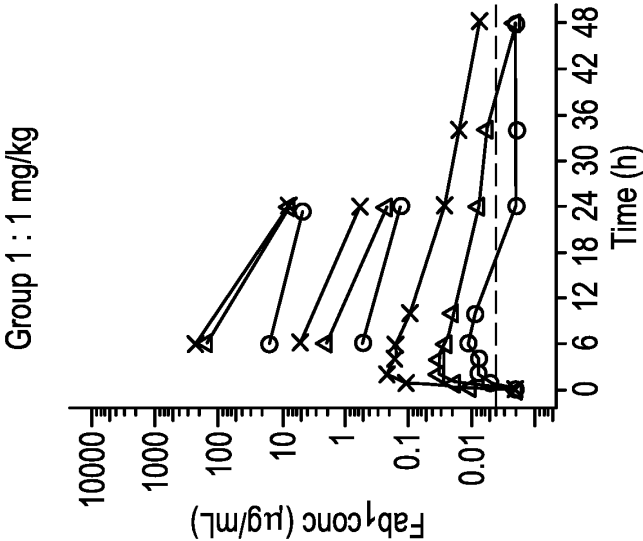


FIG. 6B


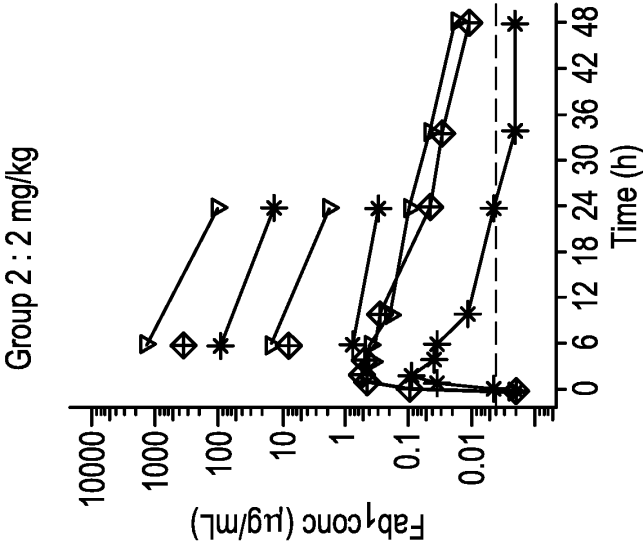


FIG. 6C

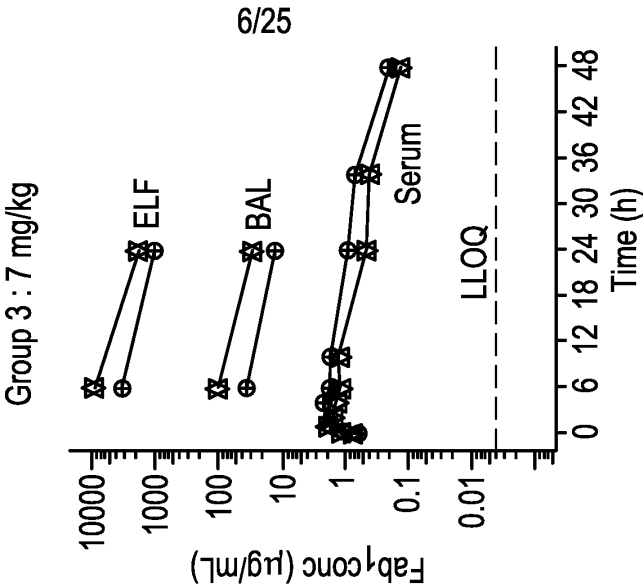

7/25

FIG. 7


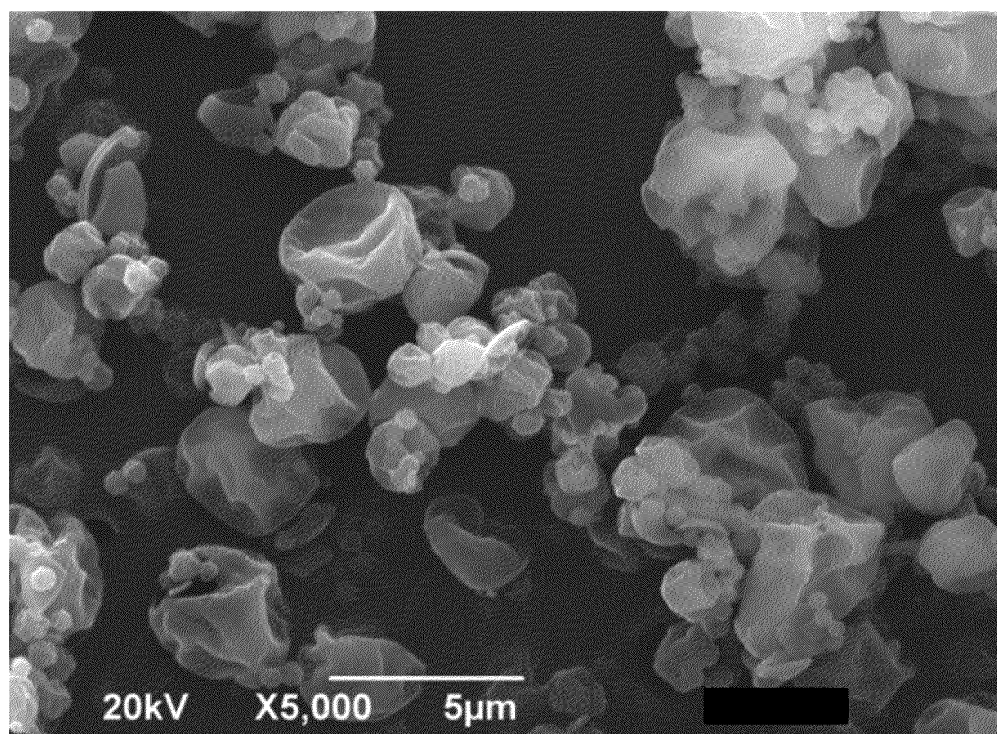



FIG. 8A

cBD vs. Leucine wt%

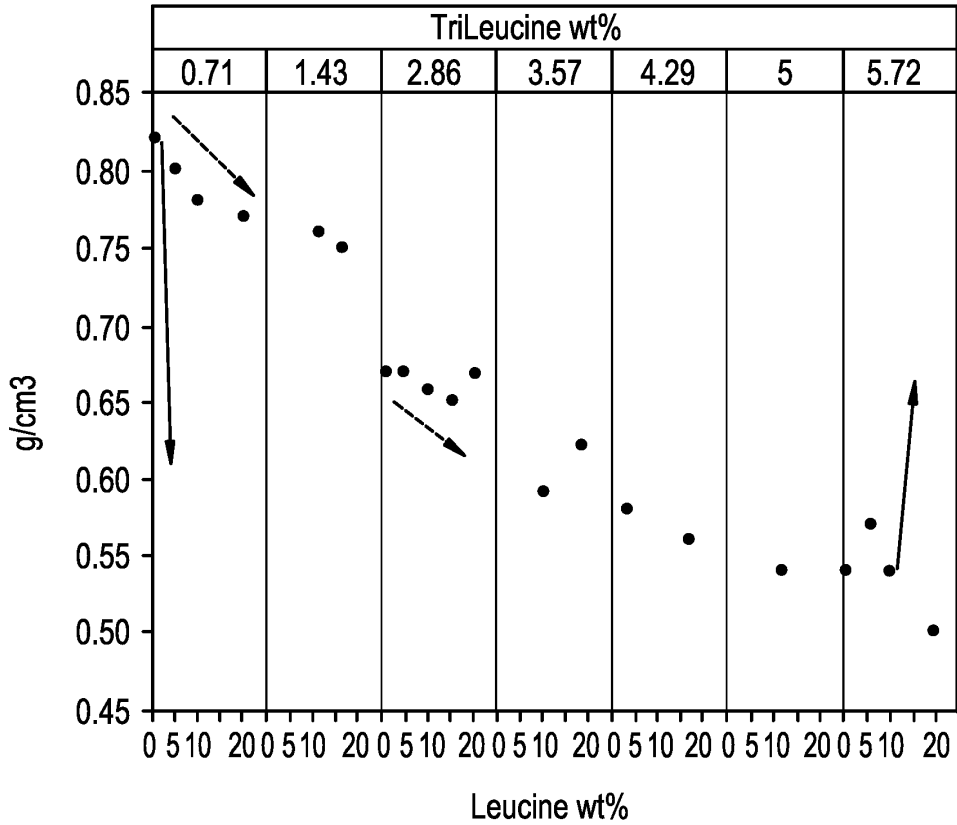

9/25

FIG. 8B

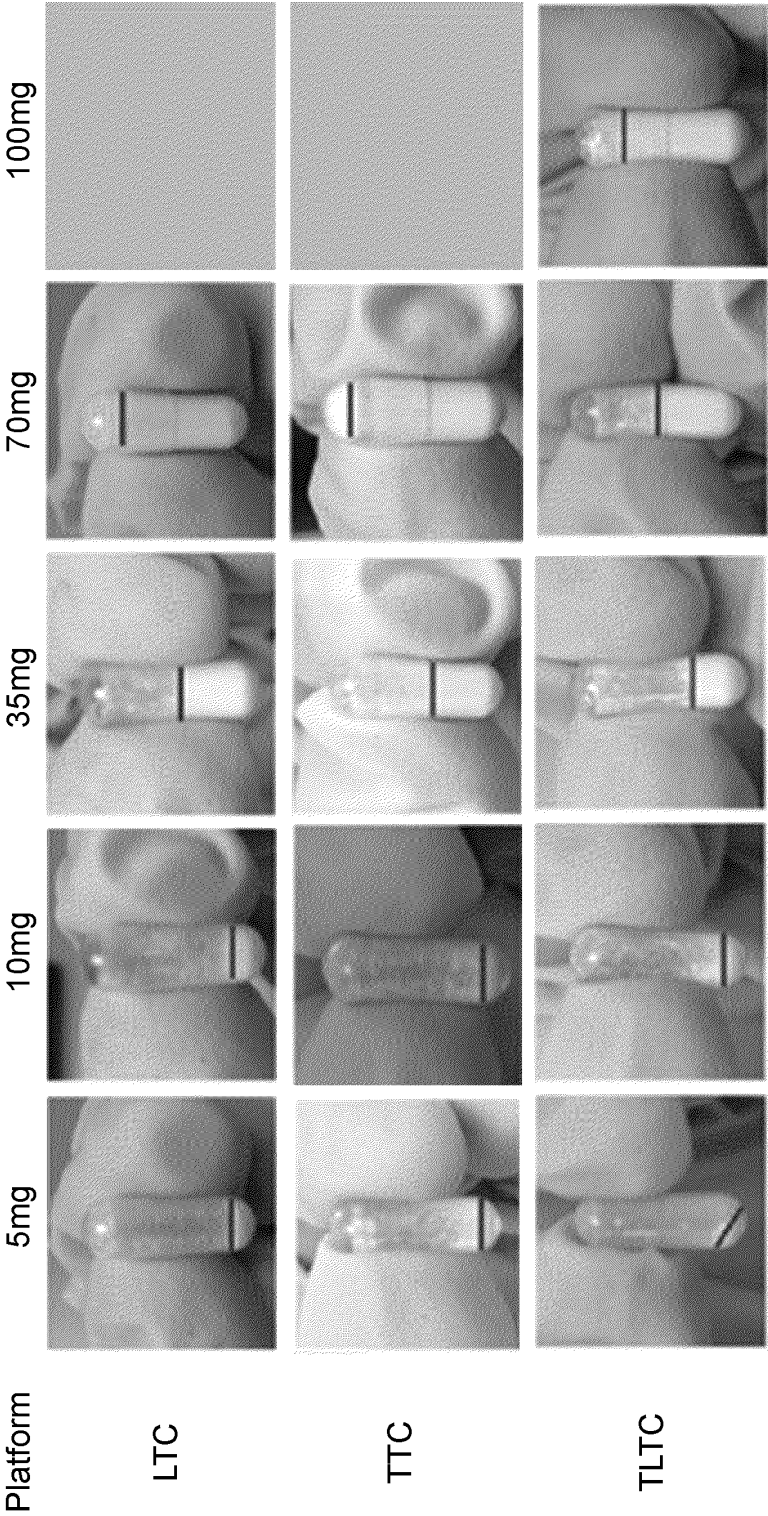

10/25

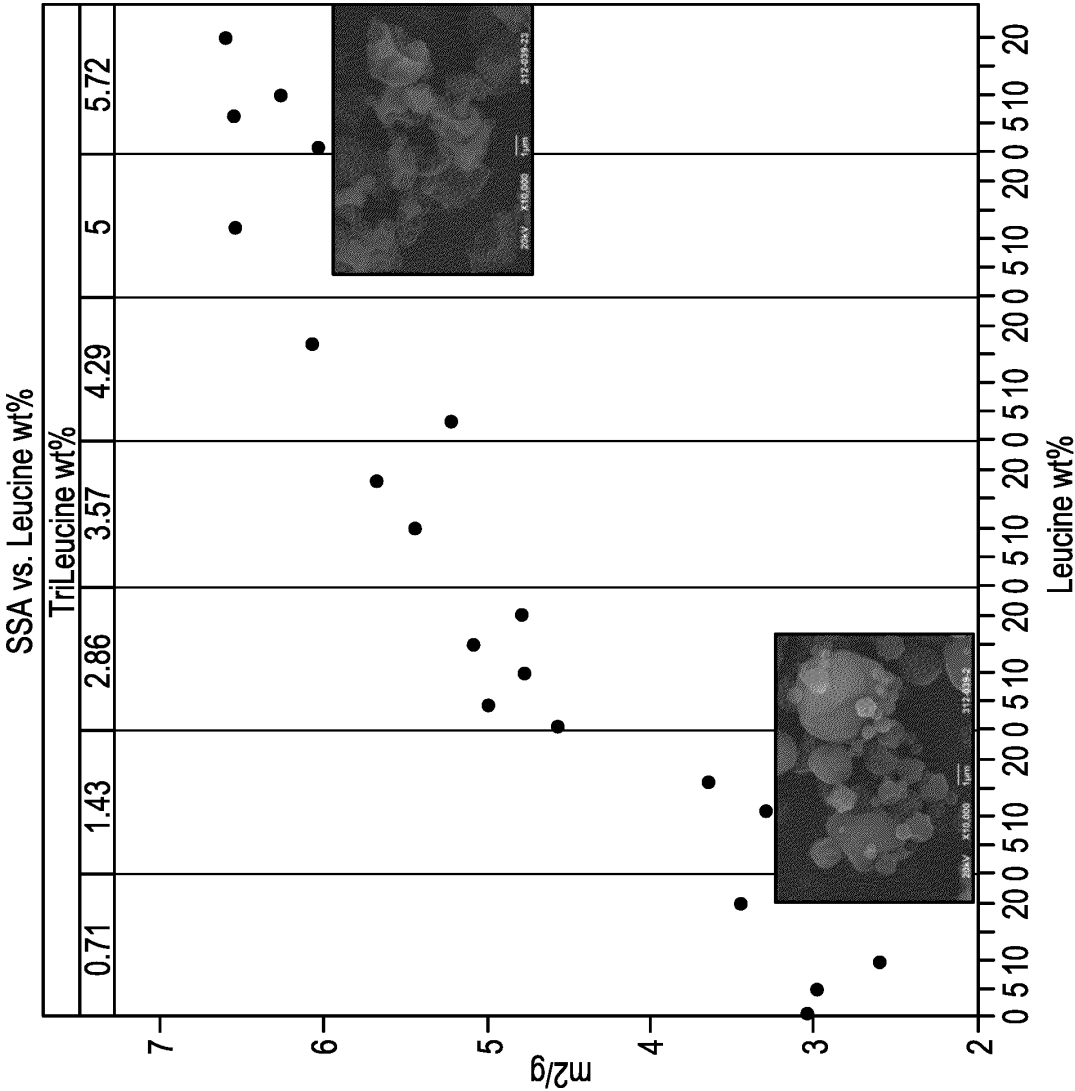


FIG. 9

11/25

FIG. 10

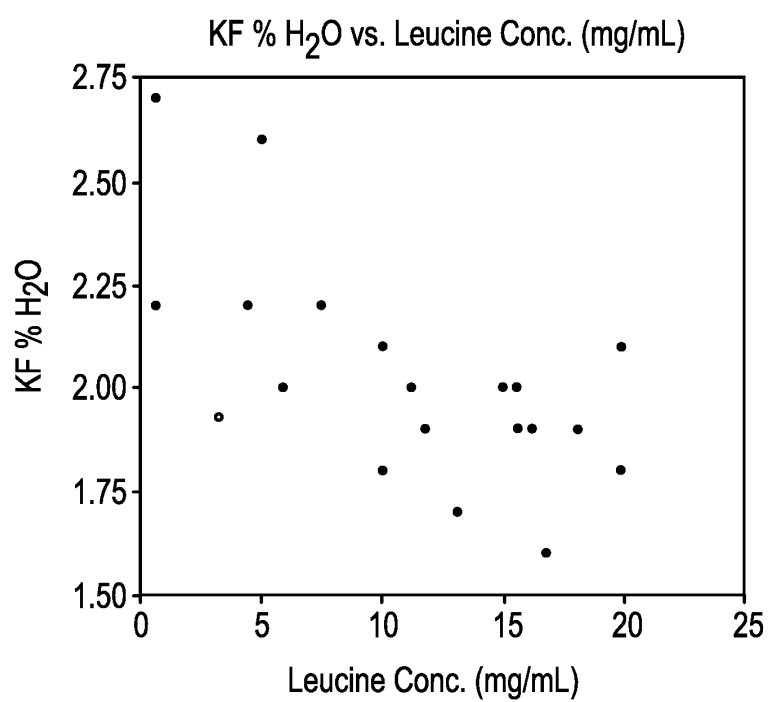


FIG. 11A

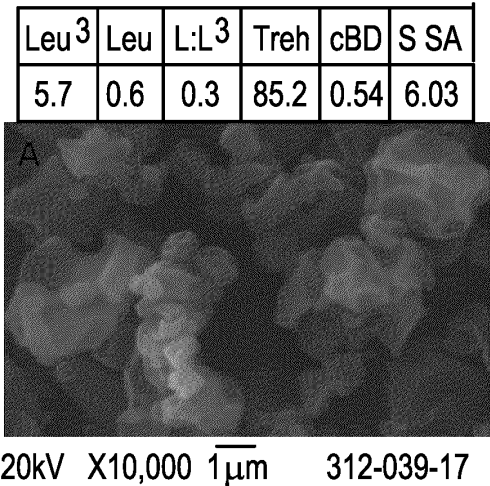


FIG. 11B

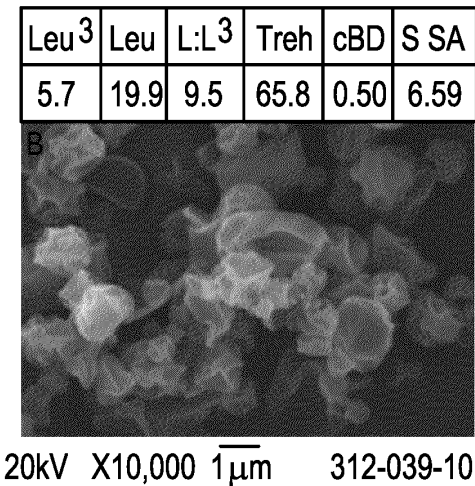


FIG. 11C

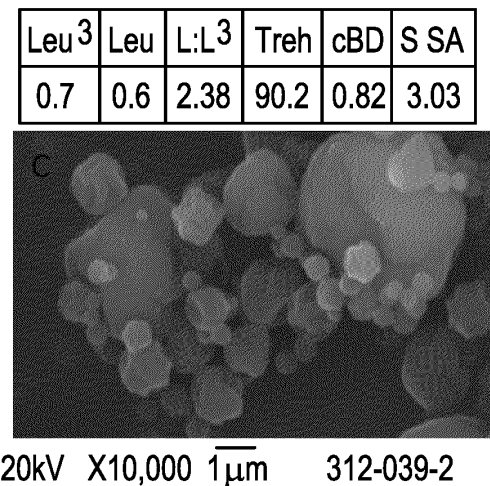


FIG. 11D

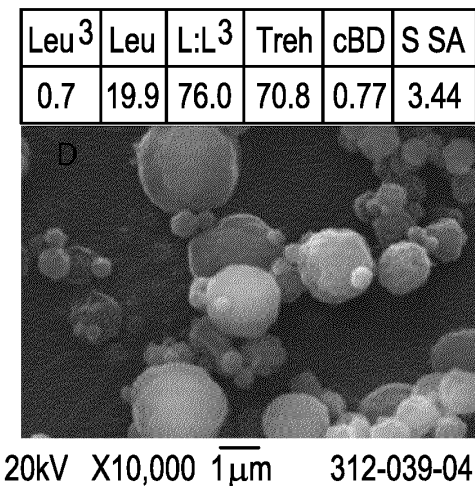


FIG. 12




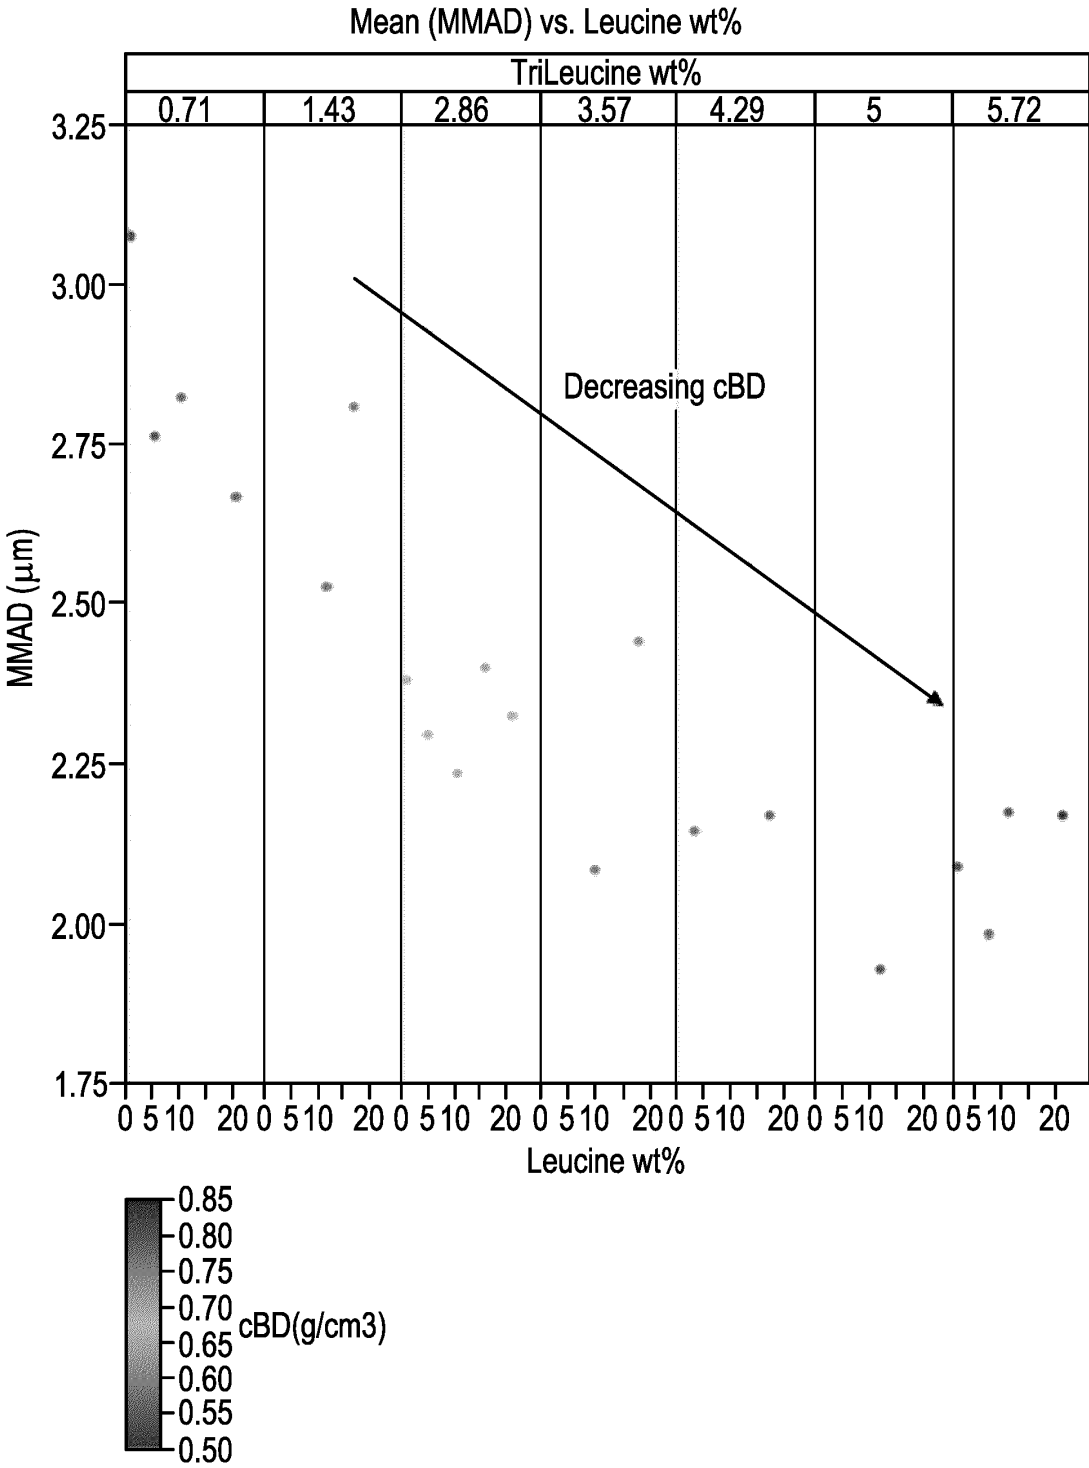


FIG. 13

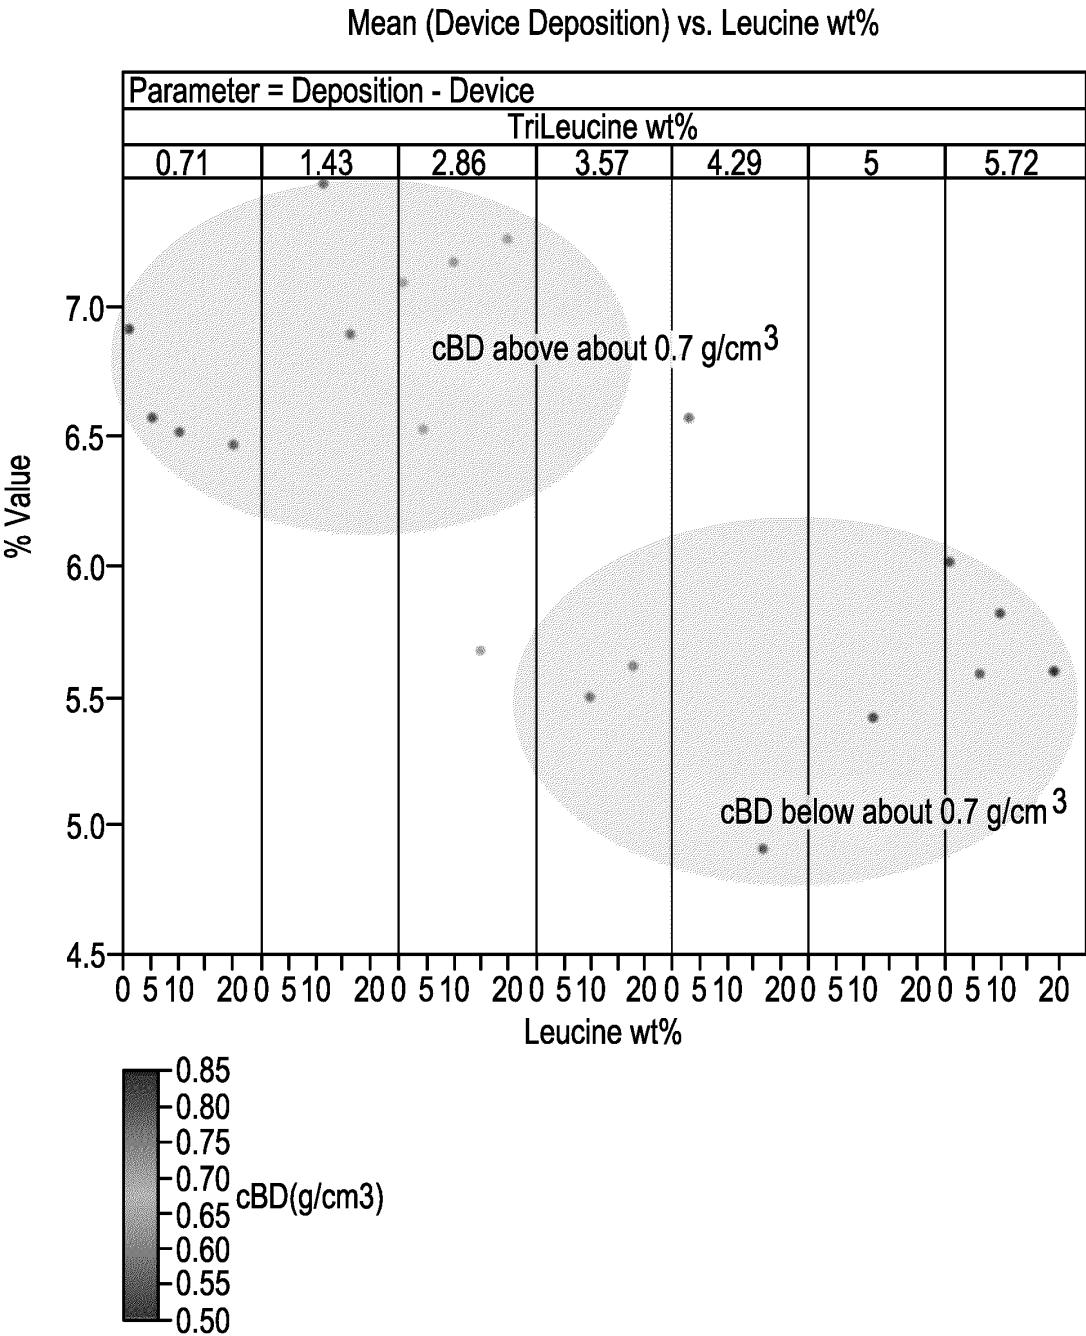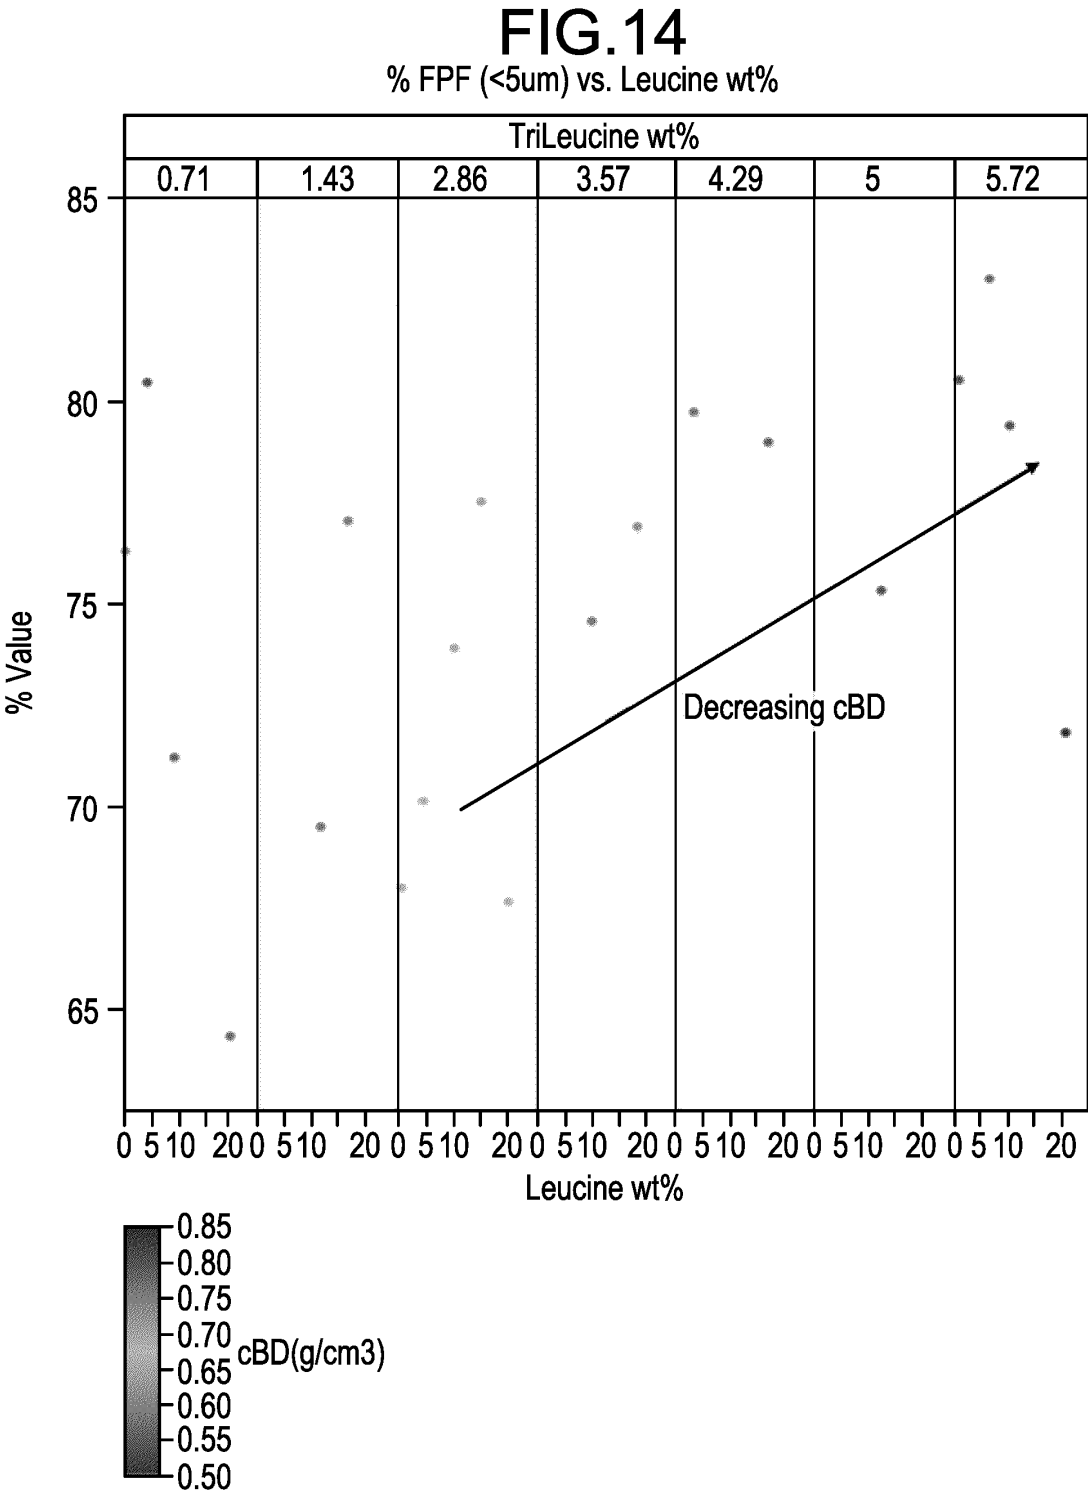


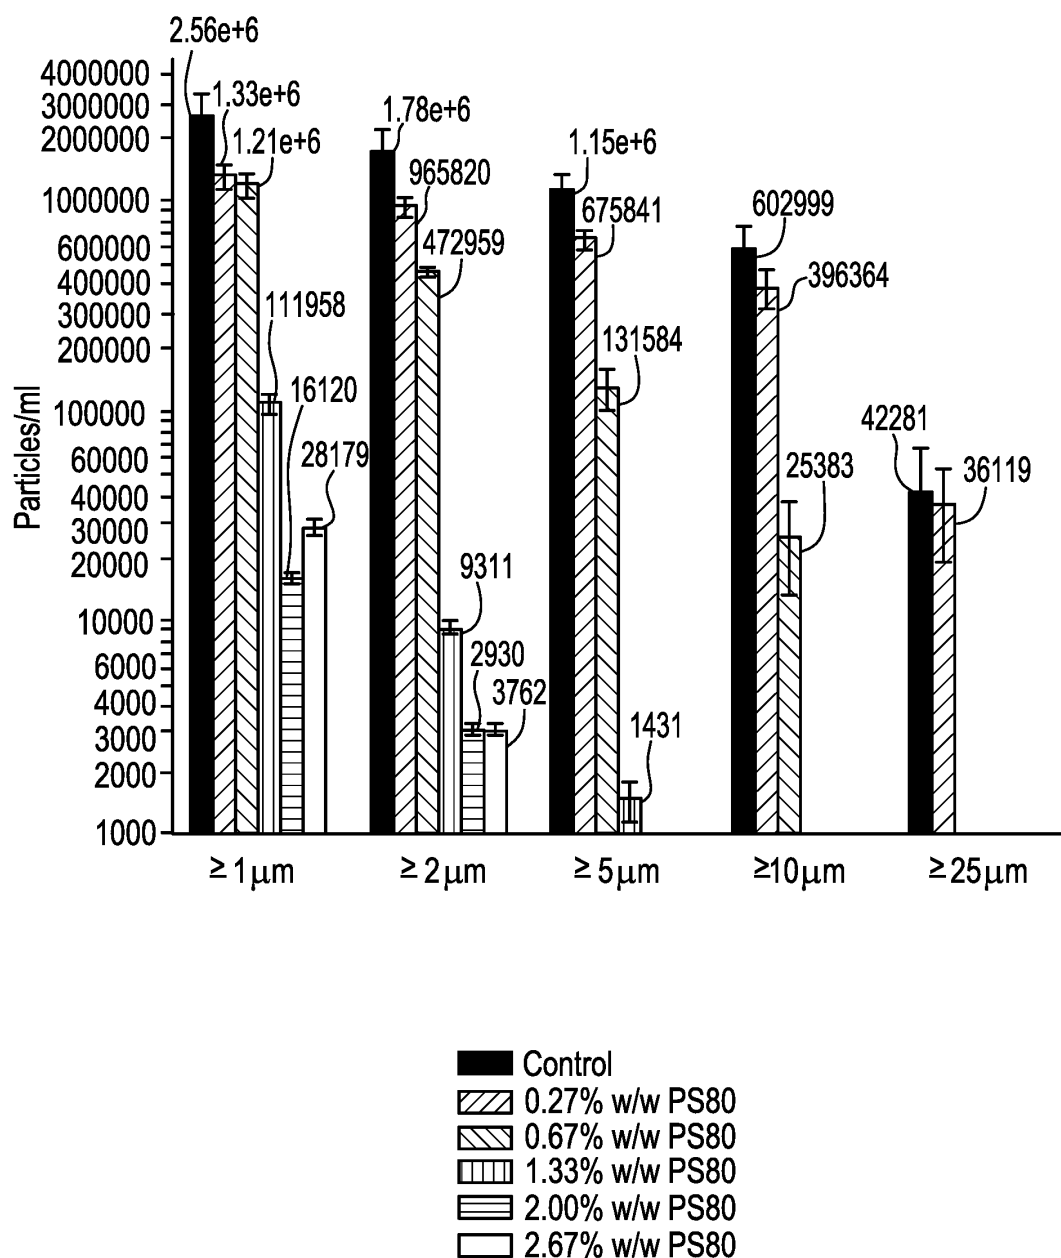


16/25

FIG. 15A30 mg/ml FAB₁

17/25

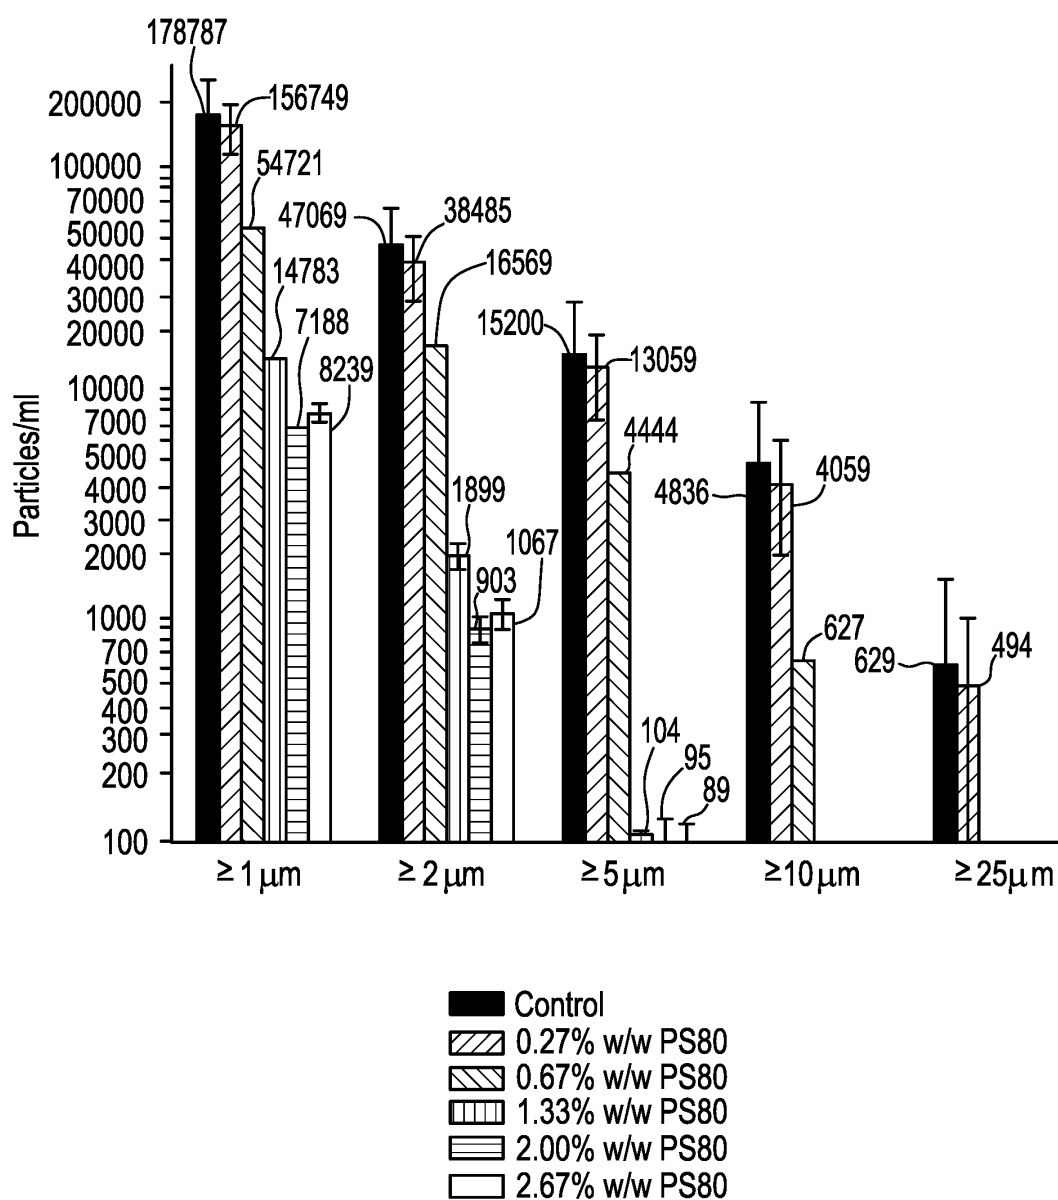FIG. 15B2.5 mg/ml FAB₁

18/25

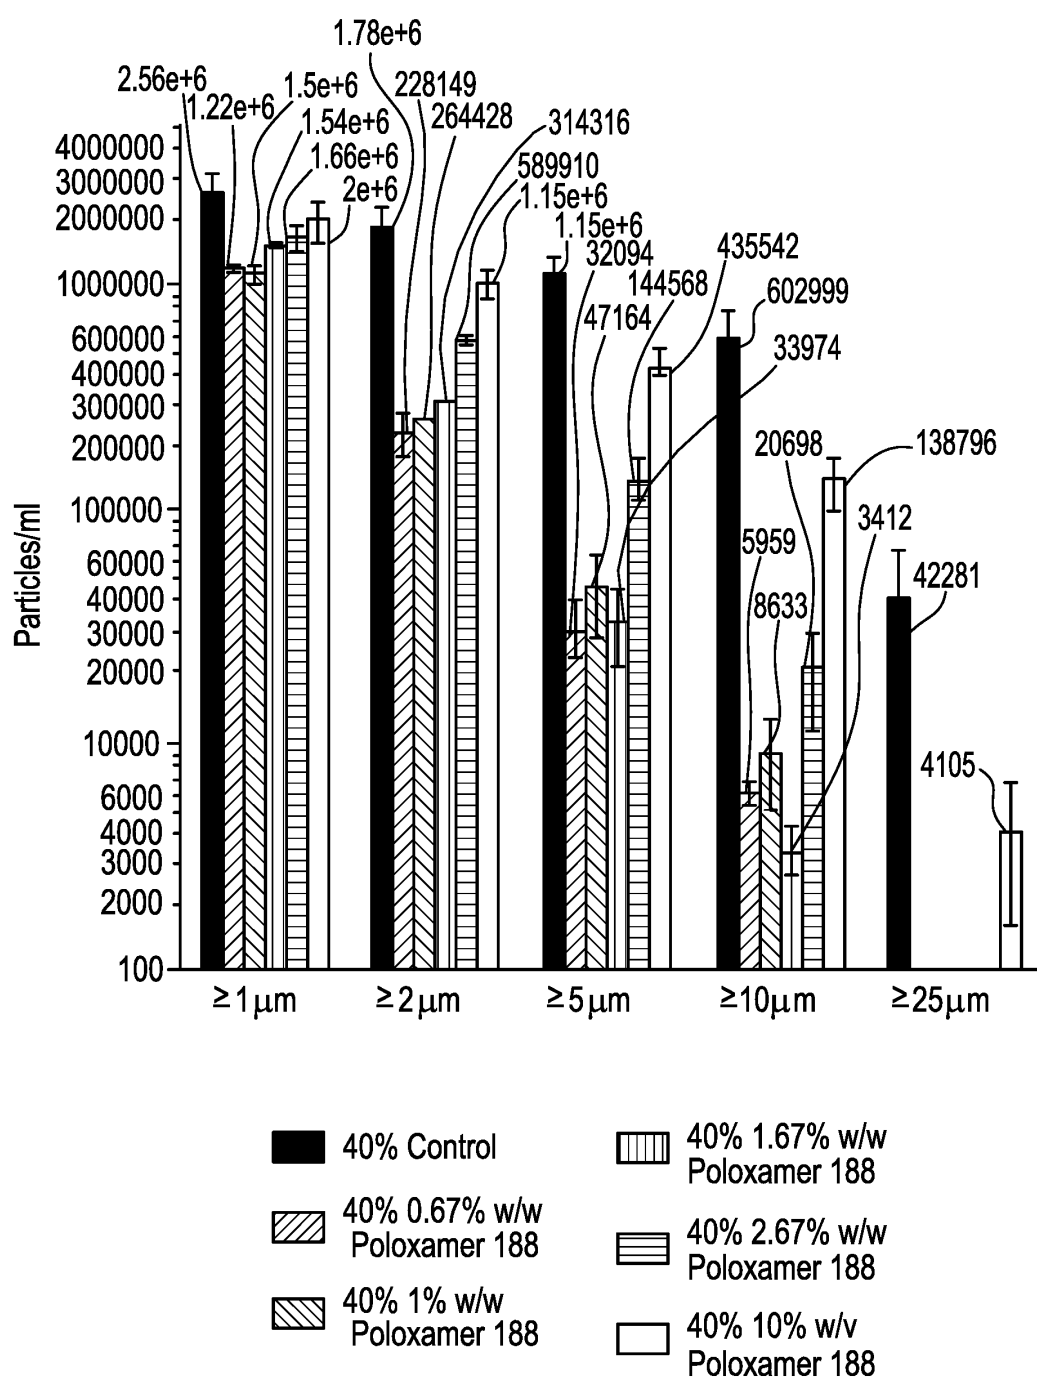FIG. 16A30 mg/ml FAB₁

19/25

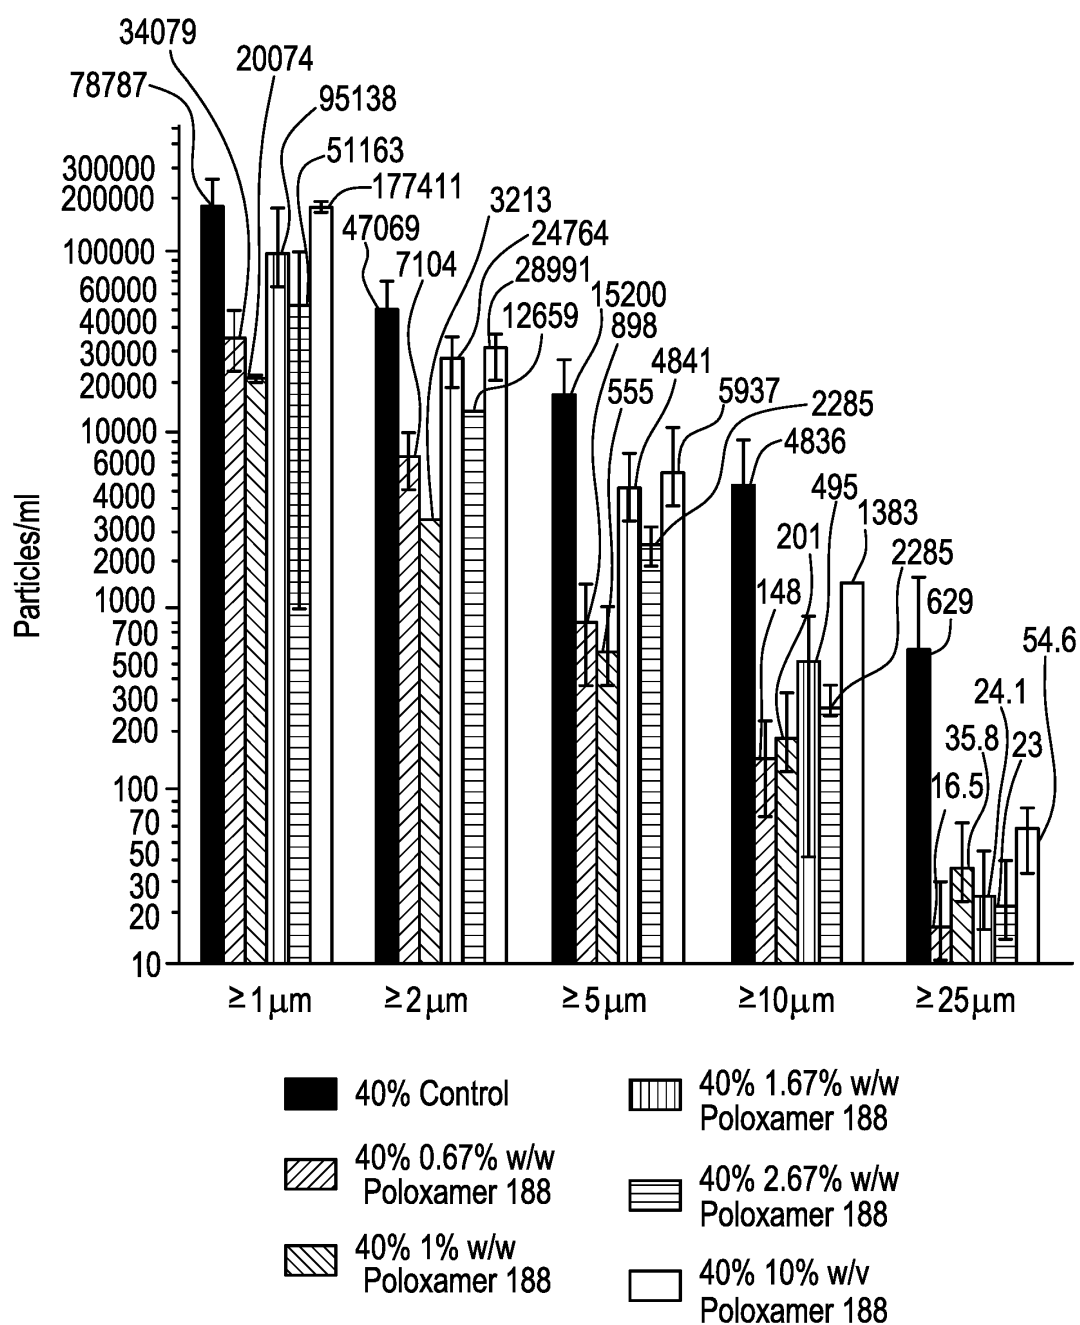
FIG. 16B2.5 mg/ml FAB₁

FIG. 17A





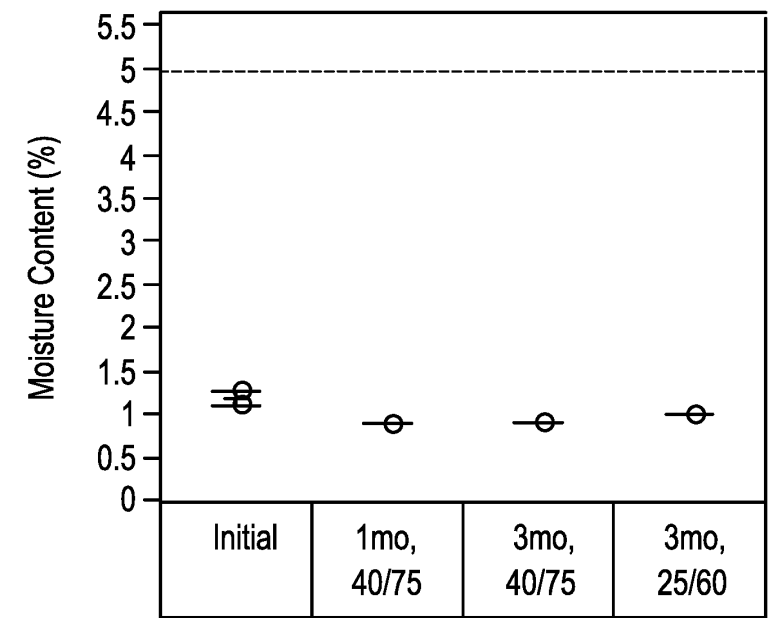


FIG. 17B

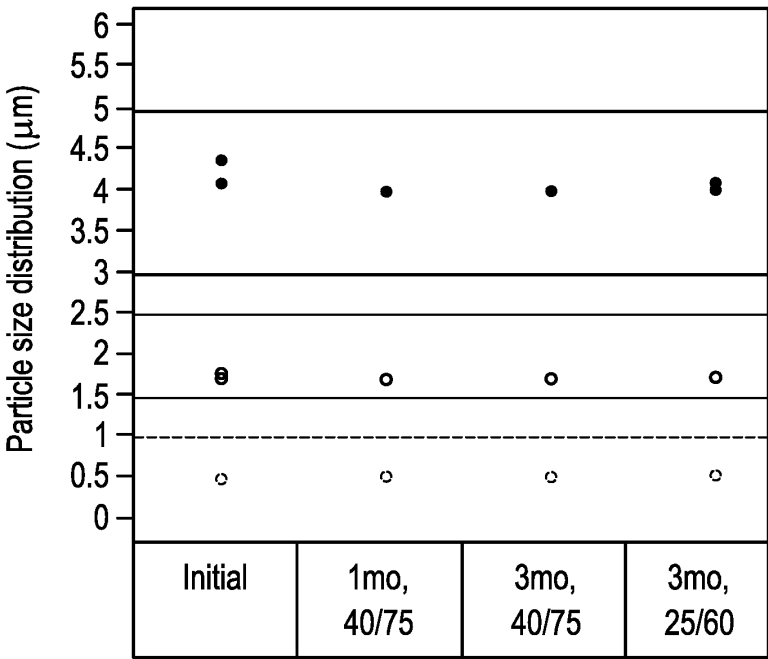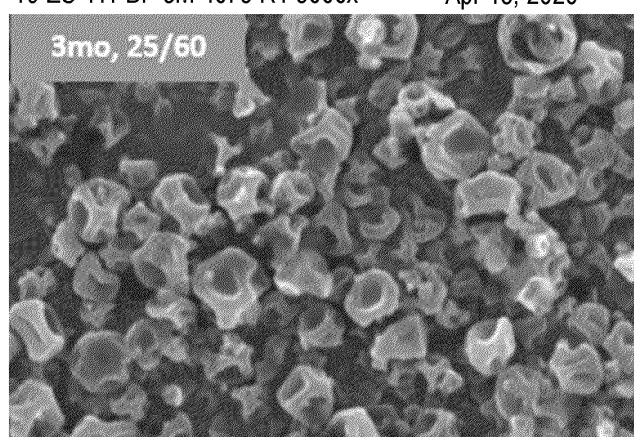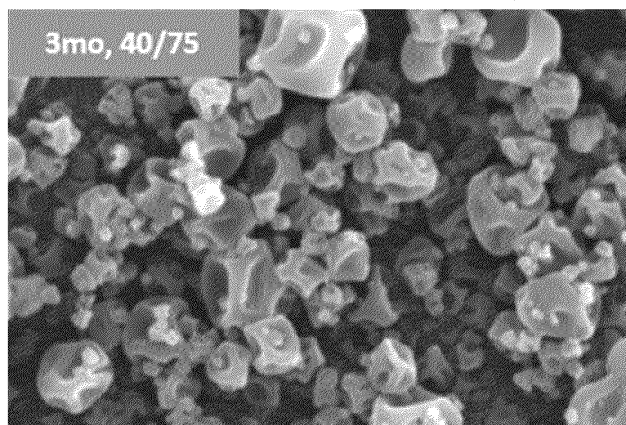

21/25

FIG. 17C

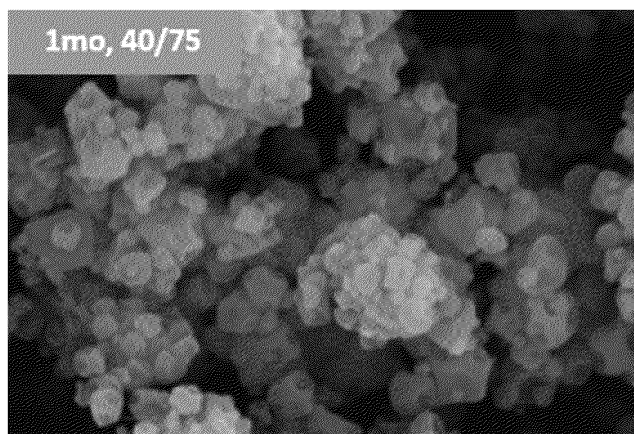

22/25

FIG. 18A



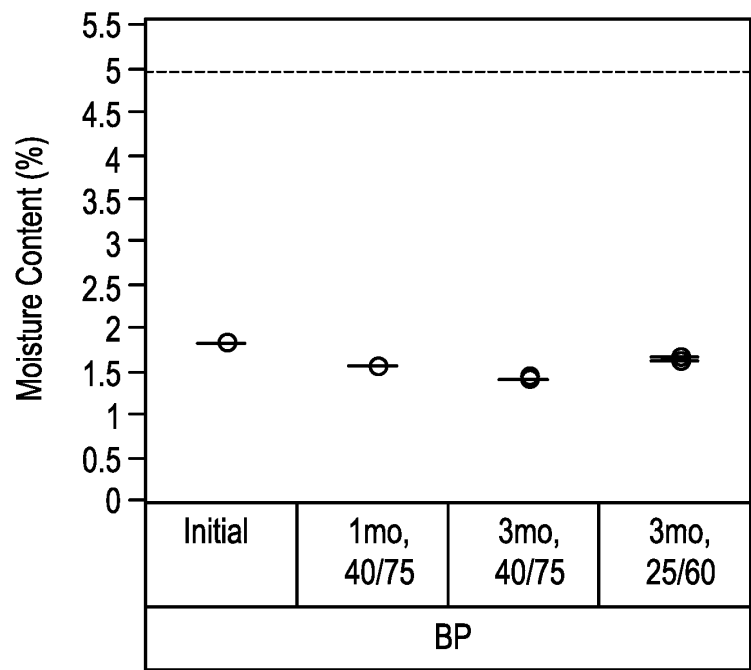


FIG. 18B

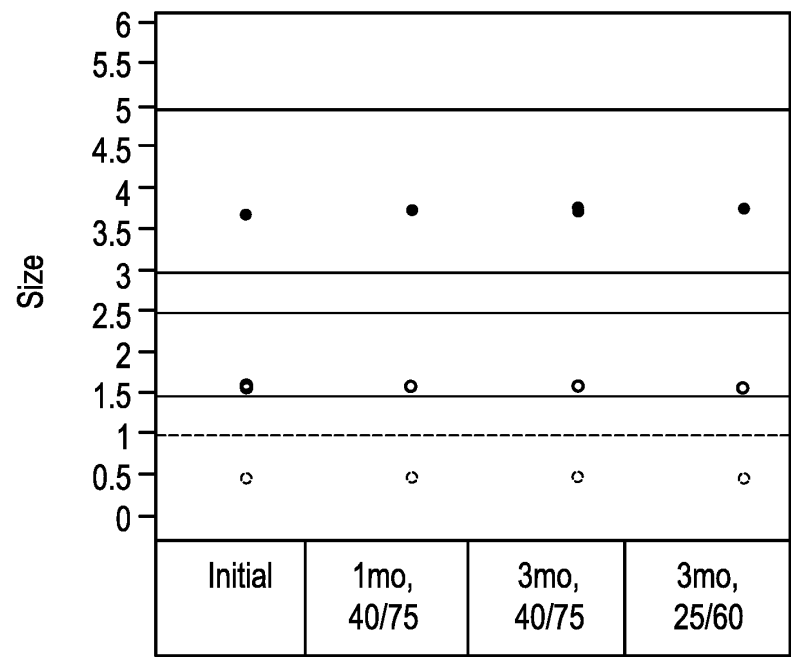


23/25


FIG. 18C

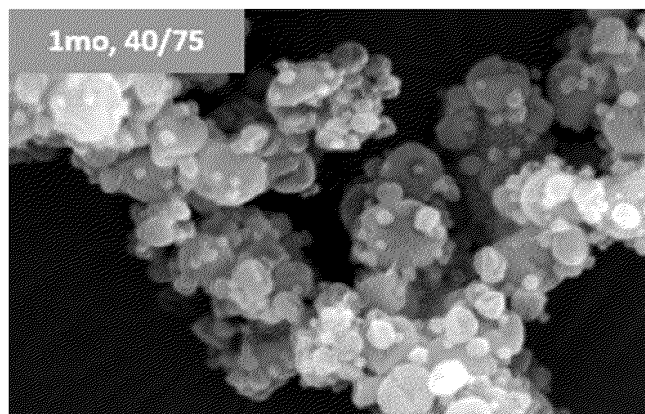

SED 20.0kV WD11mm P.C.50 X5,000 5µm
19-ZS-112 BP 1mo 40,75 R2 5000x Mar 02, 2020

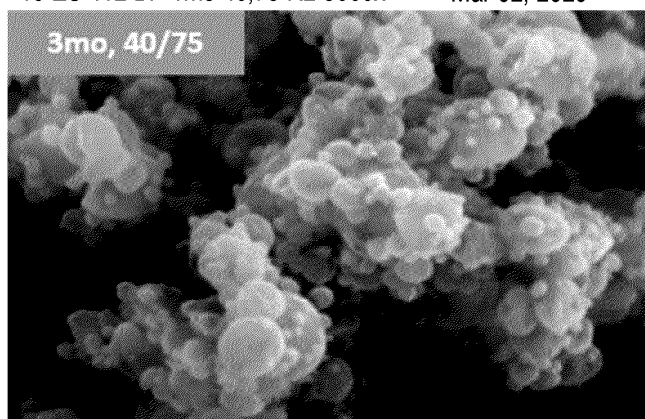

SED 20.0kV WD11mm P.C.50 X5,000 5µm
19-ZS-112BP 40C75RH 3M R2 5000x May 06, 2020

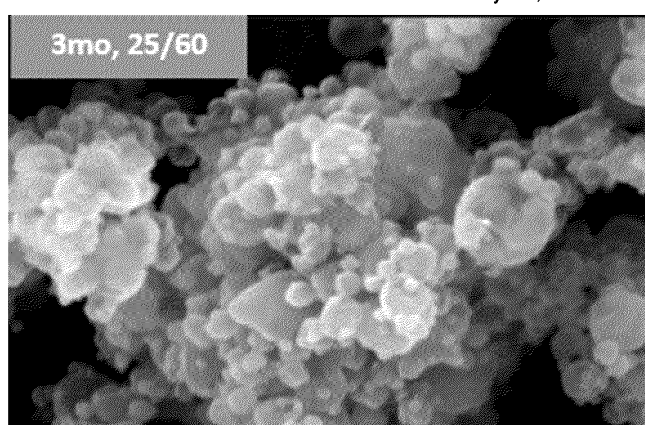

SED 20.0kV WD11mm P.C.50 X5,000 5µm
19-ZS-112BP 25C60RH 3M R1 5000x May 06, 2020

FIG. 19A

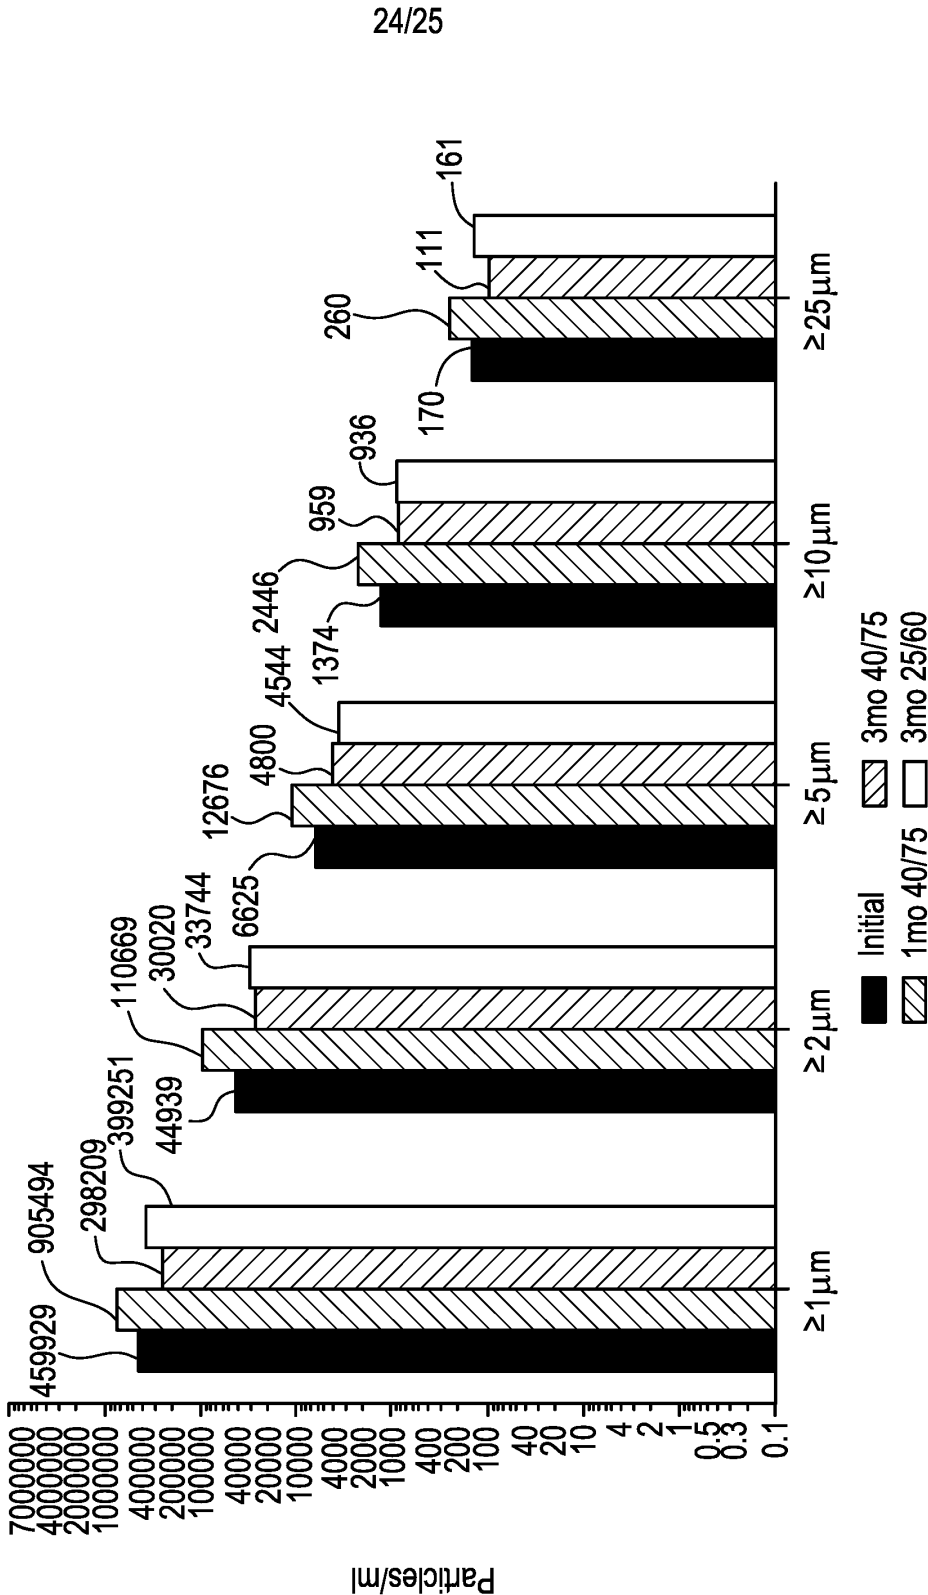


FIG. 19B

