




[図1A]

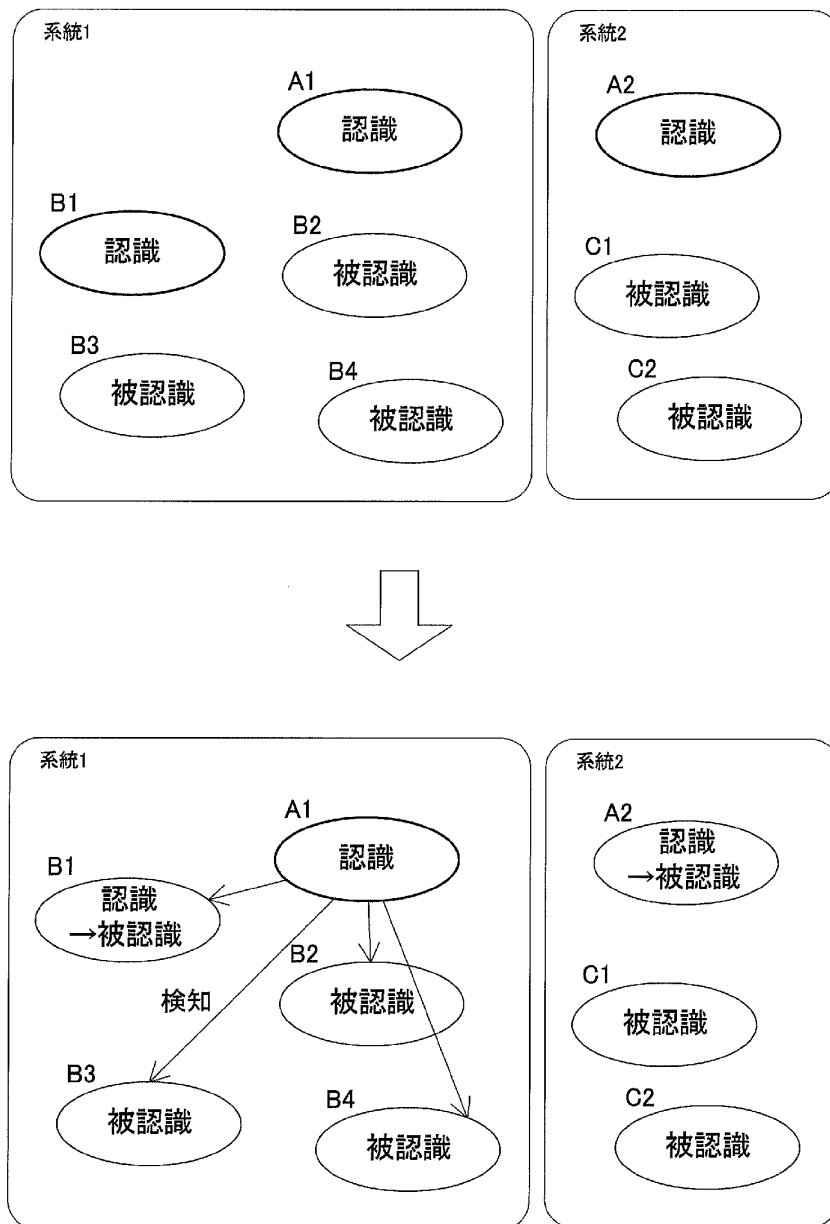


【図1B】

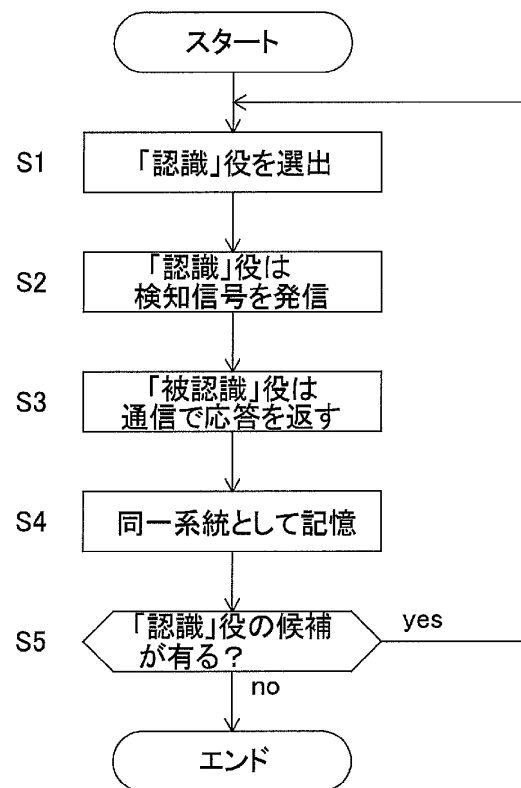


[図2]

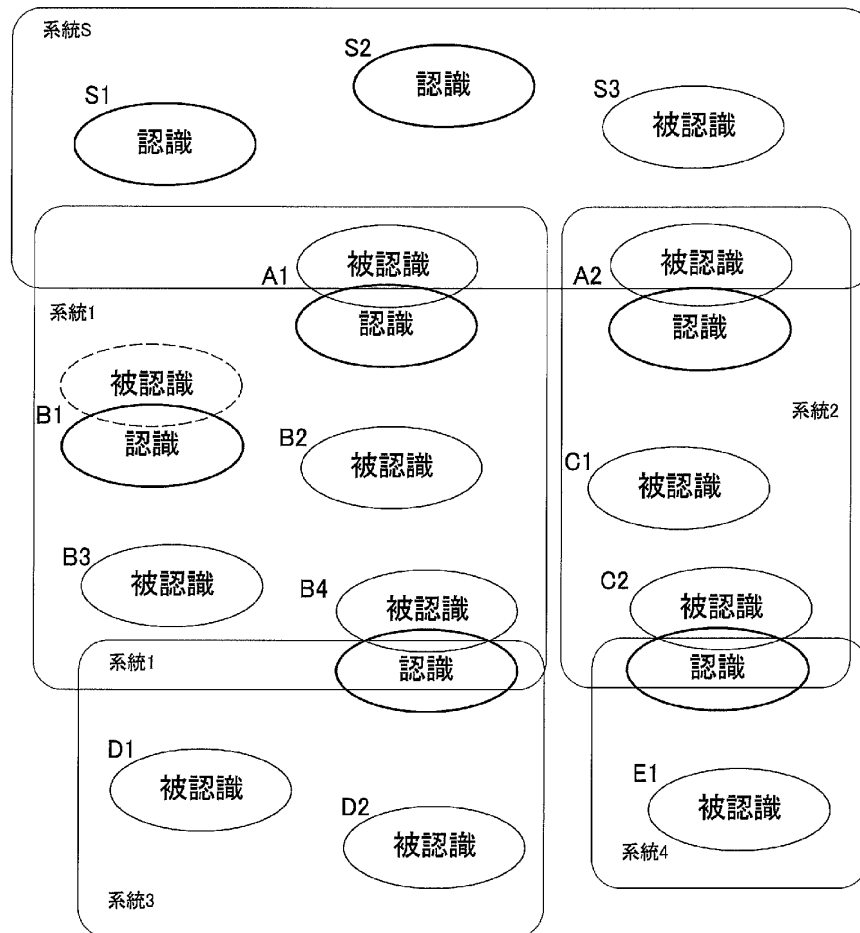

[図3]

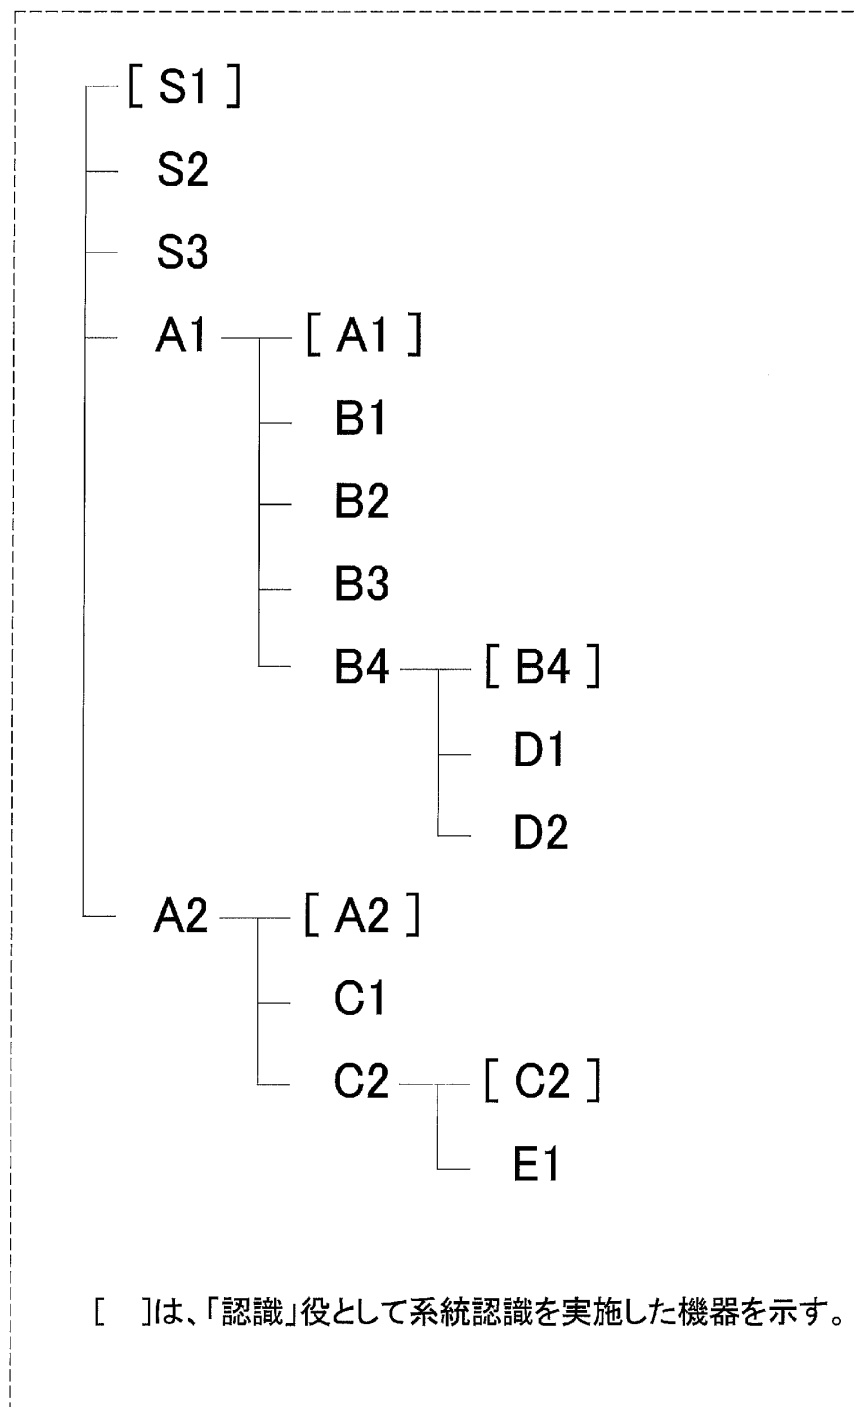

[図4]

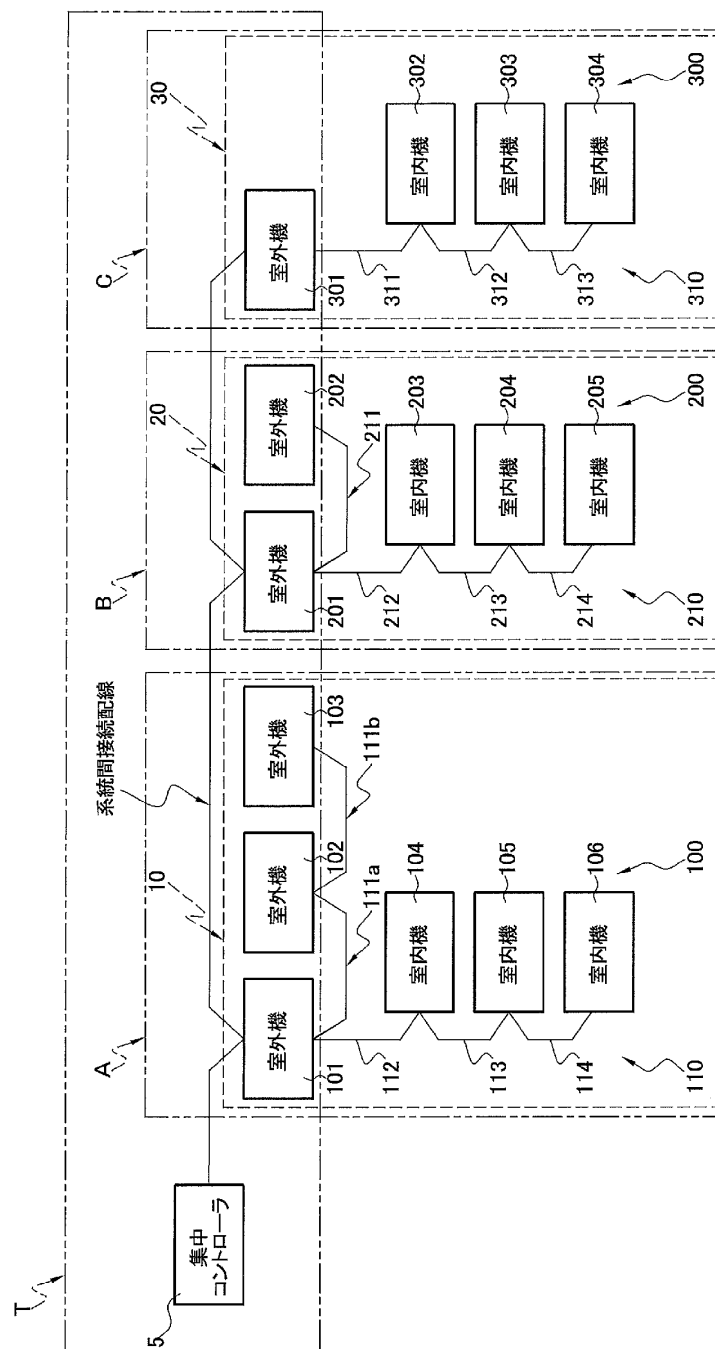

40

系統D

室外機

401

411

室内機

402

412

冷媒回路切替ユニット

403A

413

室内機

404

414

室内機

405

415

室内機

406

系統E

41

冷媒回路切替ユニット

403B

416

室内機

407

417

室内機

408

418


室内機

409


系統F

42


[図7]

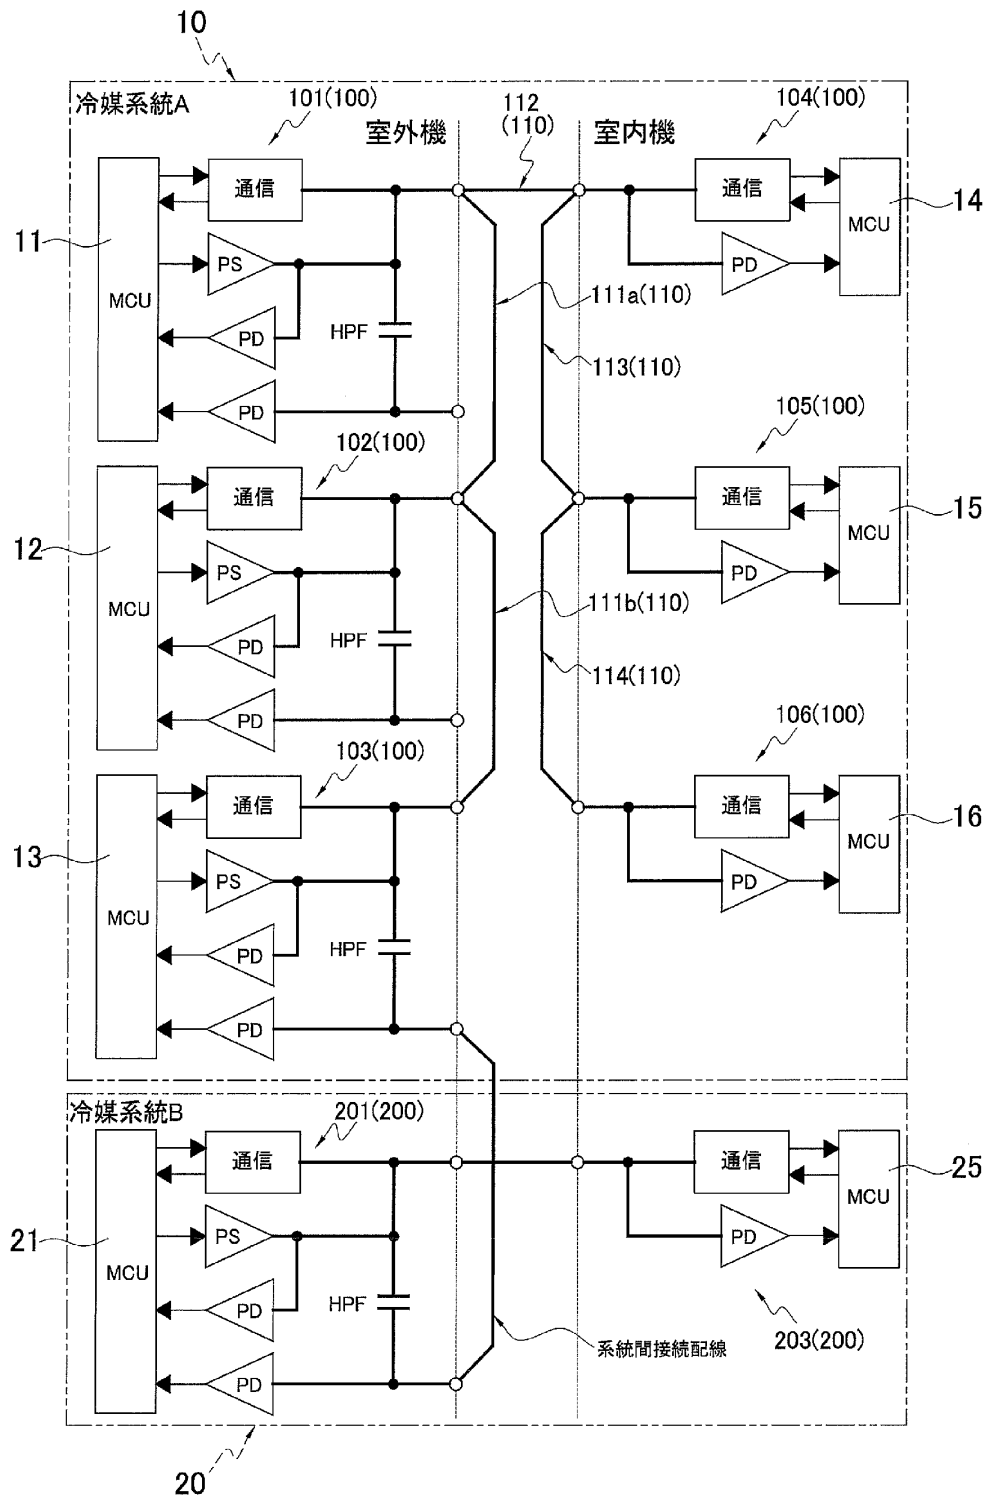


[図8]

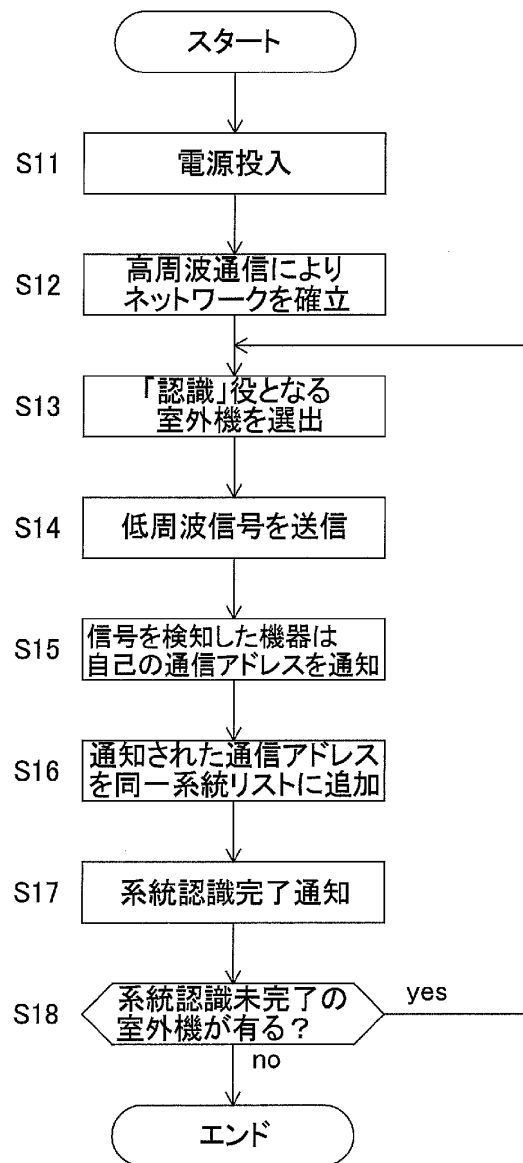

[図9A]

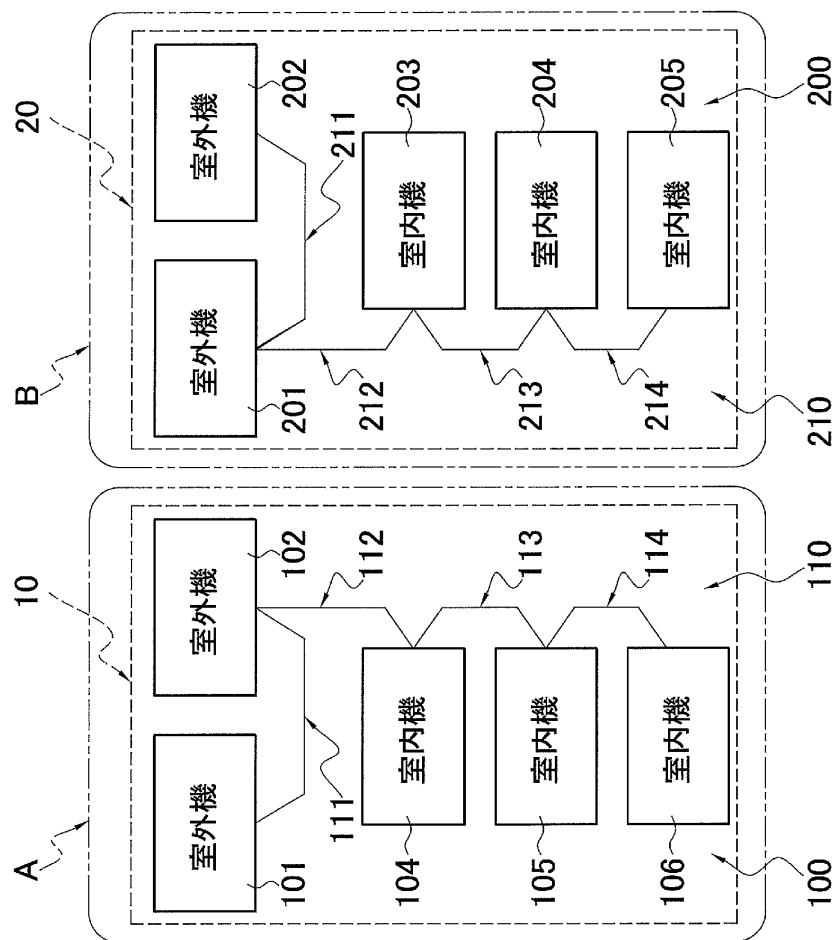

[図9B]

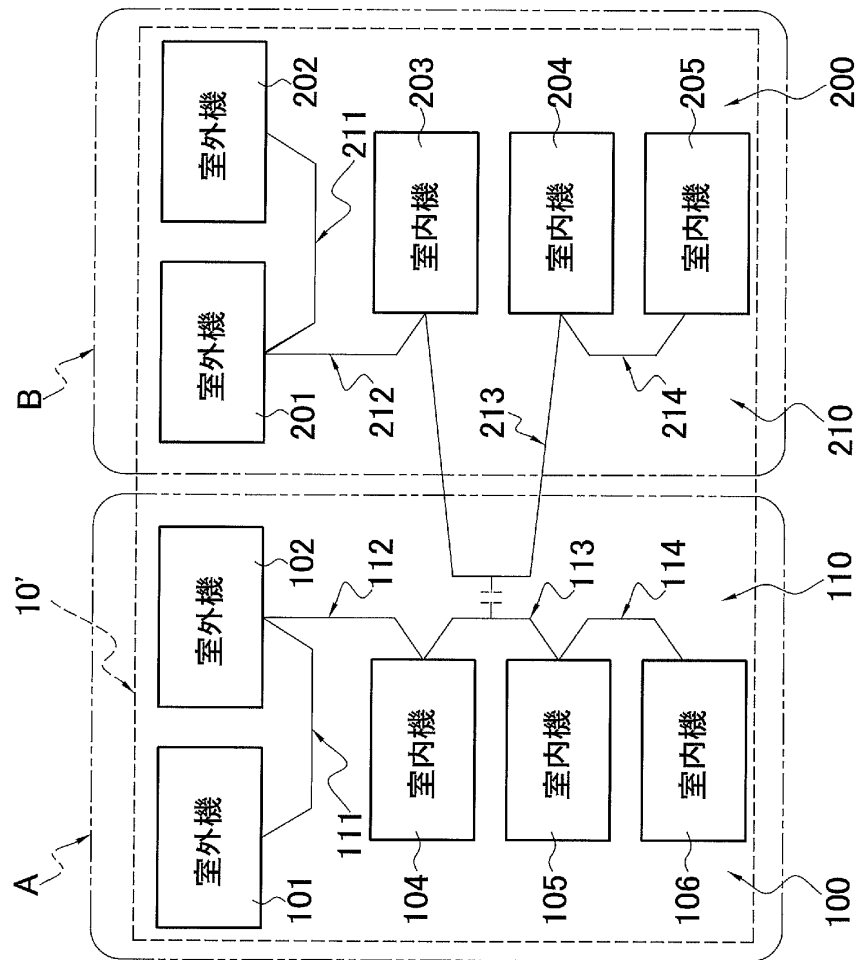

[図9C]

