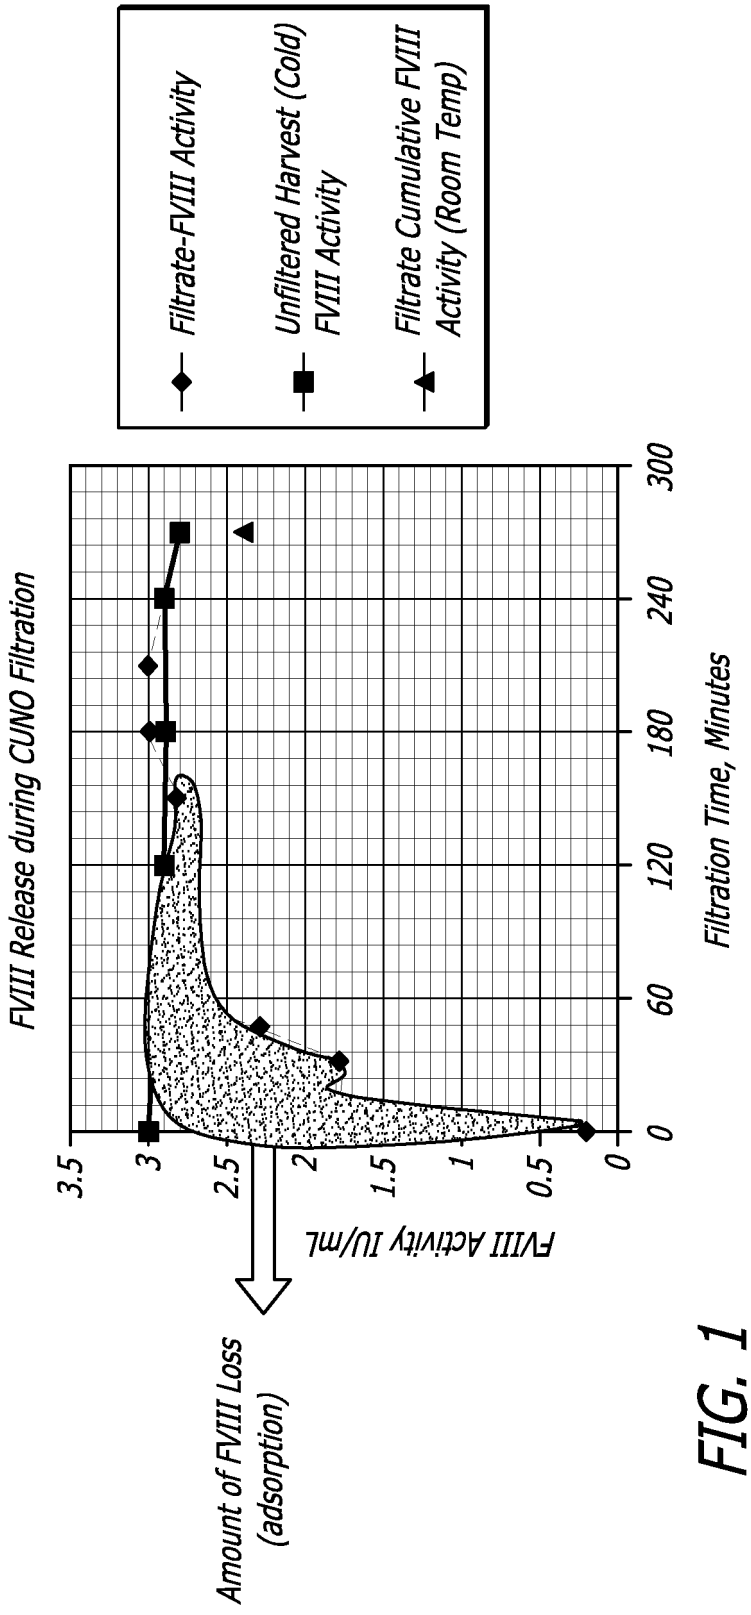

FVIII Release during CUNO Filtration
Filtrate-FVIII Activity
Unfiltered Harvest (Cold) FVIII Activity
Filtrate Cumulative FVIII Activity (Room Temp)
FVIII Activity IU/mL
Filtration Time, Minutes
Amount of FVIII Loss (adsorption)
0
0.5
1
1.5
2
2.5
3
3.5
0
60
120
180
240
300

FIG. 1

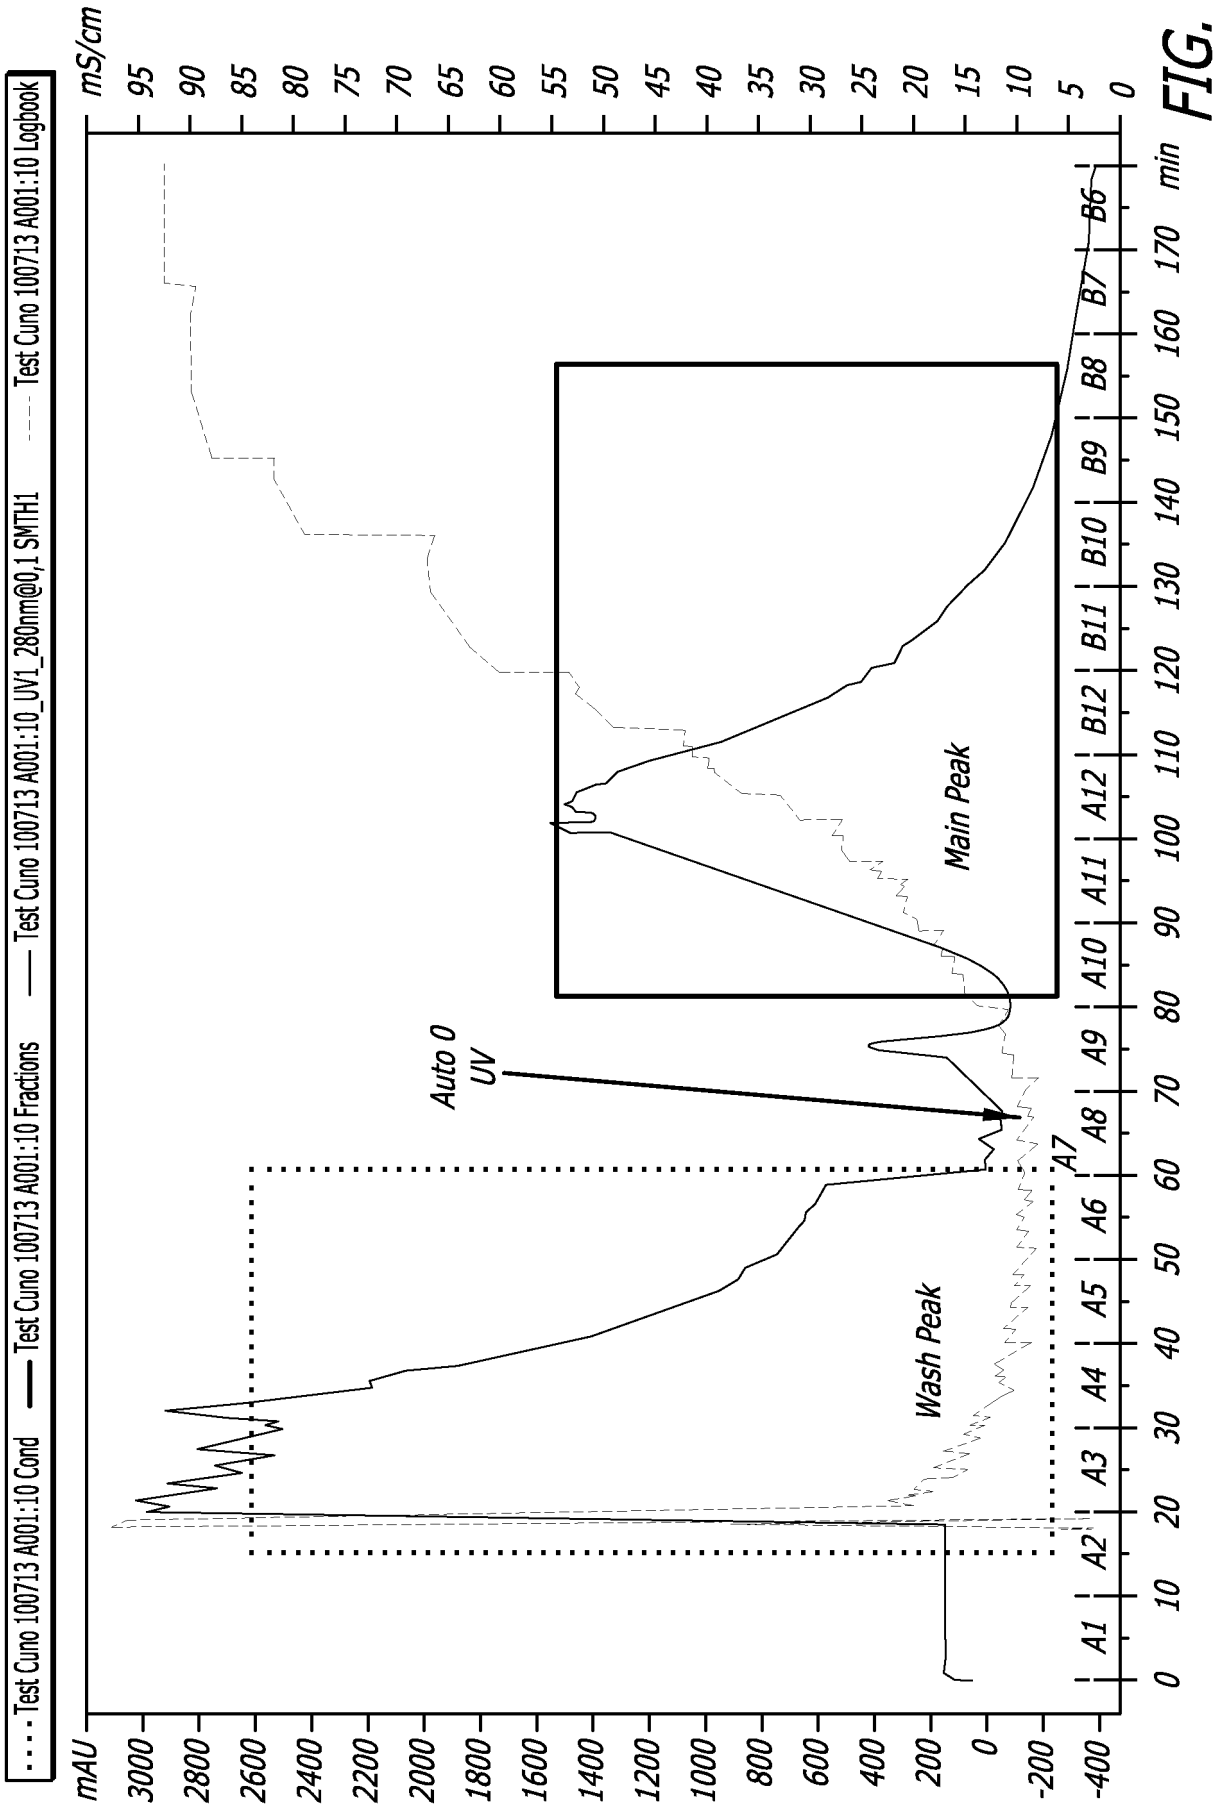

Test Cuno 100713 A001:10 Cond
Test Cuno 100713 A001:10 Fractions
Test Cuno 100713 A001:10_UV1_280nm@0,1 SMTH1
Test Cuno 100713 A001:10 Logbook
mAU
mS/cm
min
Auto 0
UV
Wash Peak
Main Peak
A1
A2
A3
A4
A5
A6
A7
A8
A9
A10
A11
A12
B1
B2
B3
B4
B5
B6
B7
B8
B9
B10
B11
B12

FIG. 2