

FIG. 1

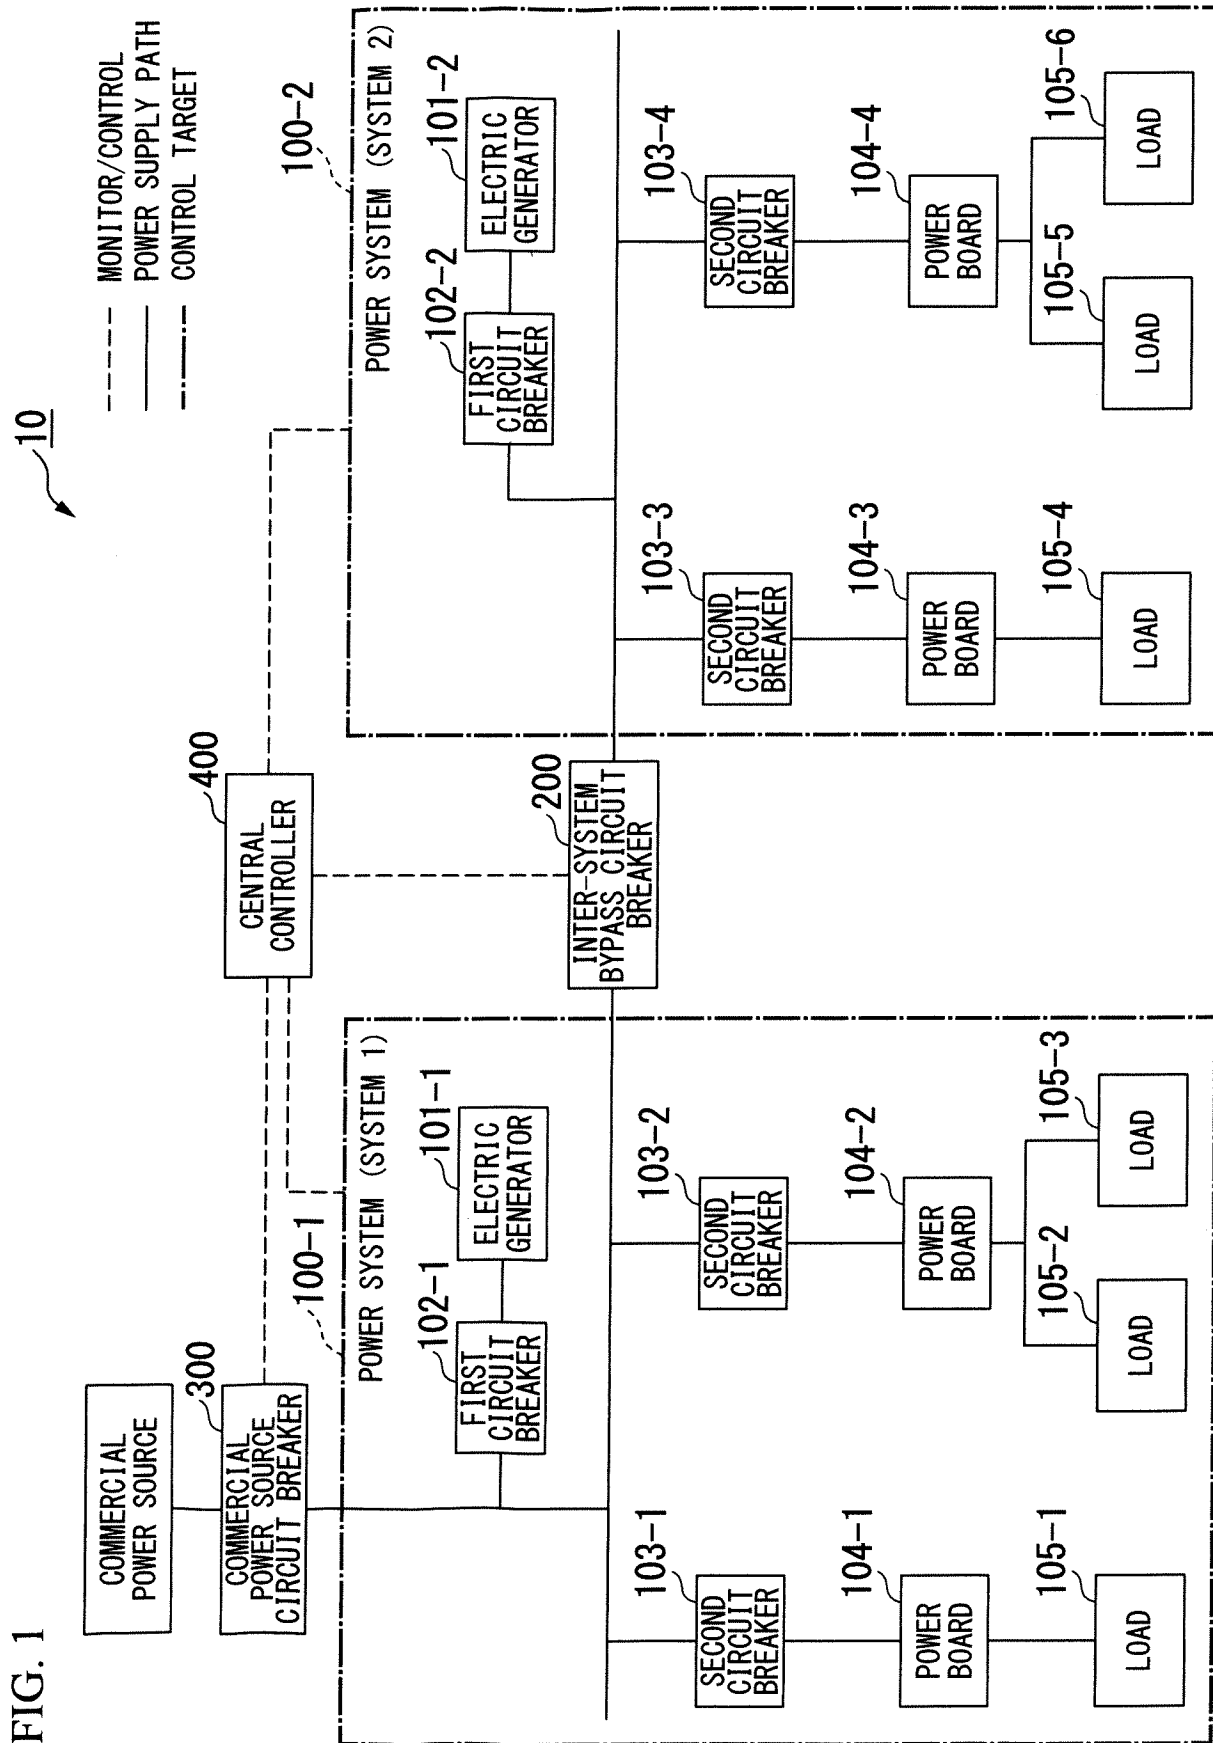


FIG. 2

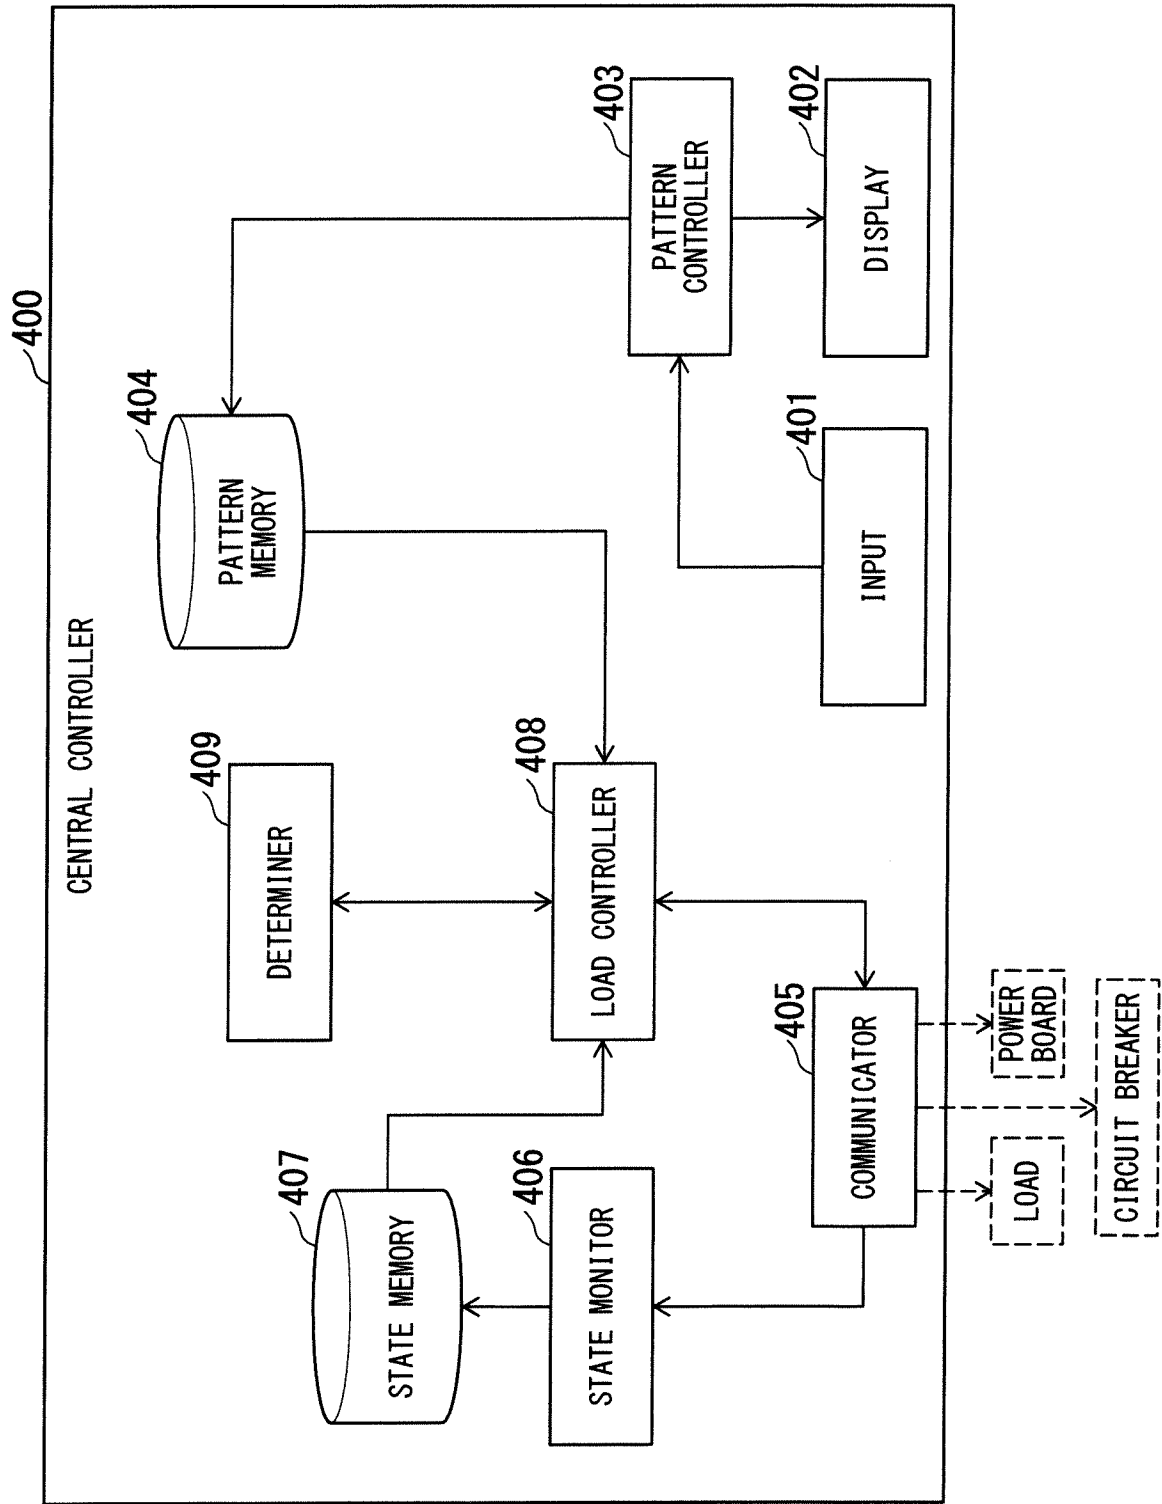


FIG. 3

41

NUMBER	PRIORITY	CONTROL TARGET	CAPACITY[kW]	EXCLUDED	TOTAL CAPACITY[kW]
NUMBER	PRIORITY	CONTROL TARGET	CAPACITY[kW]	EXCLUDED	TOTAL CAPACITY[kW]
42-1	1	TURN ON LIGHT OF 1st FLOOR A	20		42
42-2	1	TURN ON LIGHT OF 1st FLOOR B	22		42
42-3	2	TURN ON AIR CONDITIONER OF 1st FLOOR A	60		60
42-4	2	TURN ON AIR CONDITIONER OF 1st FLOOR B	55	EXCLUDED	60
42-5	3	SET TEMPERATURE OF AIR CONDITIONER OF 1st FLOOR A	0		0
⋮	⋮	⋮	⋮	⋮	⋮

FIG. 4

71

LOAD ID	LOAD STATE VALUE
72-1001	ON
72-1002	OFF
72-1003	OFF
72-1004	ON, COOLING, STRONG
72-1005	OFF
⋮	⋮

FIG. 5

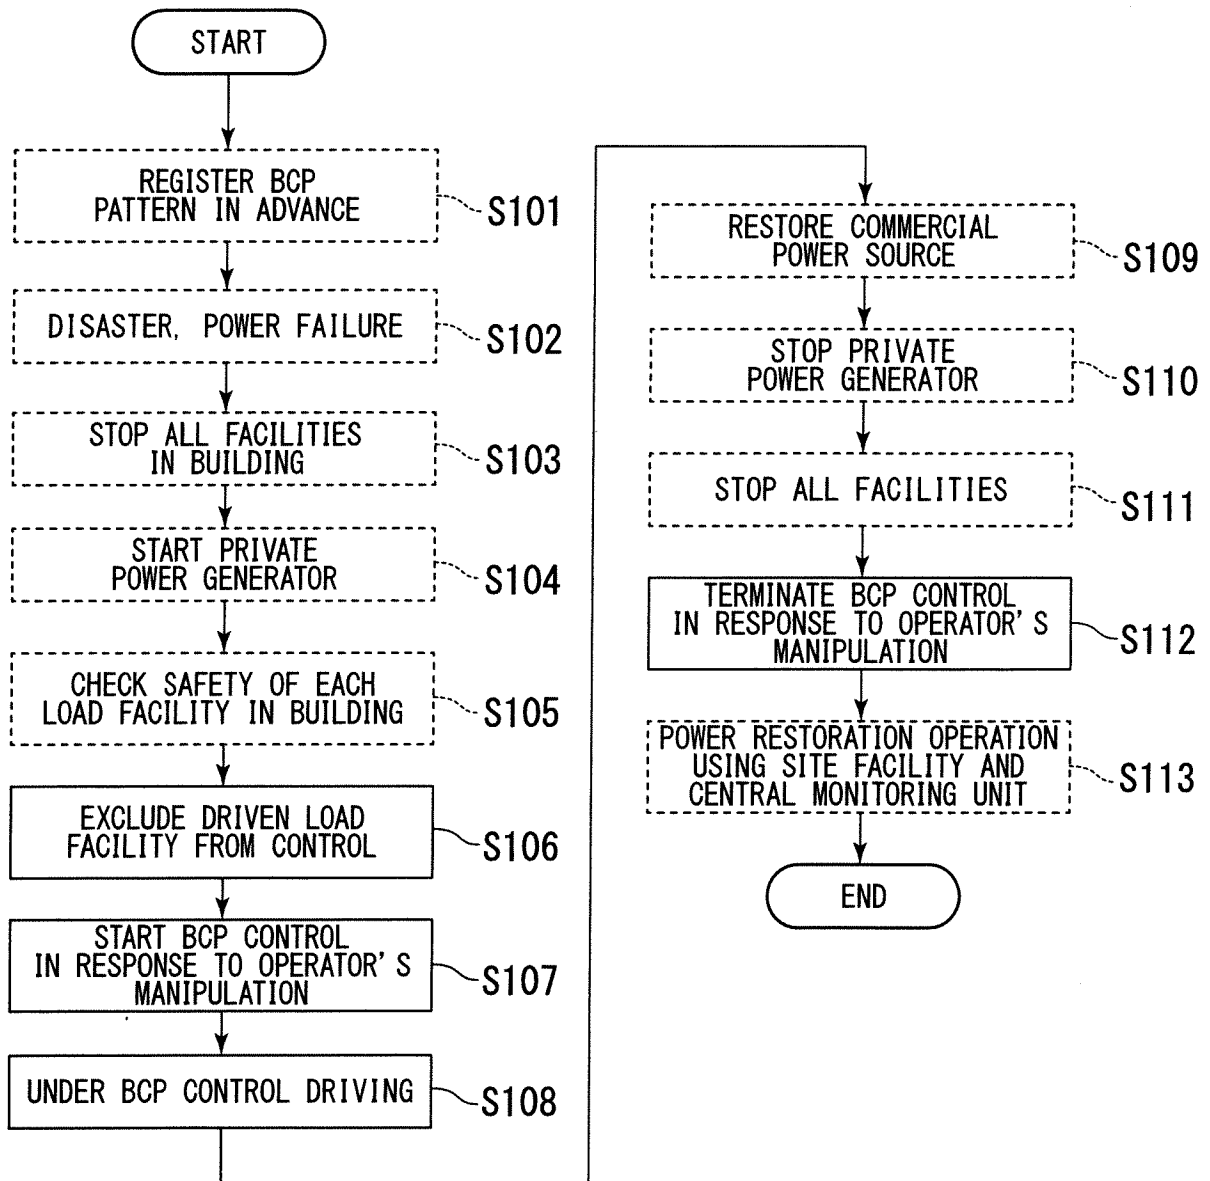


FIG. 6

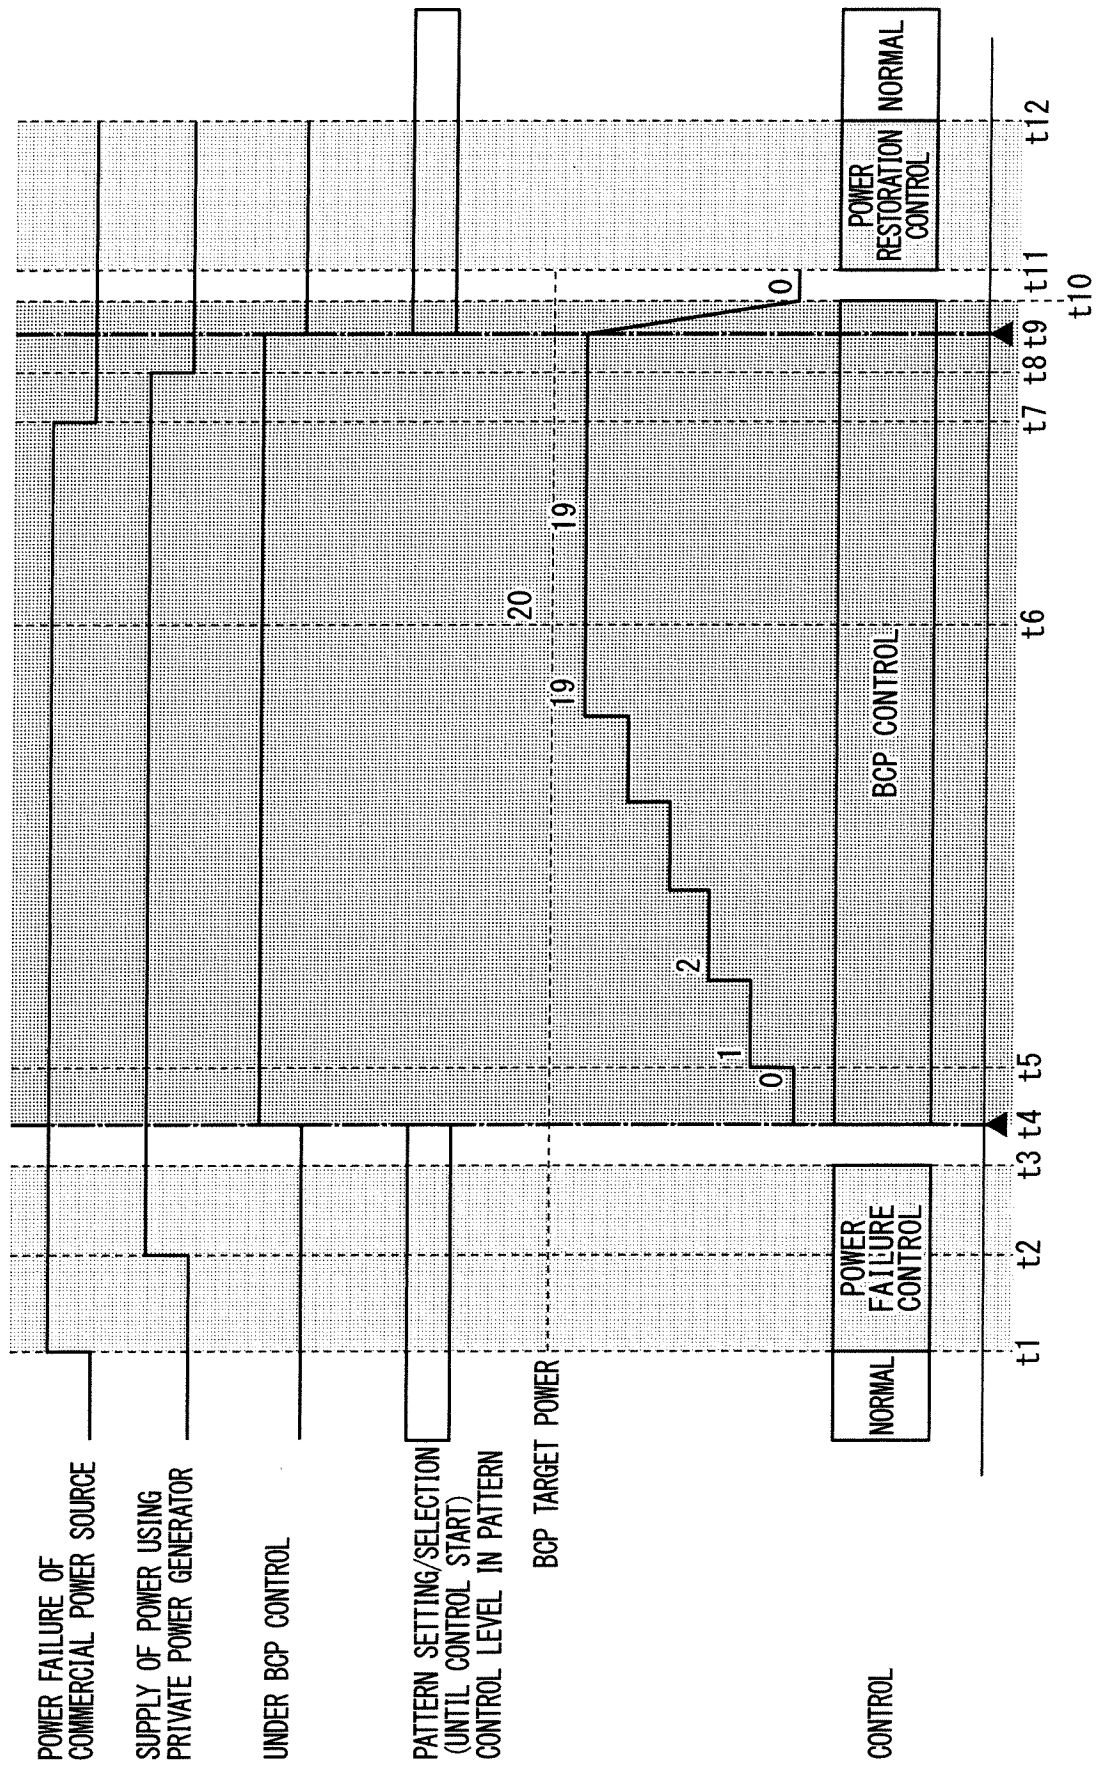


FIG. 7

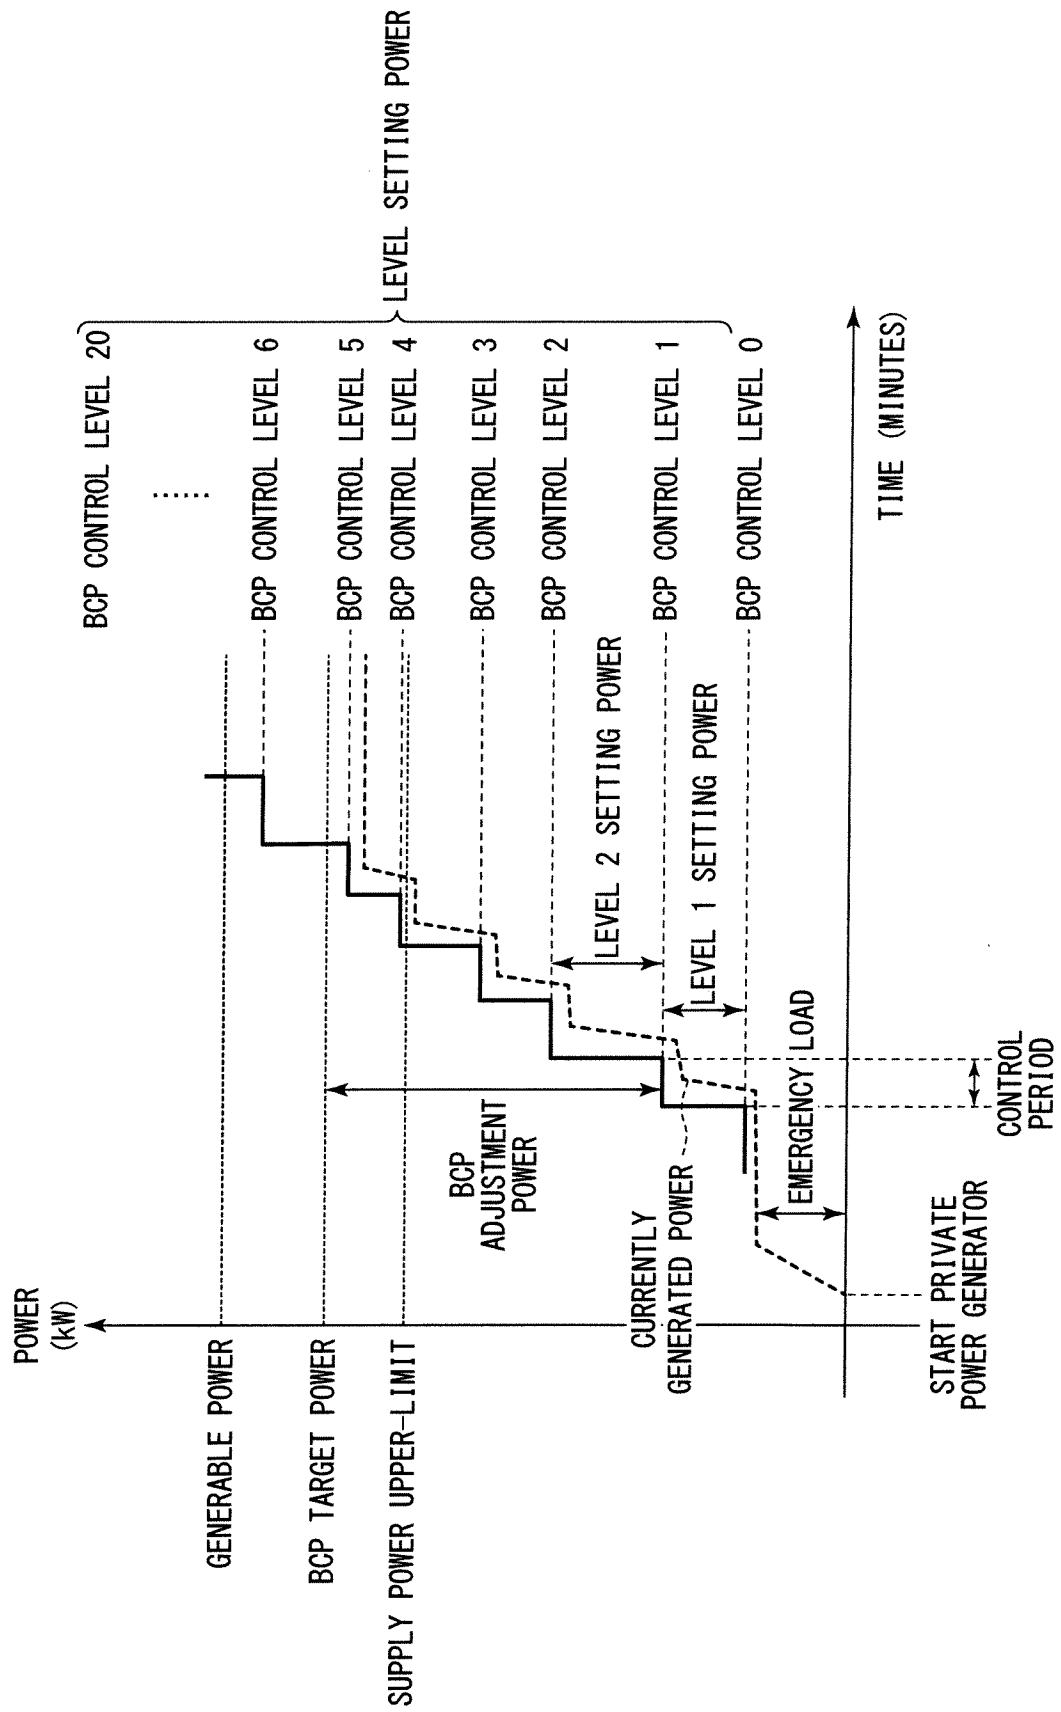


FIG. 8

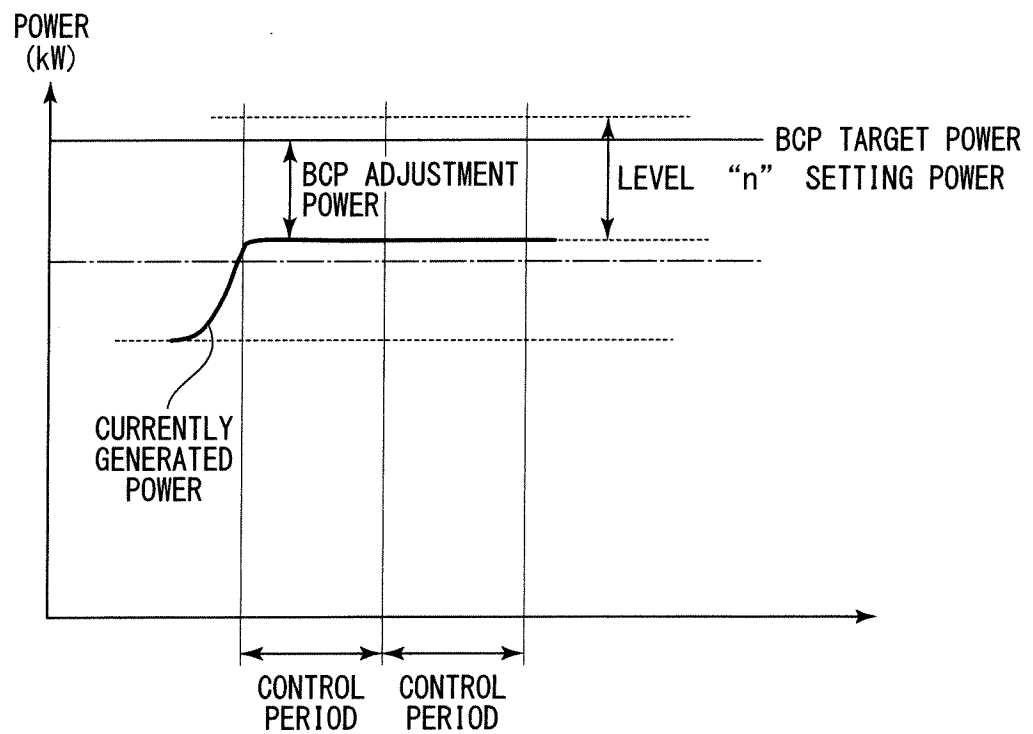


FIG. 9

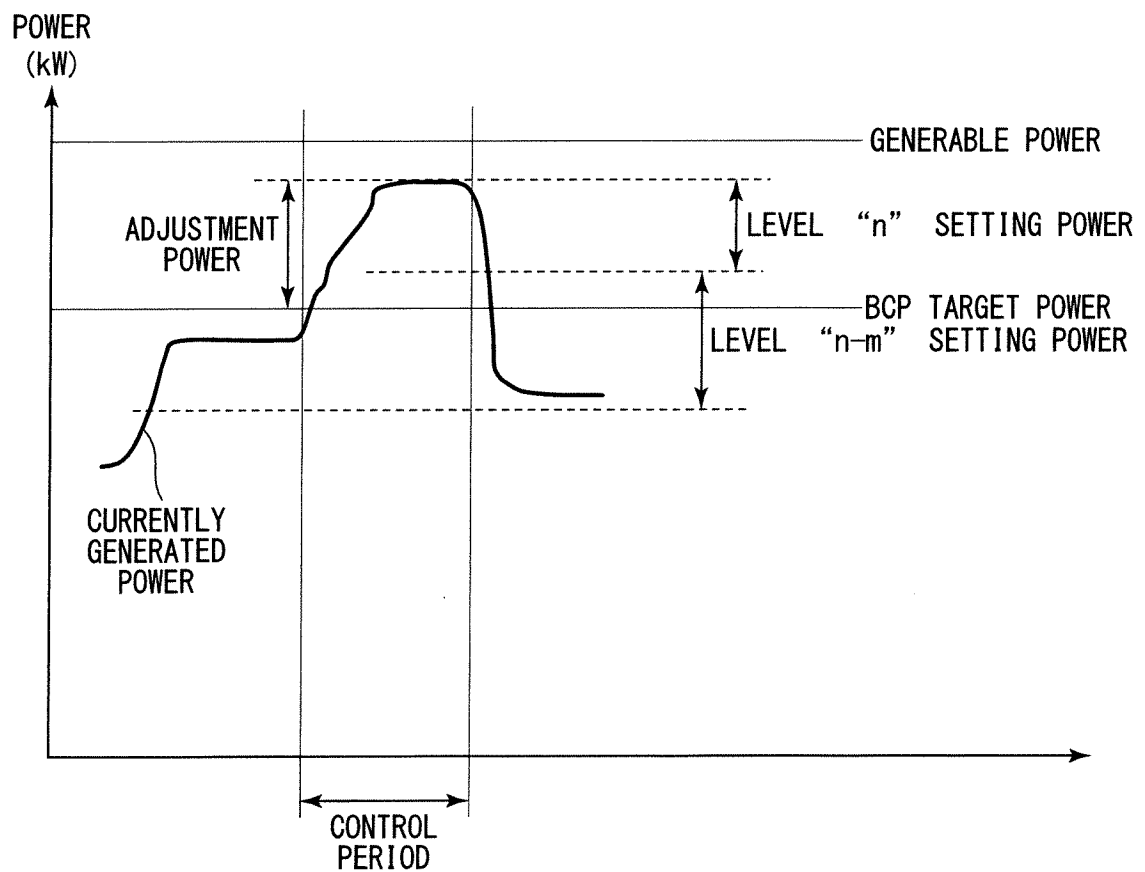


FIG. 10

BCP CONTROL

511 CONTROL MODE NORMAL (TIME-FIXED MODE)

504 SET CONTROL

505 SELECT PATTERN

506 SET PATTERN

507 SET CONTROL CONDITION

508 SET GENERATOR

509 CSV SAVE

510 PRINT

502

503

SYSTEM 1 CONTROL LEVEL 2

SYSTEM 2 CONTROL LEVEL 2

LEVEL SETTING POWER

PATTERN 1 FACILITIES OF B1F TO 2F

1	35.80
2	50.80
3	65.80
4	100.80
5	125.80
6	175.80
7	235.80
8	290.80
9	340.80
10	440.40

PATTERN 2 FACILITIES OF 11F TO 12F

1	35.80
2	55.00
3	65.00
4	75.00
5	85.80
6	100.00
7	100.00
8	100.00
9	100.00
10	100.00
11	100.00
12	100.00
13	100.00
14	100.00
15	100.00
16	100.00
17	100.00
18	100.00
19	100.00
20	100.00

SYSTEM 1 SYSTEM 2

FULFILLMENT OF BCP CONTROL CONDITION

UNDER BCP CONTROL

GENERABLE POWER(kw)

BCP TARGET POWER(kw)

SUPPLY POWER UPPER-LIMIT(kw)

CURRENTLY GENERATED POWER(kw)

BCP ADJUSTMENT POWER(kw)

BCP TRANSITION REQUEST

HEATER	TRANSITION REQUEST FAILURE
AIR CONDITIONER /OUTDOOR UNIT	TRANSITION REQUEST COMPLETED
LIGHTS	TRANSITION REQUEST COMPLETED

2200.00

900.00

756.50

365.00

605.20

0.00

410.00

0.00

346.50

365.00

FIG. 11

PATTERN SETTING

SETTING IS NOT ALLOWED DURING START OF CONTROL

SELECT PATTERN FACILITIES OF B1F TO 2F

TOTAL LOAD CAPACITY OF PATTERN 897.4kW

No.	LEVEL	NAME OF LOAD	STATUS	SETTING VALUE	SETTING CAPACITY [kW]	EXCLUDED	CHANGE STATUS	TOTAL [kW]
1	1	ACP-1-A-a_TEMPERATURE SETTING		☐	0.0			35.8
2	1	ACP-1-B-a_TEMPERATURE SETTING		☐	0.0			35.8
3	1	ACP-1-A-a_LIGHT ON	☐		20.0			35.8
4	1	ACP-1-B-a_LIGHT ON	☐		22.0	EXCLUDED		35.8
5	1	ACP-MDF-A-a_LIGHT ON	☐		15.8			35.8
6	1	ACP-1-A-a_ILLUMINANCE SETTING		☐	0.0		SKIP	35.8
7	2	ACP-1-B-c_LIGHT ON	☐		15.0			15.0
8	3	ACP-1-C-a_LIGHT ON	☐		15.0			15.0
9	4	ACP-1-C-d_LIGHT ON	☐		35.0			35.0
10	5	ACP-1-C-e_LIGHT ON	☐		25.0			25.0
11	6	ACP-1-A-b_LIGHT ON	☐		50.0			50.0
12	7	ACP-1-Ad-a_LIGHT ON	☐		60.0			60.0
13	8	ACP-1-Ad-b_LIGHT ON	☐		55.0			55.0
14	9	ACP-1-B-b_LIGHT ON	☐		50.0			50.0
15	10	ACP-1-B-d_LIGHT ON	☐		99.6			99.6

NEW REGISTRATION CHANGE DELETE CANCEL

FIG. 12

PATTERN SELECTION

SYSTEM 1	1
SYSTEM 2	2

701

702 SET 703 CANCEL