

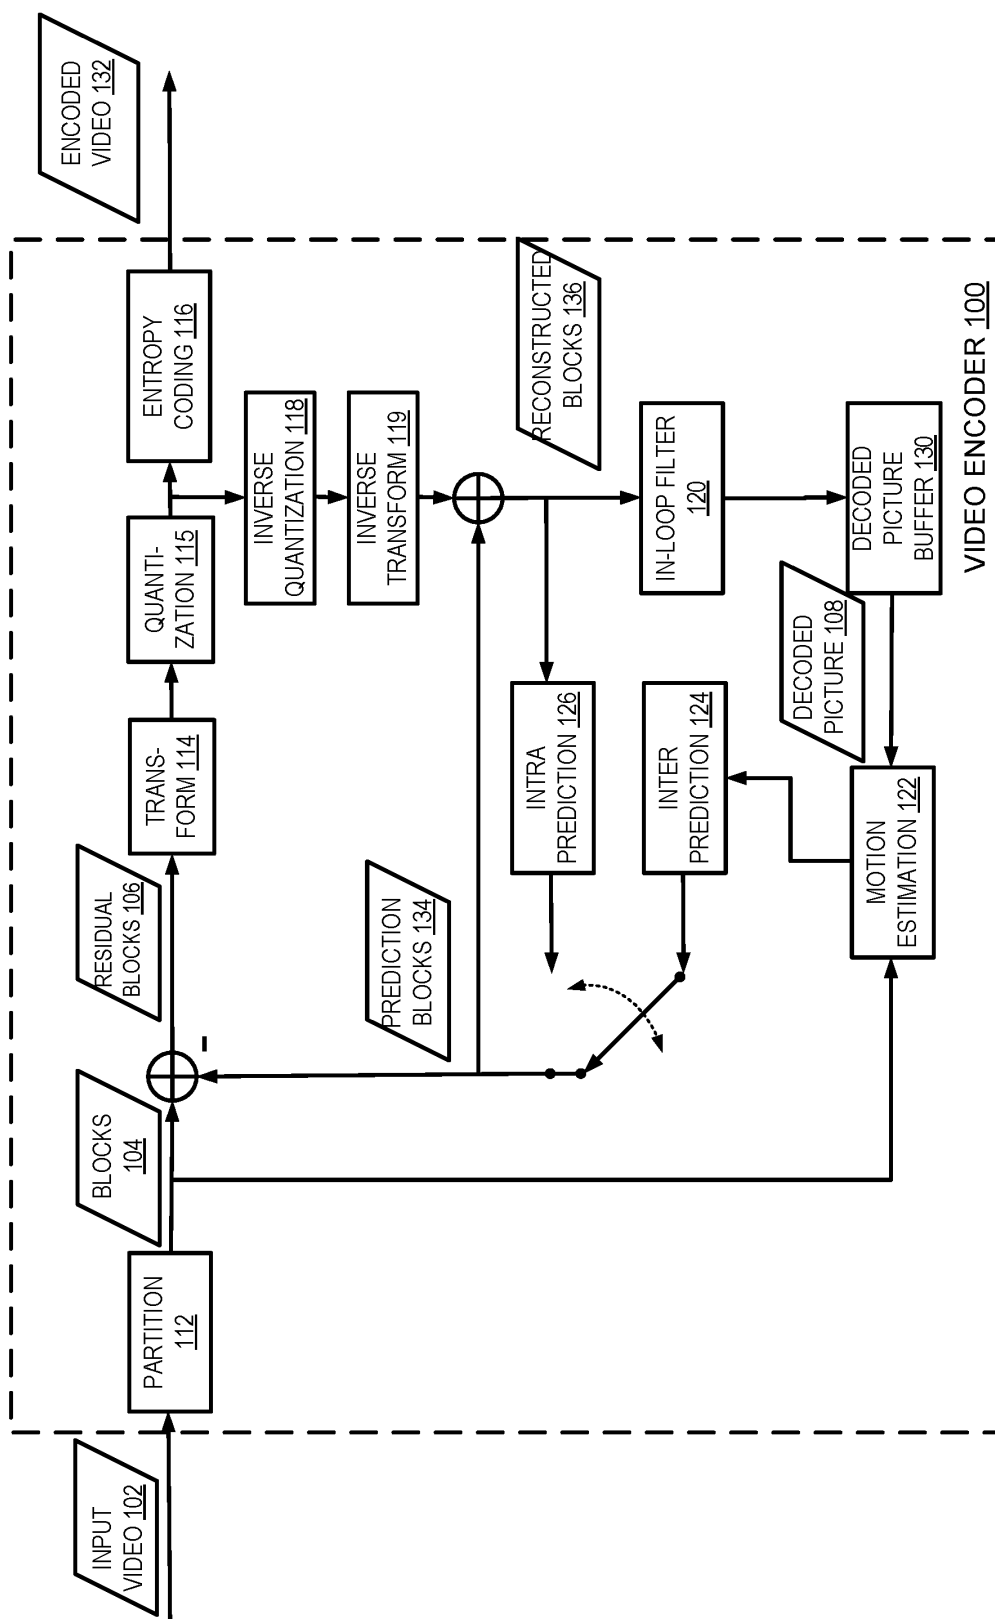


FIG. 1

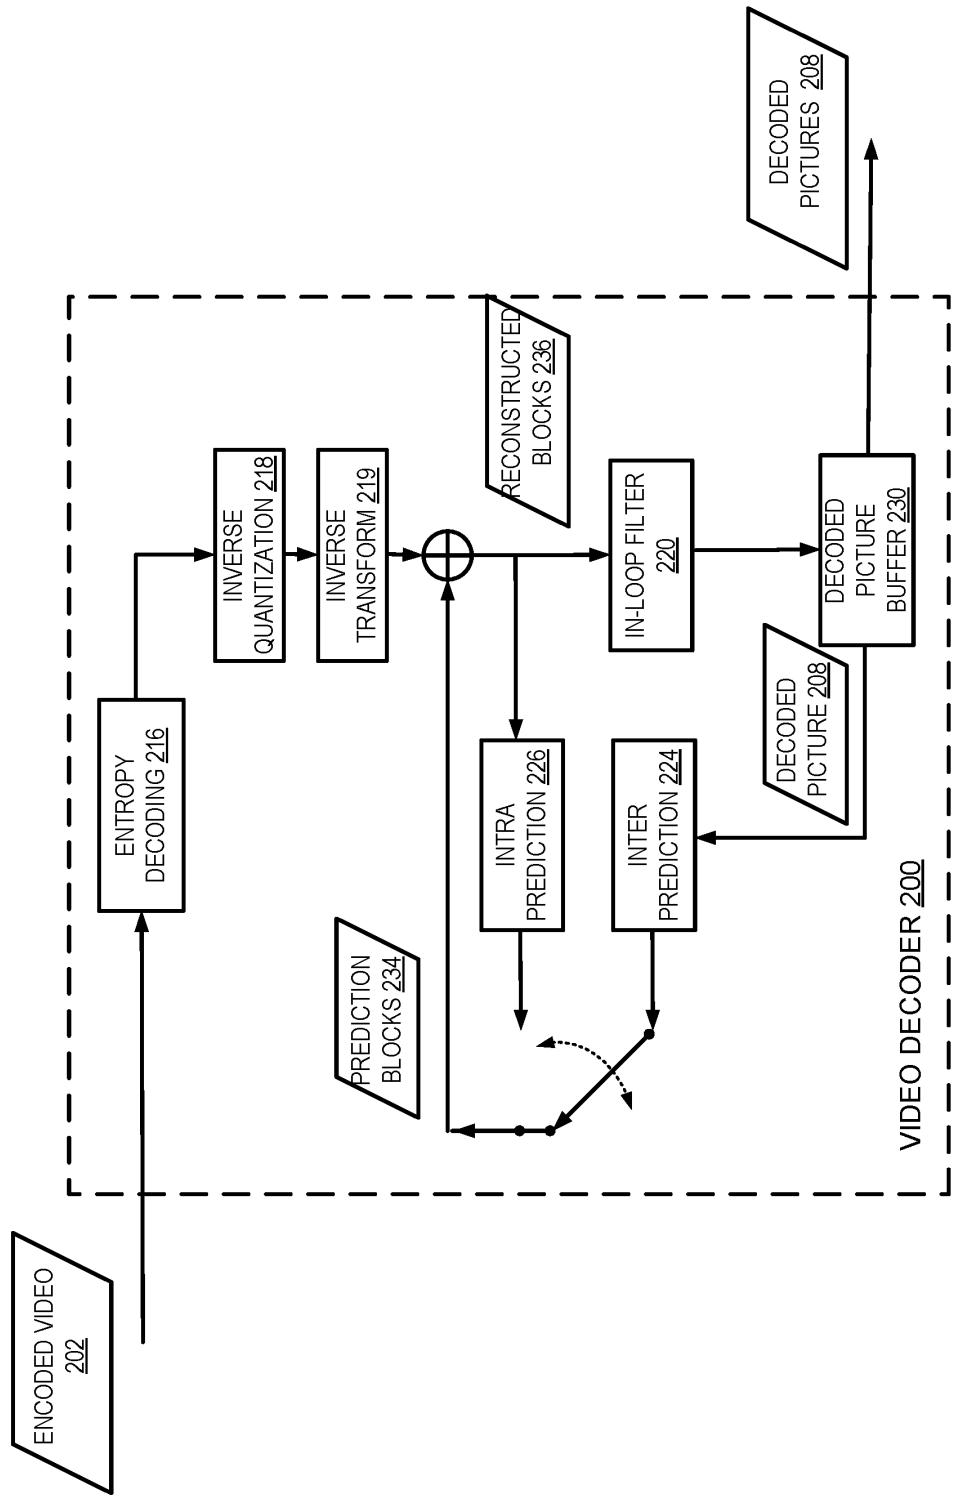


FIG. 2

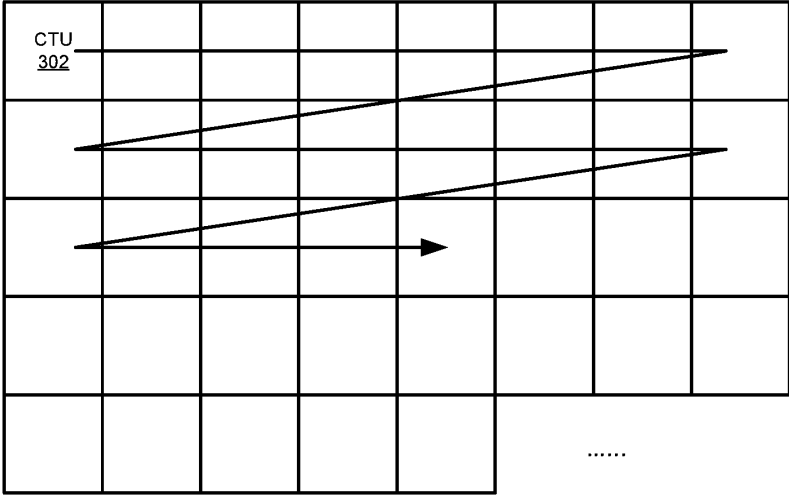


FIG. 3

<u>CU 402</u>	<u>CU 402</u>	<u>CU 402</u>	<u>CU 402</u>
			<u>CU 402</u>
			<u>CU 402</u>
<u>CU 402</u>	<u>CU 402</u> <u>CU 402</u>	<u>CU 402</u>	<u>CU 402</u>
<u>CU 402</u>			
<u>CU 402</u>			

FIG. 4

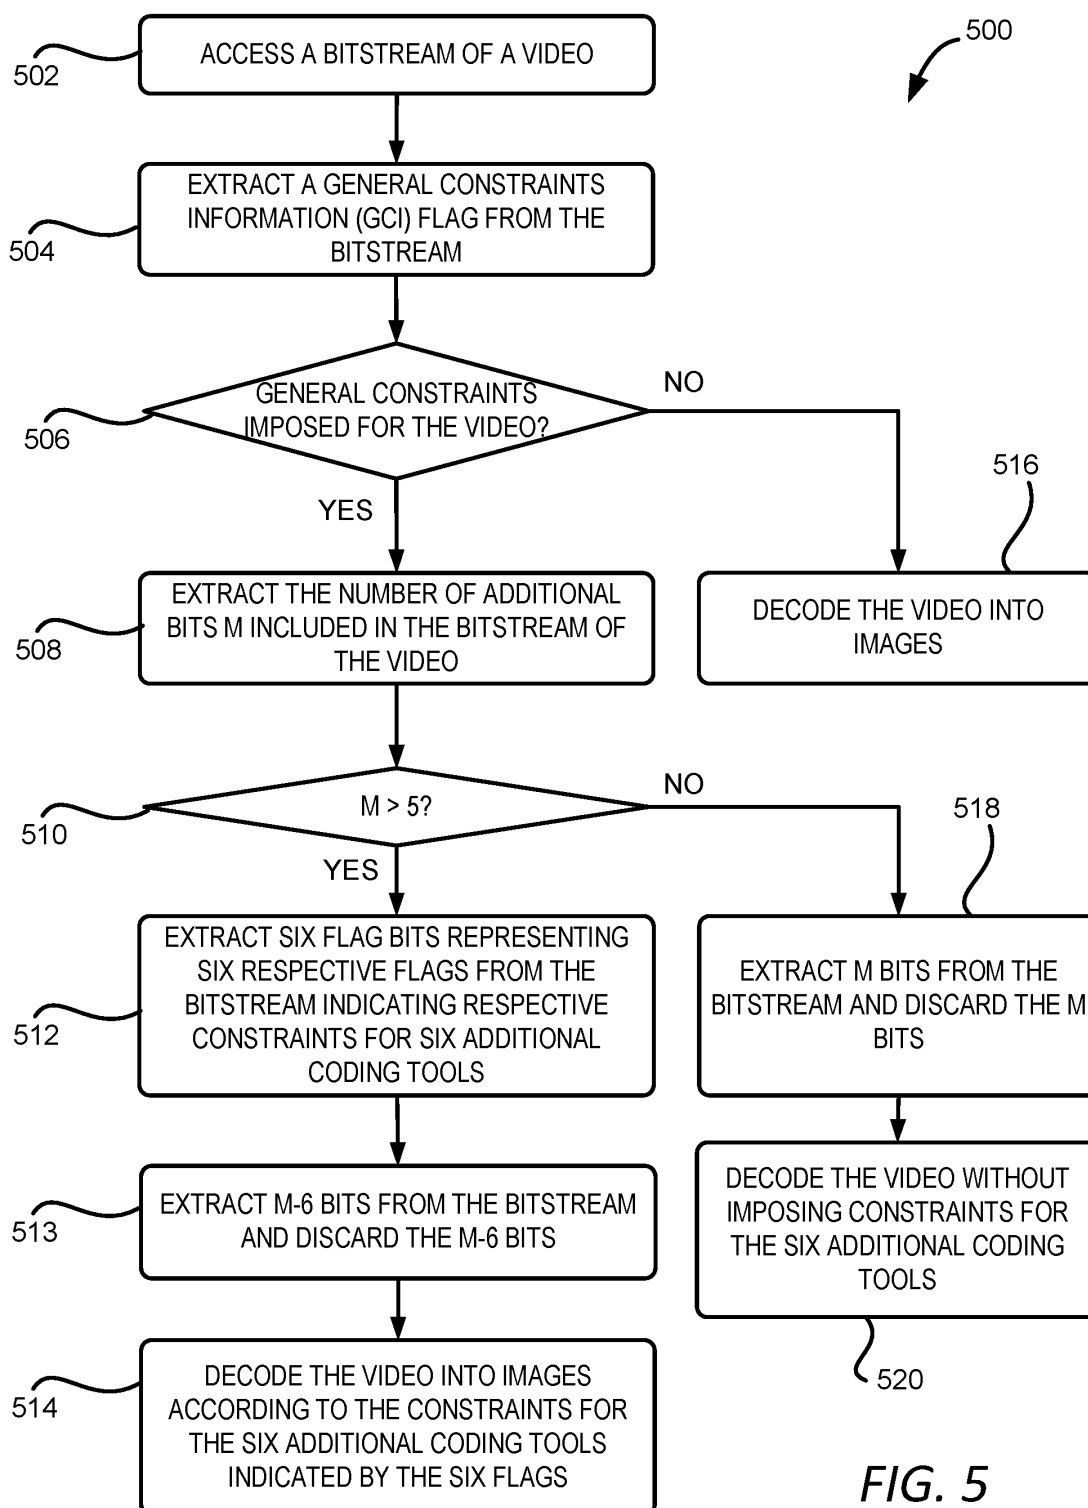


FIG. 5

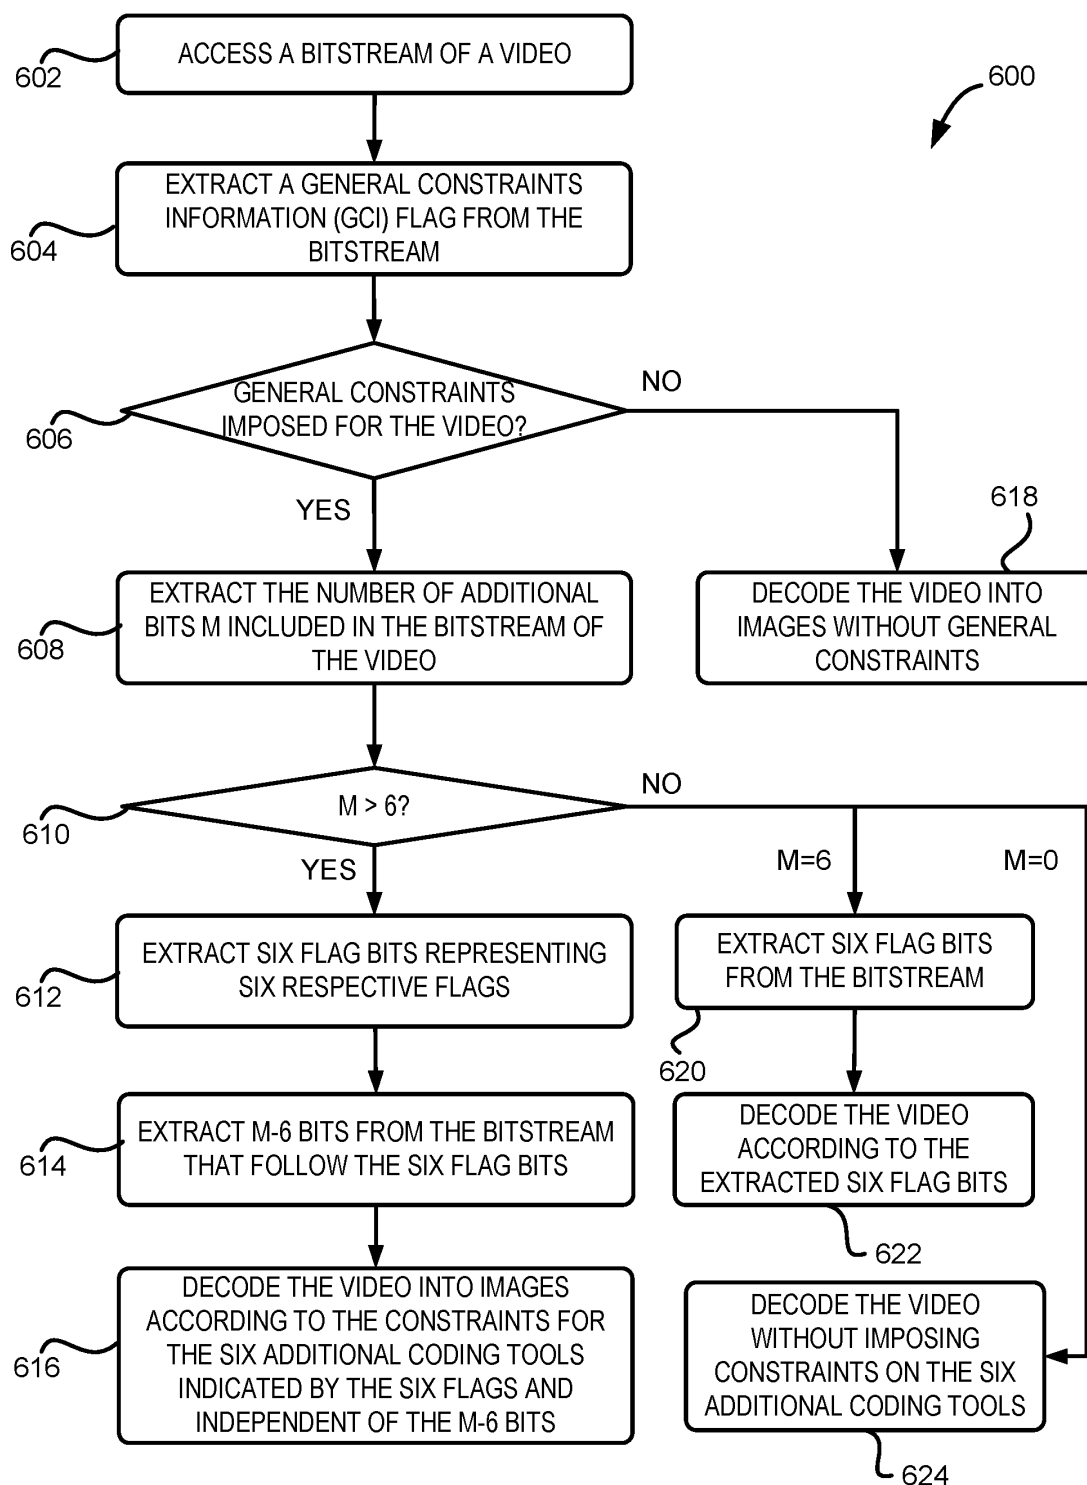
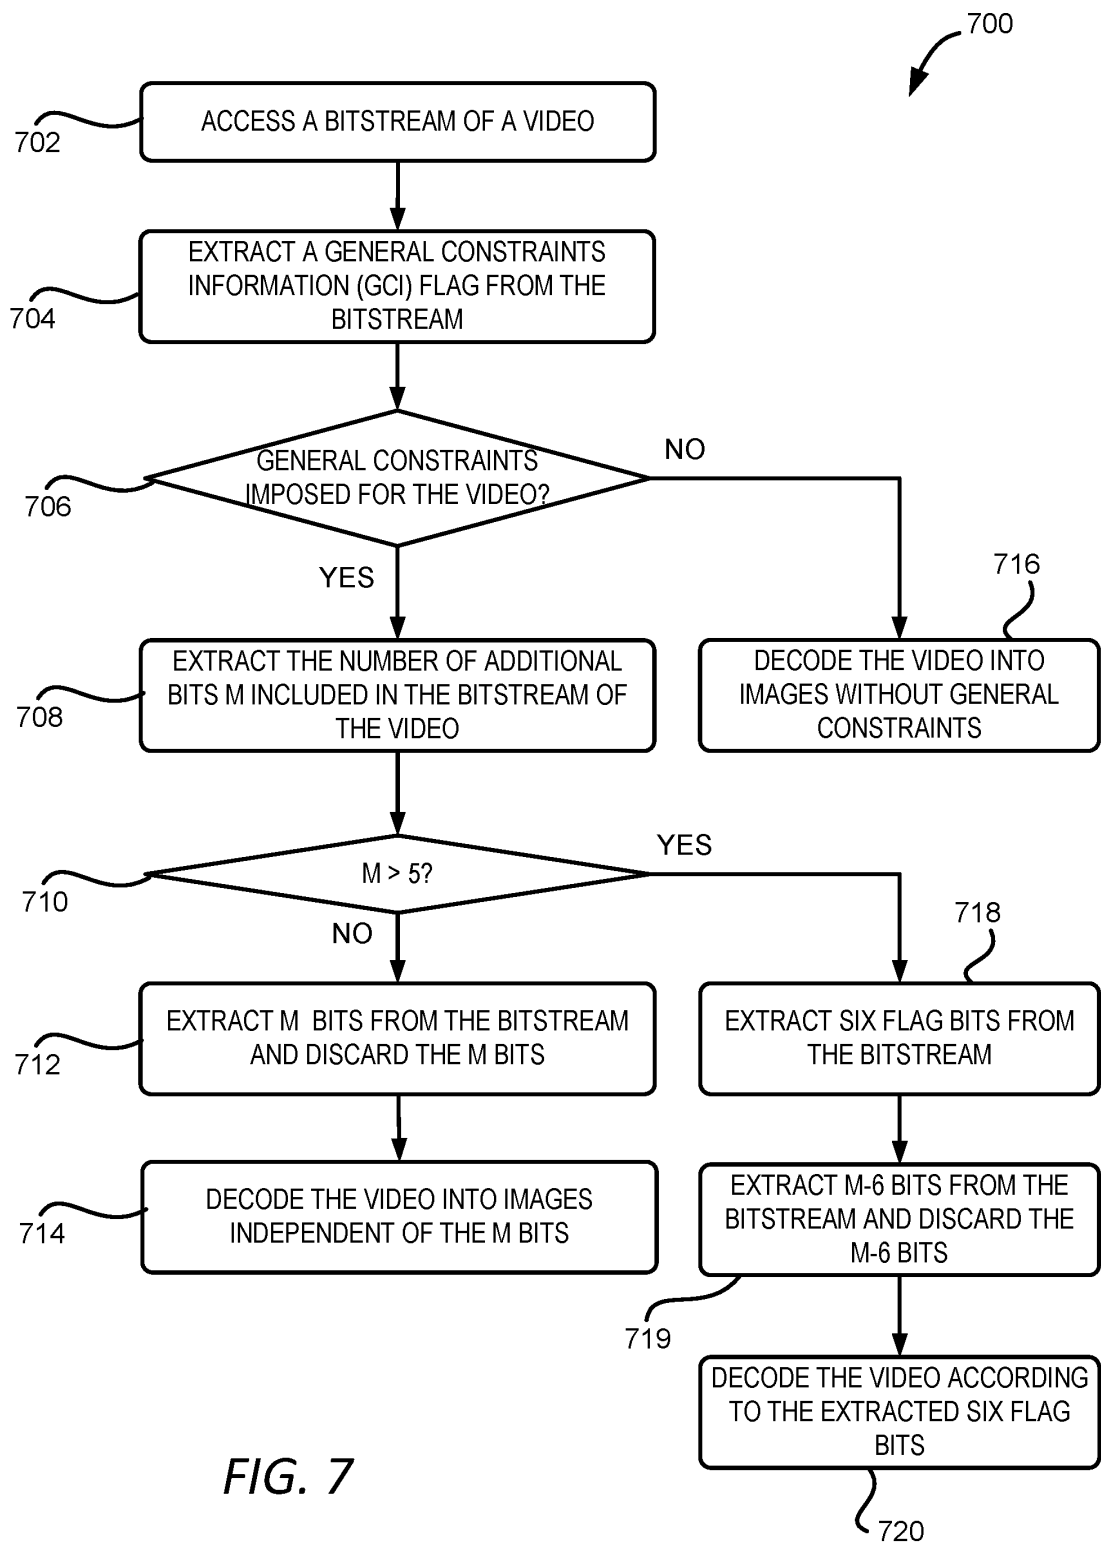


FIG. 6



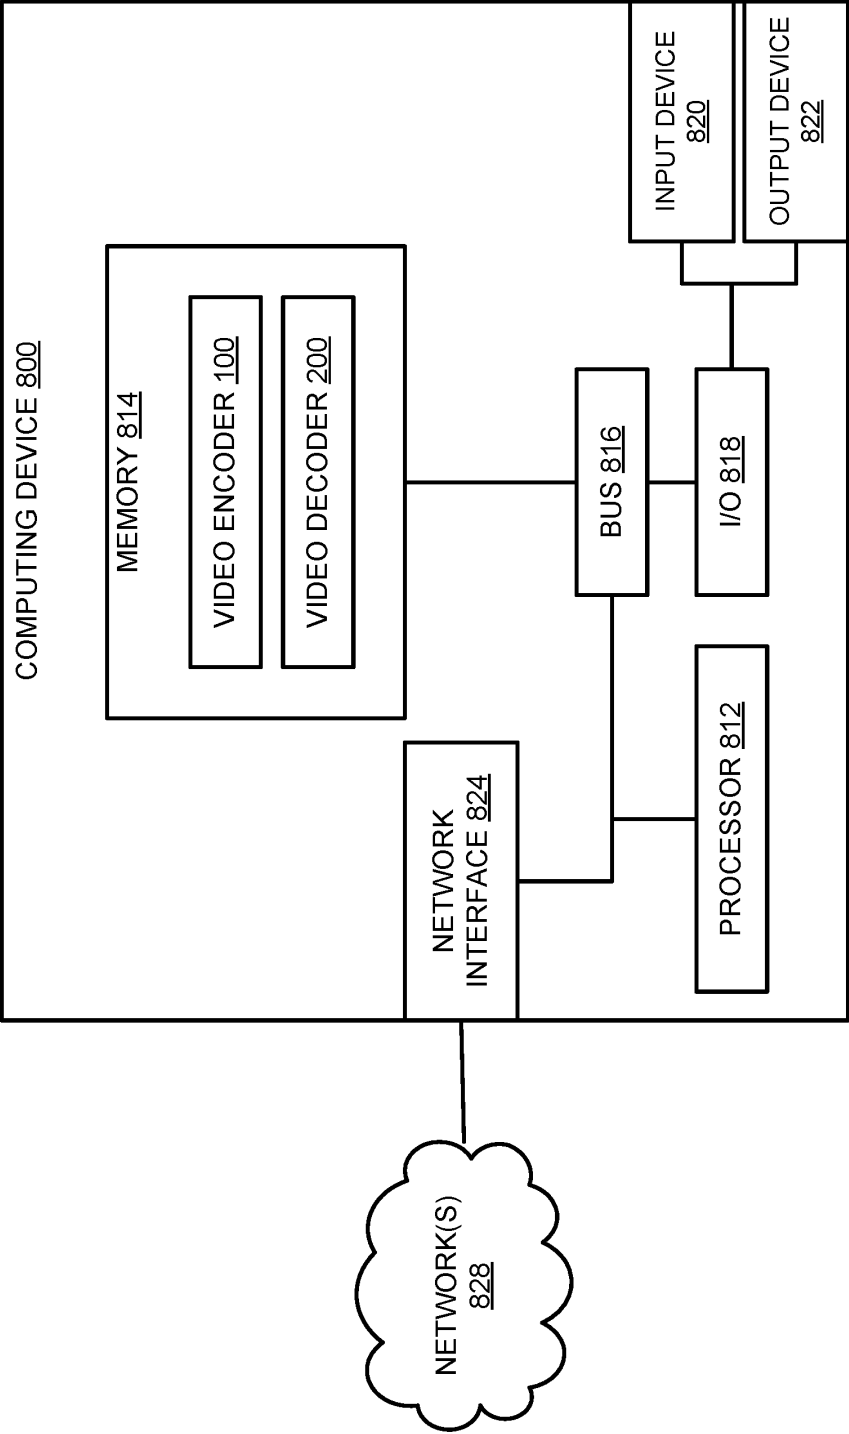


FIG. 8