

1/12

Figure 1


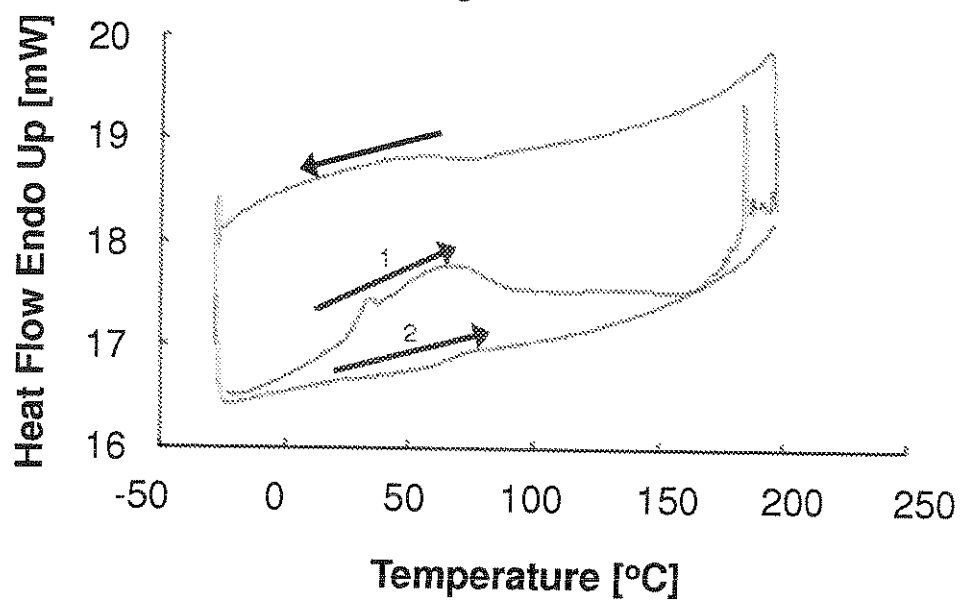


Figure 2

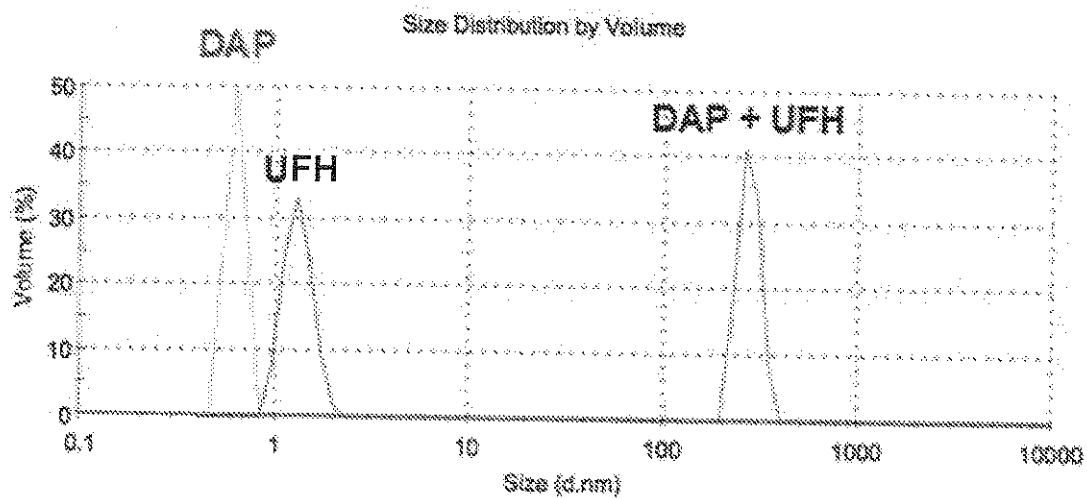

2/12

Figure 3


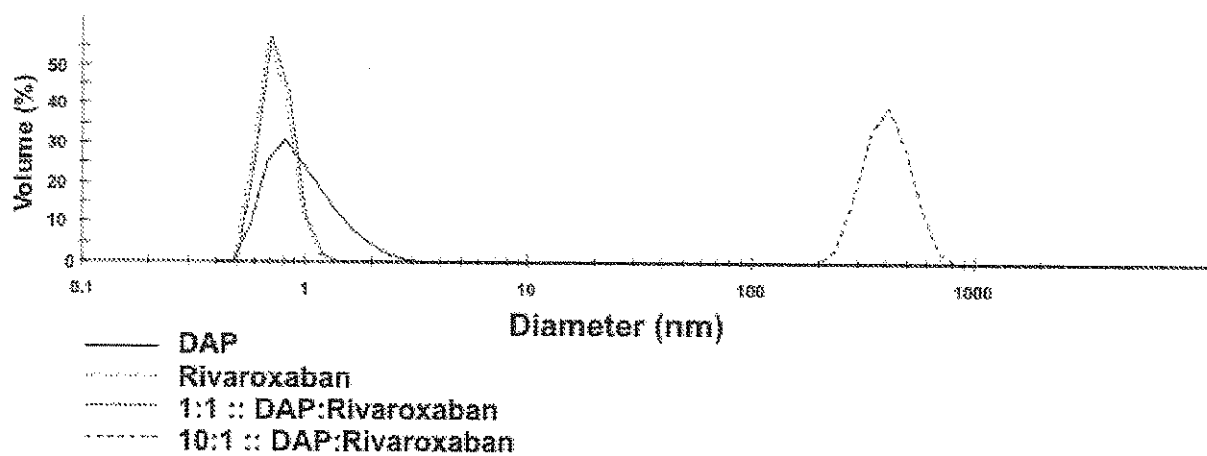


Figure 4

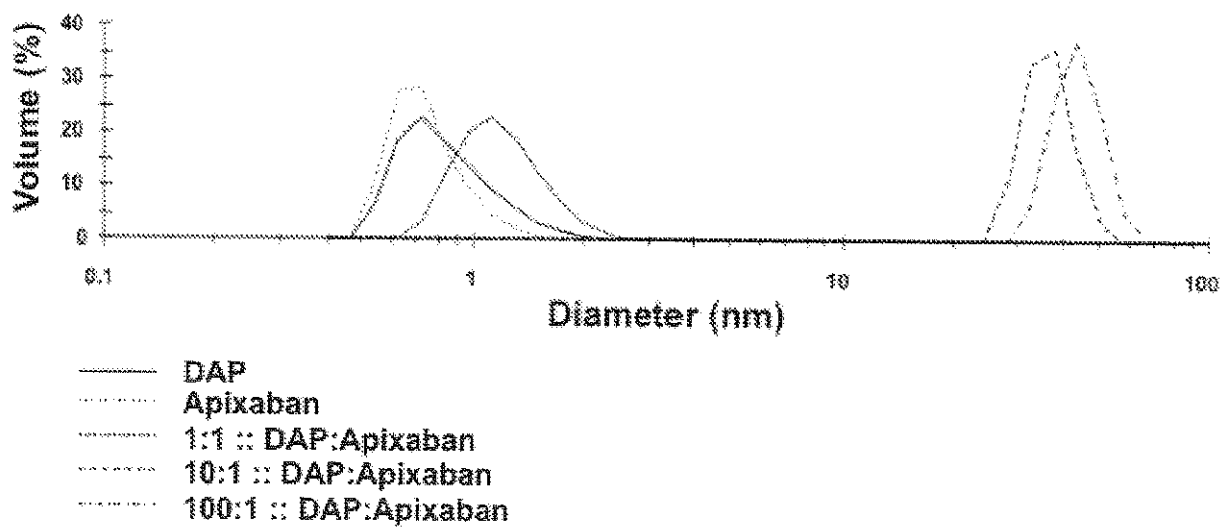

3/12

Figure 5



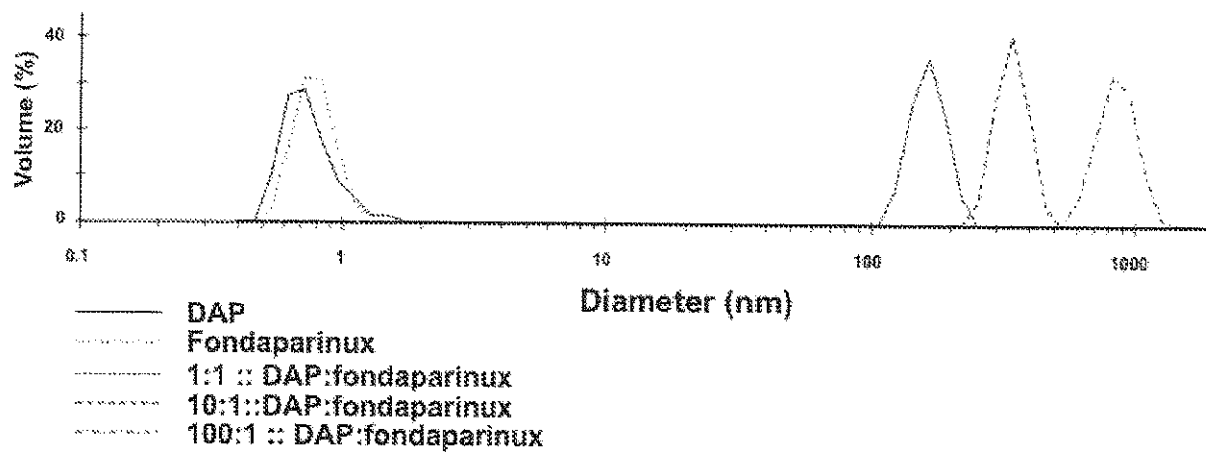


Figure 6


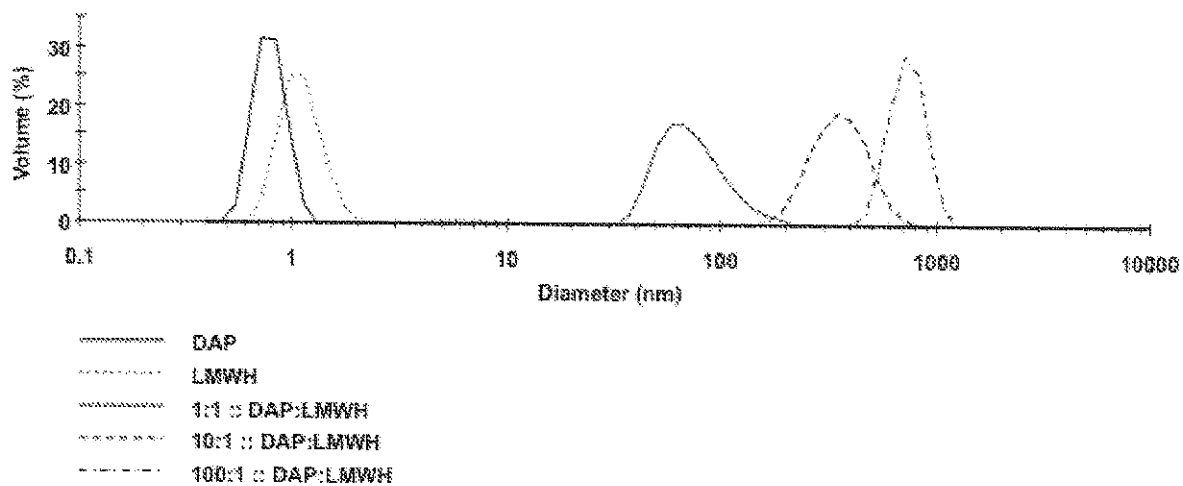


4/12

Figure 7

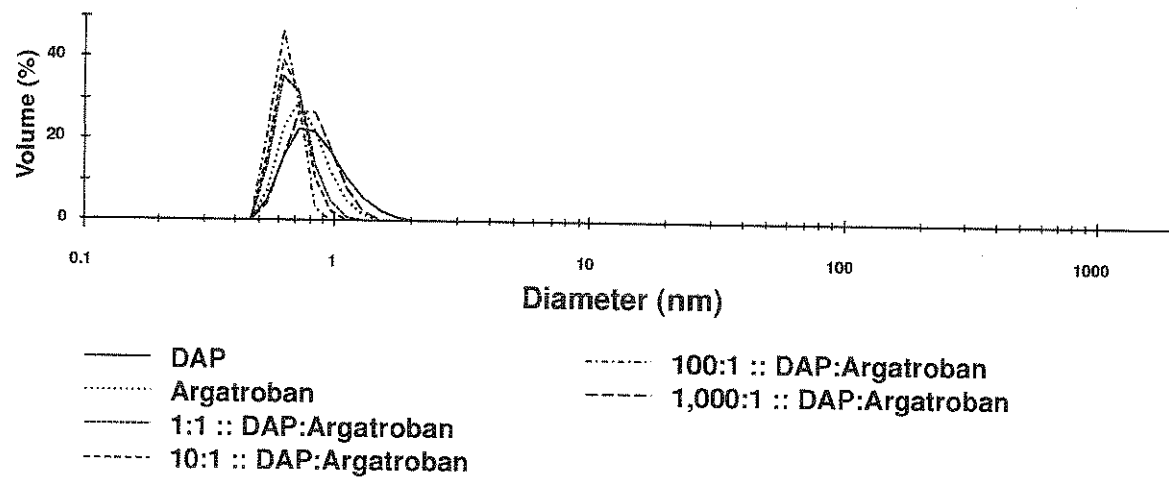

5/12

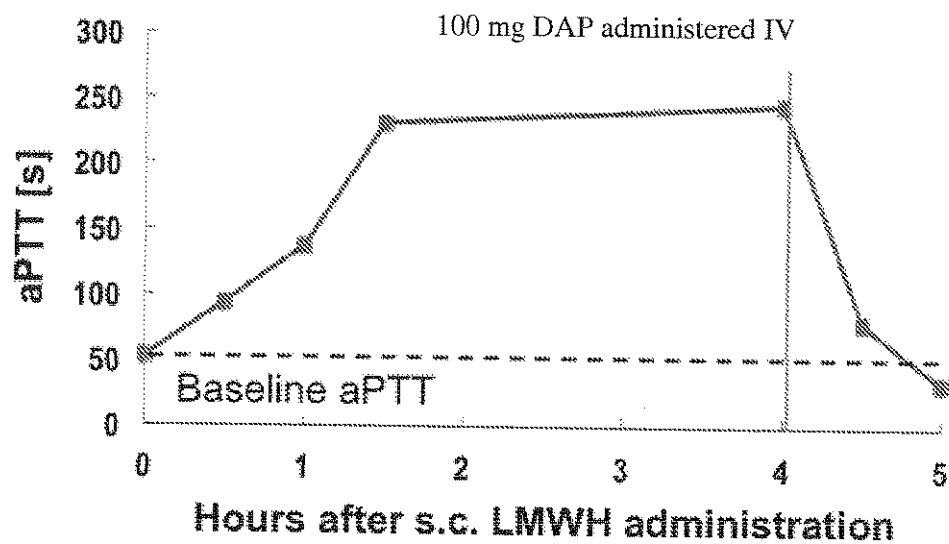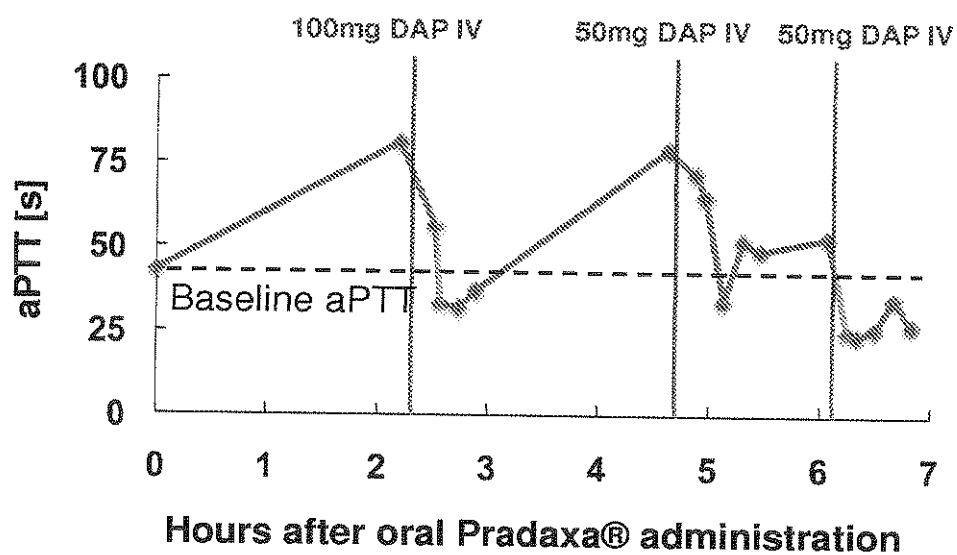Figure 8**Figure 9**

6/12

Figure 10



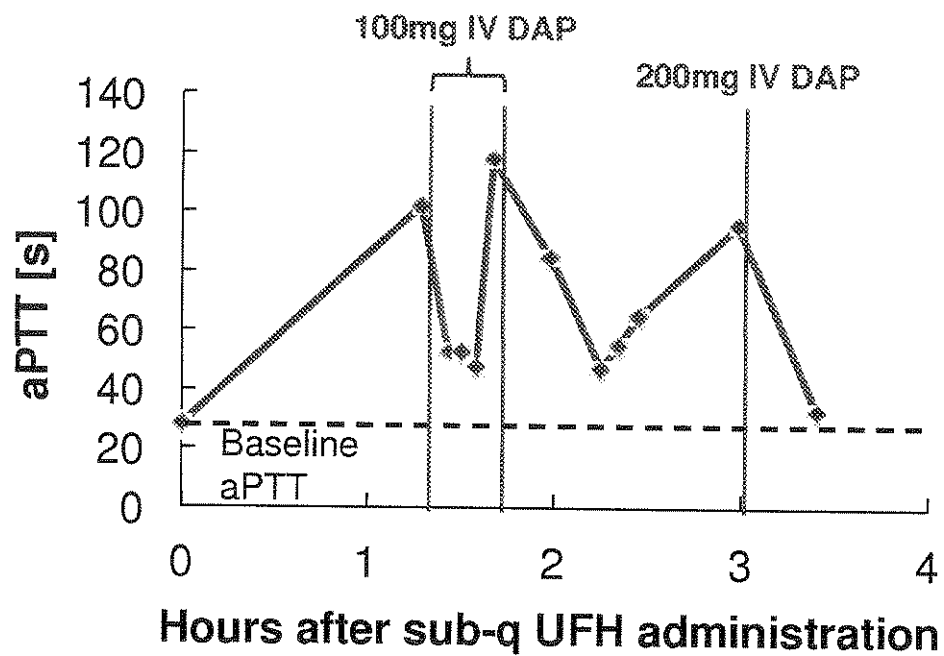


Figure 11

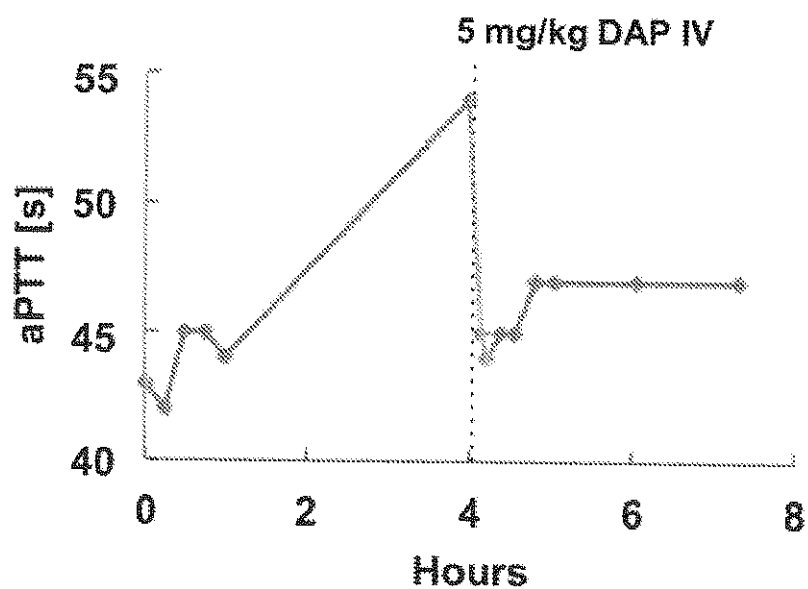


7/12

Figure 12

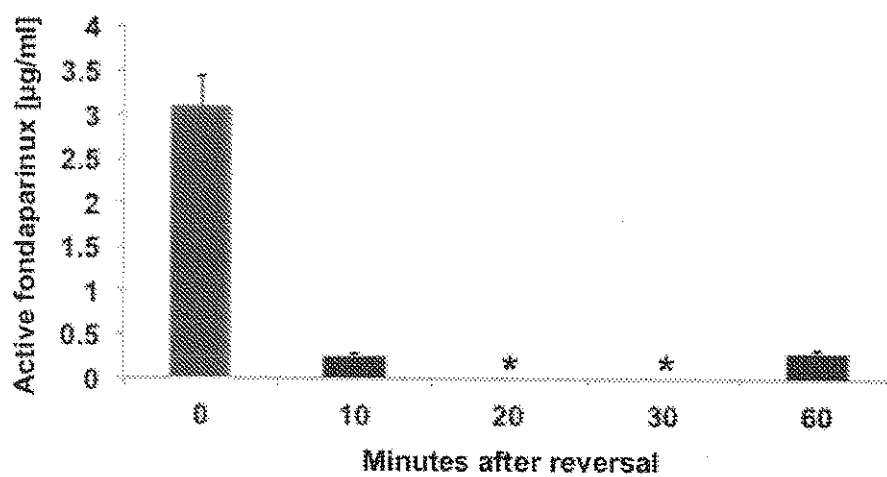

* Indicates below the limit of detection

Figure 13

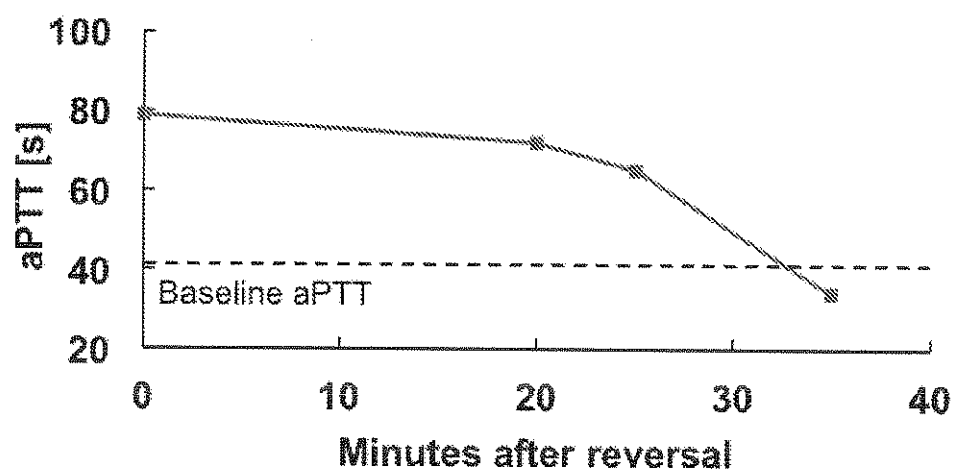

8/12

Figure 14


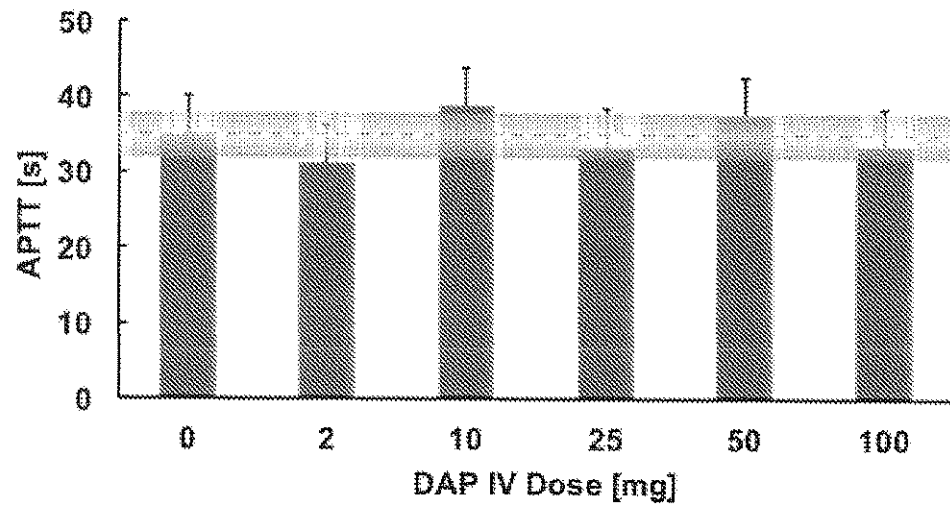


Figure 15

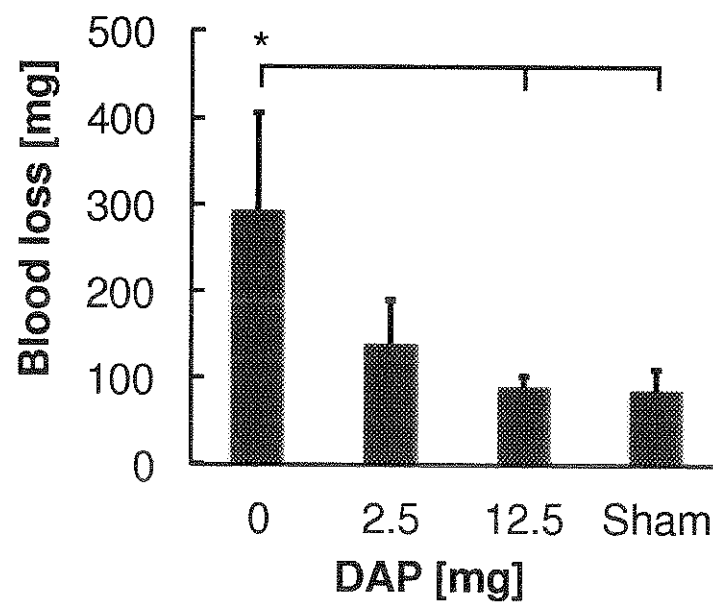

9/12

Figure 16


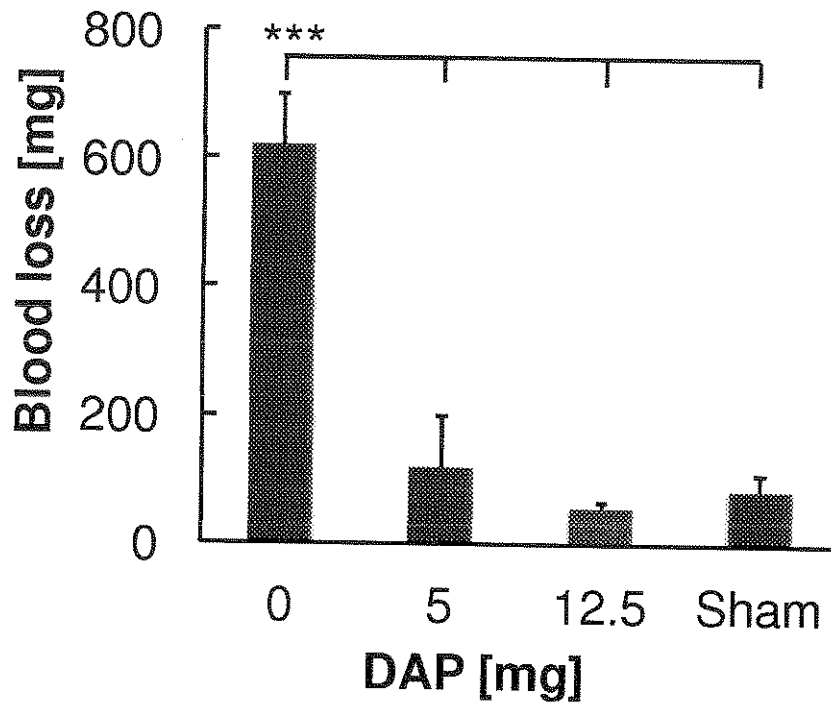


Figure 17

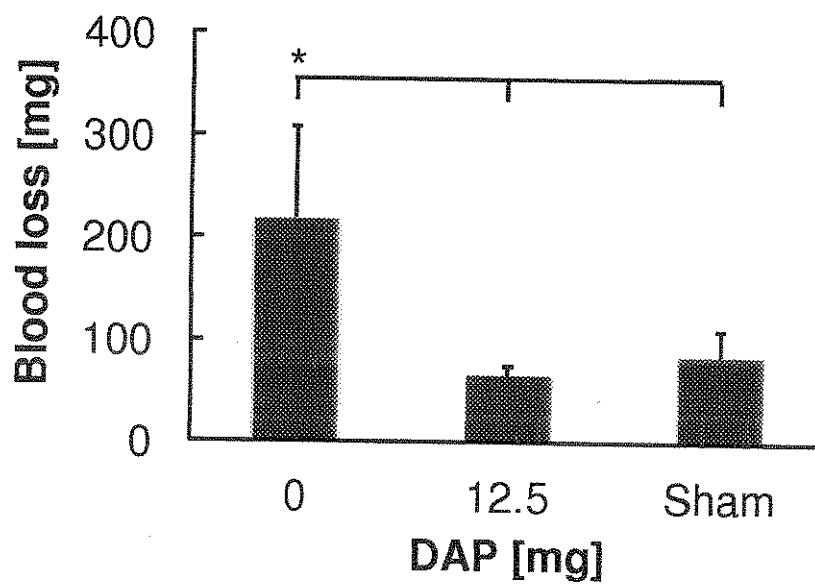

10/12

Figure 18

Dabigatran


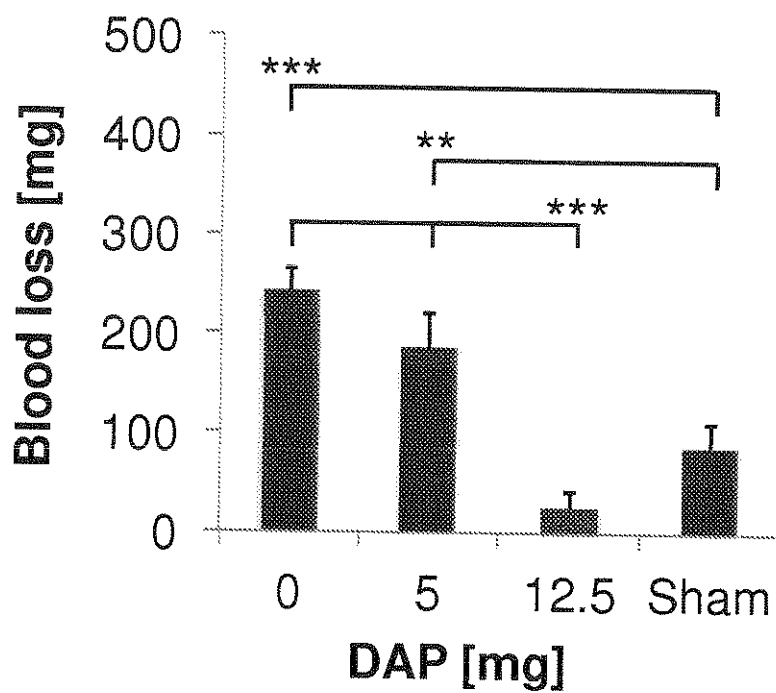


Figure 19

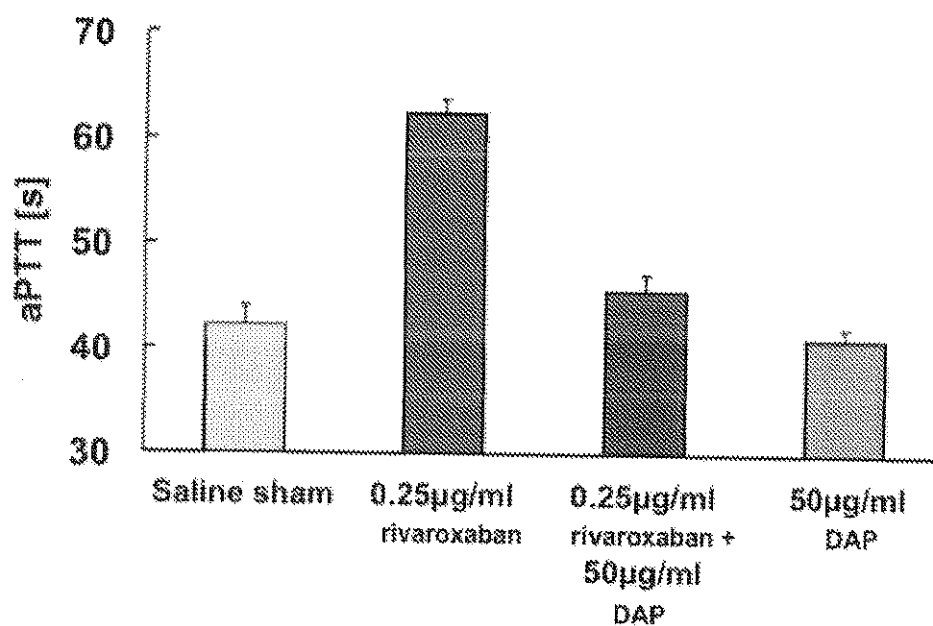

11/12

Figure 20


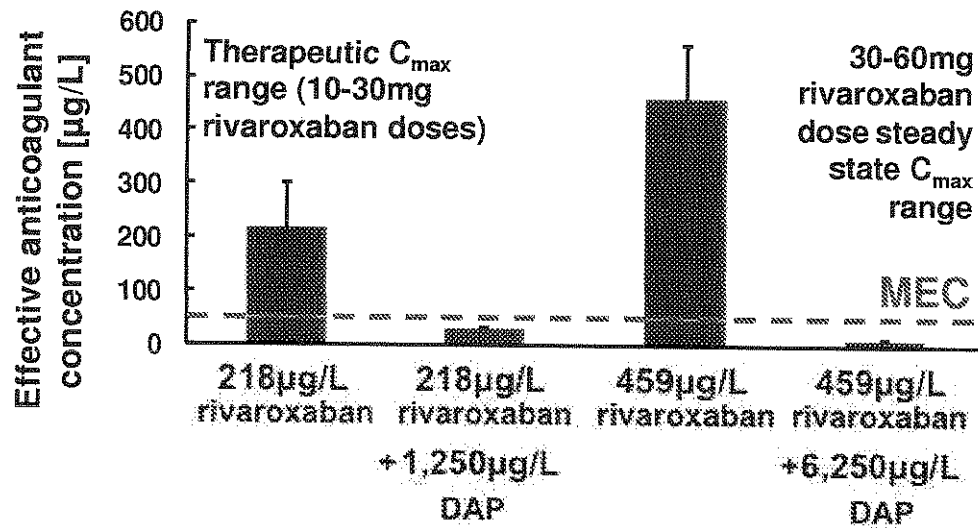


Figure 21



12/12

Figure 22

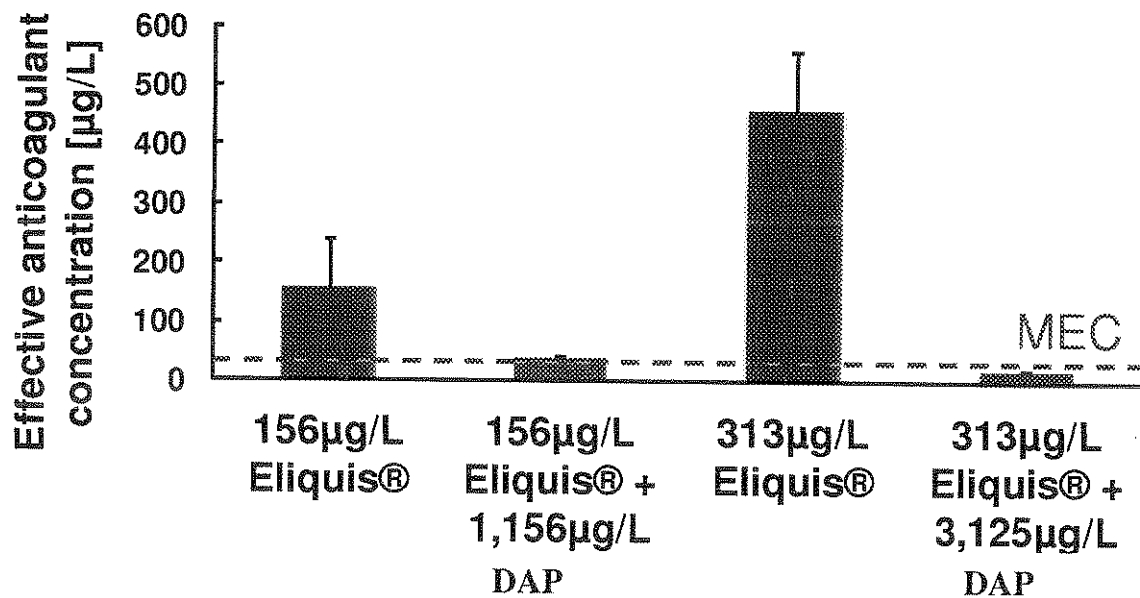