



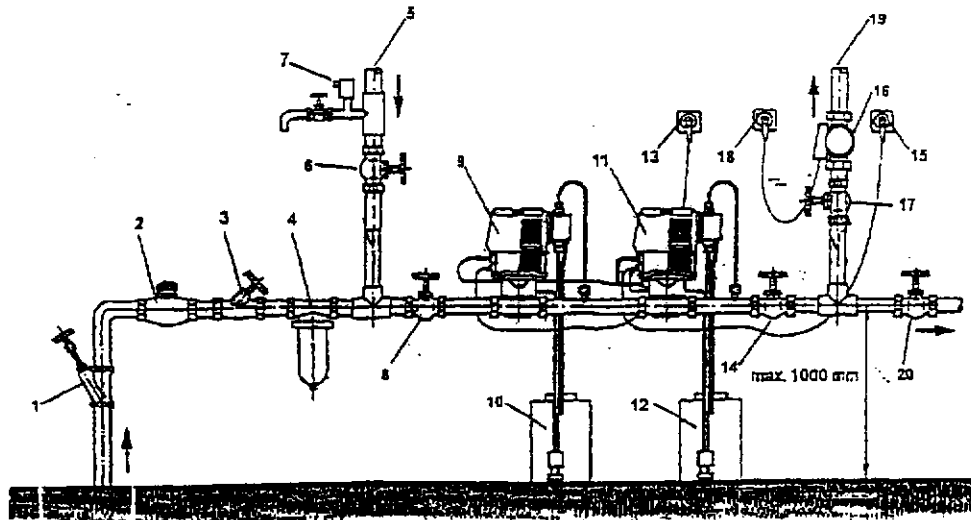

- | | |
|------------------------------|--|
| 1 shut off feed line | 11 dosing pump 2 |
| 2 water meter | 12 dosing container 2 |
| 3 shut off tap | 13 power point for dosing pump 1 |
| 4 dirt filter | 14 shut off tap |
| 5 return circulation line | 15 power point for dosing pump 2 |
| 6 shut off tap | 16 circulation pump (cleaning circuit) |
| 7 draining tap with air vent | 17 shut off tap |
| 8 shut off tap | 18 power point for circulation pump |
| 9 dosing pump 1 | 19 feed (cleaning circuit) or supply lines |
| 10 dosing container 1 | 20 shut off tap |

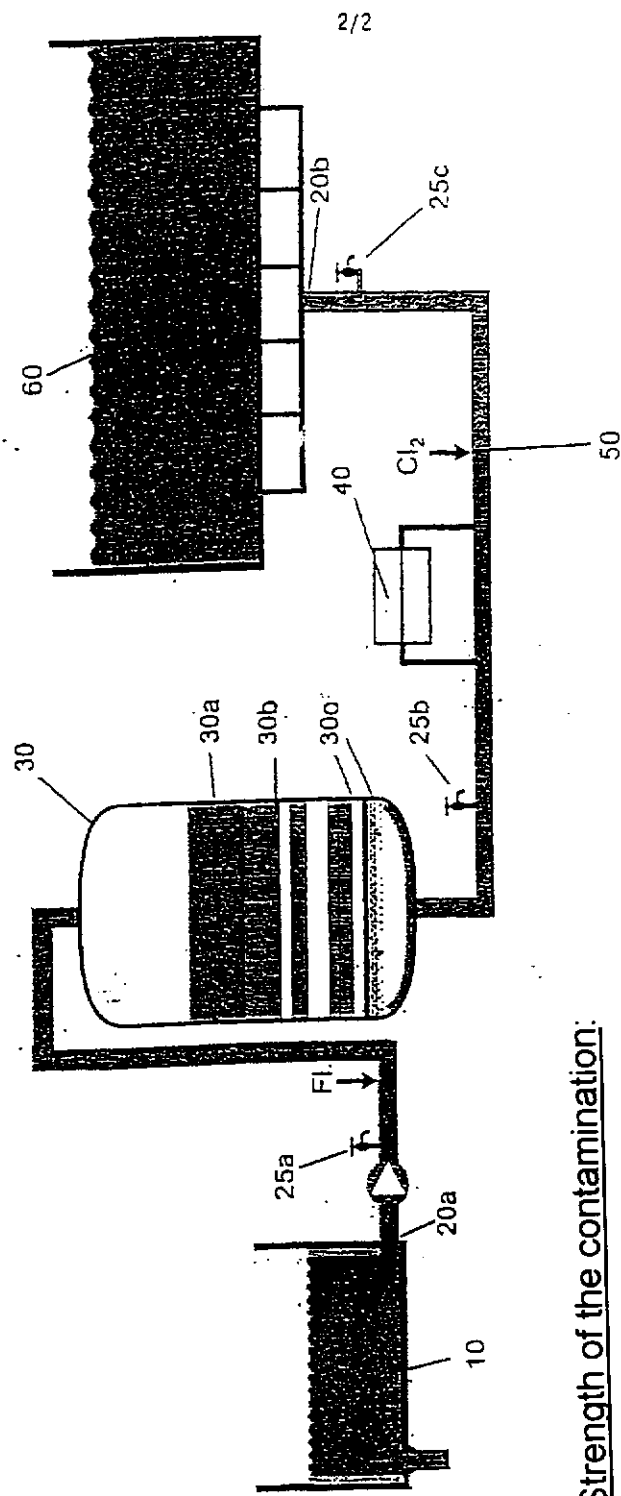

Strength of the contamination:

— level 1 (weak contamination)

▨ level 2 (medium contamination)

— level 3 (strong contamination)

Figure 2