

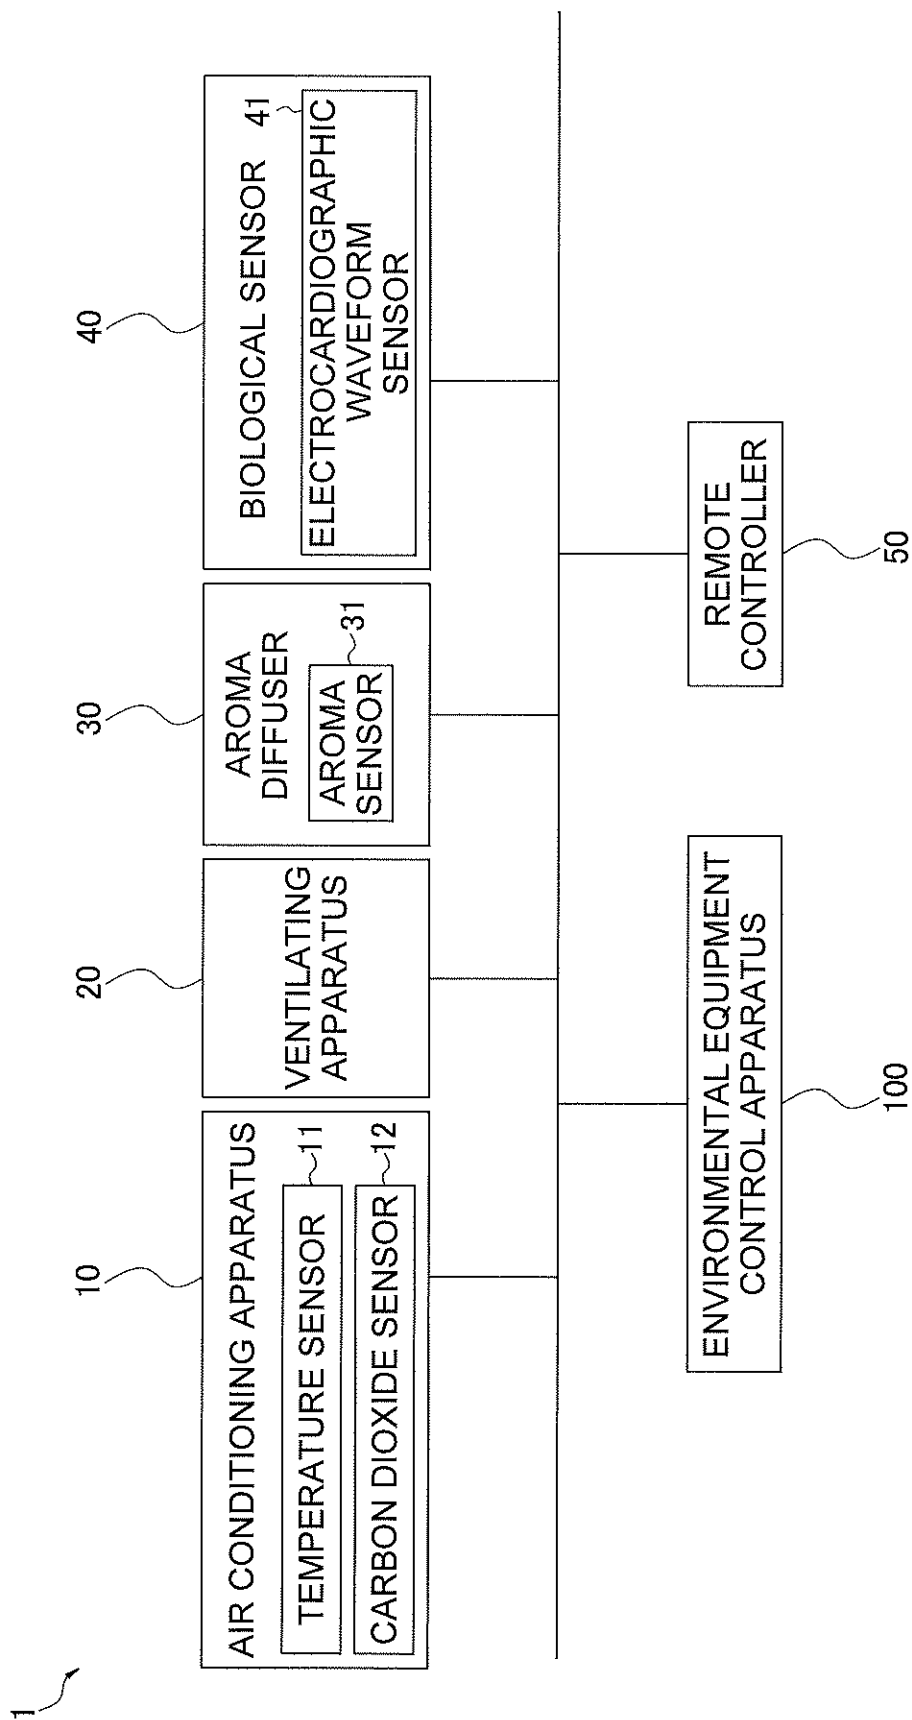


FIG. 1

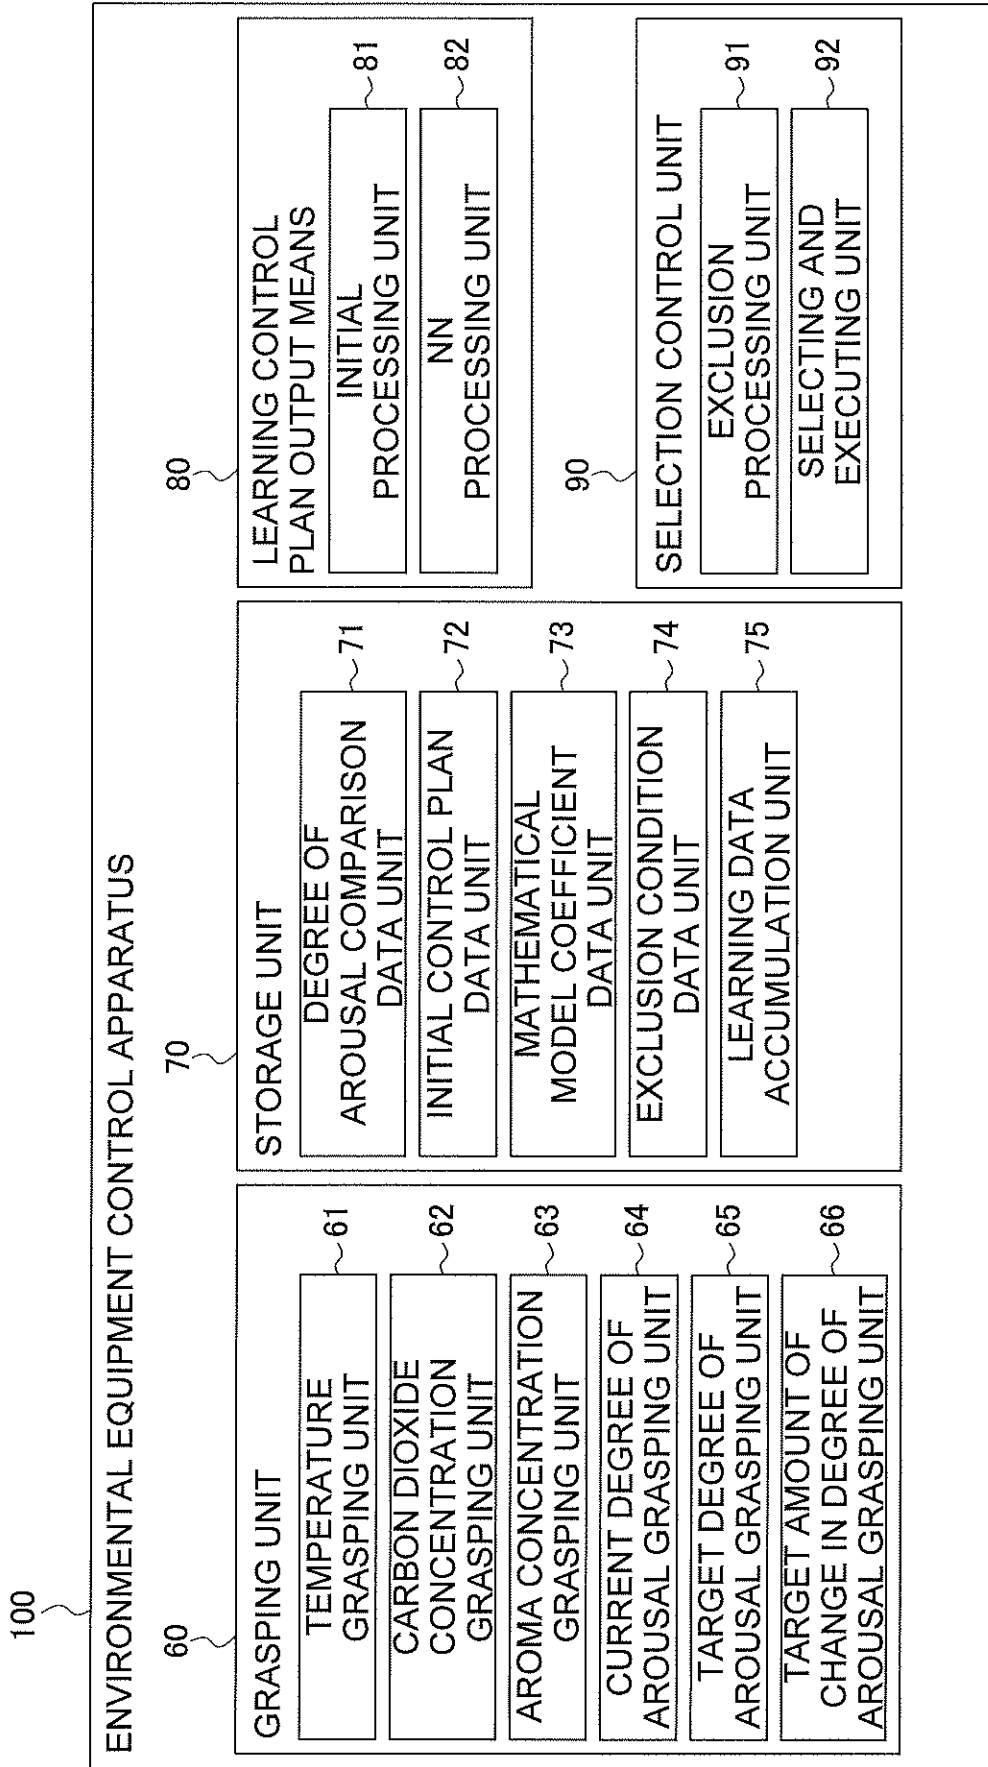


FIG. 2

	AIR CONDITIONING APPARATUS	VENTILATING APPARATUS	AROMA DIFFUSER
CONTROL PLAN A	SET TEMPERATURE -2	OFF	OFF
CONTROL PLAN B	SET TEMPERATURE -1	ON	OFF
CONTROL PLAN C	SET TEMPERATURE ±0	ON	ON (FOR INCREASING THE DEGREE OF AROUSAL)
⋮	⋮	⋮	⋮

FIG. 3

	AIR CONDITIONING APPARATUS	VENTILATING APPARATUS	AROMA DIFFUSER
CONTROL PLAN P	SET TEMPERATURE +2	OFF	OFF
CONTROL PLAN Q	SET TEMPERATURE +3	ON	OFF
CONTROL PLAN R	SET TEMPERATURE +2	ON	ON (FOR DECREASING THE DEGREE OF AROUSAL)
⋮	⋮	⋮	⋮

FIG. 4

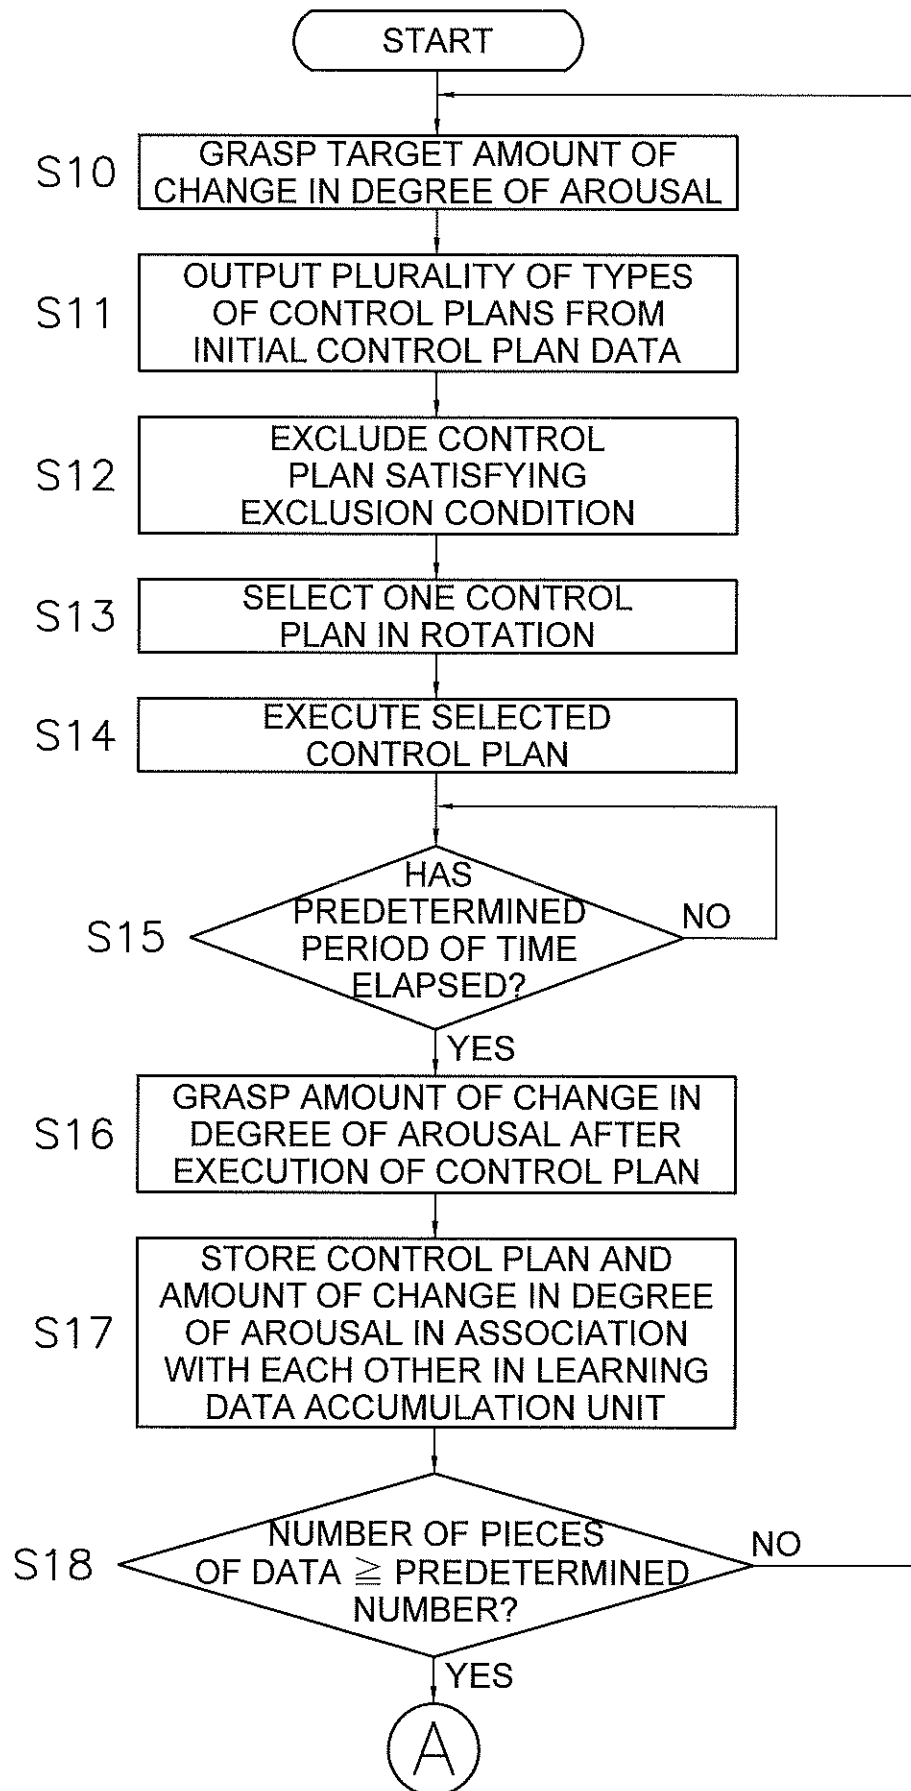


FIG. 5

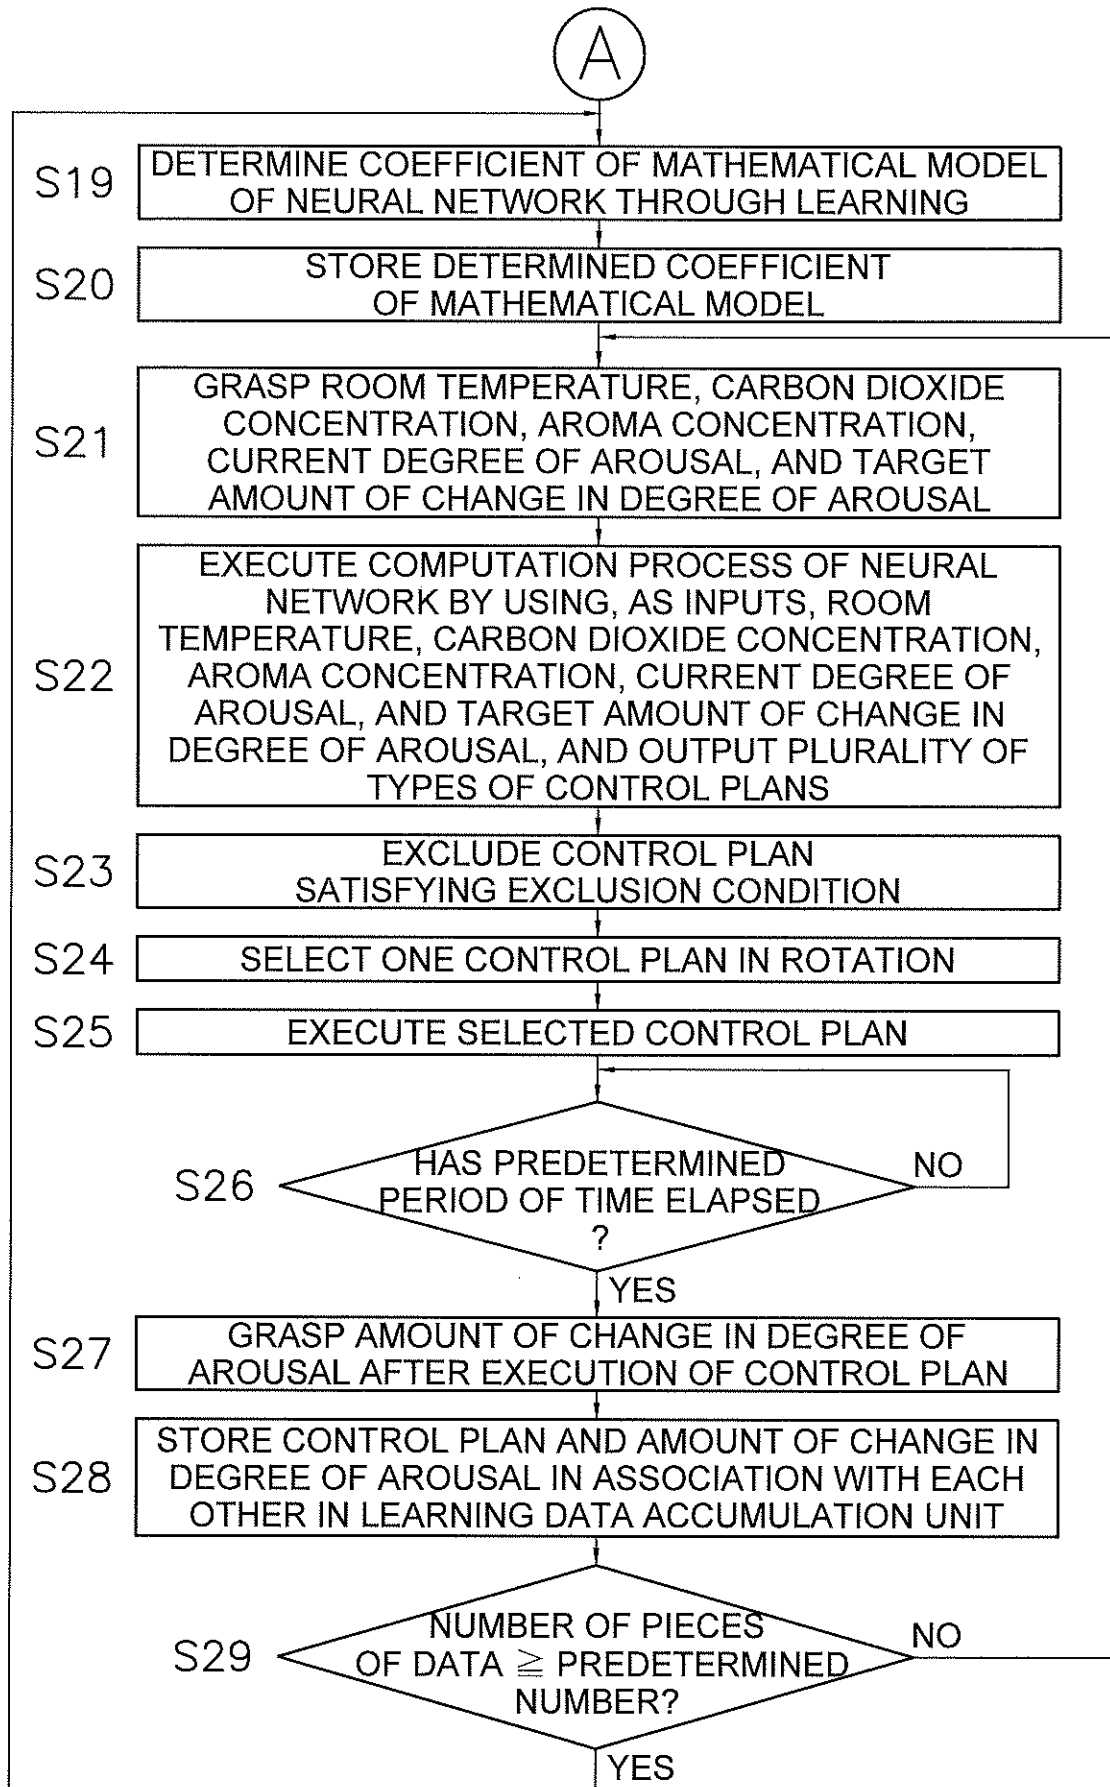


FIG. 6