

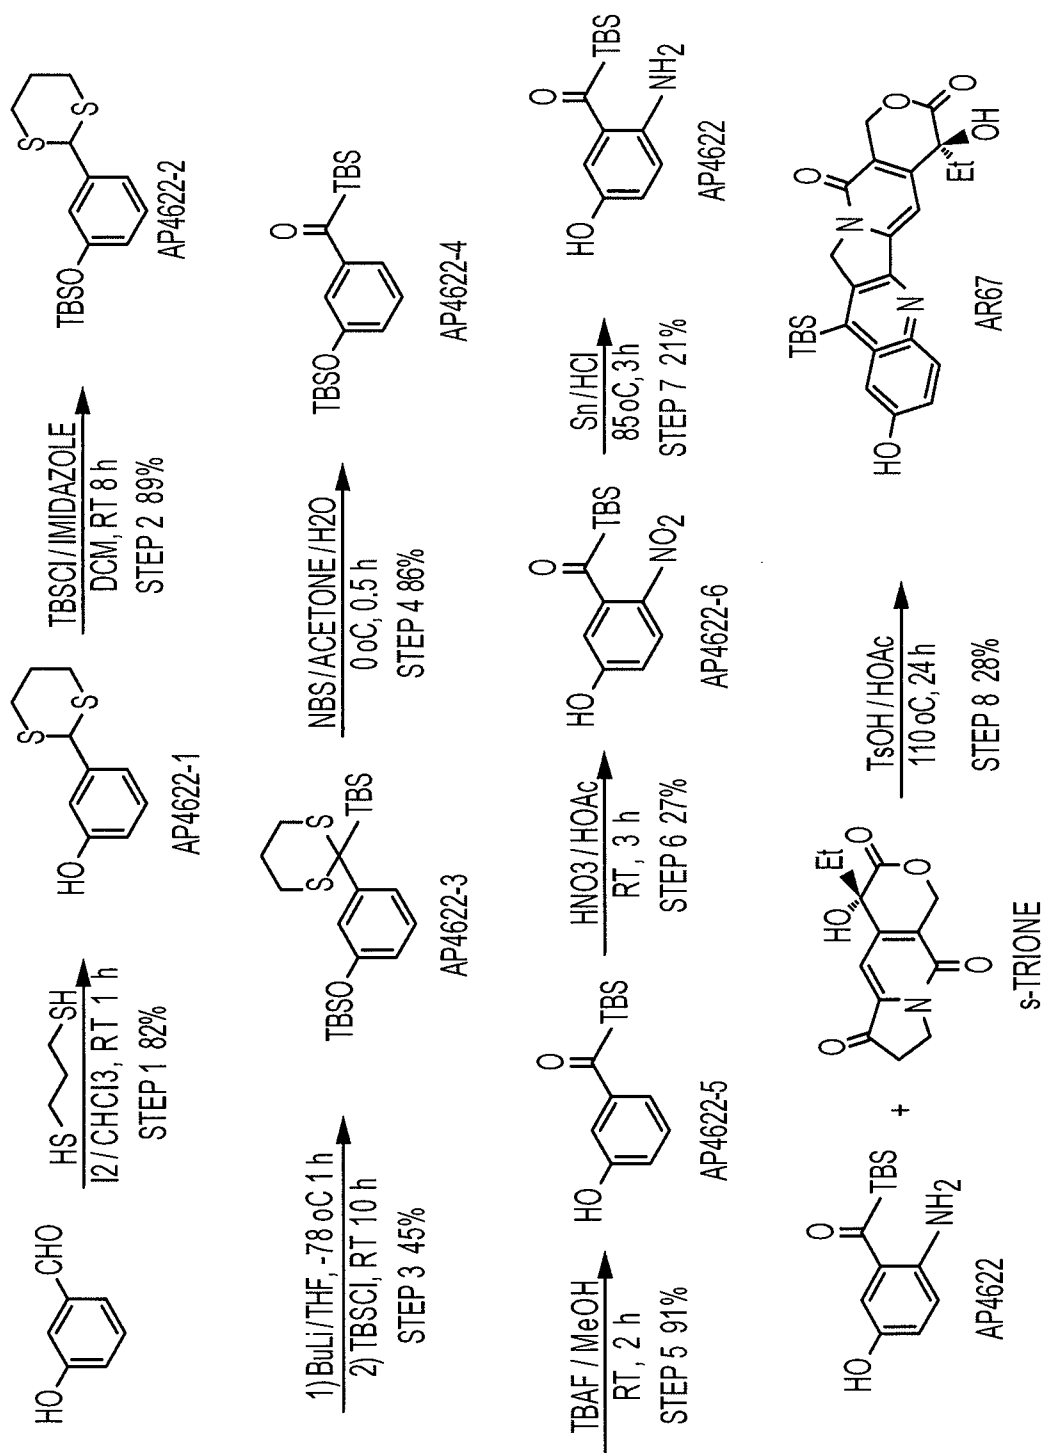


FIG. 1

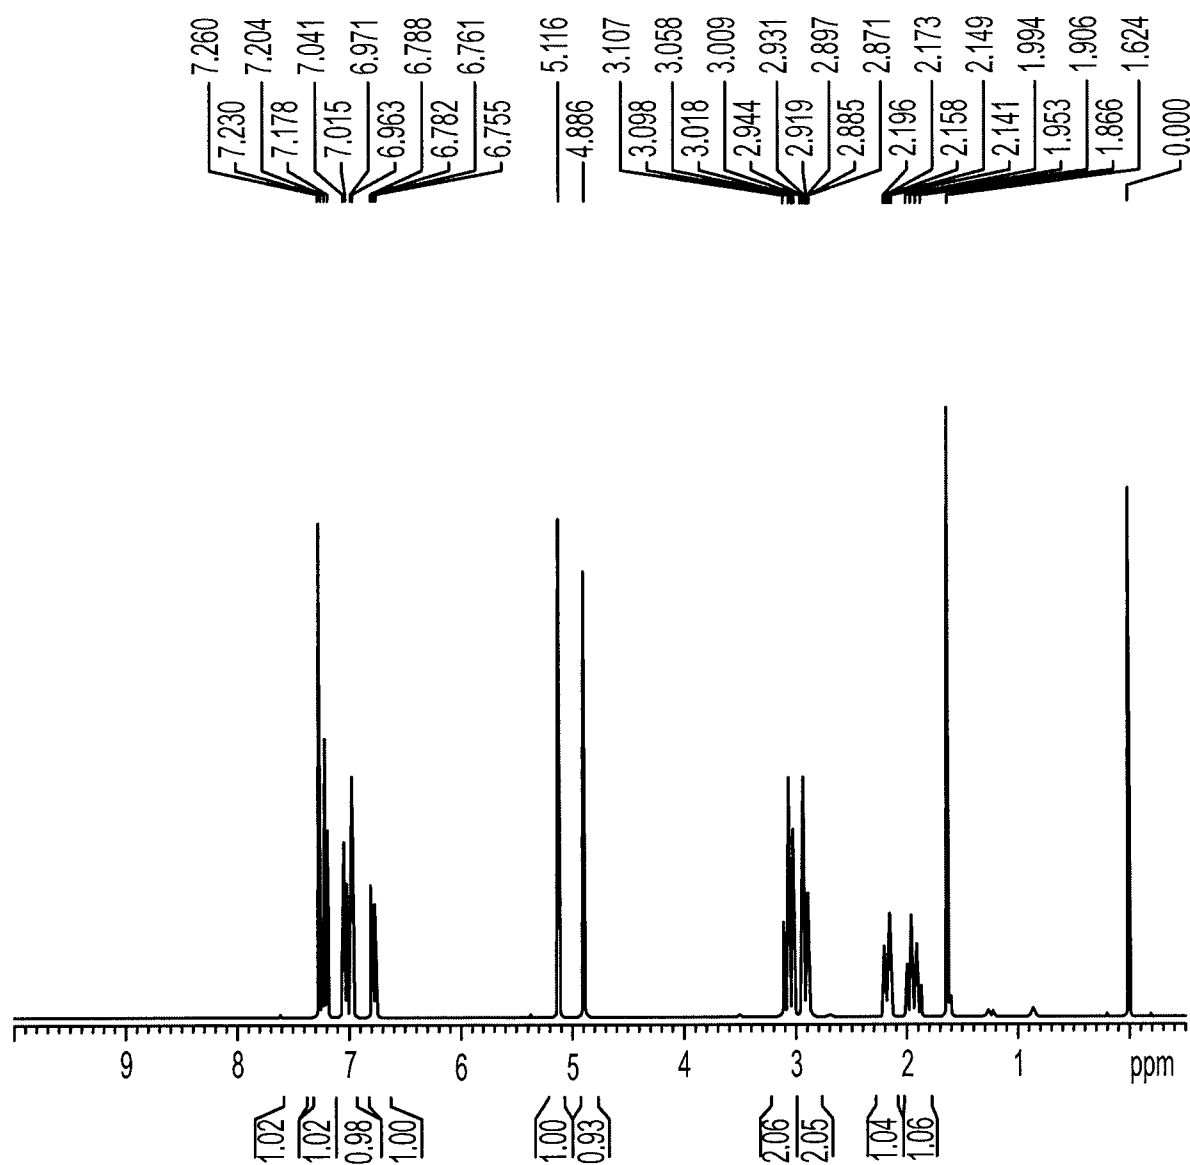


FIG. 2

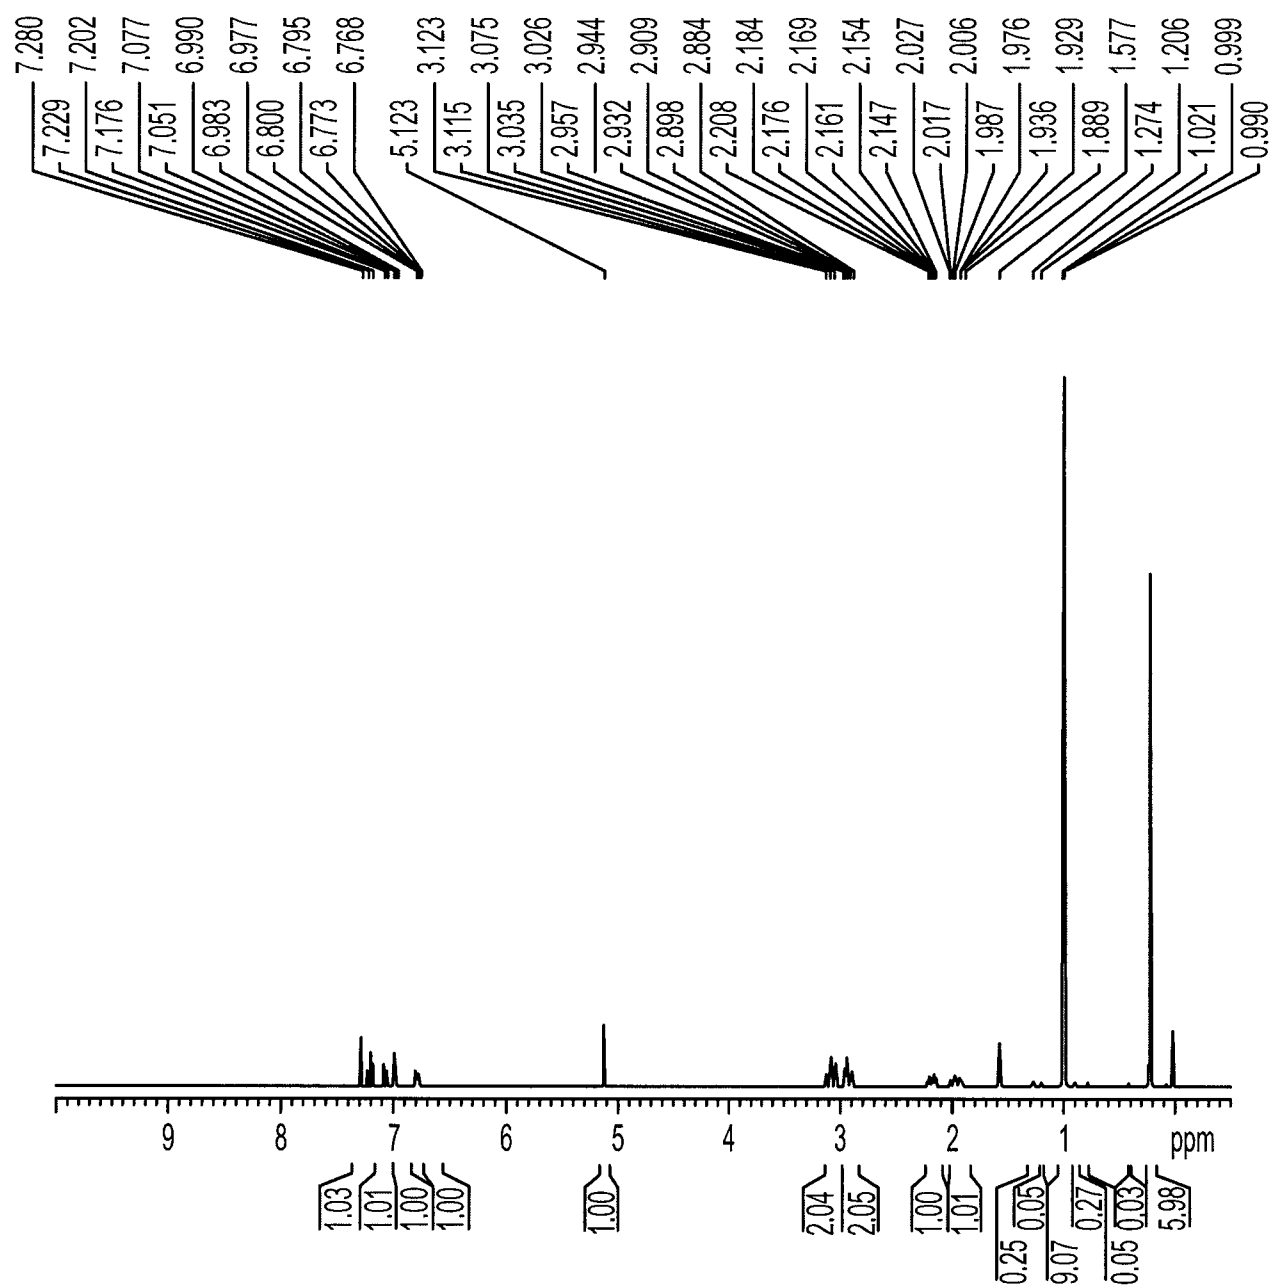


FIG. 3

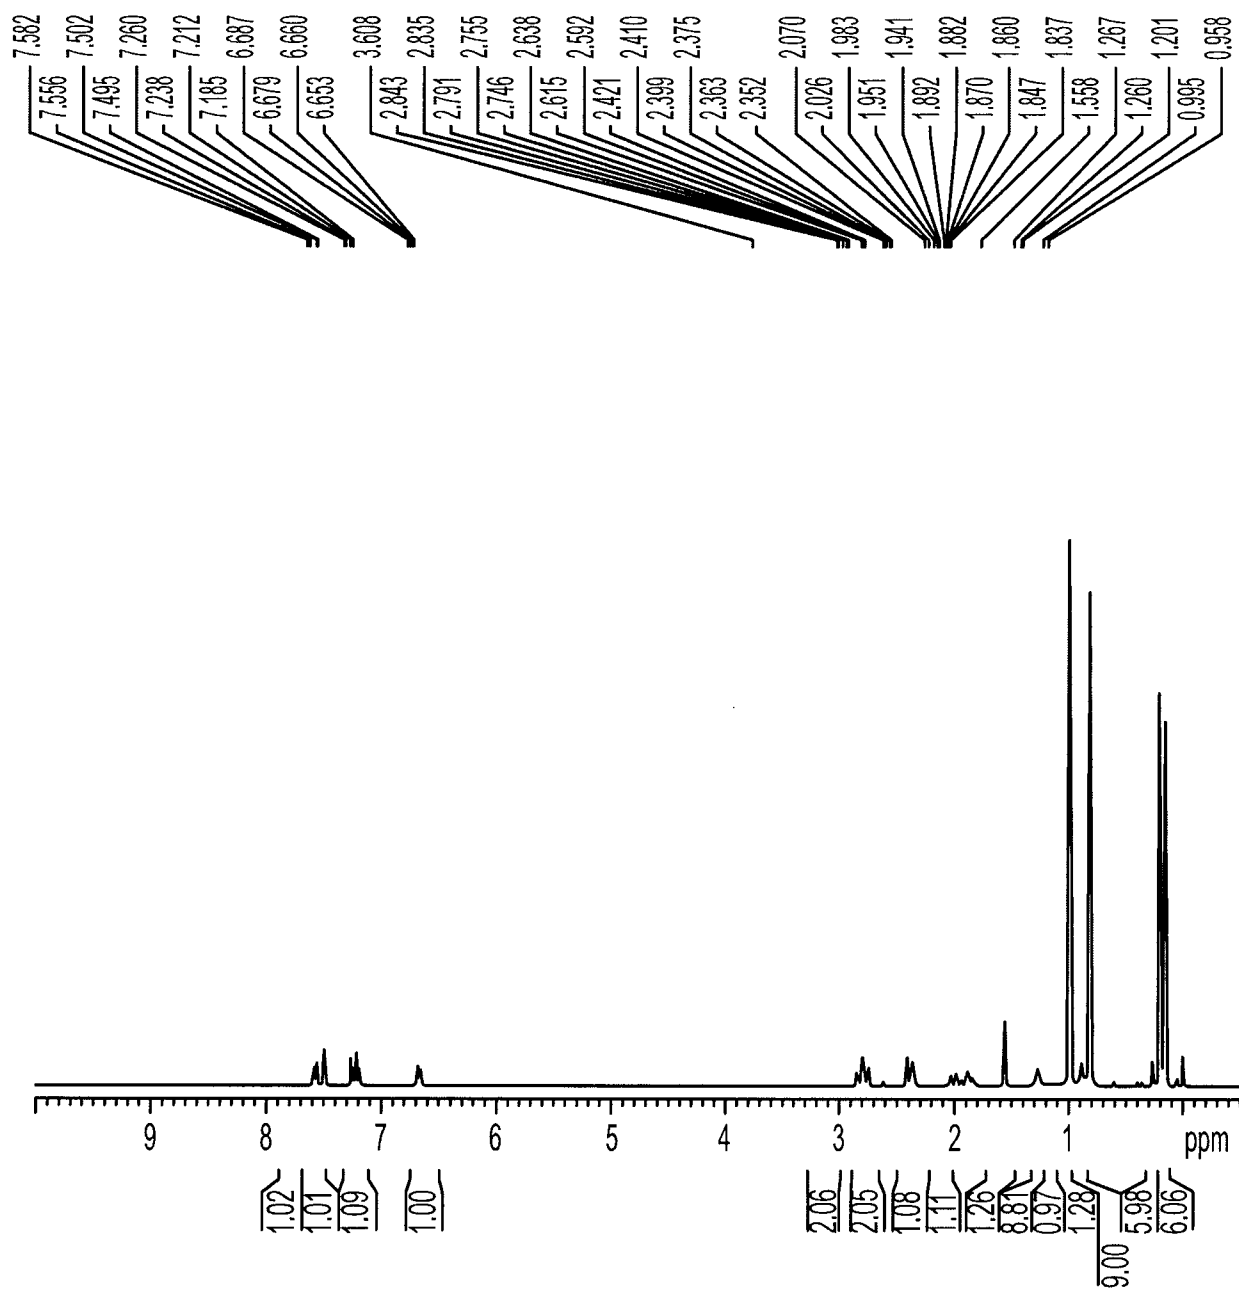


FIG. 4

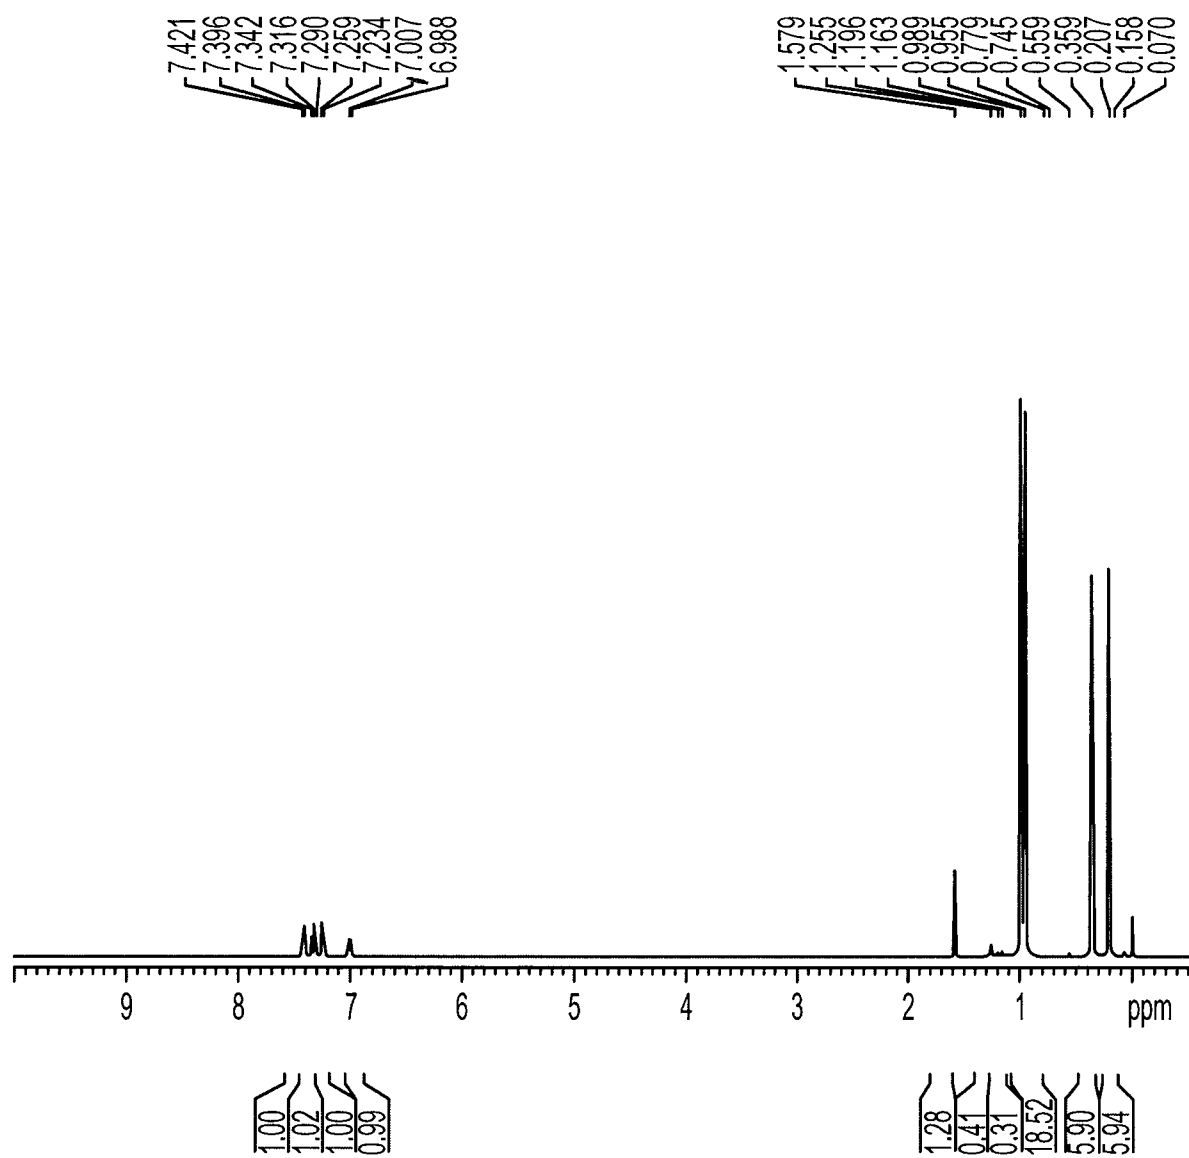


FIG. 5

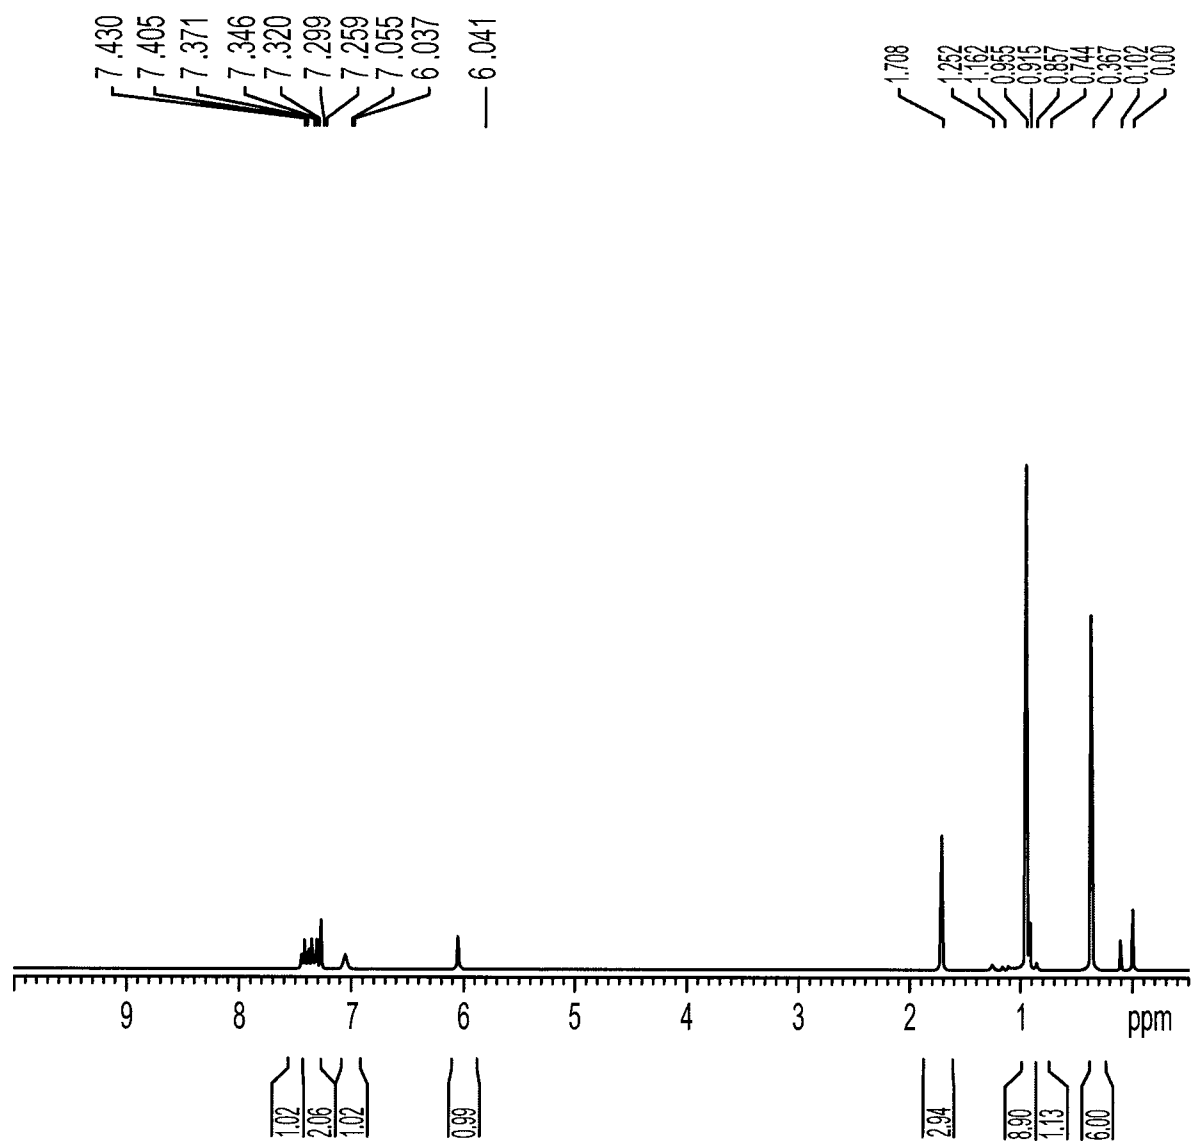


FIG. 6

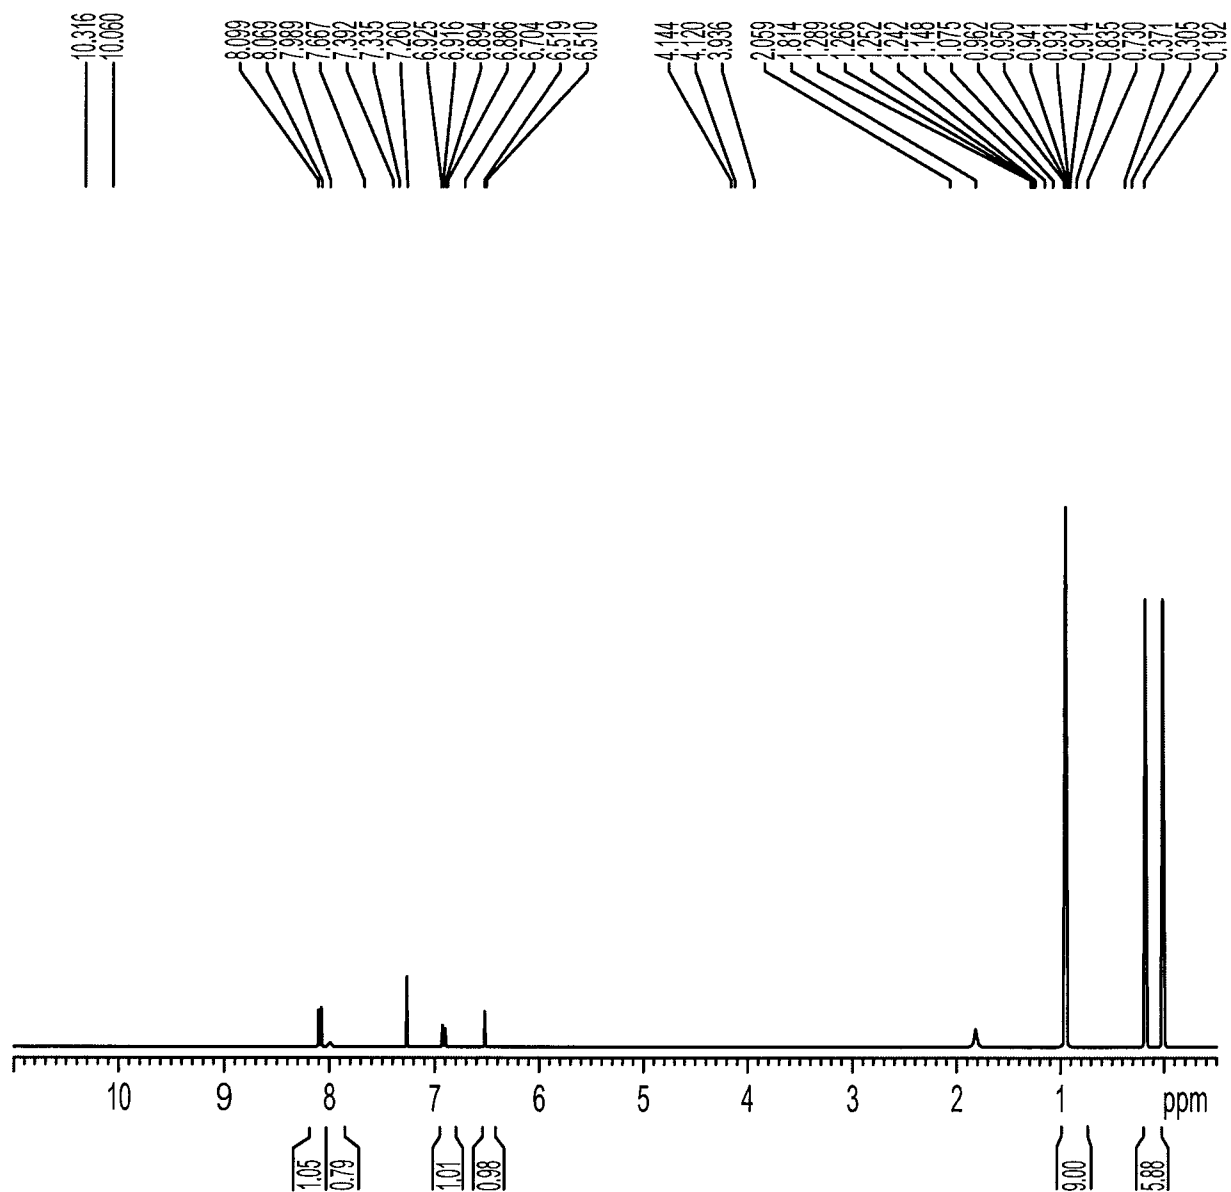


FIG. 7


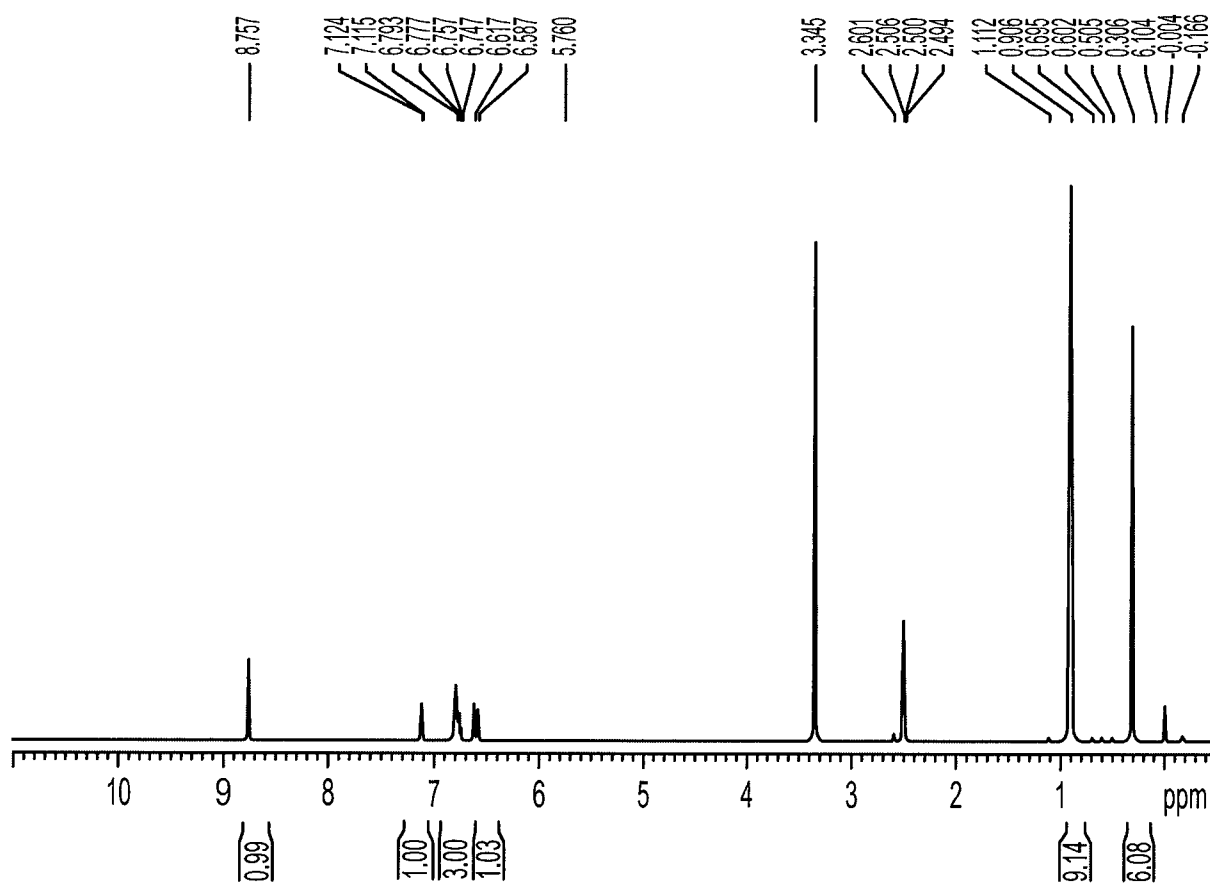


FIG. 8

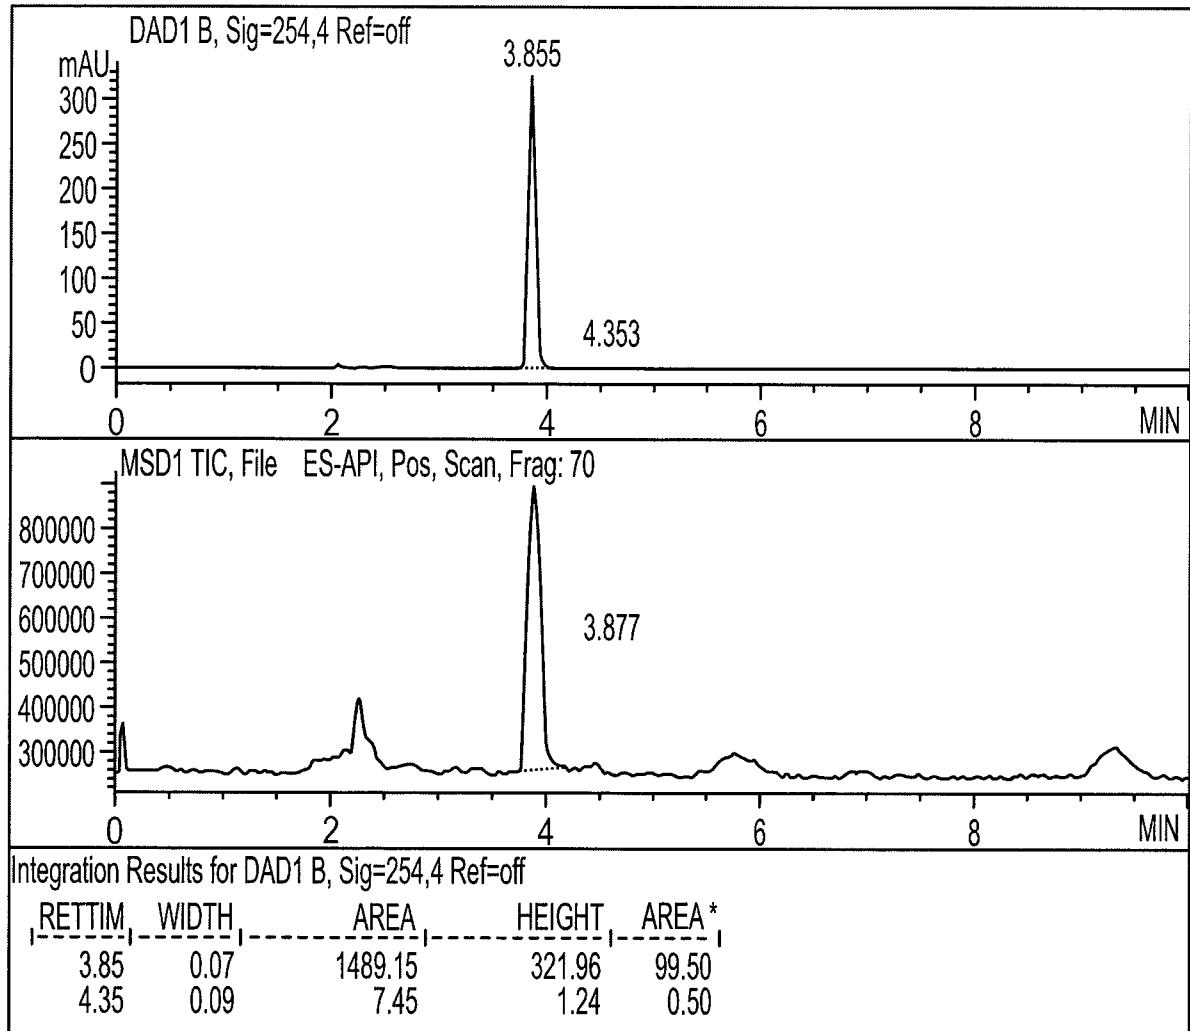

Ret. TIME: 3.88

<<<< POSITIVE SPECTRA >>>>

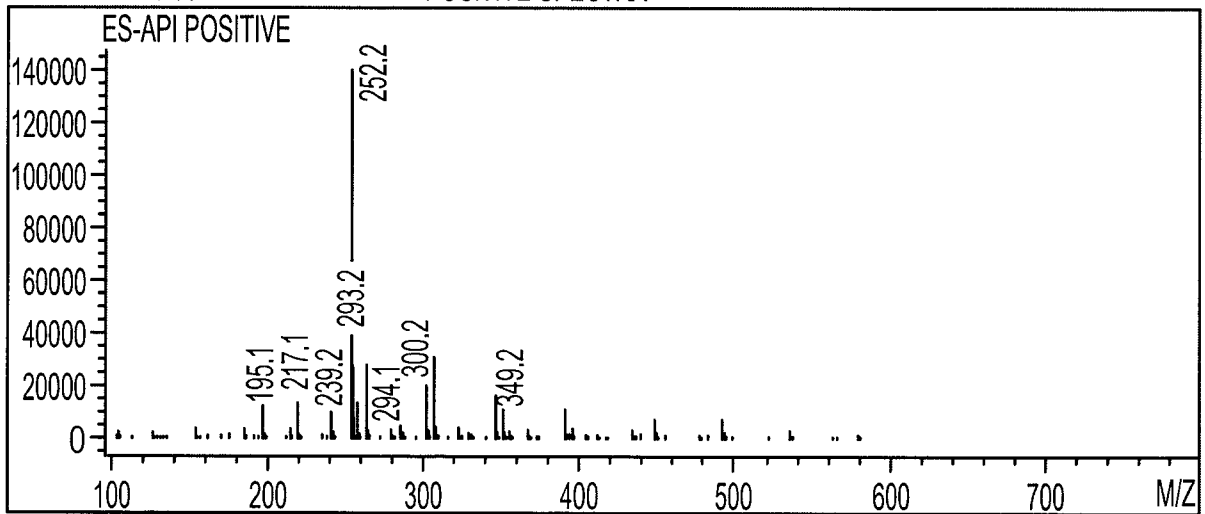


FIG. 9


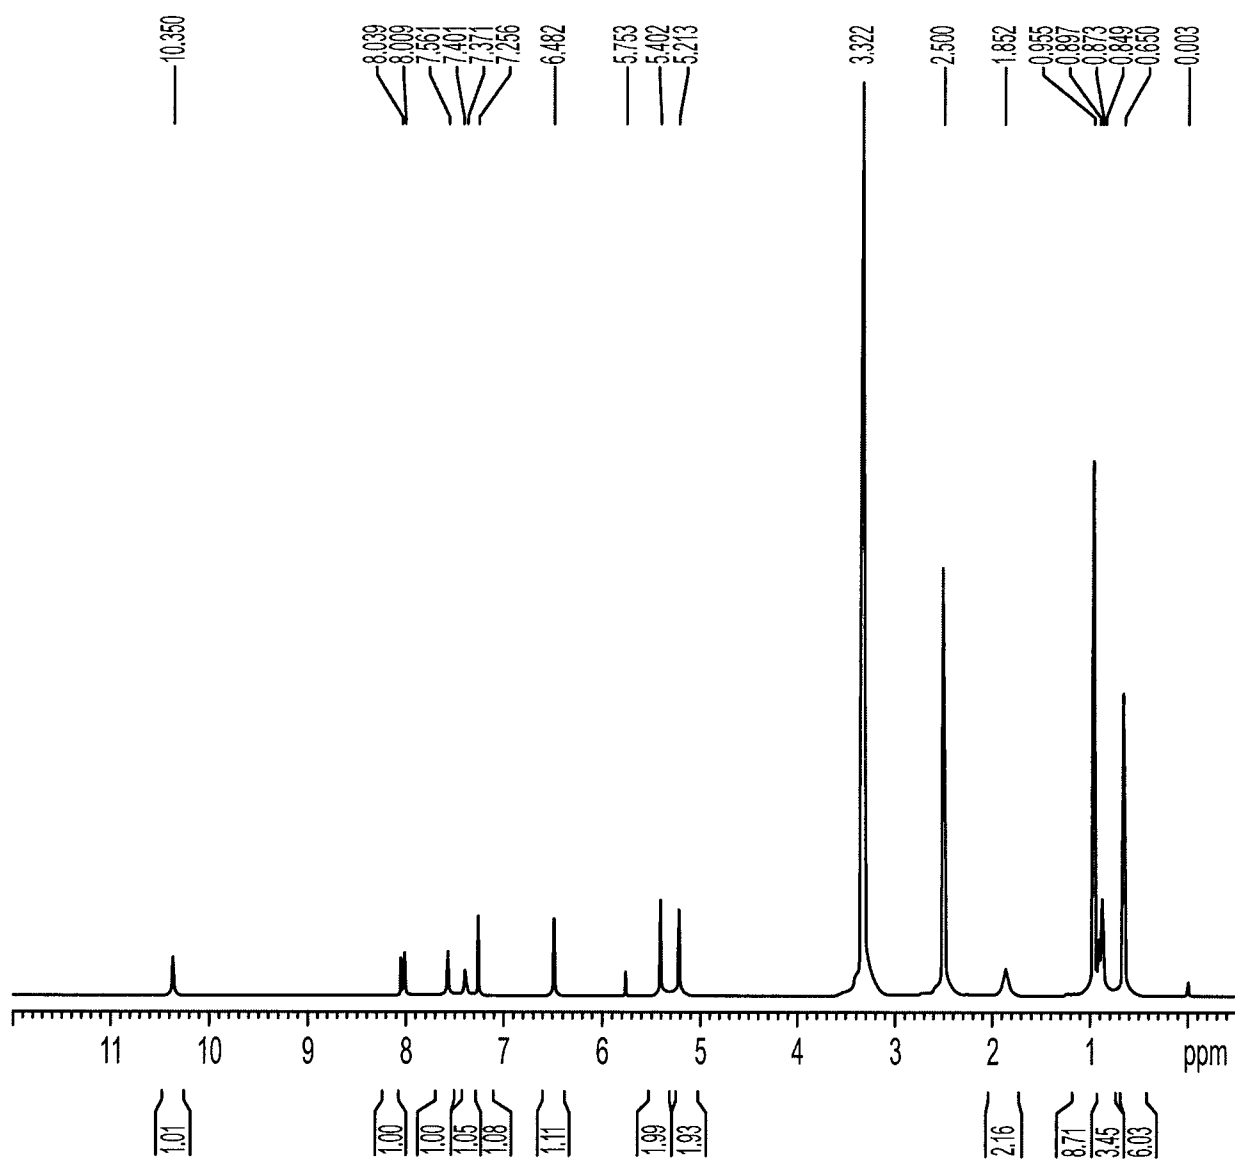


FIG. 10

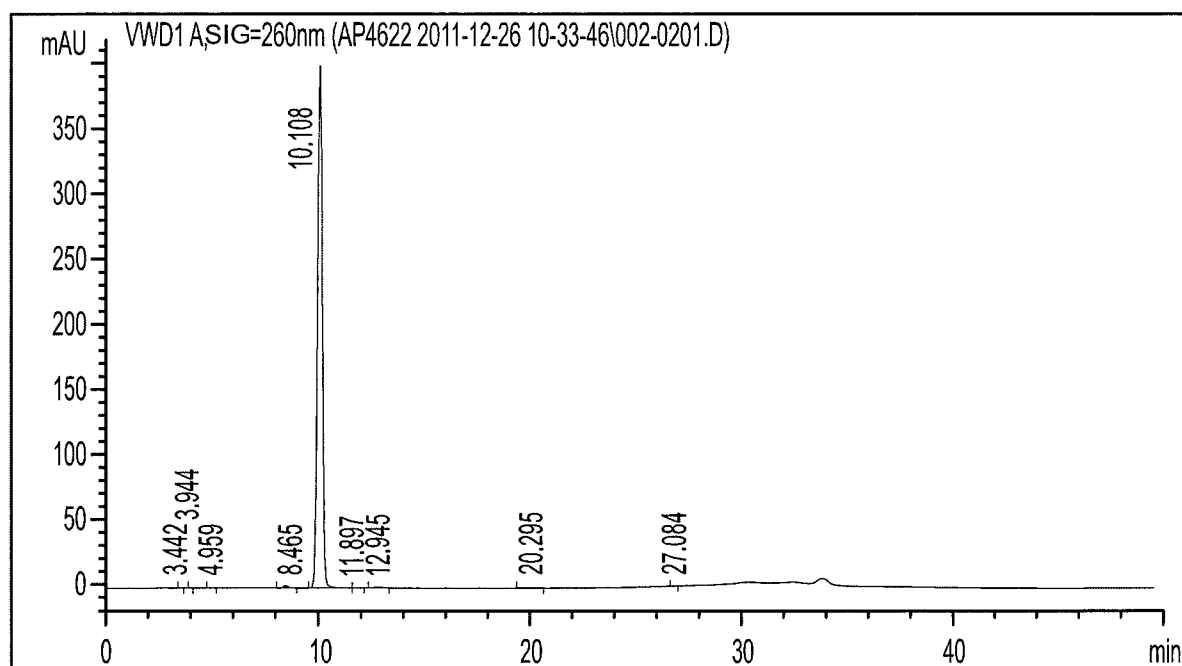

#	[min]	[min]	mAU	*s	[mAU]	%
1	3.442	FMR	0.1166	1.38086	1.97397e-1	0.0226
2	3.944	FMR	0.1008	1.31994	2.18190e-1	0.0216
3	4.959	MMR	0.2390	1.56692	1.09278e-1	0.0257
4	8.465	MMR	0.2282	26.19169	1.91301	0.4288
5	10.108	MFR	0.2539	6060.63135	397.78159	99.2249
6	11.897	FMR	0.3402	1.60059	7.84240e-2	0.0262
7	12.945	MMR	0.4250	11.43340	4.48417e-1	0.1872
8	20.295	MMR	0.6609	2.64302	6.66566e-2	0.0433
9	27.084	MMR	0.1967	1.20907	7.64238e-2	0.0198
			6107.97685	400.88938		

FIG. 11

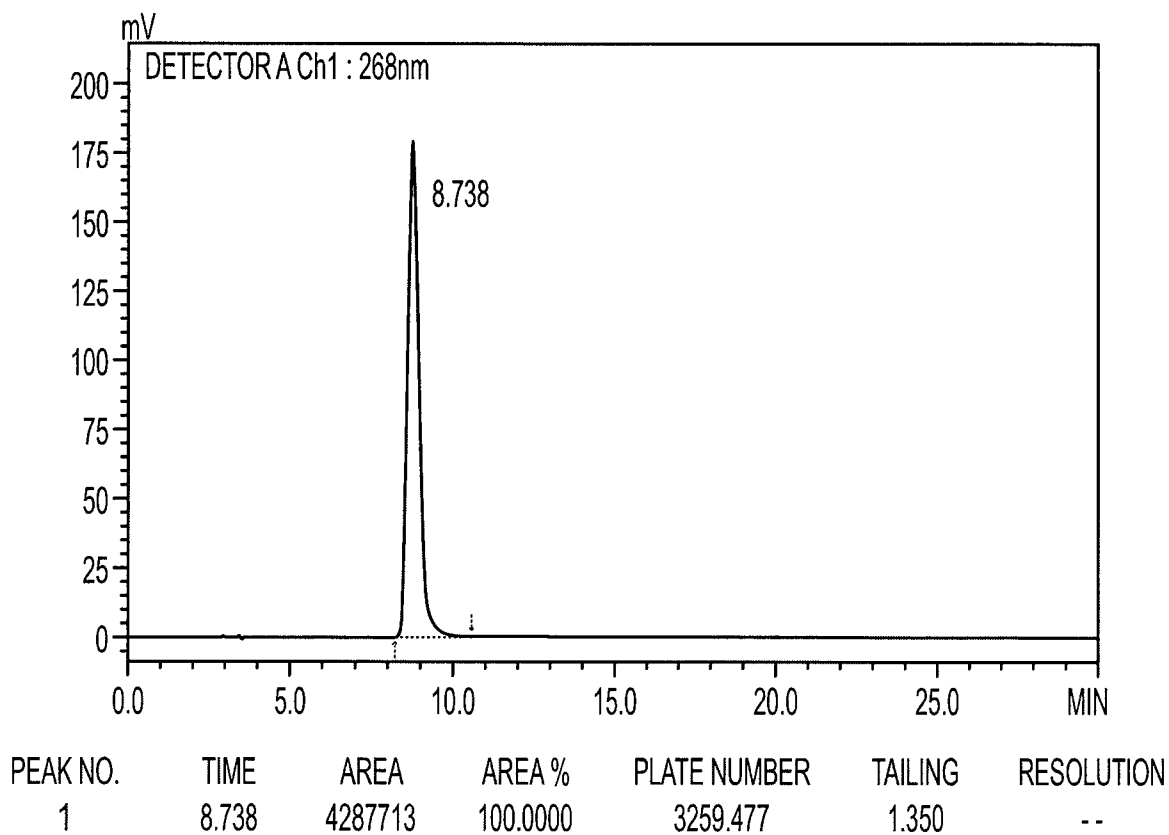
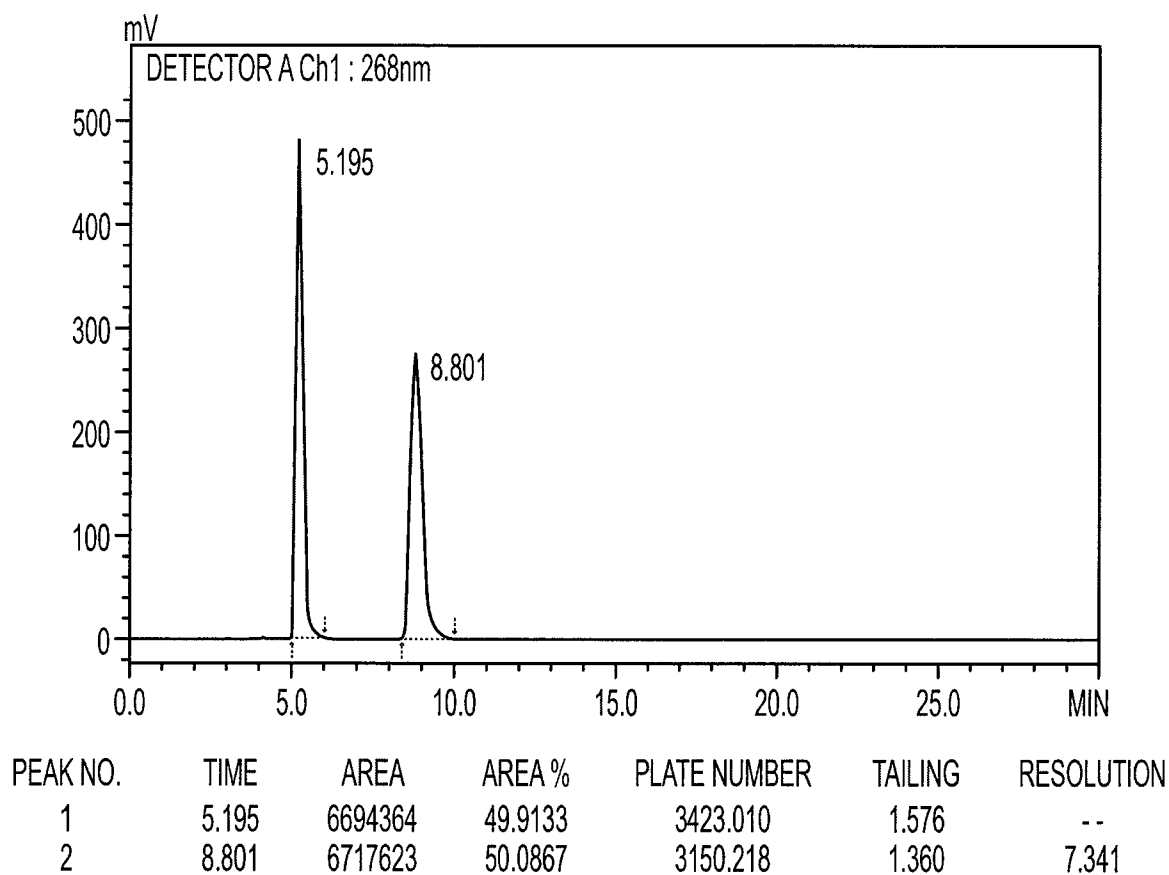


FIG. 12

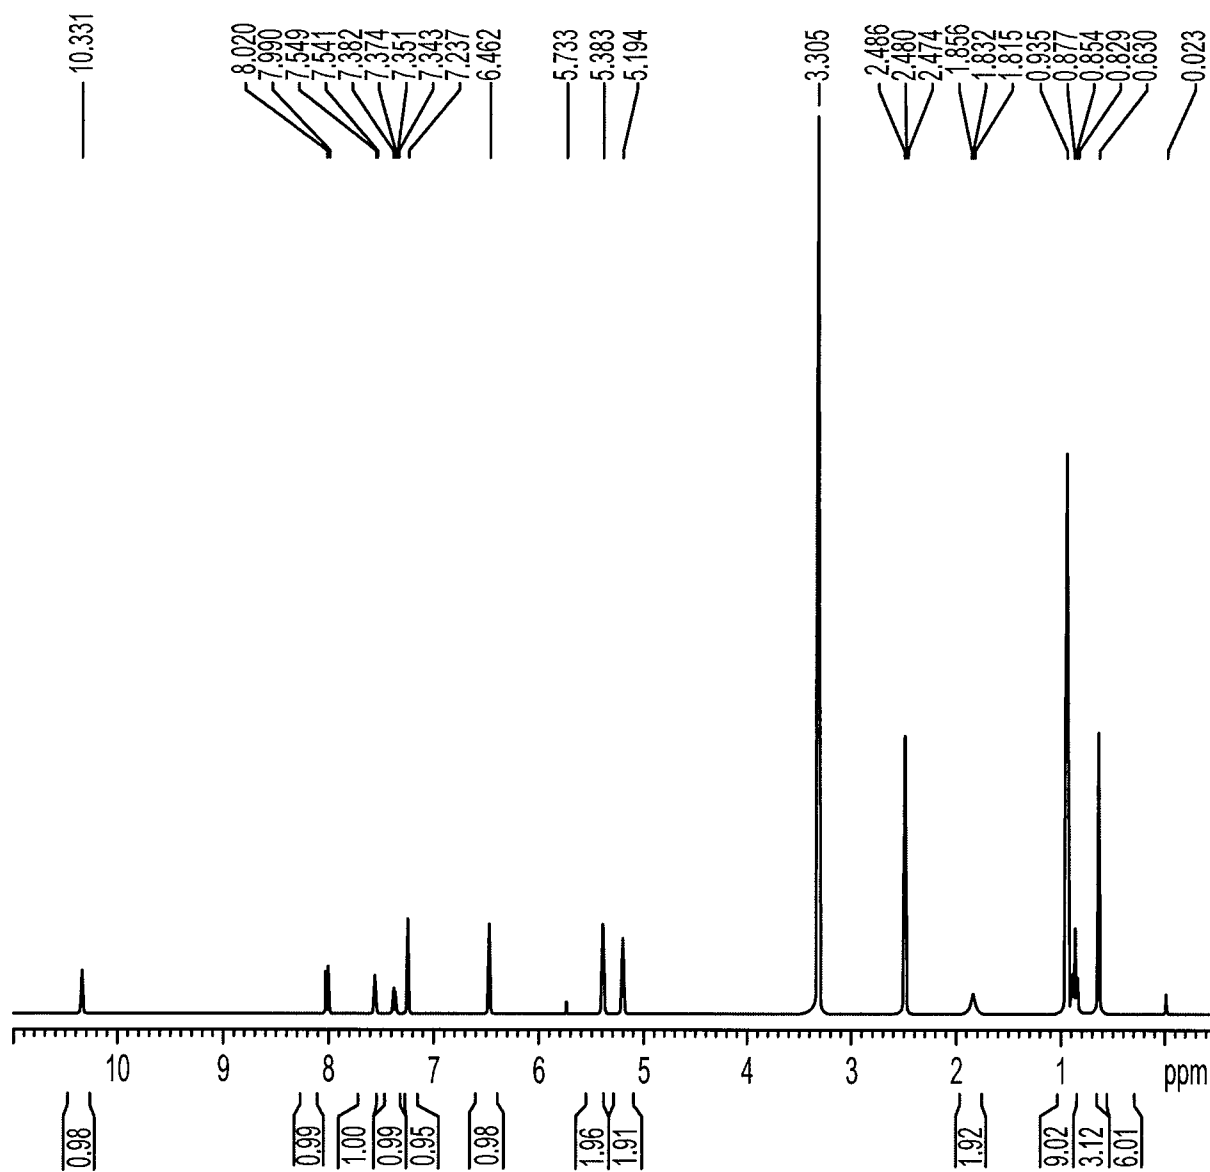


FIG. 13