

FIG. 1

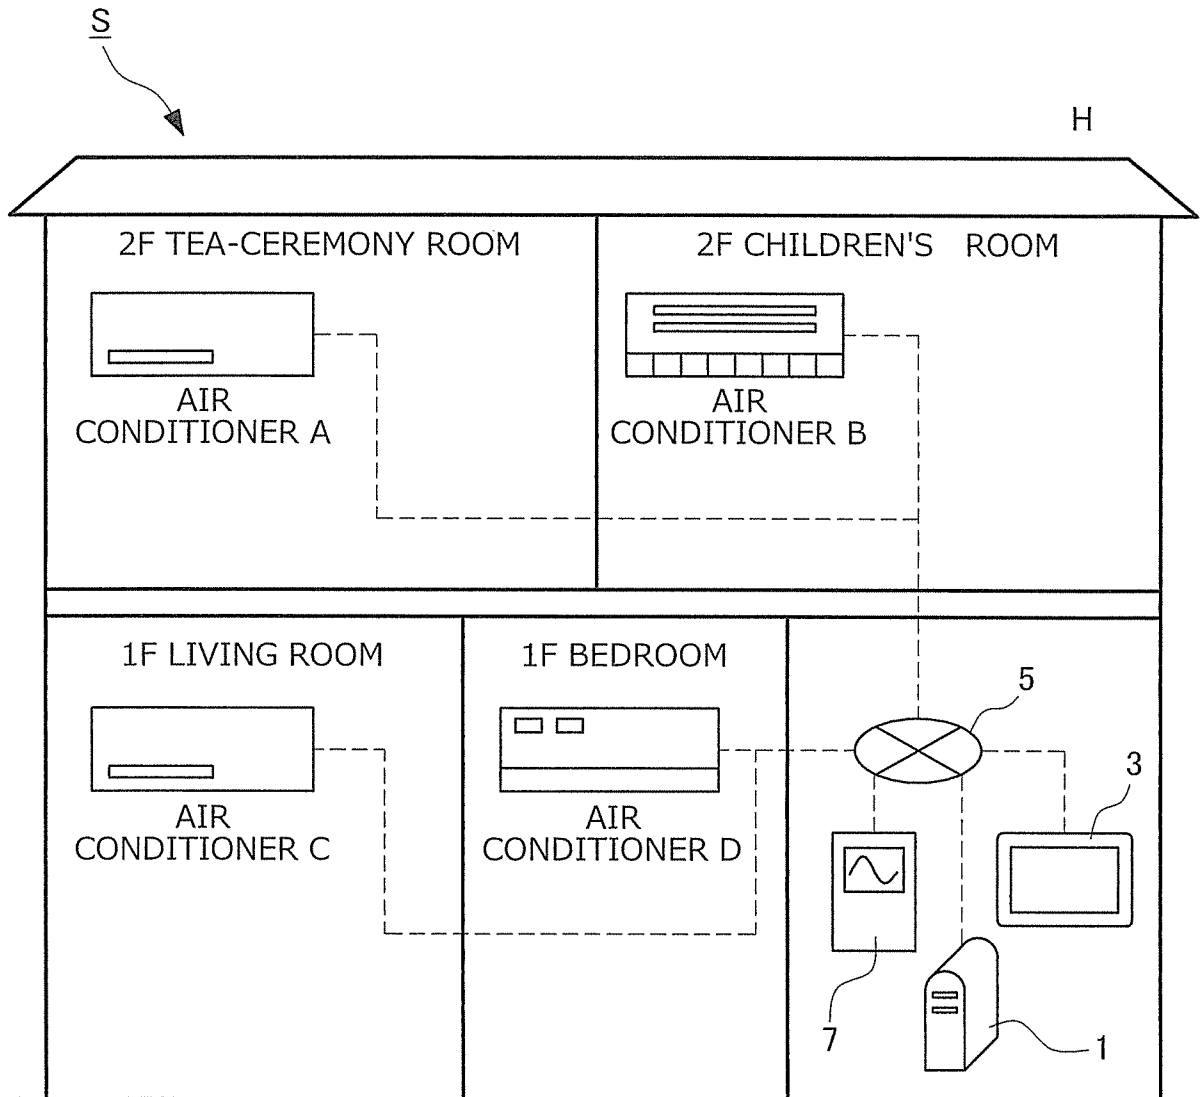


FIG. 2

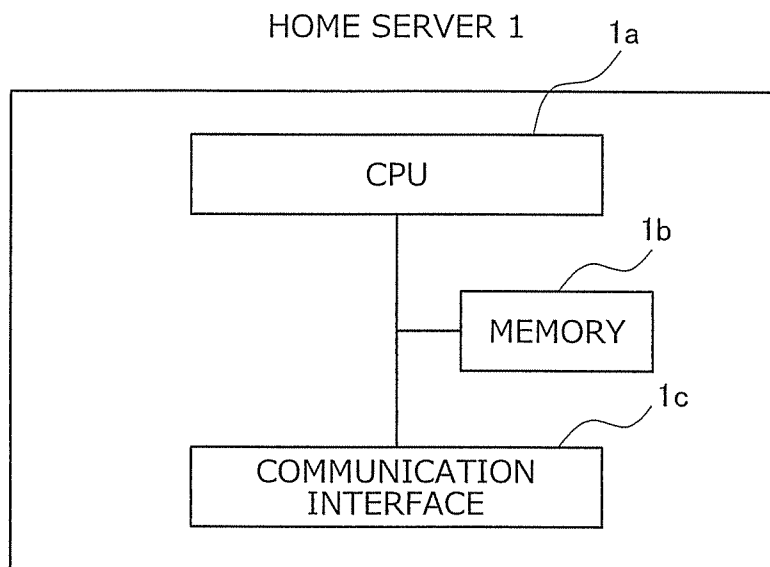


FIG. 3

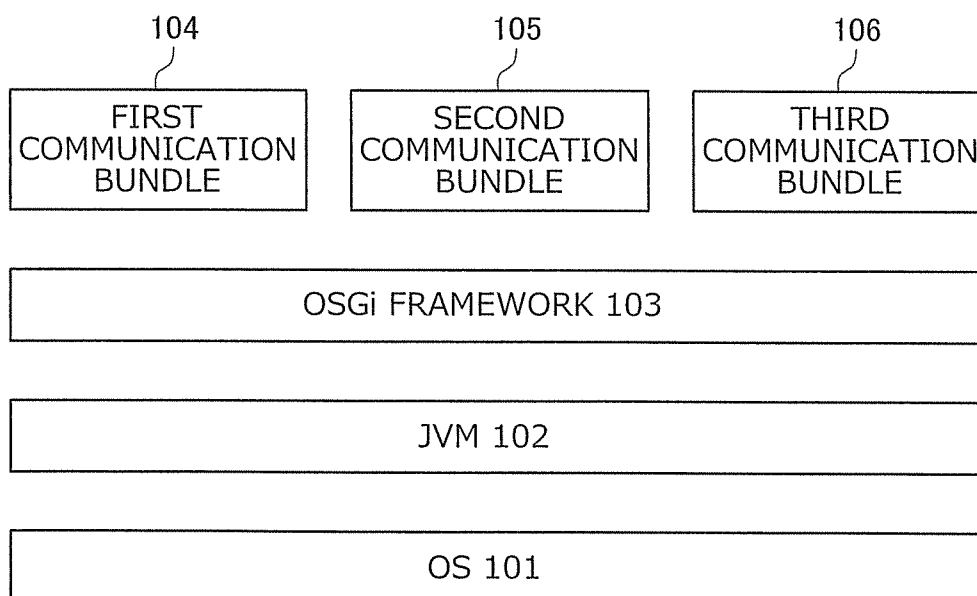


FIG. 4

● SCHEDULE IMAGE 1

COOLING-COMFORT IN OCCUPIED ROOMS

	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
room 1	OFF									20				OFF										

SCHEDULE SETTING REQUEST 1

<http://aircondition?type=scheduleset&mode=c1&deviceid=room1&t0000=OFF&t0900=20&t1300=OFF>

INDIVIDUAL SCHEDULE PROPERTY

```
room1_c1_0000=OFF
room1_c1_0900=20
room1_c1_1300=OFF
```

● SCHEDULE IMAGE 2

HEATING-JUST COMFORT

	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
room 3	OFF							 29							OFF				MANUAL SETTING PRIORITY					

SCHEDULE SETTING REQUEST 2

<http://aircondition?type=scheduleset&mode=h2&deviceid=room3&t0000=OFF&t0700=29&t1400=OFF&t1830=ANY>

INDIVIDUAL SCHEDULE PROPERTY

```
room1_c1_0000=OFF
room1_c1_0900=20
room1_c1_0000=OFF
room3_h2_0000=OFF
room3_h2_0700=29
room3_h2_1400=OFF
room3_h2_1830=ANY
```

FIG. 5

"INDIVIDUAL SCHEDULE PROPERTY" BEFORE RESET

```
room1_c1_0000=OFF
room1_c1_0900=20
room1_h2_1300=OFF
room2_h2_0000=OFF
room2_h2_1300=27
room2_h2_2200=ANY
room2_ho1_2200=ANY
```

REQUEST FOR RESET

<http://aircondition?type=scheduleclear&mode=h2>

"INDIVIDUAL SCHEDULE PROPERTY" AFTER RESET

```
room1_c1_0000=OFF
room1_c1_0900=20
room2_ho1_2200=ANY
```

FIG. 6

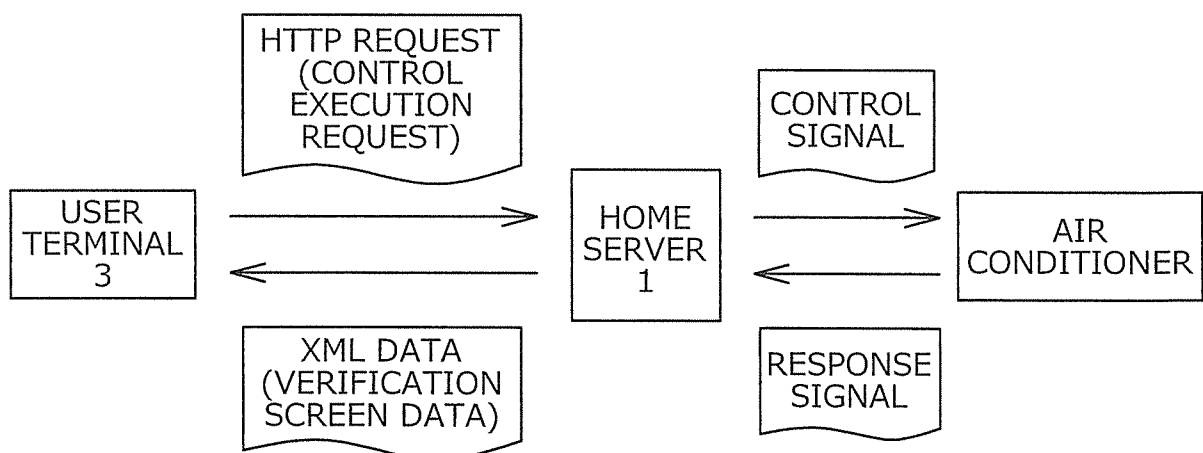


FIG. 7

◆ DETAILS OF DEFAULT MODES (FOR HEATING)

① COMFORT IN OCCUPIED ROOMS

DEVICE ID	TYPE	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
any	LIVING-ROOM/ DINING-ROOM/ KITCHEN	OFF						20°C				17°C				20°C									
any	MAIN BEDROOM	17°C						20°C		OFF												20°C			
any	WESTERN-STYLE ROOM	OFF																							
any	JAPANESE-STYLE ROOM	OFF																							
any	OTHERS	OFF																							
any	HALLWAY	17°C						OFF									17°C								

② JUST COMFORT

DEVICE ID	TYPE	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
any	LIVING-ROOM/ DINING-ROOM/ KITCHEN	OFF						20°C				17°C				20°C									
any	MAIN BEDROOM	17°C						20°C		OFF												20°C			
any	WESTERN-STYLE ROOM	17°C						20		OFF						20°C									
any	JAPANESE-STYLE ROOM	OFF																							
any	OTHERS	OFF																							
any	HALLWAY	17°C						OFF									17°C								

③ EVERYWHERE COMFORT

DEVICE ID	TYPE	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
any	LIVING-ROOM/ DINING-ROOM/ KITCHEN	17°C				20°C				17°C				20°C											
any	MAIN BEDROOM	17°C				20°C		17°C												20°C					
any	WESTERN-STYLE ROOM	17°C				20		17°C				20°C													
any	JAPANESE-STYLE ROOM	17°C																							
any	OTHERS	17°C																							
any	HALLWAY	17°C																							

④ CONTINUED IN WHOLE HOUSE

HEATING OPERATION FOR ALL ROOMS IS CONDUCTED
AT 20°C FOR 24 HOURS

FIG. 8

UPDATE PANEL

AIR CONDITIONER

AIR CONDITIONER A▼

START TIME

8▼ : 00▼

END TIME

10▼ : 30▼

ON/OFF

OFF▼

SET TEMPERATURE

29°C▼

UPDATE

Bt4

FIG. 9

EXAMPLE OF DEFAULT SCHEDULE WHEN SET TO "COMFORT IN OCCUPIED ROOMS"

DEVICE ID	LOCATION	ROOM TYPE	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
any	LIVING ROOM	LIVING-ROOM/ DINING-ROOM/ KITCHEN	OFF			20°C			17°C			20°C														
any	MAIN BEDROOM	MAIN BEDROOM	17°C			20°C			OFF			20°C														
any	BOY'S ROOM	WESTERN-STYLE ROOM							OFF																	
any	GIRL' S ROOM	WESTERN-STYLE ROOM							OFF																	
any	WORK ROOM	WESTERN-STYLE ROOM							OFF																	
any	TEA-SEREMONY ROOM	JAPANESE-STYLE ROOM							OFF																	
any	ENTRYWAY	HALLWAY	17°C						OFF			17°C														

EXAMPLE OF CUSTOMIZED "COMFORT IN OCCUPIED ROOMS"

DEVICE ID	LOCATION	ROOM TYPE	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	
any	LIVING ROOM	LIVING-ROOM/ DINING-ROOM/ KITCHEN	OFF			20°C			17°C			20°C			20°C												
any	MAIN BEDROOM	MAIN BEDROOM	17°C			20°C			OFF			20°C															
any	BOY'S ROOM	WESTERN-STYLE ROOM							OFF																		
any	GIRL' S ROOM	WESTERN-STYLE ROOM							OFF																		
room5	WORK ROOM	WESTERN-STYLE ROOM	OFF			20°C			19°C			20°C															
any	TEA-SEREMONY ROOM	JAPANESE-STYLE ROOM							OFF			20°C			19°C			20°C									
any	ENTRYWAY	HALLWAY	17°C						OFF			17°C			17°C												

FIG. 10

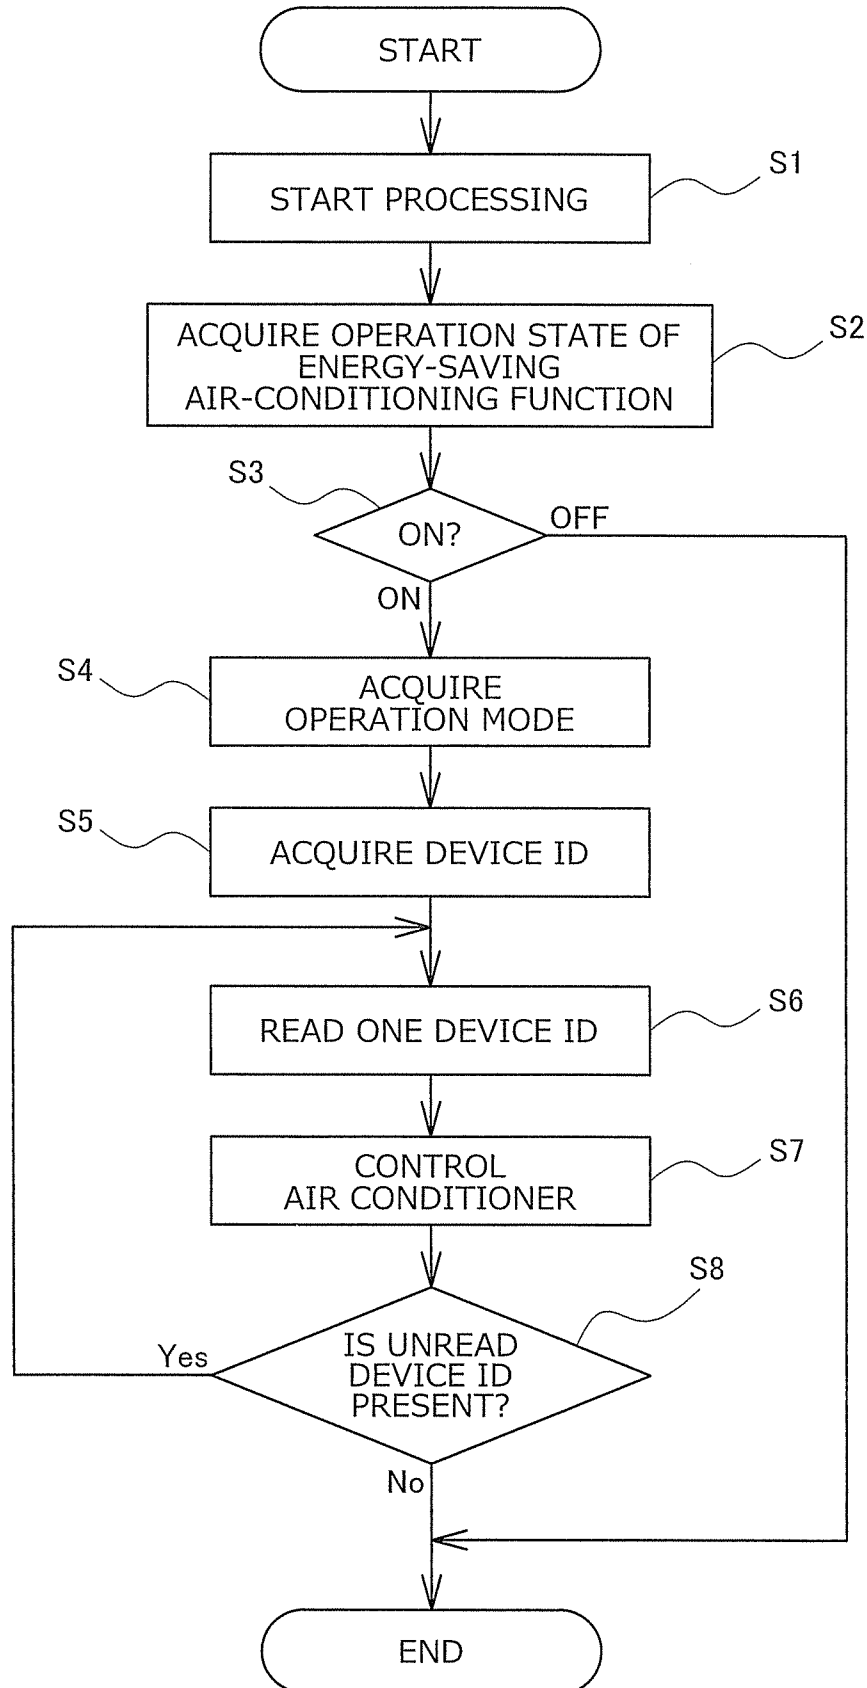


FIG. 11

