

FIG.1

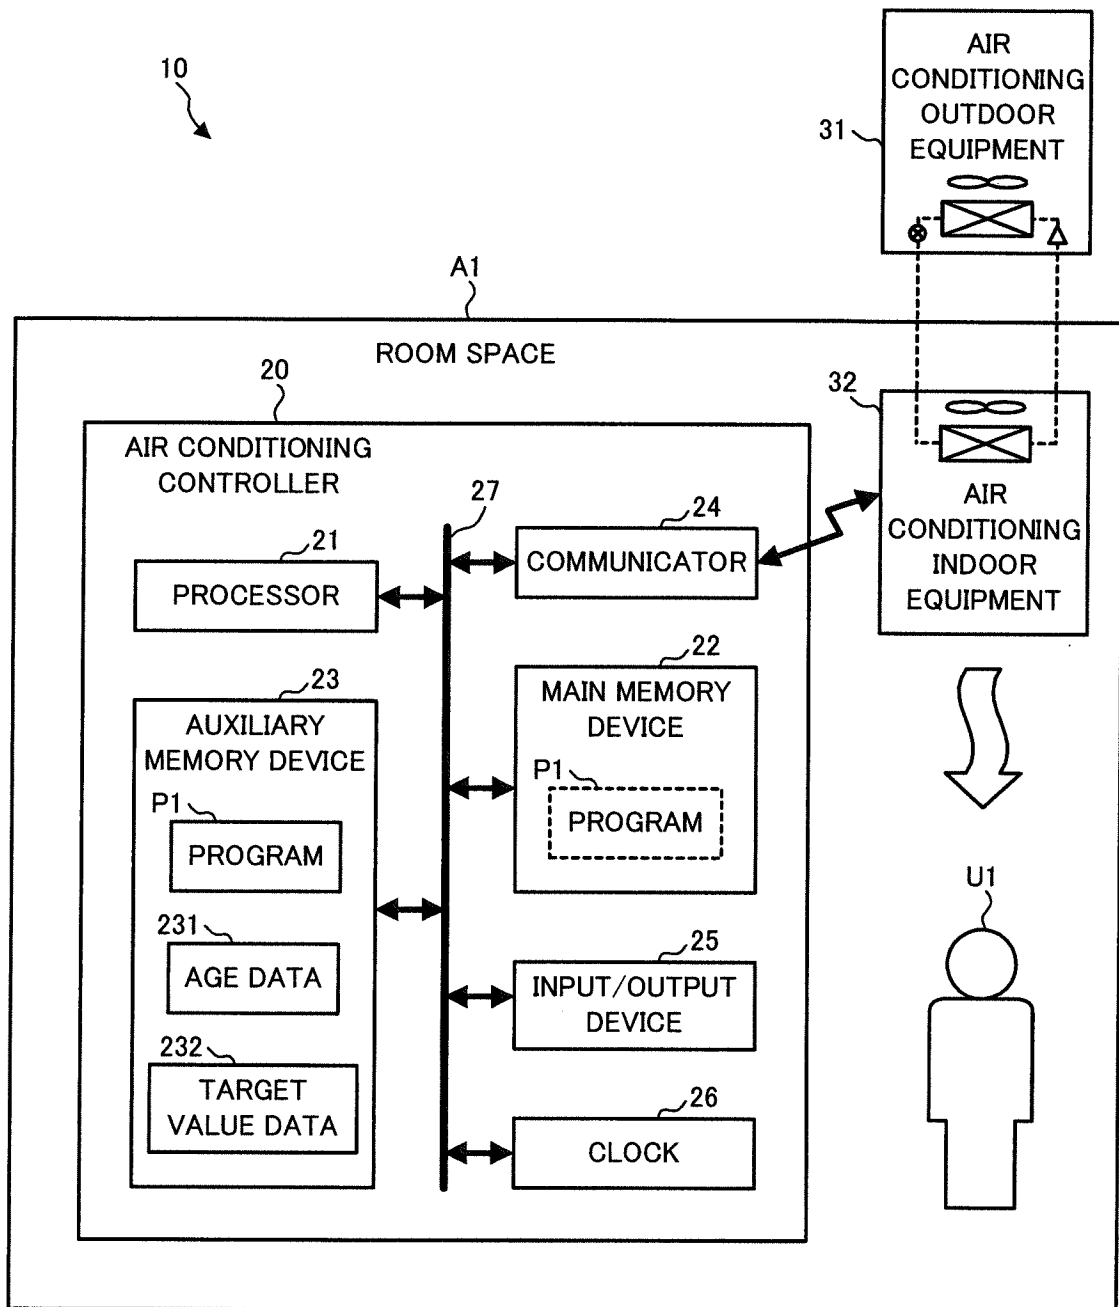


FIG.2

232

AGE	STATUS OF AIR IN ROOM SPACE (AIR CONDITIONING TARGET VALUES)			
	TEMPERATURE	HUMIDITY	AIRFLOW (DIRECTION/VOLUME)	DUST DENSITY
AGE 0-5	20-27°C	50%	0.5-1.0 m/s	0.10 mg/m ³
AGE 6-10	16-27°C	45-55%	0.5-1.0 m/s	0.15 mg/m ³
AGE 11-15	16-28°C	40-60%	0.5-1.0 m/s	0.15 mg/m ³
AGE 16-20	17-28°C	40-60%	0.5-1.0 m/s	0.15 mg/m ³
AGE 21-25	18-28°C	40-60%	0.1-1.0 m/s	0.15 mg/m ³
AGE 56-60	22-28°C	40-60%	0.1-1.0 m/s	0.15 mg/m ³
AGE 61-65	23-28°C	40-60%	0.1-1.0 m/s	0.15 mg/m ³
AGE 66-70	24-28°C	45-55%	USER SETTING	0.10 mg/m ³
OVER AGE 70	25-28°C	50%	USER SETTING	0.10 mg/m ³

FIG.3

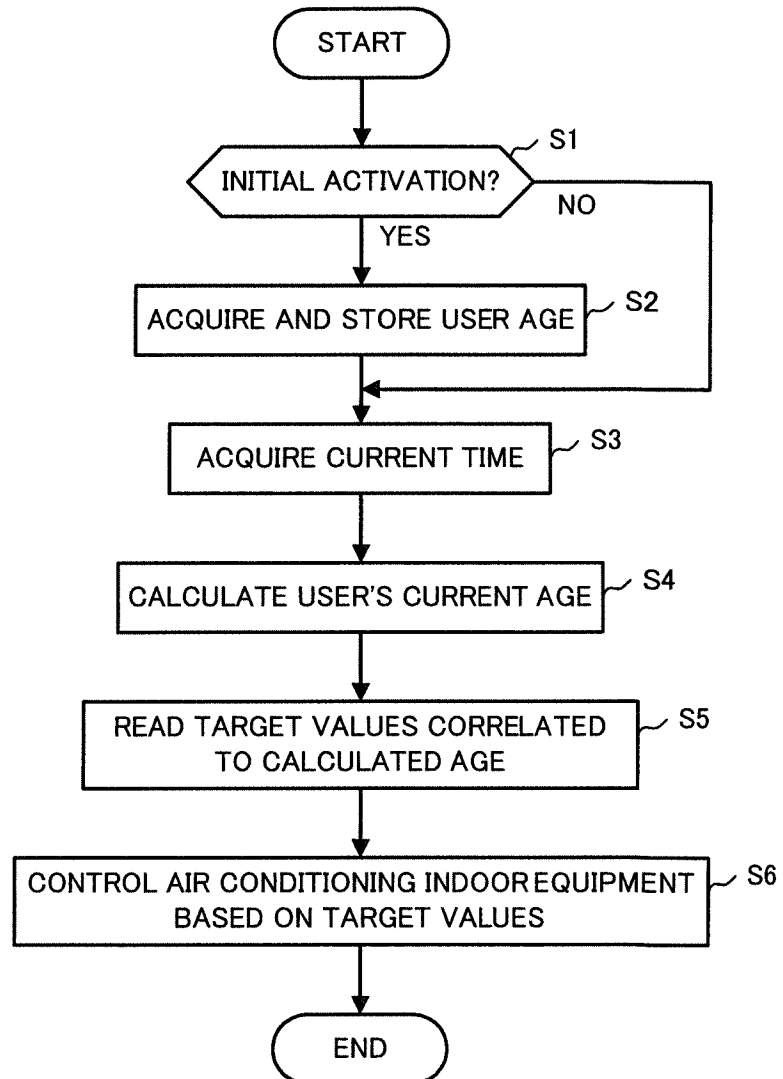


FIG.4


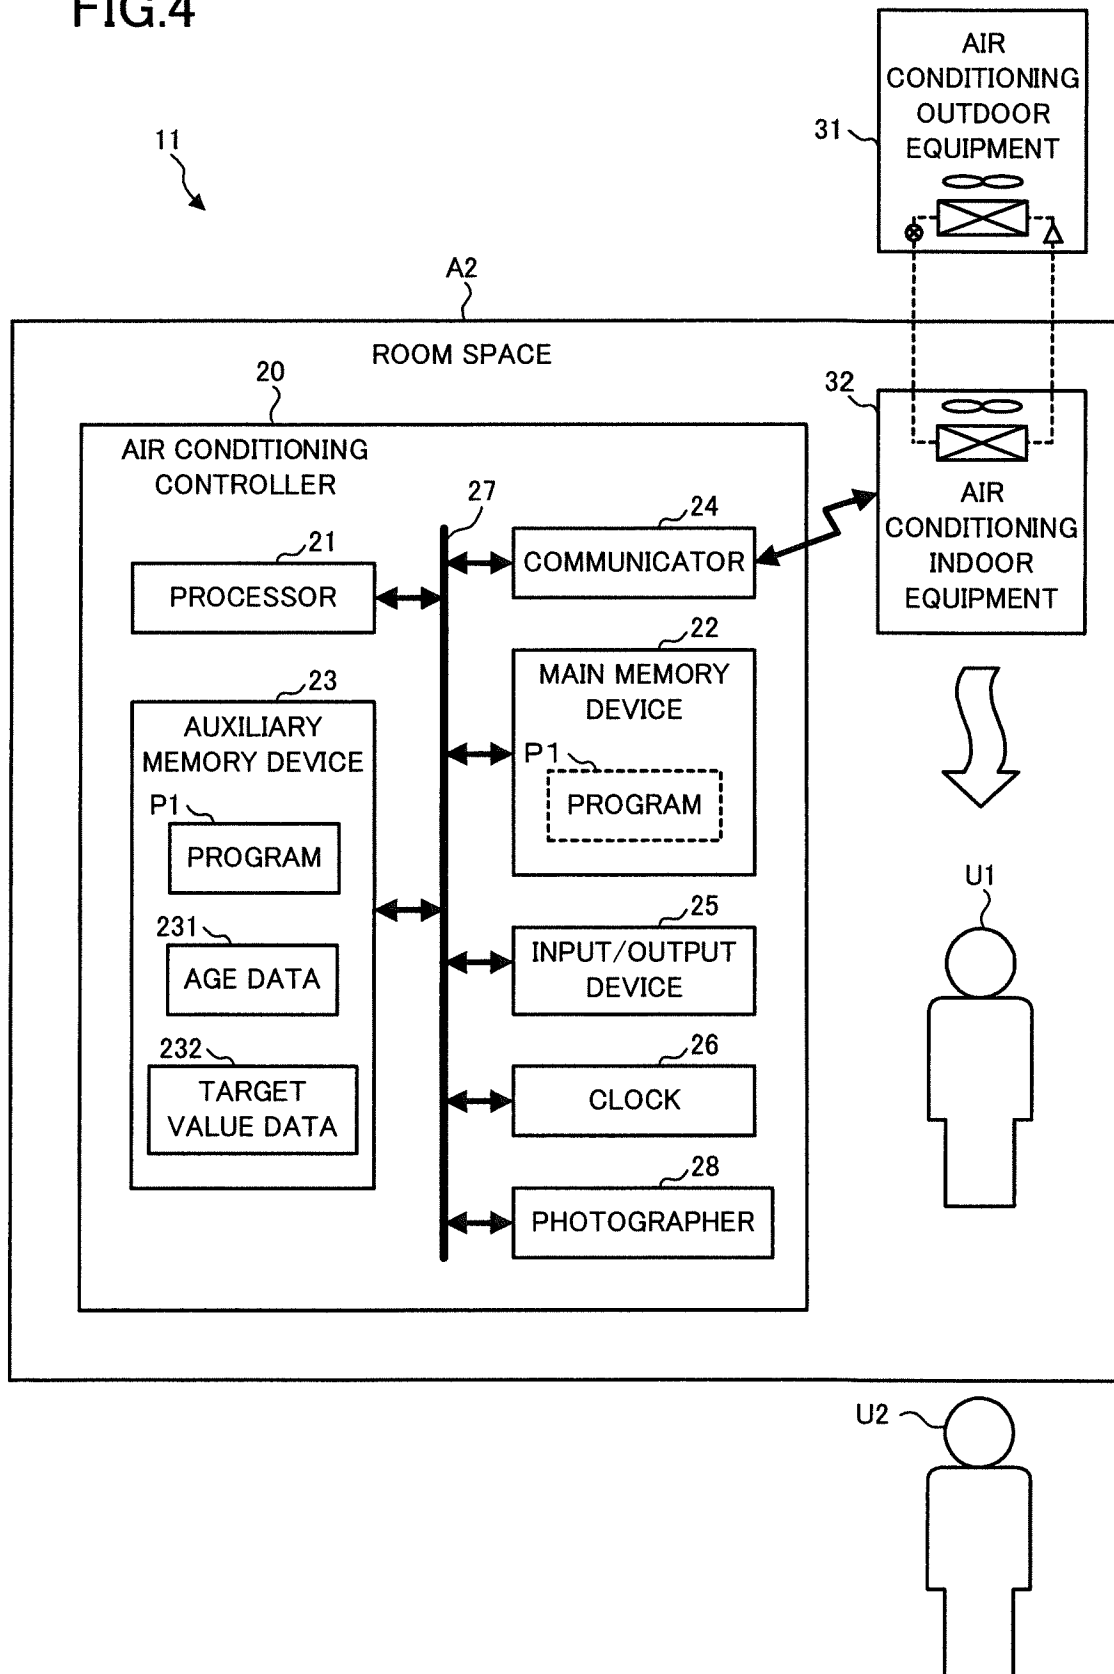


FIG.5

232 ↗

AGE	ATTRIBUTES		STATUS OF AIR IN ROOM SPACE (AIR CONDITIONING TARGET VALUES)			
	SEX	HEALTH STATUS	TEMPERATURE	HUMIDITY	AIRFLOW (DIRECTION/VOLUME)	DUST DENSITY
AGE 0-5	MALE/ FEMALE	NORMAL	20-27°C	50%	0.5-1.0 m/s	0.10 mg/m ³
		FEVERISH, ETC.	23-27°C	50%	0.1-1.0 m/s	0.10 mg/m ³
AGE 6-10	MALE	NORMAL	16-28			
AGE 61-65	MALE	NORMAL	23-28°C	40-60%	0.1-1.0 m/s	0.15 mg/m ³
		HIGH BLOOD PRESSURE	24-28°C	40-60%	0.1-1.0 m/s	0.15 mg/m ³
		⋮	⋮	50-60%	USER SETTING	0.15 mg/m ³
	FEMALE	NORMAL	23-28°C	40-60%	⋮	⋮
		SENSITIVE TO COLD	25-29°C	50-55%	0.1-1.0 m/s	0.15 mg/m ³
		⋮	⋮	⋮	USER SETTING	0.15 mg/m ³
AGE 66-70		NORMAL	24-28°C	⋮	⋮	⋮

FIG.6

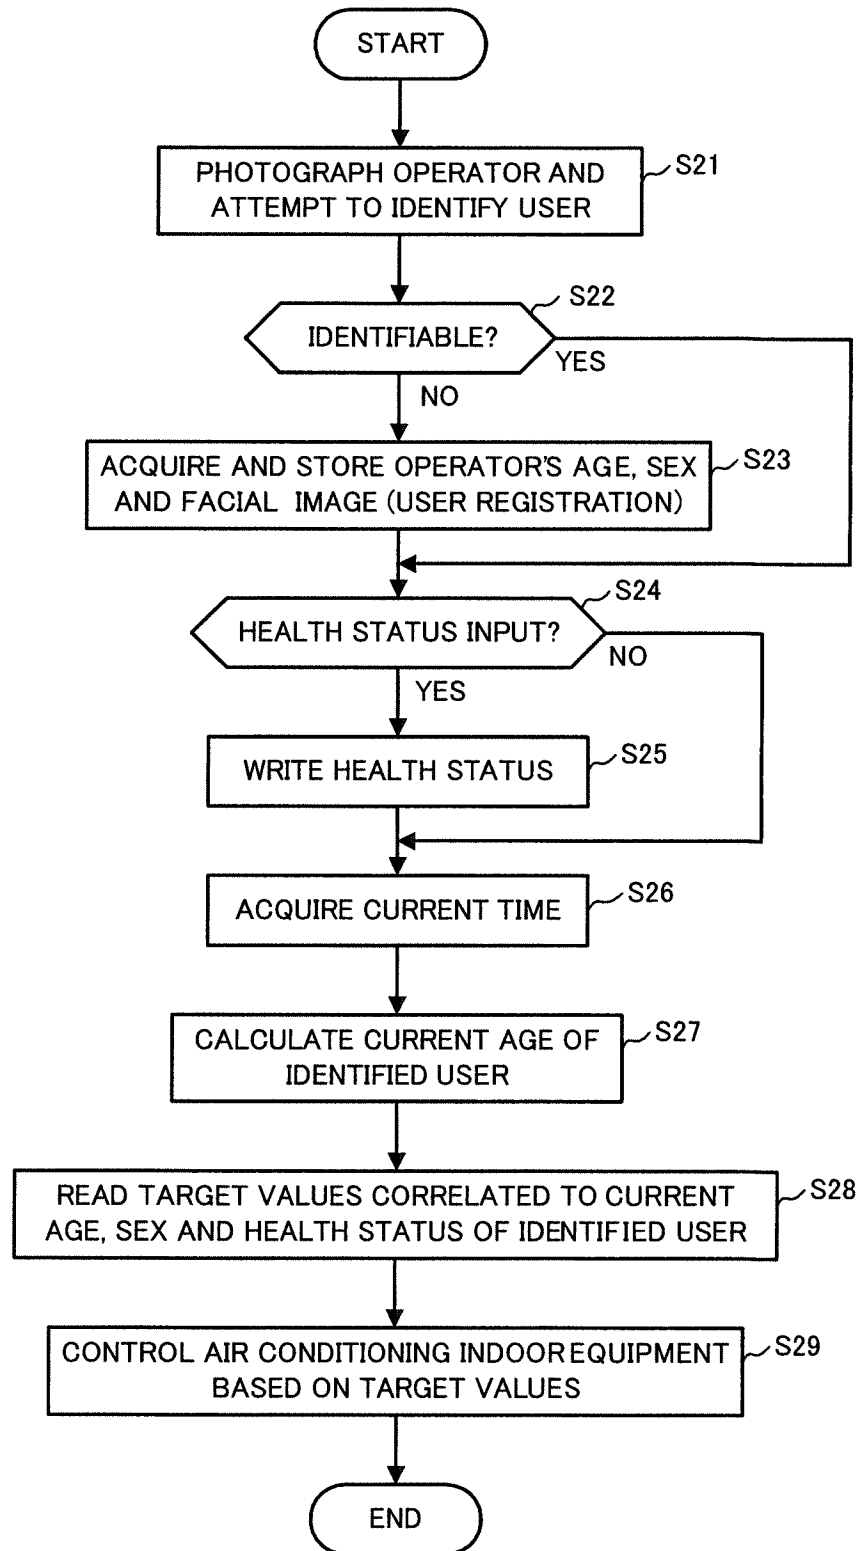

...

STANDARD VALUE (DUST DENSITY)

...

STANDARD VALUE (HUMIDITY)

...

STANDARD VALUE (TEMPERATURE)

232a

USER	TIME					20 - 24	ng/m ³	ng/m ³	%	%	...
	0 - 6	6 - 10	10 - 14	14 - 18	18 - 20						
CHILD	15-26°C	17-27°C	18-28°C	18-28°C	17-27°C	16-26°C					
MOTHER	20-26°C	22-27°C	23-27°C	23-26°C	22-26°C	21-26°C					
...	:	:	:	:	:	:					

232b

CORRECTION VALUE (20-24 HOURS)						DENSITY	g/m ³	g/m ³	g/m ³
CORRECTION VALUE (6-10 HOURS)									
CORRECTION VALUE (0-6 HOURS)						AIRFLOW (DIRECTION/VOLUME)	DUST DENSITY	0.10 mg/m ³	0.15 mg/m ³
AGE	SEX	HEALTH STATUS	TEMPERATURE	HUMIDITY	USER SETTING				
0-5	M/F	FEVERISH	+2°C	+10%					
6-10	M	FEVERISH	+2°C	+10%					
56-60	F	TO COLD	+2°C	+15%	0.1-1.0 m/s				
		HIGH BLOOD PRESSURE	+1°C	+10%					