

Figure 1

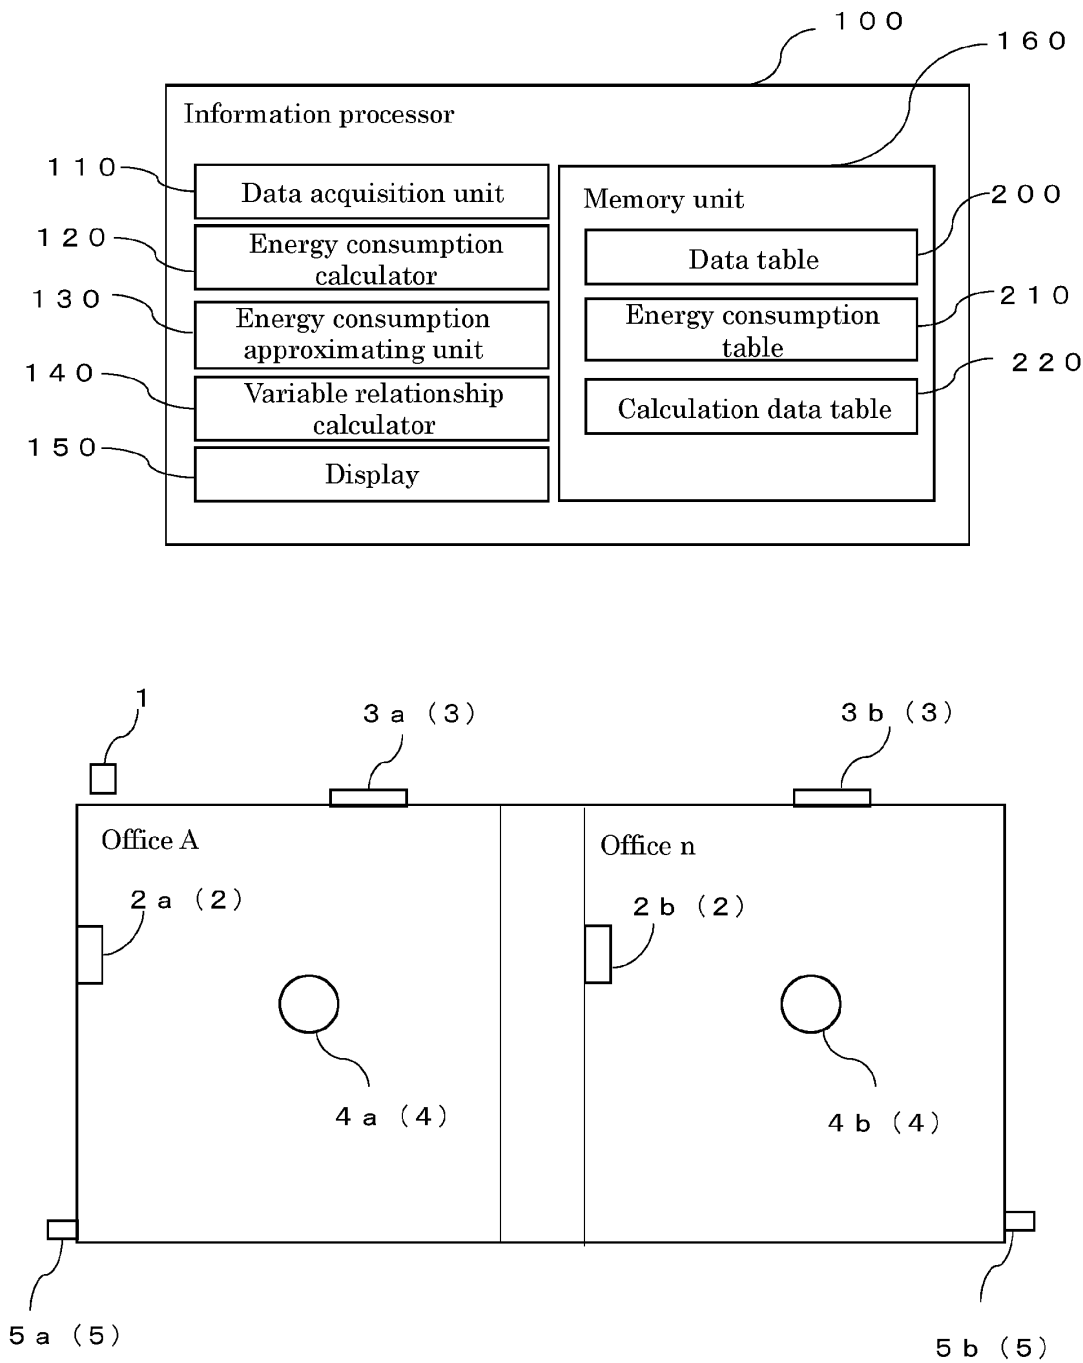


Figure 2

Data table 200

HVAC unit 3a		10:00—10:05(y1)	10:05—10:10(v2)	10:10—10:15(v3)	-----	XX:00—XX:05(yn)	-----
Environmental information	Item						
	Outside air temperature	32.5	33	33.5	-----	33.5	-----
	Indoor temperature	28	26	24	-----	24	-----
	Set temperature	24	24	24	-----	24	-----
	Congestion conditions	60%	80%	30%	-----	30%	-----
Power consumption	Other	XX	XX	XX	-----	XX:00—XX:05(yn)	-----
		1200W	600W	180W	-----	180W	-----

Figure 3


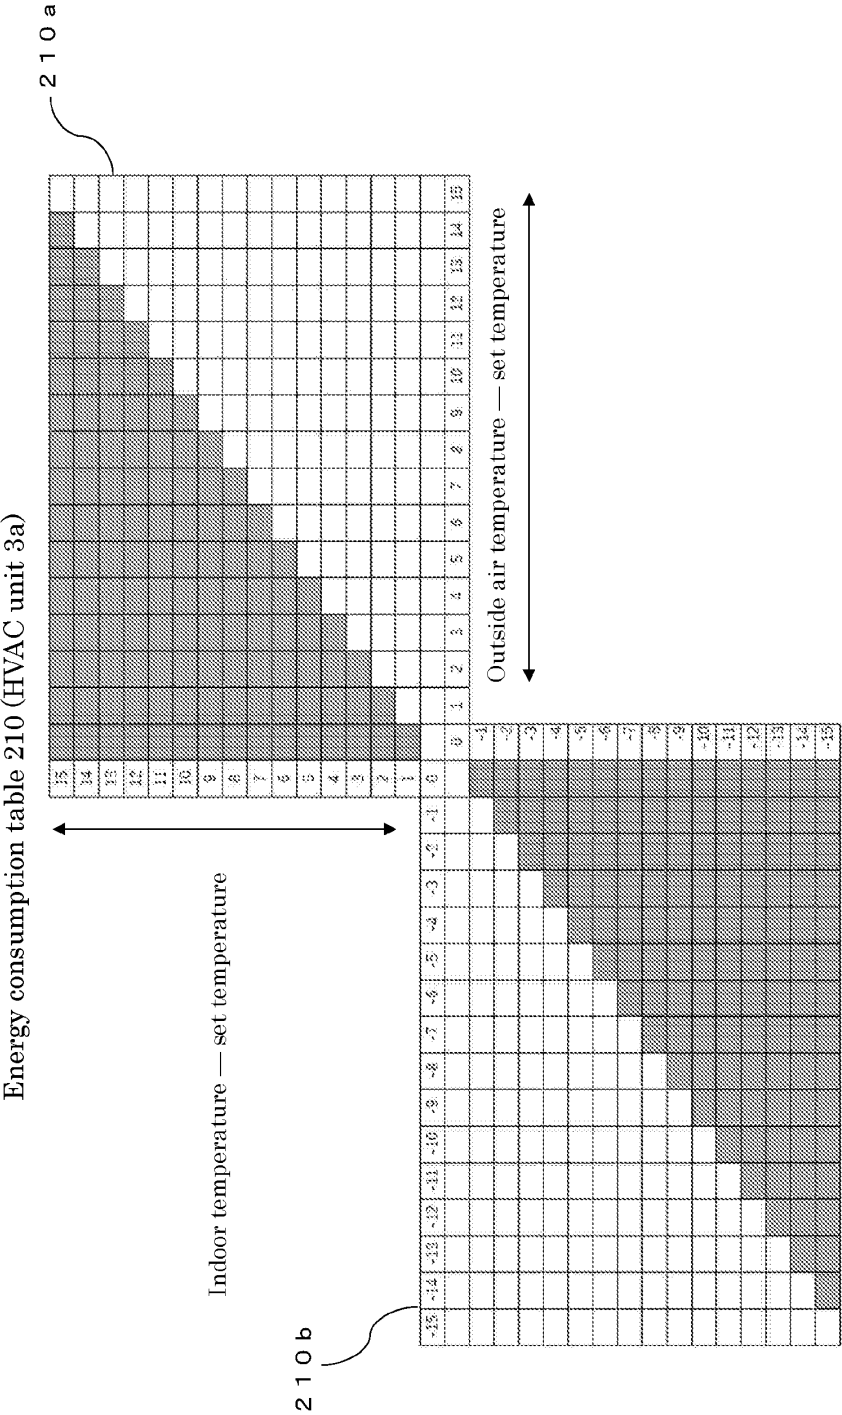


Figure4

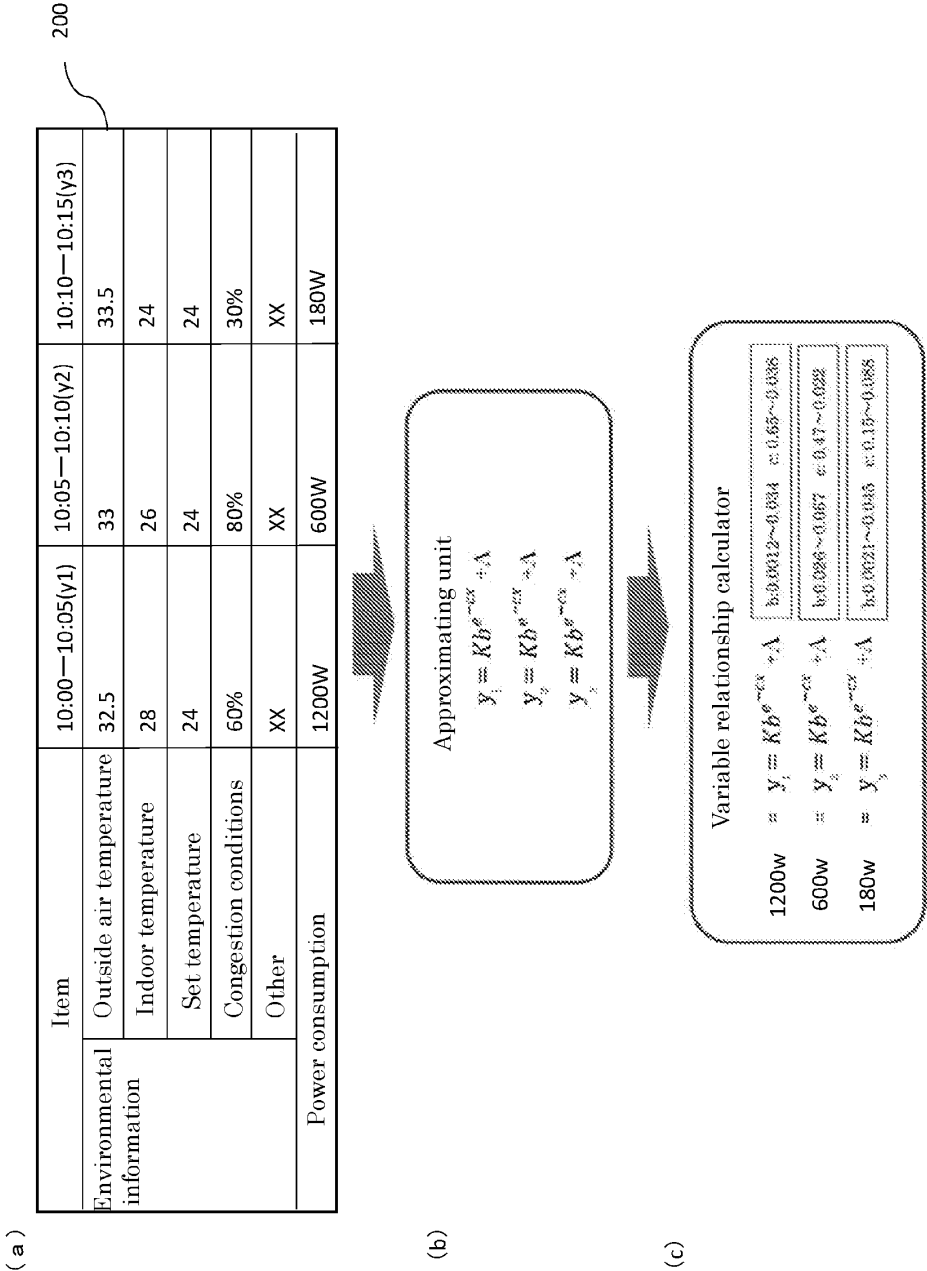

Figures

Energy consumption table 210 (HVAC unit 3a)

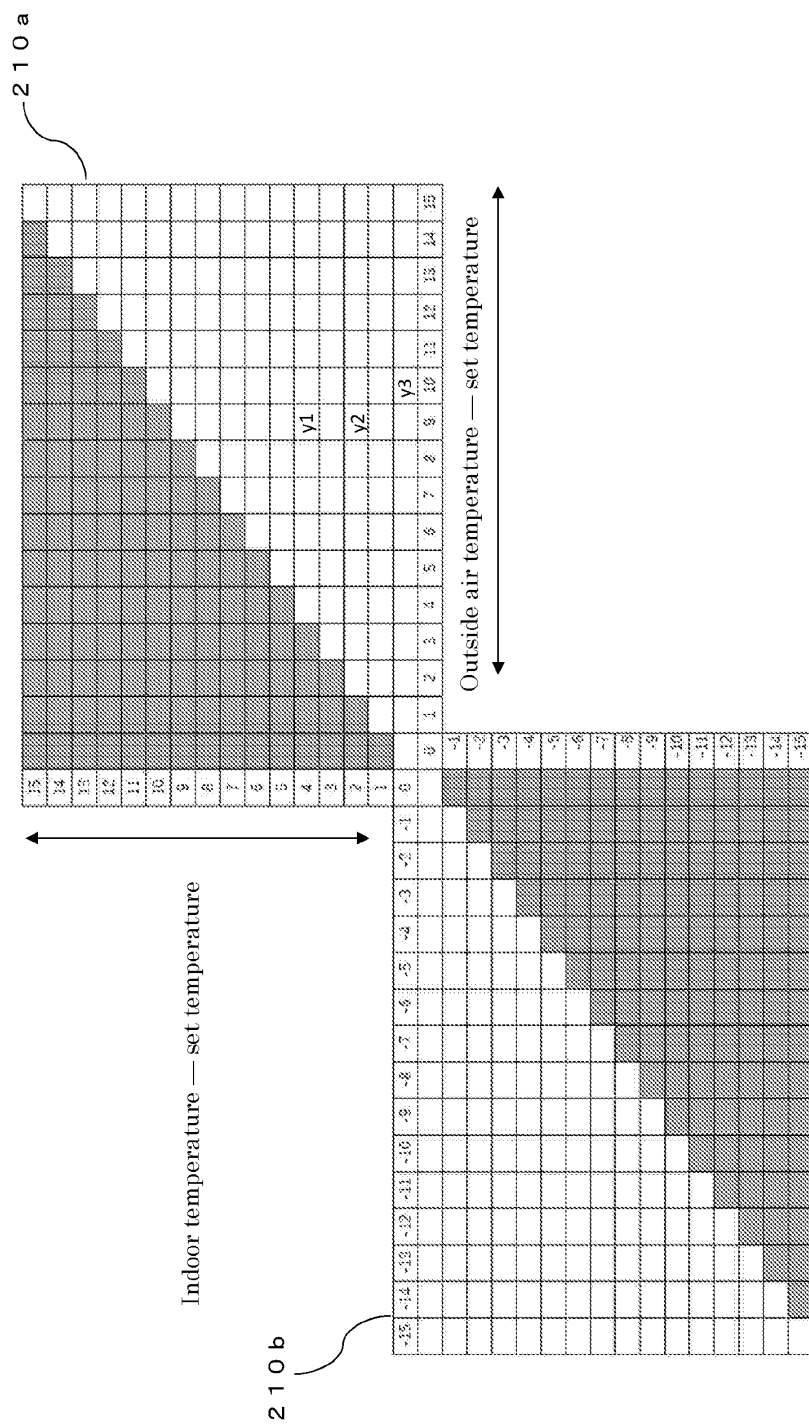


Figure 6

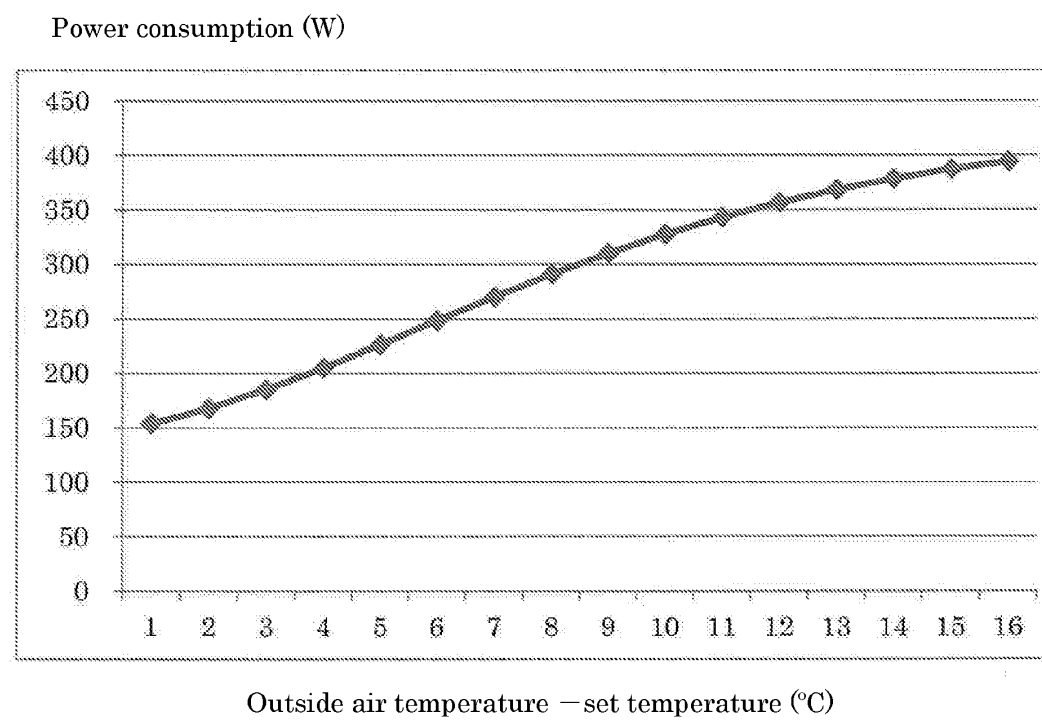


Figure 7

7/8

Power consumption (W)

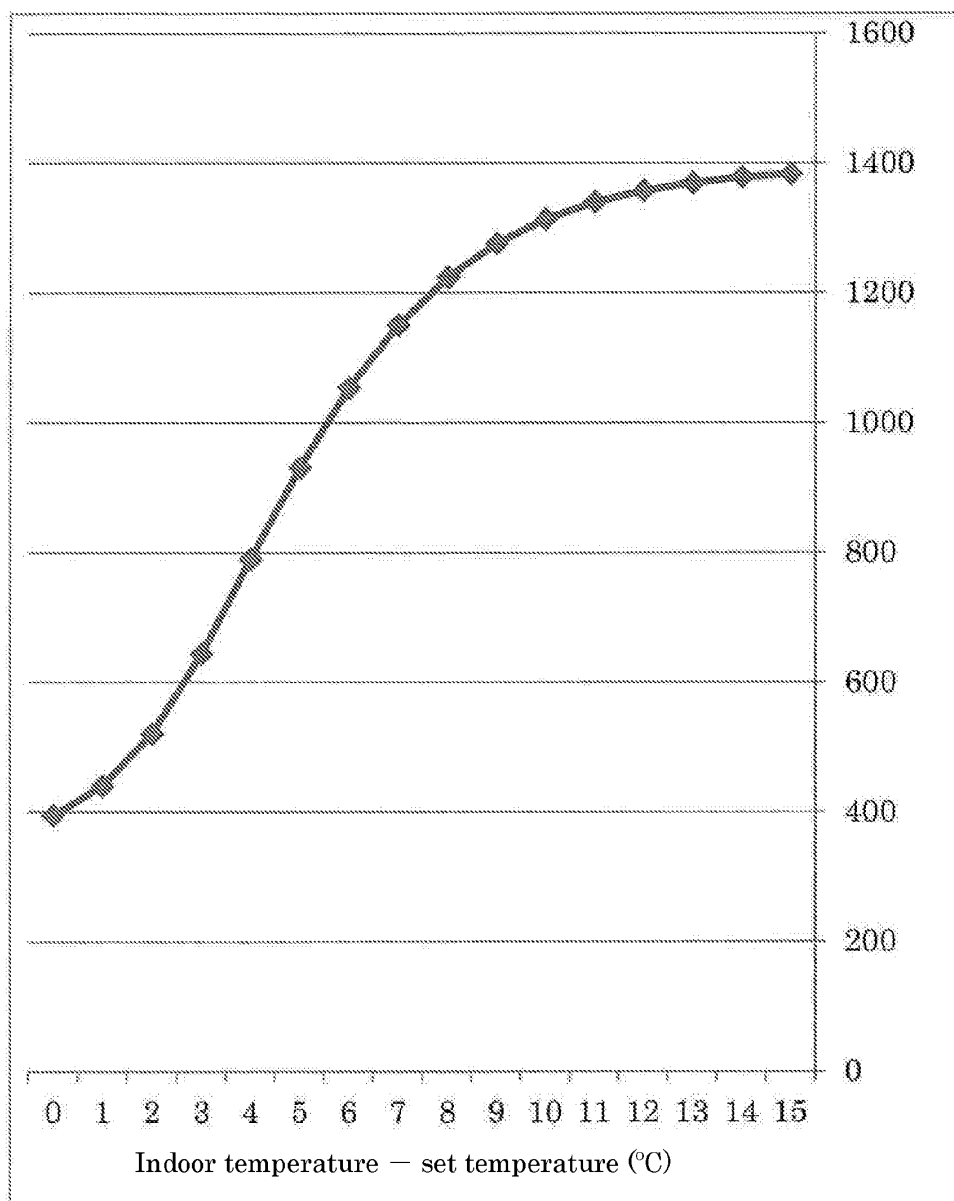


Figure 8

