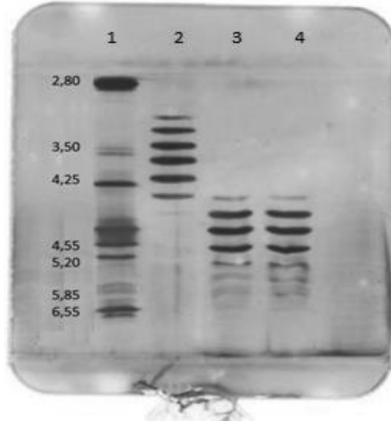
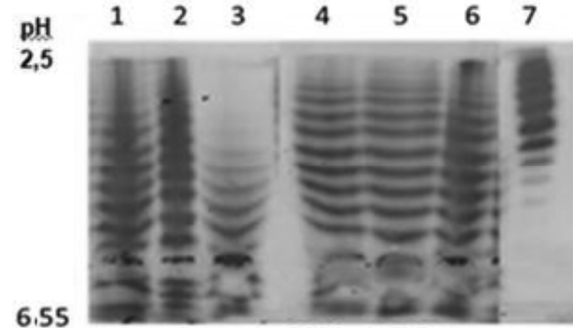


FIGURE 1**(A)**

1. IP Standard
2. Control
3. Basic EPO 1
4. Basic EPO 2

(B)

1. 35°C pH 7,5
2. 35°C pH 7,2
3. 35°C pH 7,3
4. 37°C pH 7,3
5. 37°C pH 7,2
6. 37°C pH 7,5
7. Control

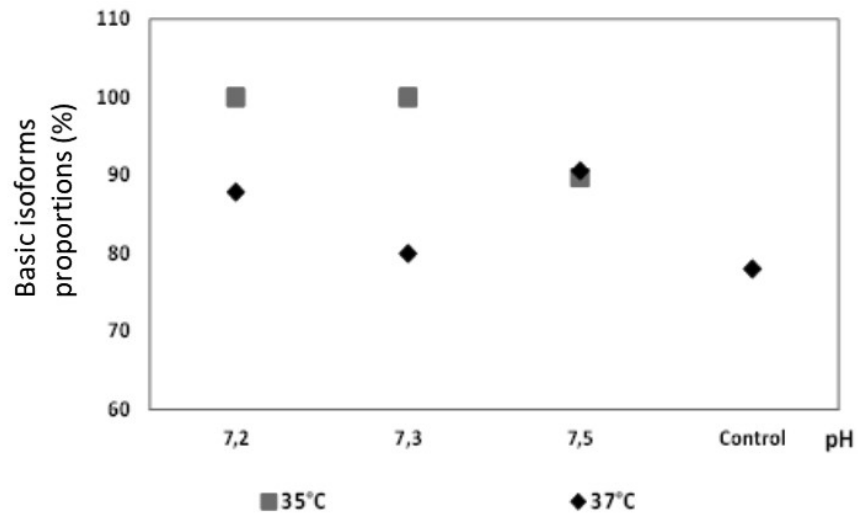
FIGURE 2

FIGURE 3

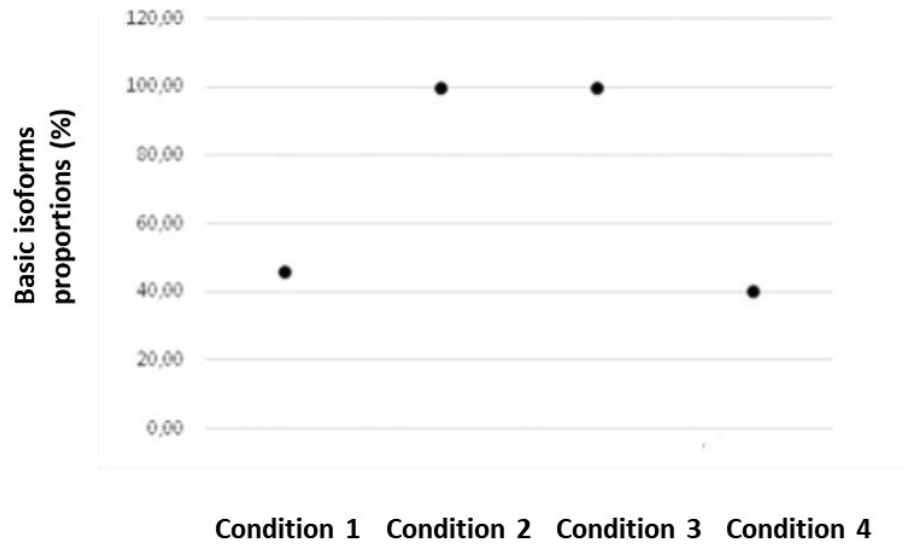


FIGURE 4

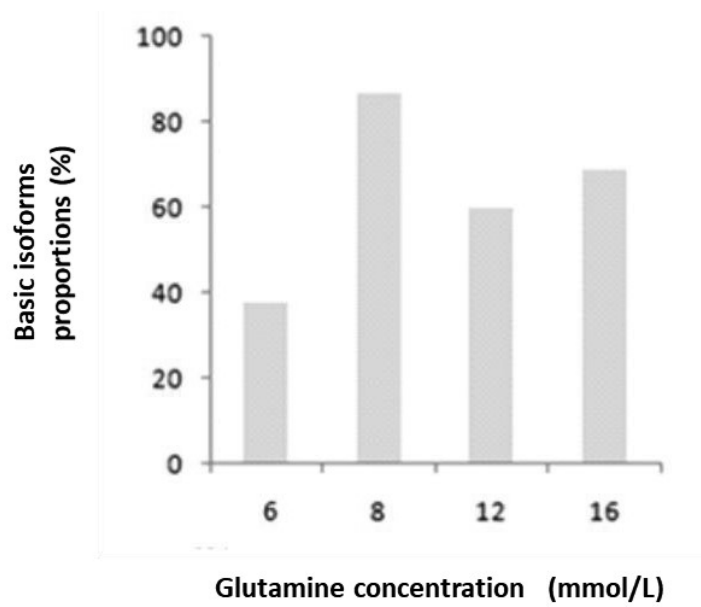


FIGURE 5

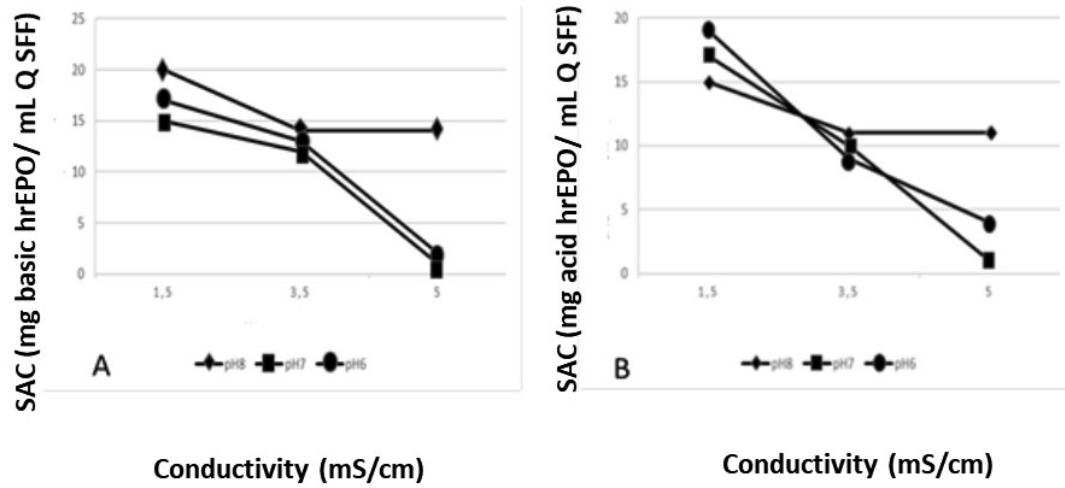


FIGURE 6

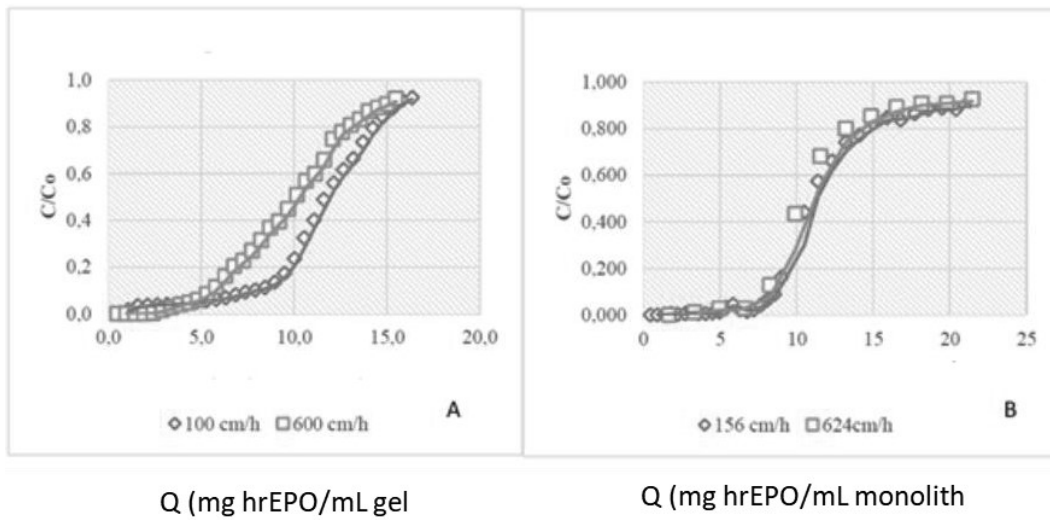


FIGURE 7

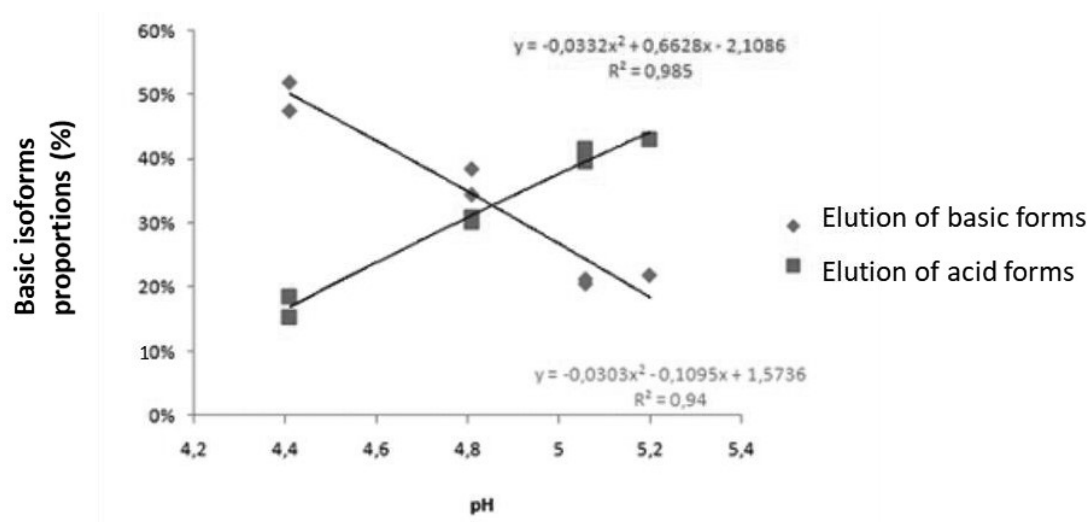


FIGURE 8

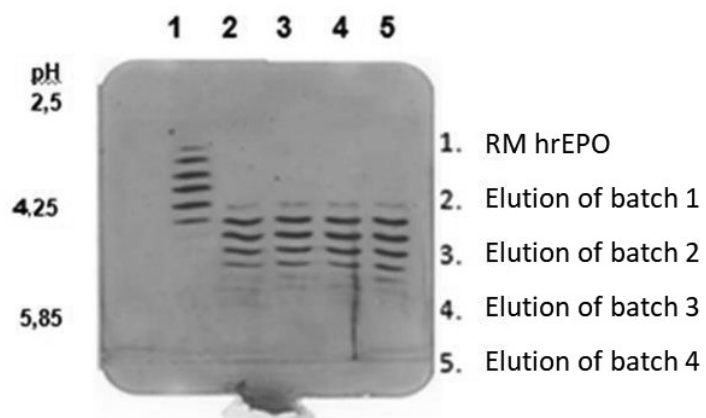


FIGURE 9

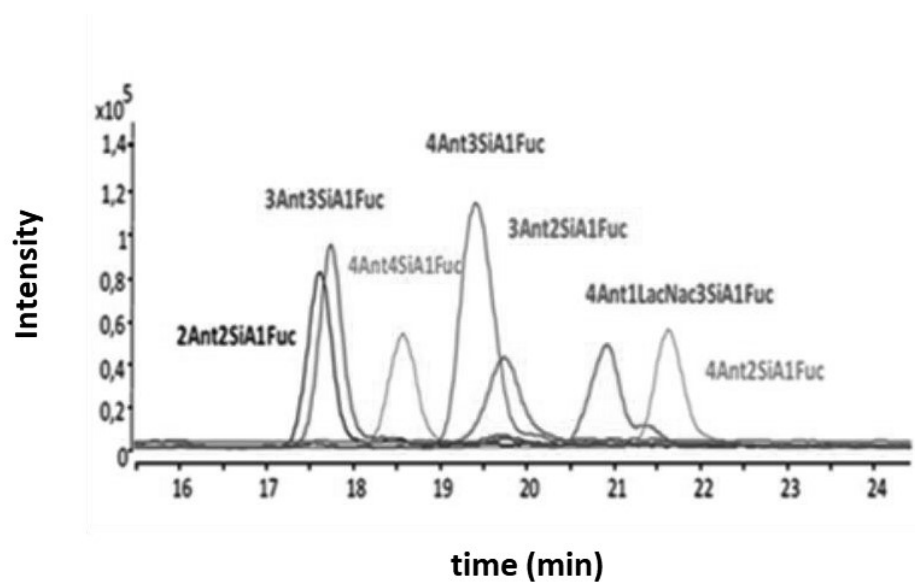


FIGURE 10

A)

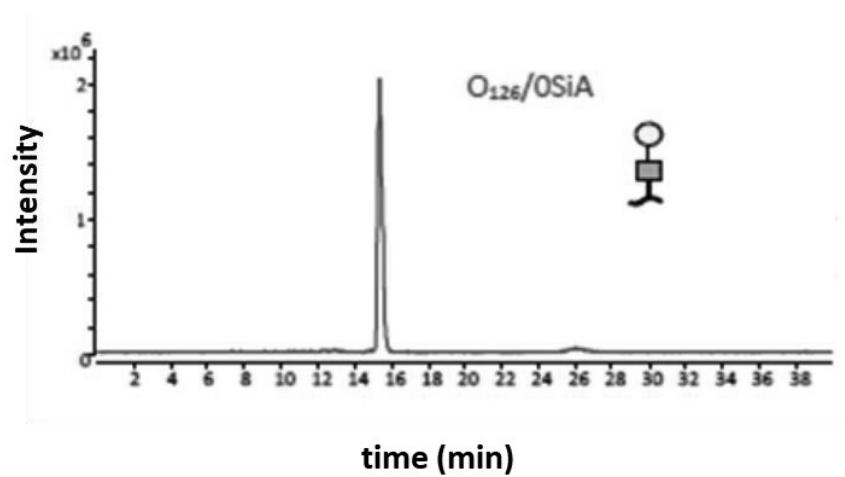


FIGURE 10

B)

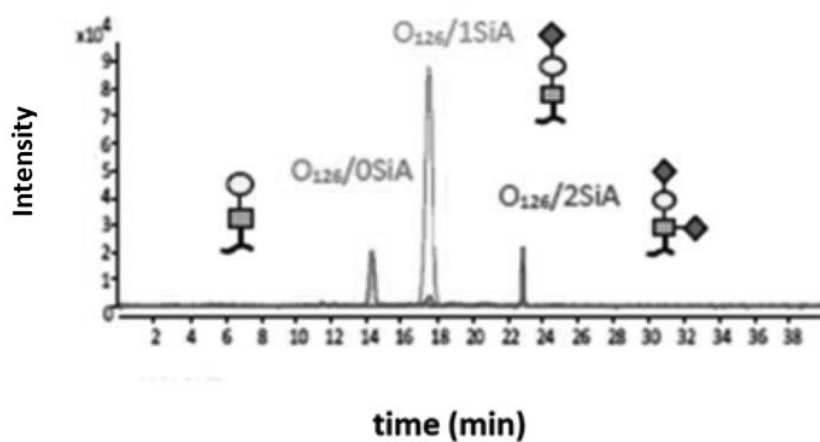


FIGURE 11


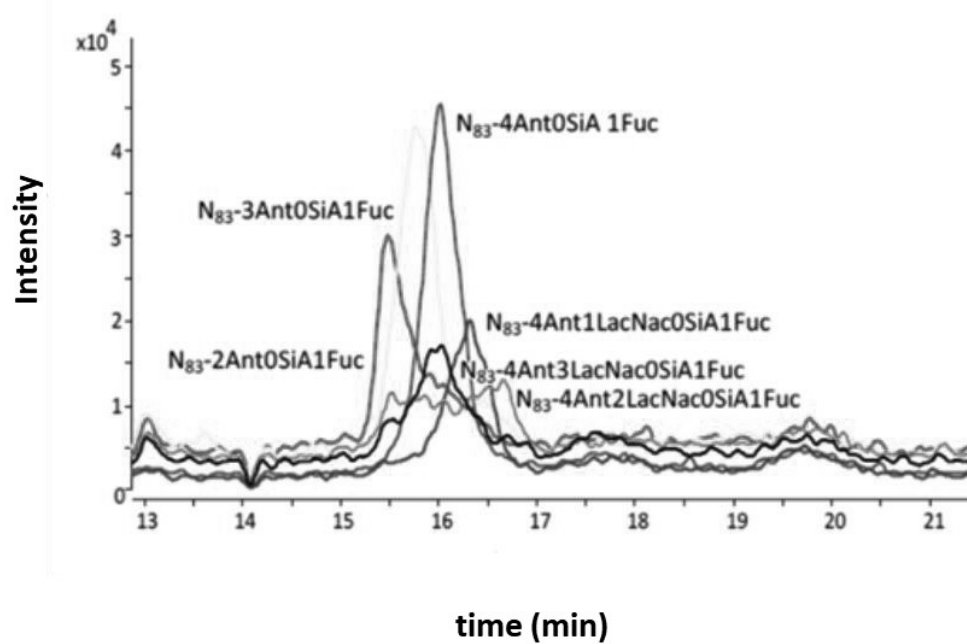


FIGURE 12

A)

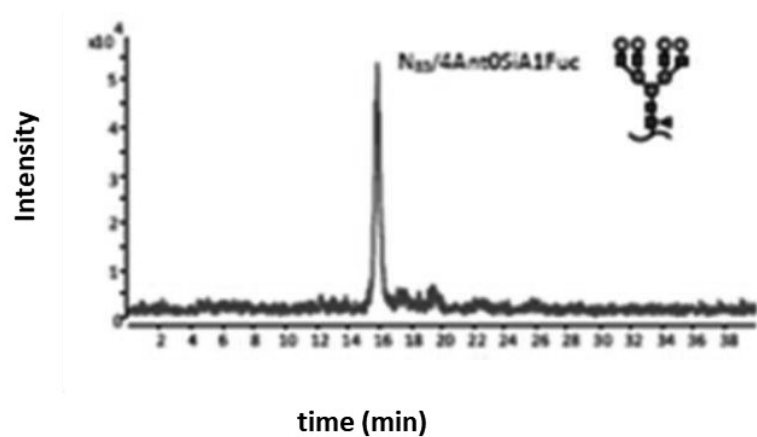

B)

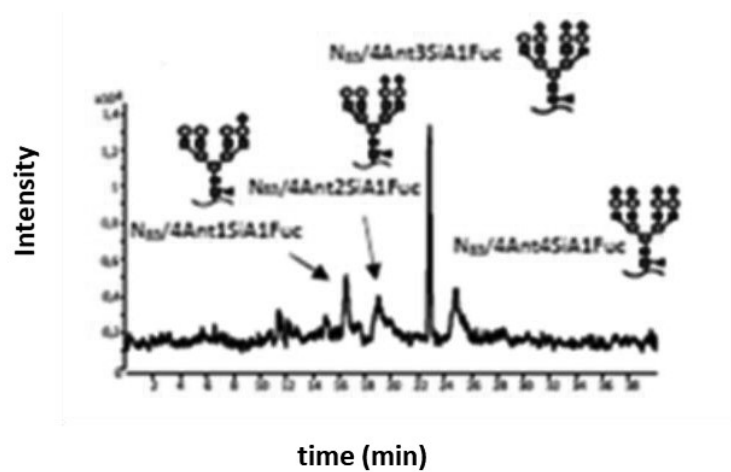


FIGURE 13

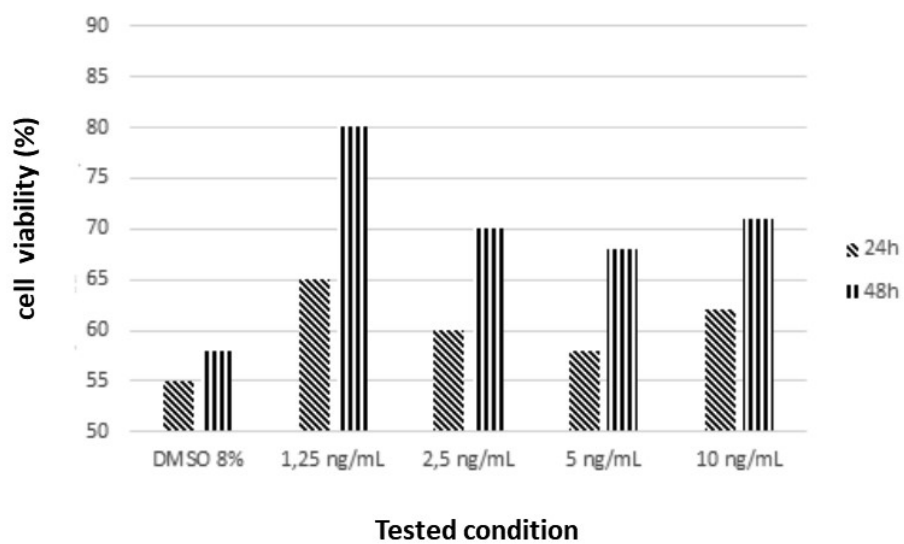


FIGURE 14

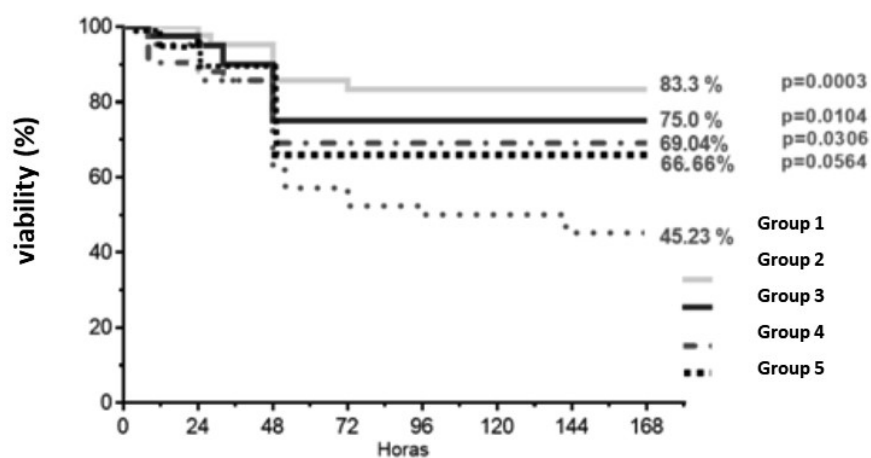


FIGURE 15

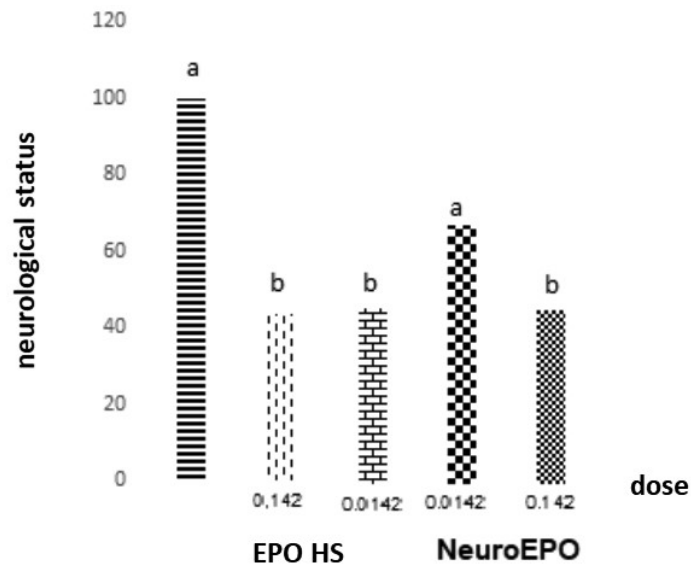


FIGURE 16

